

Illicit Discharge Detection and Elimination (IDDE) Plan

Town of Sutton, Massachusetts

**Prepared June 30, 2019
Revised August 31, 2021**

Prepared For:

Town of Sutton
4 Uxbridge Road
Sutton, MA 01590



Prepared By:

Comprehensive Environmental Inc.
41 Main Street
Bolton, MA 01740



Table of Contents

Illicit Discharge Detection and Elimination Plan – Town of Sutton

1	Introduction	1
1.1	IDDE Regulatory Background	1
1.2	Illicit Discharges.....	1
1.3	Allowable Non-Stormwater Discharges.....	2
1.4	Receiving Waters and Impairments.....	3
1.5	IDDE Program Purpose, Goals, Framework, and Work Complete	5
1.6	How to Use this Plan.....	5
2	Authority and Statement of IDDE Responsibilities	8
2.1	Legal Authority	8
2.2	Statement of Responsibilities	8
3	Stormwater System Mapping.....	9
3.1	Phase I Mapping	9
3.2	Phase II Mapping.....	9
3.3	Additional Recommended Mapping Elements	10
4	Sanitary Sewer Overflows (SSOs).....	11
5	Assessment and Priority Ranking of Outfalls	12
5.1	Outfall Catchment Delineations	12
5.2	Outfall and Interconnection Inventory and Initial Ranking	12
6	Dry Weather Outfall Screening and Sampling	15
6.1	When to Inspect: Weather Conditions	15
6.2	What to Look For: Physical Characteristics.....	15
6.3	What to Sample.....	17
6.3.1	Field Equipment.....	19
6.4	Interpreting Outfall Sampling Results	20
6.5	Follow-up Ranking of Outfalls and Interconnections	21
7	Catchment Investigations	23
7.1	Dry Weather Key Junction Structure Inspections	23
7.1.1	When to Inspect	23
7.1.2	What to Look For: Physical Characteristics	2
7.1.3	What to Sample.....	2
7.1.4	Interpreting Key Junction Inspection Results.....	2
7.2	System Vulnerability Factors and Wet Weather Sampling.....	3
7.2.1	When to Sample: Wet Weather Conditions.....	4
7.2.2	What to Sample: Wet Weather Conditions.....	4
7.2.3	Interpreting Wet Weather Sampling Results	5
8	Source Investigations.....	6
8.1	Field Reviews.....	6
8.2	Sandbagging	6
8.3	Smoke Testing.....	7

8.4	Dye Testing	7
8.5	CCTV/Video Inspection	8
8.6	Optical Brightener Monitoring	8
8.7	IDDE Canines.....	8
9	Illicit Discharge Removal.....	10
9.1	Removal Options.....	10
9.1.1	Voluntary Elimination	10
9.1.2	Legal Enforcement.....	10
9.2	Reporting.....	10
9.3	Confirmatory Outfall Screening	11
9.4	Ongoing Screening.....	11
9.5	IDDE Prevention.....	11
10	Training.....	12
11	Progress Reporting	13
11.1	Program Activity and Timeline.....	13
11.2	Annual Recordkeeping.....	13

Tables

Table 1-1.	Impaired Waters	3
Table 6-1.	Physical Observation Parameters and Likely Flow Sources.....	16
Table 6-2.	Sampling Parameters and Analysis Methods for All Waterbodies	18
Table 6-3.	Additional Sampling Parameters for Discharges to Impaired Waters	19
Table 6-4.	Field Equipment – Dry Weather Outfall Screening and Sampling.....	20
Table 6-5.	Benchmark Field Measurements for Select Parameters.....	21
Table 6-6.	Outfall Discharge Designation and Follow-Up Action.....	21
Table 7-1.	Key Junction Discharge Designation and Follow-Up Action.....	3
Table 8-1.	Tips for Successful Dye Testing	9

Figures

Figure 1-1.	Urbanized Area	6
-------------	----------------------	---

Appendices

Appendix A.	Stormwater System Mapping
Appendix B.	SSO Inventory
Appendix C.	IDDE Outfall Classification/Ranking and Vulnerability Assessment
Appendix D.	SOP for Dry Weather Outfall Investigation/Sampling
Appendix E.	SOP for Illicit Discharge Source Investigation
Appendix F.	SOP for Dry Weather Key Junction Investigation/Sampling
Appendix G.	SOP for Wet Weather Outfall Sampling
Appendix H.	Field Evaluation Records
Appendix I.	IDDE Employee Training Records

1 Introduction

1.1 IDDE Regulatory Background

This Illicit Discharge Detection and Elimination (IDDE) Plan has been developed by the Town of Sutton to address the requirements of the United States Environmental Protection Agency's (EPA's) 2016 National Pollutant Discharge Elimination System (NPDES) General Permit for Stormwater Discharges from Small Municipal Separate Storm Sewer Systems (MS4) in Massachusetts, hereafter referred to as the "2016 MS4 Permit." The 2016 Massachusetts MS4 Permit was signed on April 4, 2016 and has an effective date of July 1, 2018, and more recently updated on December 7, 2020 with an effective date of January 6, 2021. The permit was cosigned by the Massachusetts Department of Environmental Protection (MassDEP) and thus is jointly regulated by EPA and MassDEP.

The 2016 Massachusetts MS4 Permit requires that each permittee, or regulated community, address six Minimum Control Measures (MCMs). These measures include the following:

1. Public Education and Outreach;
2. Public Involvement and Participation;
3. Illicit Discharge Detection and Elimination Program;
4. Construction Site Stormwater Runoff Control;
5. Stormwater Management in New Development and Redevelopment (Post Construction Stormwater Management); and
6. Good Housekeeping and Pollution Prevention for Permittee Owned Operations.

Under MCM 3, the permittee is required to implement an IDDE program to systematically find and eliminate sources of non-stormwater discharges to its municipal separate storm sewer system and implement procedures to prevent such discharges. The IDDE program must be recorded in a written (hardcopy or electronic) document. This IDDE Plan has been prepared to address this requirement.

1.2 Illicit Discharges

An "illicit discharge" is any discharge to a MS4 that is not composed entirely of stormwater except non-stormwater discharges pursuant to a NPDES permit and discharges resulting from fire-fighting activities.

Illicit discharges may take a variety of forms. Illicit discharges may enter the drainage system through direct or indirect connections. Direct connections may be relatively obvious, such as cross-connections of a sewer service pipe to the storm drain system. Indirect illicit discharges may be more difficult to detect or address, such as a cracked pipe, leaking tank; failing septic systems that discharge untreated sewage to a ditch within the MS4, or a sump pump that discharges contaminated water on an intermittent basis.

Some illicit discharges are intentional, such as dumping used oil (or other pollutant material) into catch basins, a resident or contractor illegally tapping a sewer lateral into a storm drain pipe to avoid the costs of a sewer connection fee and service, and illegal dumping of yard

wastes into surface waters. Some illicit discharges are related to the unsuitability of original infrastructure to the modern regulatory environment. Examples of illicit discharges in this category include connected floor drains in old buildings, as well as sanitary sewer overflows that enter the drainage system. Sump pumps legally connected to the storm drain system can also be an illicit discharge if used inappropriately, such as for the disposal of floor wash water or old household products, in many cases due to a lack of understanding on the part of the homeowner.

Common illicit discharges can include the following:

- Sanitary wastewater from crushed, cracked, or collapsed pipes or from surcharges;
- Sewer lines from a house, basement, or individual bathroom to a storm drain;
- Overflow or seepage from septic tanks;
- Cross connections between a sewer or combined sewer line and the storm system;
- Commercial vehicle wash wastewater; and/or
- Improper disposal of automobile and household products.

Elimination of some discharges may require substantial costs and efforts, such as funding and designing a project to reconnect sanitary sewer laterals. Others, such as improving self-policing of dog waste management, can be accomplished by outreach in conjunction with the minimal additional cost of dog waste bins and the municipal commitment to dispose of collected materials on a regular basis. Regardless of the intention, when not addressed, illicit discharges can contribute high levels of pollutants, such as heavy metals, toxics, oil, grease, solvents, nutrients, and/or pathogens to surface waters. Thus, the 2016 MS4 Permit requires a program to identify, locate and remove illicit discharges.

1.3 Allowable Non-Stormwater Discharges

The following categories of non-storm water discharges are allowed under the MS4 Permit unless the permittee, EPA or MassDEP identifies any category or individual discharge of non-stormwater discharge as a significant contributor of pollutants to the MS4:

- Water line flushing;
- Landscape irrigation;
- Diverted stream flows;
- Rising ground water;
- Uncontaminated pumped groundwater;
- Discharge from potable water sources;
- Uncontaminated ground water infiltration (as defined at 40 CFR 35.2005(20));
- Foundation drains;
- Air conditioning condensation;
- Irrigation water, springs;
- Water from crawl space pumps;
- Footing drains;
- Lawn watering;
- Individual resident car washing
- Flows from riparian habitats and wetlands;
- De-chlorinated swimming pool discharges;
- Street wash waters; and
- Residential building wash waters without detergents.

If these discharges are identified as significant contributors to the MS4, they must be considered an “illicit discharge” and addressed under the IDDE Program (i.e., control these sources so they are no longer significant contributors of pollutants, and/or eliminate them entirely).

1.4 Receiving Waters and Impairments

As part of the 2016 MS4 Permit, communities must implement specific actions and BMPs to address waters with an approved Total Maximum Daily Load (TMDL) as of the issuance date of the permit (April 4, 2016) and to address water quality limited waters, including but not limited to waters listed in categories 5 or 4a on the most recent EPA-approved Massachusetts Clean Water Act section 303(d) list or Massachusetts Integrated Report of water under Clean Water Act section 305(b). IDDE requirements include consideration of these waters in the prioritization of IDDE activities and sampling programs.

Table 1-1 lists the “impaired waters” within the boundaries of Sutton’s regulated area based on the Final 2016 Massachusetts Integrated List of Waters produced by MassDEP every two years¹. Impaired waters are water bodies that do not meet water quality standards for one or more designated use(s) such as recreation or aquatic habitat.

Table 1-1. Impaired Waters

Waterbody Name	Segment ID and Category		Impairment(s)	Approved TMDL ²
Hudson Pond	MA42029	4a	Aquatic Plants (Macrophytes)	2363 ³
			Nutrient/Eutrophication Biological Indicators	
Girard Pond	MA51053	4c	(Non-native aquatic plants*)	
Sibley Reservoir	MA51148	4c	(Low-flow alterations*)	
Singletary Pond	MA51152	4c	(Eurasian Water Milfoil, Myriophyllum spicatum*)	
			(Non-Native Aquatic Plants*)	
Stevens Pond	MA51159	4c	(Non-Native Aquatic Plants*)	
Swans Pond	MA51164	4c	(Non-Native Aquatic Plants*)	
Tuckers Pond	MA51169	4c	(Non-Native Aquatic Plants*)	
Whitins Pond	MA51180	4c	(Non-Native Aquatic Plants*)	
Aldrich Pond	MA51002	5	(Non-Native Aquatic Plants*)	
			Aquatic Plants (Macrophytes)	
Cook Allen Brook	MA51-28	5	Fishes Bioassessments	
Marble Pond	MA51093	5	(Non-Native Aquatic Plants*)	
			Aquatic Plants (Macrophytes)	

¹Note that at the time of preparation of this plan (August 2021), the 2016 303d list is the most up to date finalized 303d List as approved by USEPA on December 2019.

²“Approved TMDLs” are those that have been approved by EPA as of the date of issuance of the 2016 MS4 Permit.

³Sutton is subject to the *TMDL of Phosphorus for Selected French Basin Lakes, May 28 2002*.

Table 1-1 (continued). Impaired Waters

Waterbody Name	Segment ID and Category		Impairment(s)	Approved TMDL ⁴
Mumford River	MA51-14	5	(Low-flow alterations*)	
			(Non-Native Aquatic Plants*)	
			Aquatic Plants (Macrophytes)	
			Copper	
			Lead	
Blackstone River	MA51-03	5	(Debris/Floatables/Trash*)	
			(Other flow regime alterations*)	
			(Physical substrate habitat alterations*)	
			Ambient Bioassays – Chronic Aquatic Toxicity	
			Aquatic Macroinvertebrate Bioassessments	
			Escherichia coli	
			Excess Algal Growth	
			Fishes Bioassessments	
			Foam/Flocs/Scum/Oil Slicks	
			Lead	
			Nutrient/Eutrophication Biological Indicators	
			Other	
			Oxygen, Dissolved	
			Phosphorus (Total)	
			Sedimentation/Siltation	
Number 1 Pond	MA51114	5	Aquatic Plants (Macrophytes)	
			Turbidity	
Sutton Falls	MA51163	5	Harmful Algal Blooms	
			Turbidity	
Welsh Pond	MA51176	5	(Non-Native Aquatic Plants*)	
			Aquatic Plants (Macrophytes)	
Woodbury Pond	MA51185	5	(Non-Native Aquatic Plants*)	
			Aquatic Plants (Macrophytes)	

Category 4a Waters – impaired waters with a completed Total Maximum Daily Load (TMDL).

Category 4c Waters – impaired waters where the impairment is not caused by a pollutant. No TMDL required.

Category 5 Waters – impaired waters that require a TMDL.

Sutton is also subject to the Long Island Sound nitrogen TMDL. Thus, Sutton will meet the sampling requirements for this waterbody as outlined further below.

⁴“Approved TMDLs” are those that have been approved by EPA as of the date of issuance of the 2016 MS4 Permit.


1.5 IDDE Program Purpose, Goals, Framework, and Work Complete

The purpose of this plan is to document the Town's IDDE program and to assist field staff and program staff with the proper identification, reporting, and resolution of pollution problems. A locus map with the regulated Urbanized Area shown is provided as **Figure 1-1** at the end of this section.

The goals of the IDDE program are to find and eliminate illicit discharges to the municipal separate storm sewer system and to prevent illicit discharges from happening in the future. The program consists of the following major components as outlined in the 2016 MS4 Permit:

- Legal authority and regulatory mechanism to prohibit illicit discharges and enforce this prohibition;
- Storm system mapping;
- Inventory and ranking of outfalls;
- Dry weather outfall screening;
- Catchment investigations;
- Identification/confirmation of illicit sources;
- Illicit discharge removal;
- Follow-up screening; and
- Employee training.


The general IDDE investigation procedure framework is shown below:

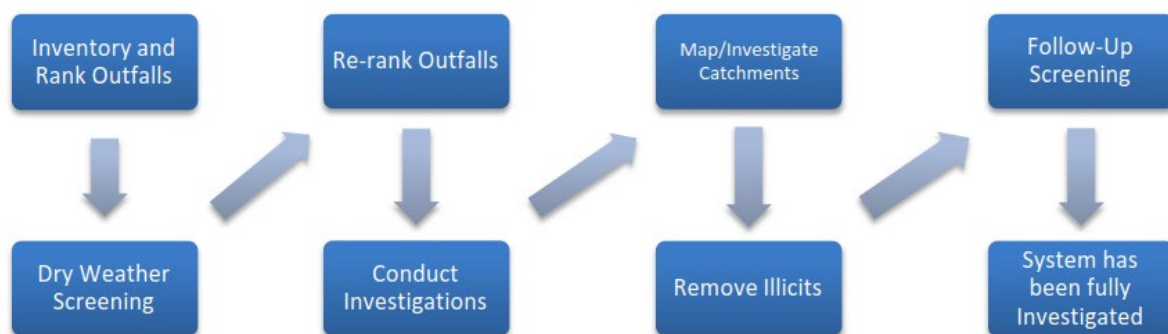

1.6 How to Use this Plan

This plan is intended to be used by Town of Sutton staff whose job involves frequent field or site visits, as well as staff responsible for administering the MS4 permit. This will primarily consist of staff from the Highway Department and the Board of Health. This plan is divided into several sections and includes the following components:


- Section 2** **Authority and Statement of IDDE Responsibilities** – references the Town’s legal authority to regulate illicit connections and discharges and identifies Town staff responsible for IDDE Program components.
- Section 3** **Stormwater System Mapping** – outlines the procedures for completing required stormwater system mapping, as well as additional recommendations in the 2016 MS4 Permit.
- Section 4** **Sanitary Sewer Overflows (SSOs)** – provides an inventory of known SSOs that have discharged to the MS4 and then to waterways within the five (5) years prior to the effective date of the 2016 MS4 Permit, and outlines the procedures for their elimination.
- Section 5** **Assessment and Priority Ranking of Outfalls** – assesses and ranks each outfall catchment area for illicit discharge potential. The ranking is used to prioritize IDDE investigations.
- Section 6** **Dry Weather Outfall Screening and Sampling** – outlines the procedures for performing outfall screening investigations during dry weather.
- Section 7** **Catchment Investigations** – details various additional investigations used to locate evidence of illicit discharges or SSOs and to isolate and confirm the source of the potential discharge within the outfall catchment area.
- Section 8** **Source Investigations** – describes methods for identifying the source of an illicit discharge.
- Section 9** **Illicit Discharge Removal** – describes methods for illicit discharge removal, as well as subsequent confirmation screening and discharge prevention.
- Section 10** **Training** – details the minimum IDDE training that will be made available to all employees involved in the IDDE program.
- Section 11** **Progress Reporting** – outlines the scope of annual progress reports which will evaluate the progress and success of the IDDE program.

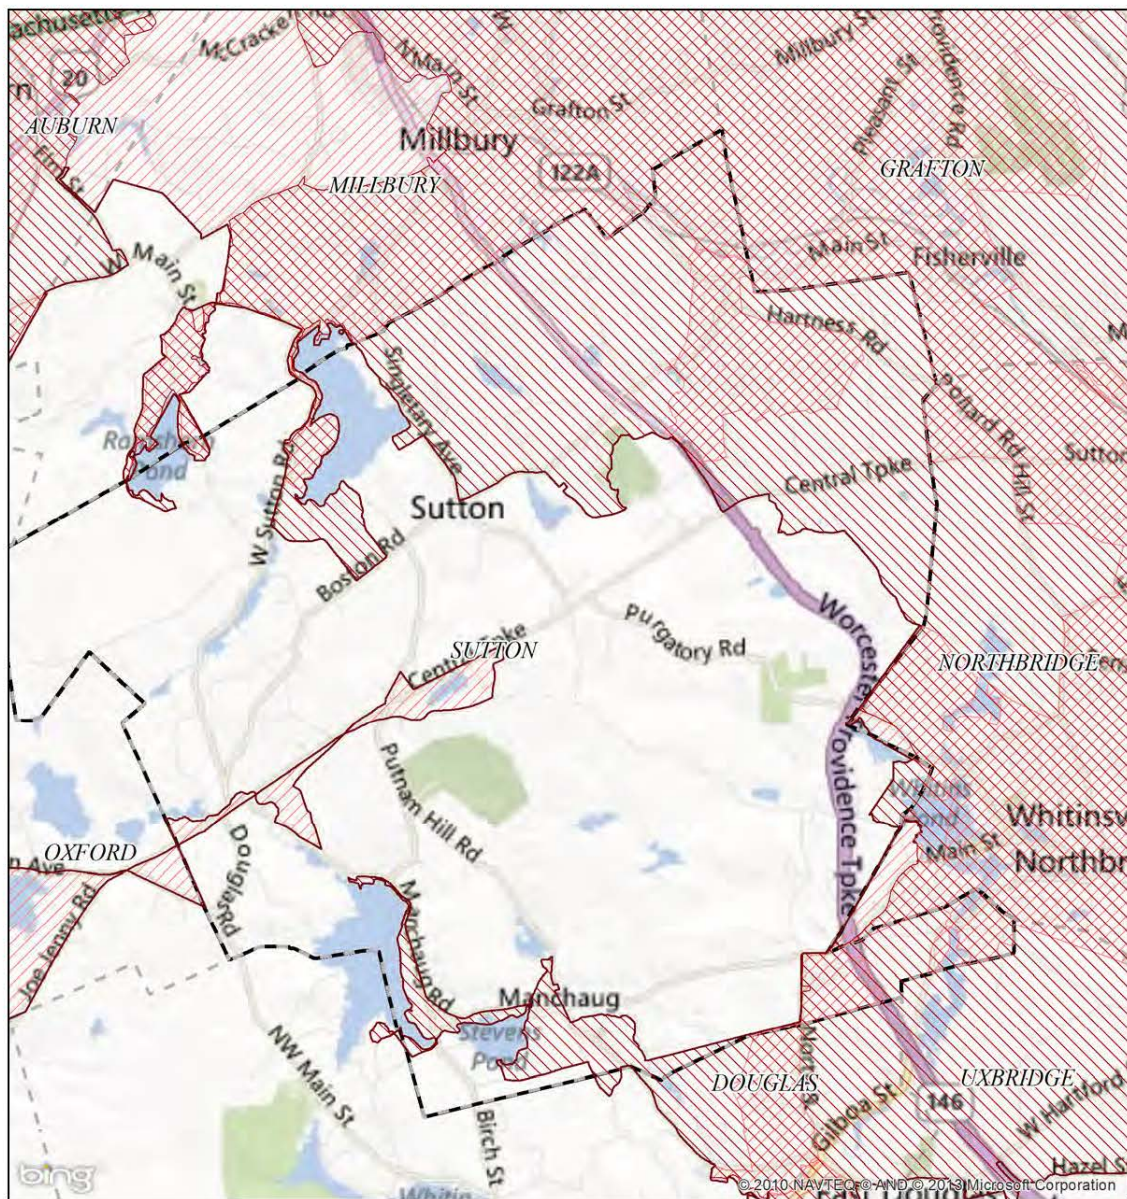

NPDES Phase II Stormwater Program Automatically Designated MS4 Areas

Sutton MA

Regulated Area:



Town Population: **8965**
Regulated Population: **5764**
(Populations estimated from 2010 Census)



Urbanized Areas, Town Boundaries:
US Census (2000, 2010)
Base map © 2013 Microsoft Corporation
and its data suppliers

US EPA Region 1 GIS Center Map #8824, 8/9/2013

Figure 1-1. Urbanized Area

2 Authority and Statement of IDDE Responsibilities

2.1 Legal Authority

The Town of Sutton has adopted a bylaw titled “Illicit Storm Water Connections & Discharges” in Article 10 of the General Town bylaws dated May 11, 2009 as required under the 2016 MS4 Permit. A copy of the bylaw is provided in the Stormwater Management Program (SWMP) Plan. This regulatory mechanism provides the Town of Sutton with adequate legal authority as required to comply with 2016 MS4 Permit requirements, including:

- Prohibiting illicit discharges and unauthorized discharges to the MS4;
- Investigating suspected illicit discharges;
- Requiring the removal of all such illicit connections;
- Eliminating illicit discharges, including discharges from properties not owned by or controlled by the MS4 that discharge into the MS4 system; and
- Implementing appropriate enforcement procedures and actions.

2.2 Statement of Responsibilities

The Highway Department (HD) and the Board of Health (BOH) are responsible for implementing the IDDE program. The Superintendent or his/her appointed designee has the authority to enforce Chapter 10.3.4, “Illicit Storm Water Connections & Discharges” of the Town’s General Bylaws. Program Responsibilities include:

- Drainage system mapping (HD);
- Determining and inspecting key junction manholes (HD, BOH);
- Catchment delineation and prioritization for field screening (HD);
- Dry and wet weather outfall investigations where required (HD, BOH);
- Performing systematic catchment investigations (HD, BOH);
- Investigating and eliminating IDDE sources (HD, BOH);
- Enforcing IDDE ordinance requirements (HD, BOH);
- Tracking illicit discharge connections and removals for annual reporting (HD);
- Incorporating IDDE into public education efforts (HD, BOH); and
- Providing annual employee training (HD, BOH).

3 Stormwater System Mapping

The 2016 MS4 Permit requires a detailed storm system map to facilitate identification of key infrastructure, factors influencing proper system operation, and the potential for illicit discharges. The 2016 MS4 Permit requires the storm system map to be developed in two phases as outlined below. The Highway Department is responsible for developing the stormwater system mapping pursuant to the 2016 MS4 Permit. The status of Sutton's stormwater infrastructure mapping is provided in **Appendix A** along with a copy of the map. The Town of Sutton will report on the progress towards completion of the storm system map in each annual report with updates to the stormwater mapping included in **Appendix A**.

3.1 Phase I Mapping

Phase I mapping must be completed within two (2) years of the effective date of the permit (July 1, 2020) and include the following information:

- Outfalls and receiving waters (previously required by the MS4-2003 permit);
- Open channel conveyances (swales, ditches, etc.);
- Interconnections with other MS4s and other storm sewer systems;
- Municipally owned stormwater treatment structures;
- Waterbodies identified by name with a list of impairments as identified on the most recent EPA approved Massachusetts Integrated List of Waters report; and
- Initial catchment delineations. Topographic contours and drainage system information may be used to produce initial catchment delineations.

3.2 Phase II Mapping

Phase II mapping must be completed within ten (10) years of the effective date of the permit (July 1, 2028) and include the following information:

- Outfall locations (latitude and longitude with a minimum accuracy of +/-30 feet);
- Pipe connectivity;
- Manholes;
- Catch basins;
- Refined catchment delineations. Catchment delineations must be updated to reflect information collected during catchment investigations;
- Municipal sanitary sewer system; and
- Municipal combined sewer system.

Note that Sutton has no combined sewer system and thus these mapping components do not apply to the Town's mapping program.

3.3 Additional Recommended Mapping Elements

Although not required, the 2016 MS4 Permit recommends mapping the following items as additional components to the Town of Sutton's storm system mapping:

- Storm sewer material, size (pipe diameter), age;
- Sanitary sewer system material, size (pipe diameter), age;
- Privately owned stormwater treatment structures;
- Where a municipal sanitary sewer system exists, properties known or suspected to be served by a septic system, especially in high density urban areas;
- Area where the permittee's MS4 has received or could receive flow from septic system discharges;
- Seasonal high-water table elevations impacting sanitary alignments;
- Topography;
- Orthophotography (aerial imagery);
- Alignments, dates and representation of work completed of past investigations; and
- Locations of suspected, confirmed and corrected illicit discharges with dates and flow estimates.

As the Town of Sutton's IDDE program progresses through the mapping requirements of the next ten years, the Highway Department will assess the feasibility, usefulness, and cost implications of including some or all of the above information into the GIS database. Maps will be updated as additional information is obtained.

4 Sanitary Sewer Overflows (SSOs)

The 2016 MS4 Permit requires municipalities to prohibit illicit discharges, including sanitary sewer overflows (SSOs), to the separate storm sewer system. SSOs are discharges of untreated sanitary wastewater from a municipal sanitary sewer that can contaminate surface waters, cause serious water quality problems and property damage, and threaten public health. SSOs can be caused by blockages, line breaks, sewer defects that allow stormwater and groundwater to overload the system, power failures, improper sewer design, and/or vandalism.

The Town of Sutton will annually complete an inventory of SSOs that have discharged to the MS4 within the 5 years prior to the effective date of the 2016 MS4 Permit, based on review of available documentation pertaining to SSOs. The SSO inventory is provided in **Appendix B** and will be included in the annual report, including the status of mitigation and corrective measures to address each identified SSO.

5 Assessment and Priority Ranking of Outfalls

The 2016 MS4 Permit requires an assessment and priority ranking of outfalls in terms of their potential to have illicit discharges and SSOs and the related public health significance. The ranking helps determine the priority order for performing IDDE investigations and meeting permit milestones.

5.1 Outfall Catchment Delineations

Catchments for each of the MS4 outfalls⁵ and interconnections⁶ have been delineated based on available topographic contours and mapped drainage infrastructure to define contributing areas for investigation of potential sources of illicit discharges. Initial catchment delineations will be continually refined as additional mapping is completed and to reflect information collected during catchment investigations.

5.2 Outfall and Interconnection Inventory and Initial Ranking

The Highway Department completed an initial outfall and interconnection inventory and priority ranking to assess illicit discharge potential based on existing information. The inventory will be updated annually to include data collected in connection with dry weather screening and other relevant inspections and an updated inventory and ranking will be provided in each annual report.

For the ranking, outfalls and interconnections have been classified into one of the following categories:

1. **Problem Outfalls:** Outfalls/interconnections with known or suspected contributions of illicit discharges based on existing information. This includes any outfalls/interconnections where previous screening indicates likely sewer input. Likely sewer input indicators are any of the following:

- Olfactory or visual evidence of sewage;
- Ammonia ≥ 0.5 mg/L, surfactants ≥ 0.25 mg/L, and bacteria levels greater than the water quality criteria applicable to the receiving water; or

⁵ **Outfall** means a point source as defined by 40 CFR § 122.2 as the point where the municipal separate storm sewer discharges to waters of the United States. An outfall does not include open conveyances connecting two municipal separate storm sewers or pipes, tunnels or other conveyances that connect segments of the same stream or other waters of the United States and that are used to convey waters of the United States. Culverts longer than a simple road crossing shall be included in the inventory unless the permittee can confirm that they are free of any connections and simply convey waters of the United States.

⁶ **Interconnection** means the point (excluding sheet flow over impervious surfaces) where the permittee's MS4 discharges to another MS4 or other storm sewer system, through which the discharge is conveyed to waters of the United States or to another storm sewer system and eventually to a water of the United States.

- Ammonia ≥ 0.5 mg/L, surfactants ≥ 0.25 mg/L, and detectable levels of chlorine.

Note that Problem Catchments are only identified during the initial round of catchment ranking, and no additional catchments should be added to this category. If future evidence indicates that the above pollutant levels may be present, catchments must be ranked at the top of the High Priority Catchments list. Dry weather screening and sampling is not required for Problem Outfalls.

2. High Priority Outfalls: Outfalls/interconnections that have not been classified as Problem Outfalls and that contain any of the following characteristics:

- Discharging to an area of concern to public health due to proximity of public beaches, recreational areas, drinking water supplies or shellfish beds;
- Past discharge complaints;
- Discharges exceeding water quality standards for bacteria; ammonia levels ≥ 0.5 mg/l; surfactants greater ≥ 0.25 mg/l;
- Sites that have a potential to generate pollutants that could contribute to illicit discharges. Examples of these sites include car dealers, car washes, gas stations, garden centers, industrial manufacturing, etc.;
- Industrial areas >40 years old where the sanitary sewer system is >40 years old;
- Areas that were once serviced by septic systems that have been converted to sewer;
- Areas that were once served by a combined sewer system, but have been separated;
- Septic systems > 30 years old in residential land use and prone to failure;
- Any river or stream that is culverted for distances greater than a simple road crossing; and
- Catchment areas draining to waterbody segments impaired for bacteria and pathogens. In Sutton, this includes catchments that discharge directly to the Blackstone River.

3. Low Priority Outfalls: Outfalls/interconnections that do not meet any of the problem outfall, high priority outfall, or excluded (below) outfall criteria.

4. Excluded outfalls: Outfalls/interconnections with no potential for illicit discharges. This category is limited to roadway drainage in undeveloped areas with no dwellings and no sanitary sewers; drainage for athletic fields, parks or undeveloped green space and associated parking without services; cross-country drainage alignments (that neither cross nor are in proximity to sanitary sewer alignments) through undeveloped land.

The IDDE prioritization categories, from highest to lowest priority are Problem Outfalls, High Priority Outfalls and Low Priority Outfalls. Excluded Outfalls do not require any investigation. Outfalls that meet criteria in more than one category are automatically assigned the higher of the priority categories. Those within the Problem and High Priority

Outfall category are further ranked based on the number of criteria each outfall meets in the respective category. For example, the more criteria the outfall meets, the higher it is ranked in priority. Refer to **Appendix C** for a tabulated breakdown of the current prioritization (classification and ranking) for each outfall and a map identifying the prioritization by area. The map includes a grid overlay that breaks the Town into sections. The grid overlay is used to prioritize IDDE activities by section of Town (i.e., grid ID), rather than individual outfall, to more efficiently direct inspection activities by area. Classifications and rankings will be updated as additional information is collected.

6 Dry Weather Outfall Screening and Sampling

Dry weather flow is a common indicator of potential illicit connections. The MS4 Permit requires all outfalls/interconnections (excluding Problem and excluded Outfalls) be inspected for the presence of dry weather flow. The first step for detecting illicit (non-stormwater) connections in MS4s is to physically observe all regulated outfall discharge points in the field during periods of dry weather. Outfall locations are shown on the Town Drainage System Maps provided in **Appendix A**.

Stormwater discharges to culverted streams that cannot be easily accessed (i.e., underground discharge locations) should be inspected at the nearest upstream location (e.g., manhole structure or the last “downstream” catch basin before the outfall pipe). A comprehensive SOP for Outfall Dry Weather Screening with checklist and forms is included in **Appendix D**. Screening procedures should be implemented starting with High Priority outfalls, followed by Low Priority outfalls, based on the initial priority rankings provided in **Appendix C**. Problem Outfalls do not require screening, rather proceed right to source investigations.

6.1 When to Inspect: Weather Conditions

Dry weather outfall screening and sampling may occur when no more than 0.1 inches of rainfall has occurred in the previous 24-hour period and no significant snow melt is occurring. For purposes of determining dry weather conditions, program staff will use precipitation data from the following sources:

1. Weather Underground, Rhodes Farm Station KMASUTTO4 in Sutton
https://www.wunderground.com/dashboard/pws/KMASUTTO4?cm_ven=localwx_pwsdash; or
2. NOAA, Station KORH at the Worcester Regional Airport in Worcester
<https://forecast.weather.gov/MapClick.php?CityName=Sutton&state=MA&site=BOX&textField1=42.15&textField2=-71.7667#.XQFKuBZKjRY>

6.2 What to Look For: Physical Characteristics

Illicit discharges can be intermittent or continuous as defined below:

- **Intermittent** – Intermittent discharges are short in duration, lasting only a short time and then disappearing. Examples include:
 - Materials that have been dumped into a storm drain (catch basin) or drainage way, and
 - A floor drain that is connected to the storm sewer.
- **Continuous** – Continuous discharges continue without changing, stopping, or being interrupted. Examples include:

- Sanitary wastewater piping that is cross-connected from a building or sanitary sewer line to the storm sewer, and
- An industrial operational discharge that is not permitted.

Some intermittent illicit discharges may only occur in wet weather or when one part of the system overflows. These flows are generally associated with combined sewer and drainage systems that can back up or bypass diversion structures during heavy flows and discharge wastes to the storm drain system, but can also occur with failing septic systems that pond and discharge through the surface. Illicit discharges can be detected at the stormwater outfall, as evident from unusual debris (e.g. toilet paper), stressed vegetation, sheen, etc.

Physical inspections should include observations for flow, and when flow is not present, for potential signs of intermittent illicit discharges. When flow is present, observations on the presence and severity of odor, color, turbidity and floatables should be made and recorded in accordance with the SOP and checklist in **Appendix D**. Observations for other physical indicators should also be made, under flowing and non-flowing conditions, including the condition of the outfall pipe, deposits or stains in the vicinity of the outfall, abnormal vegetation growth, the quality of any pooled water at the outlet and any benthic growth on the pipe. **Table 6-1** describes various physical observation parameters and what they may indicate.

Table 6-1. Physical Observation Parameters and Likely Flow Sources

Parameter	Observations	Interpretation
Odor	Sewage	Stale sanitary wastewater, especially in pools near outfall
	Sulfur (rotten eggs)	Industries that discharge sulfide compounds or organics (meat packers, canneries, dairies, etc.). Also, could be petroleum related “high – sulfur” fuels
	Rancid-sour	Food preparation facilities (restaurants, hotels, etc.)
	Oil and gas	Petroleum refineries or many facilities associated with vehicle maintenance or petroleum product storage
	Chlorine	Pool discharges, washing activities
	Sweet / Fruity	Washing activities
	Sharp, pungent (chemicals)	Hazardous waste
Color	Yellow	Chemical plants, textile and tanning plants
	Brown	Meat packers, printing plants, metal works, stone and concrete, fertilizers, petroleum refining facilities, construction sites, and glass cutting
	Green	Chemical plants, textile facilities, algae/plankton bloom, antifreeze (fluorescent green), fertilizer
	Red	Meat packers, metal works, iron floc (bacterium)
	Gray	Dairies, food processing, sewage, concrete wash-out
	Red, Purple, Blue, Black	Fabric dyes, inks from paper and cardboard manufacturers

Table 6-1 (continued). Physical Observation Parameters and Likely Flow Sources

Parameter	Observations	Interpretation
Turbidity	Cloudy	Sanitary wastewater, concrete or stone operations, fertilizer facilities, automotive dealers
	Opaque	Food processors, lumber mills, metal operations, pigment plants
Floatable Matter	Oil sheen, grease	Petroleum refineries or storage facilities and vehicle service facilities, restaurants
	Sewage	Sanitary wastewater
Deposits & Stains	Sediment	Construction site erosion
	Oily	Sanitary wastewater
Vegetation	Excessive growth	Food product facilities, fertilizers, farming agricultural use
	Inhibited growth, stressed vegetation	High stormwater flows, beverage facilities, printing plants, metal product facilities, drug manufacturing, petroleum facilities, vehicle service facilities and automobile dealers
Pipe Benthic Growth	Brown	Elevated nutrient level, possibly from sewage or fertilizers
	Orange/Red	High iron and manganese concentration, not typically associated with illicit discharges
	Green	Elevated nutrient level, possibly from sewage or fertilizers
Damage to Outfall Structures	Concrete cracking	Industrial flows, chemicals
	Concrete spalling ¹	
	Peeling paint	
	Metal corrosion	

¹Concrete spalling: minor cracks and bulges in concrete caused by corrosion of the steel reinforcement inside the concrete.

6.3 What to Sample

If flow is present during a dry weather outfall inspection, a sample will be collected and analyzed for the required permit parameters⁷ listed in **Table 6-2**. Field test kits or field instrumentation can be used for all parameters except indicator bacteria and any pollutants of concern. Field kits need to have appropriate detection limits and ranges. **Table 6-2** lists various field test kits and field instruments that can be used for outfall sampling associated with the 2016 MS4 Permit parameters for all waterbodies, other than indicator bacteria and any pollutants of concern.

Table 6-3 lists additional analyses for pollutants of concern in Sutton based on the 2016 Integrated List of Waters which must be sampled for select waterbodies. This list will require review and update each time a new list is finalized in Massachusetts. Updates will be

⁷Other potentially useful parameters, although not required by the MS4 Permit, include **fluoride** (indicator of potable water sources in areas where water supplies are fluoridated), **potassium** (high levels may indicate the presence of sanitary wastewater), and **optical brighteners** (indicative of laundry detergents).

maintained in **Appendix D** with the comprehensive SOP for Outfall Dry Weather Screening. Analytic procedures and user's manuals for field test kits and field instrumentation are also provided in **Appendix D**.

Table 6-2. Sampling Parameters and Analysis Methods for All Waterbodies

Analyte or Parameter	Instrumentation (Portable Meter)	Field Test Kit
Ammonia	CHEMetrics™ V-2000 Colorimeter Hach™ DR/890 Colorimeter Hach™ Pocket Colorimeter™ II	CHEMetrics™ K-1410 CHEMetrics™ K-1510 (series) Hach™ NI-SA Hach™ Ammonia Test Strips
Chlorine	CHEMetrics™ V-2000, K-2513 Hach™ Pocket Colorimeter™ II	NA
Conductivity	CHEMetrics™ I-1200 YSI Pro30 YSI EC300A Oakton 450	NA
Salinity	YSI Pro30 YSI EC300A Oakton 450	NA
Indicator Bacteria: <i>E. coli</i> (freshwater) or <i>Enterococcus</i> (saline water)	EPA certified laboratory Procedure (40 CFR § 136) Method 1103.1; 1603; Colilert 12 16, Colilert-18 12 15 16; mColiBlue-24 17	NA
Surfactants (Detergents)	CHEMetrics™ I-2017	CHEMetrics™ K-9400 and K-9404 Hach™ DE-2
Temperature	YSI Pro30 YSI EC300A Oakton 450	NA
Pollutants of Concern ⁸ :	EPA certified laboratory procedure (40 CFR § 136)	NA
See Table 6-3	See Table 6-3	

Samples for laboratory analysis must also be stored and preserved in accordance with procedures found in 40 CFR § 136. The SOP in **Appendix D** lists analytical methods, detection limits, hold times, and preservatives for laboratory analysis of dry weather sampling parameters.

⁸Where the discharge is directly into a water quality limited water or a water subject to an approved TMDL, samples must be analyzed for the pollutants of concern identified as the cause of the water quality impairment

Table 6-3. Additional Sampling Parameters for Discharges to Impaired Waters

Sample Parameter	Impairment	Impaired Water	Method
BOD5	<ul style="list-style-type: none"> • DO 	<ul style="list-style-type: none"> • Manchaug Pond • Blackstone River 	Laboratory Analysis: 360.1; 360.2
Dissolved oxygen	<ul style="list-style-type: none"> • DO 	<ul style="list-style-type: none"> • Manchaug Pond • Blackstone River 	Field Meter or Laboratory Analysis: 365.1; 365.2; 365.3
Total Phosphorus	<ul style="list-style-type: none"> • Phosphorus • DO • Excess algal growth • Nutrient/Eutrophication Biological Indicators 	<ul style="list-style-type: none"> • Manchaug Pond • Blackstone River 	Laboratory Analysis: 365.1; 365.2; 365.3; SM 4500-P-E
Total Nitrogen	<ul style="list-style-type: none"> • Nitrogen 	<ul style="list-style-type: none"> • Long Island Sound watershed 	Test Kit (e.g., Hach Colorimeter Test Kit, total nitrogen (TNT)) or Laboratory Analysis 351.1/351.2 + 353.2
Turbidity	<ul style="list-style-type: none"> • Turbidity 	<ul style="list-style-type: none"> • Sutton Falls • Number 1 Pond • Blackstone River 	Field Meter or Laboratory Analysis: 160.2; 180.1
Total Suspended Solids	<ul style="list-style-type: none"> • Turbidity • Sedimentation/Siltation 	<ul style="list-style-type: none"> • Sutton Falls • Number 1 Pond • Blackstone River 	Field Meter or Laboratory Analysis: 160.2; 180.1
Copper, Total	<ul style="list-style-type: none"> • Copper 	<ul style="list-style-type: none"> • Mumford River 	Field Meter or Laboratory Analysis: 200.7; 200.8; 200.9
Lead, Total	<ul style="list-style-type: none"> • Lead 	<ul style="list-style-type: none"> • Mumford River • Blackstone River 	Field Meter or Laboratory Analysis: 200.7; 200.8; 200.9
N/A⁹	<ul style="list-style-type: none"> • Fishes Bioassessments • Ambient Bioassays – Chronic Aquatic Toxicity • Foam/Flocs/Scum/Oil Slicks • Other 	<ul style="list-style-type: none"> • Blackstone River • Cook Allen Brook 	

6.3.1 Field Equipment

Table 6-4 lists field equipment commonly used for dry weather screening and sampling.

⁹For waterbodies with the listed impairments, permittees are instructed to contact MassDEP to determine which parameter must be sampled. Sutton reached out to MassDEP for comment in 2018 and MassDEP indicated that no additional sampling is required for these impairments.

Table 6-4. Field Equipment – Dry Weather Outfall Screening and Sampling

Equipment	Use/Notes
Clipboard	For organization of field sheets and writing surface
Field Sheets	Field sheets for both dry weather inspection and Dry weather sampling should be available with extras
Chain of Custody Forms	To ensure proper handling of all samples
Pens/Pencils/Permanent Markers	For proper labeling
Nitrile Gloves	To protect the sampler as well as the sample from contamination
Flashlight/headlamp w/batteries	For looking in outfalls or manholes, helpful in early mornings as well
Cooler with Ice	For transporting samples to the laboratory
Digital Camera	For documenting field conditions at time of inspection
Personal Protective Equipment (PPE)	Reflective vest, Safety glasses and boots at a minimum
GPS Receiver	For taking spatial location data
Water Quality Sonde	If needed, for sampling conductivity, temperature, pH
Water Quality Meter	Hand held meter, for testing for various water quality parameters such as ammonia, surfactants and chlorine
Test Kits	Have extra kits on hand to sample more outfalls than are anticipated to be screened in a single day
Label Tape	For labeling sample containers
Sample Containers	Make sure all sample containers are clean. Keep extra sample containers on hand at all times. Make sure there are proper sample containers for what is being sampled for (i.e., bacteria requires sterile containers).
Pry Bar or Pick	For opening catch basins and manholes when necessary
Sandbags	For damming low flows in order to take samples
Small Mallet or Hammer	Helping to free stuck manhole and catch basin covers
Utility Knife	Multiple uses
Measuring Tape	Measuring distances and depth of flow
Safety Cones	Safety
Hand Sanitizer	Disinfectant/decontaminant
Zip Ties/Duct Tape	For making field repairs
Rubber Boots/Waders	For accessing shallow streams/areas
Sampling Pole/Dipper/Sampling Cage	For accessing hard to reach outfalls and manholes

6.4 Interpreting Outfall Sampling Results

Outfall analytical data from dry weather sampling can be used to help identify the major type or source of discharge. **Table 6-5** shows values identified by the U.S. EPA and the Center for Watershed Protection as typical screening values for select parameters. These represent the typical concentration (or value) of each parameter expected to be found in

stormwater. Screening values that exceed these benchmarks may indicate illicit discharges. All results are documented in **Appendix H**.

Table 6-5. Benchmark Field Measurements for Select Parameters

Parameter	Benchmark
Ammonia	>0.5 mg/L
Chlorine	>0.02 mg/L (detectable levels per the 2016 MS4 Permit)
Conductivity	>2,000 µS/cm
Salinity	Reference only, determine type of bacteria analysis
Indicator Bacteria ¹⁰ : <i>E.coli</i> <i>Enterococcus</i>	The geometric mean of the five most recent samples taken during the same bathing season shall not exceed: <i>E.coli</i> : 126 colonies per 100 ml and no single sample taken during the bathing season shall exceed 235 colonies per 100 ml <i>Enterococcus</i> : 33 colonies per 100 ml and no single sample taken during the bathing season shall exceed 61 colonies per 100 ml
Surfactants	>0.25 mg/L
Temperature	>83°F
Pollutants of Concern	>Applicable water quality criteria

Table 6-6 provides a summary on the types of discharge that may be encountered and follow-up actions to be performed. Additional information on next step actions is included in the SOPs in **Appendix E**.

Table 6-6. Outfall Discharge Designation and Follow-Up Action

Type	Description	Action
Obvious Discharge	Outfalls where there is an illicit discharge that do not require sample collection for confirmation (e.g., strong sewage odors, gray sewage water, toilet paper, etc.)	Full source investigation
Suspect Discharge	Flowing outfalls with: 1) high severity on one or more physical indicators and 2) ammonia >0.5 mg/L, surfactants >0.25 mg/L, bacteria >WQ criteria OR ammonia >0.5 mg/L, surfactants >0.25 mg/L, & detectable levels of chlorine	Full source investigation
Potential Discharge	Flowing or non-flowing outfalls with presence of two or more physical indicators	Intermittent flow source investigation
Unlikely Discharge	Non-flowing outfalls with no physical indicators of an illicit discharge	No further action

6.5 Follow-up Ranking of Outfalls and Interconnections

The Town of Sutton will update and re-prioritize the initial outfall and interconnection rankings based on information gathered during dry weather screening as dry weather

¹⁰ Massachusetts Water Quality Standards:

<http://www.mass.gov/eea/docs/dep/service/regulations/314cmr04.pdf>

screening information becomes available. Outfalls/interconnections where relevant information was found indicating sewer input to the MS4 or sampling results indicating sewer input are highly likely to contain illicit discharges from sanitary sources will be ranked at the top of the High Priority Outfalls category for investigation. Other outfalls and interconnections may be re-ranked based on any new information from the dry weather screening. All results are documented in **Appendix H**.

7 Catchment Investigations

The 2016 MS4 Permit requires that investigations be performed for all MS4-owned outfall catchment areas regardless of whether flows are observed at the outfall. The catchment area represents the drainage area to the outfall. Catchment investigations must include: 1) a review of mapping and historic plans and records for each catchment to identify system vulnerability factors; 2) a manhole inspection methodology; and 3) procedures to isolate and confirm sources of illicit discharges.

This section outlines a systematic procedure to investigate outfall catchments. All data collected as part of the catchment investigations will be recorded and reported in each annual report.

7.1 Dry Weather Key Junction Structure Inspections

In addition to the outfall screening discussed in Section 6, catchment investigations of key junction manholes must be performed during dry weather conditions. Several important terms related to the dry weather manhole inspection program are defined by the MS4 Permit as follows:

- **Junction Manhole** is a manhole or structure with two or more inlets accepting flow from two or more MS4 alignments. Manholes with inlets solely from private storm drains, individual catch basins, or both are not considered junction manholes for these purposes.
- **Key Junction Manholes** are those junction manholes/structures that can represent one or more junction manholes/structures without compromising adequate implementation of the illicit discharge program. Adequate implementation of the illicit discharge program would not be compromised if the exclusion of a particular junction manhole/structure as a key junction manhole/structure would not affect the permittee's ability to determine the possible presence of an upstream illicit discharge. A permittee may exclude a junction manhole/structure located upstream from another located in the immediate vicinity or that is serving a drainage alignment with no potential for illicit connections.

Sutton has not yet mapped its key junction manholes. Key junction manholes will be inventoried by identifying all junction manholes/structures with two or more inlets and then eliminating those that were located in the immediate vicinity of the outfall, in the immediate vicinity of another key junction manhole and those that only received flow from one or two catch basins with no potential for illicit connections. For all catchments identified for investigation field crews will systematically inspect key junction manholes for evidence of illicit discharges during dry weather. A stormwater key junction manhole screening standard operating procedure (SOP) and checklist is included in **Appendix F**. Screening procedures should be implemented beginning with High Priority Outfalls and ending with Low Priority

Outfalls. Problem Outfalls do not require screening, rather proceed right to source investigations (refer to Section 6.0).

7.1.1 When to Inspect

Visual inspections for illicit discharges must occur during dry weather conditions. Dry weather conditions are defined as a minimum of 24 consecutive hours with less than 0.10 inches of rainfall and no significant snow melt is occurring. MS4s are designed to only carry stormwater runoff. If a flow exists at a discharge point during the dry weather inspections, it is identified as a potential illicit discharge.

7.1.2 What to Look For: Physical Characteristics

Each identified key junction manhole must be opened and inspected systematically for visual and olfactory evidence of illicit connections (e.g., excrement, toilet paper, gray filamentous bacterial growth, or sanitary products present). The same observation made for outfalls can also be applied to key junction manhole investigations. Refer to **Table 6-1** in Section 6.0 for parameters and what they mean.

Key junction manholes within the same catchment area can be inspected working from the outfall upstream or working from the most upstream key junction manholes down towards the outfall.

7.1.3 What to Sample

If flow is observed in any manhole, a sample must be collected and analyzed for:

- Ammonia
- Chlorine
- Surfactants

Field kits or instrumentation can be used for these analyses. All results will be documented in **Appendix H**.

7.1.4 Interpreting Key Junction Inspection Results

Where sampling results or visual or olfactory evidence indicate potential illicit discharges or SSOs (**Table 7-1**), the area draining to the junction manhole must be flagged for further upstream investigation to isolate and confirm sources of illicit discharges in accordance with Section 8.0. Key junction and subsequent manhole investigations will proceed until the location of suspected illicit discharges or SSOs can be isolated to a pipe segment between two manholes.

Screening procedures should be implemented beginning with High Priority Catchments and ending with Low Priority Catchments. Problem Outfalls do not require screening and should instead proceed right to source investigations (refer to Section 8). A comprehensive SOP for

Key Junction Manhole Dry Weather Screening with checklist and forms are included in **Appendix F**. All results will be documented in **Appendix H**.

Table 7-1. Key Junction Discharge Designation and Follow-Up Action

Type	Description	Action
Obvious Discharge	Key junction manholes where there is an illicit discharge that do not require sample collection for confirmation (e.g., strong sewage odors, gray sewage water, toilet paper, etc.)	Full source investigation
Suspect Discharge	Flowing key junction manholes with: 1) high severity on one or more physical indicators and 2) ammonia >0.5 mg/L, surfactants >0.25 mg/L, & detectable levels of chlorine	Full source investigation
Potential Discharge	Flowing or non-flowing key junction manholes with presence of two or more physical indicators	Intermittent flow source investigation
Unlikely Discharge	Non-flowing key junction manholes with no physical indicators of an illicit discharge	No further action

7.2 System Vulnerability Factors and Wet Weather Sampling

Wet weather screening and sampling is required where System Vulnerability Factors (SVFs) exist within a catchment area, including:

- History of SSOs, including but not limited to, those resulting from wet weather, high water table, or fat/oil/grease blockages;
- Common or twin-invert manholes serving storm and sanitary sewer alignments;
- Common trench construction serving both storm and sanitary sewer alignments;
- Crossings of storm and sanitary sewer alignments where the sanitary system is shallower than the storm drain system;
- Sanitary sewer alignments known or suspected to have been constructed in regular surcharging, customer back-ups, or frequent customer complaints;
- Areas formerly served by combined sewer systems;
- Sanitary sewer infrastructure defects such as leaking service laterals, cracked, broken, or offset sanitary infrastructure, directly piped connections between storm drain and sanitary sewer infrastructure, or other vulnerability factors identified through Inflow/Infiltration Analyses, Sanitary Sewer Evaluation Surveys, or other infrastructure investigations.

EPA recommends that the following SVFs also be considered:

- Sewer pump/lift stations, siphons, or known sanitary sewer restriction where power/equipment failures or blockages could readily result in SSOs;
- Any sanitary sewer and storm drain infrastructure greater than 40 years old;
- Widespread code-required septic system upgrades required at property transfers or history of multiple Board of Health actions addressing widespread septic system failures (indicative of inadequate soils, water table separation, or other physical constraints of the area rather than poor owner maintenance).

Wet weather sampling will be performed in accordance with the SOP included in **Appendix G**. The SVF inventory (**Appendix C**) will be updated as new information becomes available and included in the annual report.

7.2.1 When to Sample: Wet Weather Conditions

Where a minimum of one System Vulnerability Factor (SVF) is identified based on previous information or the catchment investigation, one wet weather screening and sampling event shall be performed at the outlet. A comprehensive SOP for Catchment Wet Weather Sampling with checklist and forms are included in **Appendix G**, however inspections will generally proceed as follows:

1. At least one wet weather sample will be collected at the outfall for the same parameters required during dry weather screening.
2. Wet weather sampling will occur during or after a storm event of sufficient depth or intensity to produce a stormwater discharge at the outfall. There is no specific rainfall amount that will trigger sampling, although minimum storm event intensities that are likely to trigger sanitary sewer interconnections are preferred. To the extent feasible, sampling should occur during the spring (March through June) when groundwater levels are relatively high.
3. If wet weather outfall sampling indicates a potential illicit discharge, then additional wet weather source sampling will be performed, as warranted, or source isolation and confirmation procedures will be followed as described in Section 8.
4. If wet weather outfall sampling does not identify evidence of illicit discharges, and no evidence of an illicit discharge is found during dry weather manhole inspections, catchment investigations will be considered complete.

7.2.2 What to Sample: Wet Weather Conditions

Samples collected during wet weather investigations should be analyzed for:

- Ammonia
- Chlorine
- Conductivity
- Salinity
- E.coli (freshwater receiving water) or enterococcus (saline or brackish receiving water)
- Surfactants (such as MBAS)
- Temperature

- Pollutants of concern – where the discharge is directly into a water quality limited water or a water subject to an approved TMDL, the sample shall be analyzed for the pollutant(s) of concern identified as the cause of the impairment

All analyses, with the exception of indicator bacteria can be performed with field test kits or field instrumentation. Refer to **Table 6-6** in Section 6.0 for additional details on acceptable concentrations that can be used to assess potential illicit discharges from Sutton’s MS4. All results will be documented in **Appendix H**.

7.2.3 Interpreting Wet Weather Sampling Results

Wet weather sampling results can be compared to the benchmark values in **Table 6-5**. Screening values that exceed these benchmarks may be indicative of pollution and/or illicit discharges that warrant further investigation. In the case of wet weather sampling, low to moderate levels of bacteria may be associated with wildlife or domestic animal feces, rather than an illicit connection. Similarly, slight exceedances of ammonia benchmarks may also be caused by natural conditions. However, evidence of surfactants and/or chlorine are more likely to be attributed to man-made sources. All data collected during preparation of the IDDE Plan and throughout the catchment investigation process, including information on the surrounding land uses, visual and olfactory observations during dry and wet weather screening, age and history of surrounding septic tanks and/or sewer, storm characteristics, and water quality data should be considered in determining the potential presence of an illicit discharge and the steps for investigation.

Exceedances of one or more parameters by substantial amounts (e.g., an order of magnitude) may be indicative of an illicit discharge and a follow-up round of wet weather sampling should be performed. If additional samples deliver similar results, additional manhole sampling should be completed during wet weather in an attempt to “bracket” a potential source to confirm the presence or absence of an illicit discharge. All results will be documented in **Appendix H**.

8 Source Investigations

Once an illicit discharge is identified at an outfall or manhole, further investigation is necessary to identify the specific point where the illicit discharge comes from (source). The objective of a source investigation is to trace the path of an illicit discharge from the outfall or manhole to the upstream source.

The following methods may be used in isolating and confirming the source of illicit discharges

- Field Reviews;
- Sandbagging;
- Smoke Testing;
- Dye Testing;
- CCTV/Video Inspections;
- Optical Brightener Monitoring; and
- IDDE Canines.

Public notification is an important aspect of a detailed source investigation program. Prior to smoke testing, dye testing, or TV inspections, the Department of Public Works will notify property owners in the affected area. These methods are described in more detail below.

8.1 Field Reviews

Reviewing the drainage system and land uses within contributing catchment areas is the first and perhaps the most efficient method for identifying the source of an illicit discharge. It is important for field crews to observe the land use and activities around the upgradient drainage system to determine if there are any obvious sources of the illicit discharge, as a quick review of nearby land uses and activities may reveal the source immediately. In addition, field crews can simply follow the non-stormwater discharge if it is flowing by tracing the drainage system such as manholes and connecting drainage pipes (refer to SOP in **Appendix E**). Sampling these upgradient connections may also indicate where the source is located. However, some cases may require additional methods, such as sandbagging, dye testing, smoke testing, or television inspection as discussed below, if a flow cannot be traced due to blind connections or complicated drainage networks.

8.2 Sandbagging

This technique can be particularly useful when attempting to isolate intermittent illicit discharges or those with very little perceptible flow. The technique involves placing sandbags or similar barriers (e.g., caulking, weirs/plates, or other temporary barriers) within manholes to form a temporary dam that collects any intermittent flows that may occur. Sandbags are typically left in place for 48 hours, and should only be installed when dry weather is forecast. If flow has collected behind the sandbags/barriers after 48 hours it can be assessed using visual observations or by sampling. If no flow collects behind the sandbag, the upstream pipe network can be ruled out as a source of the intermittent discharge. Finding

appropriate durations of dry weather and the need for multiple trips to each manhole makes this method both time-consuming and somewhat limiting.

8.3 Smoke Testing

Smoke testing involves injecting non-toxic smoke into drain lines and noting the emergence of smoke from sanitary sewer vents in illegally connected buildings or from cracks and leaks in the system itself. Typically, a smoke bomb or smoke generator is used to inject the smoke into the system at a catch basin or manhole and air is then forced through the system. Test personnel are placed in areas where there are suspected illegal connections or cracks/leaks, noting any escape of smoke (indicating an illicit connection or damaged storm drain infrastructure).

To be most effective, pipes may need to be plugged to prevent smoke from easily escaping through manholes, catch basins, or daylight areas. If a cross connection exists, smoke should appear from the building's sanitary sewer vent at the roof. The smoke should not affect residents since nearly all sanitary sewer systems have a trap to prevent odors from backing up into the house; however, residents with respiratory conditions may need to be monitored or evacuated from the area of testing to ensure safety during testing. In many cases, smoke testing should only be used once an unknown pipe is identified. The individual pipe can be plugged and filled with smoke while workers look for signs of smoke at nearby buildings or facilities.

It is important when using this technique to make proper notifications to area residents and business owners as well as local police and fire departments. This notification presents a good opportunity to involve the public as observers during the smoke test and to educate local residents about stormwater, allowable non-stormwater discharges and illicit discharges. Providing the public with an opportunity to participate in the illicit discharge source investigation will promote IDDE efforts and awareness throughout town.

If the initial test of the storm drain system is unsuccessful then a more thorough smoke-test of the sanitary sewer lines can also be performed. Note that buildings that do not emit smoke during sanitary sewer smoke tests may have problem connections and may also have sewer gas venting inside, which is hazardous.

8.4 Dye Testing

Dye testing involves flushing non-toxic dye into plumbing fixtures such as toilets, showers, and sinks and observing nearby storm drains and sewer manholes as well as stormwater outfalls for the presence of the dye. Similar to smoke testing, it is important to inform local residents and business owners. Police, fire, and local public health staff should also be notified prior to testing in preparation of responding to citizen phone calls concerning the dye and its presence in local surface waters.

A team of two or more people is needed to perform dye testing (ideally, all with two-way radios). One person is inside the building, while the others are stationed at the appropriate

storm sewer and sanitary sewer manholes (which should be opened) and/or outfalls. The person inside the building adds dye into a plumbing fixture (i.e., toilet or sink) and runs a sufficient amount of water to move the dye through the plumbing system. The person inside the building then radios to the outside crew that the dye has been dropped, and the outside crew watches for the dye in the storm sewer and sanitary sewer, recording the presence or absence of the dye.

The test can be relatively quick (about 30 minutes per test), effective (results are usually definitive), and inexpensive. Dye testing is best used when the likely source of an illicit discharge has been narrowed down to a few specific houses or businesses. Successful Tips for dye testing are provided in **Table 8-1**.

8.5 CCTV/Video Inspection

Another method of source isolation involves the use of mobile video cameras that are guided remotely through stormwater drain lines to observe possible illicit discharges. IDDE program staff can review the videos and note any visible illicit discharges. While this tool is both effective and usually definitive, it can be costly and time consuming when compared to other source isolation techniques.

8.6 Optical Brightener Monitoring

Optical brighteners are fluorescent dyes that are used in detergents and paper products to enhance their appearance. The presence of optical brighteners in surface waters or dry weather discharges suggests there is a possible illicit discharge or insufficient removal through adsorption in nearby septic systems or wastewater treatment. Optical brightener monitoring can be done in two ways. The most common, and least expensive, methodology involves placing a cotton pad in a wire cage and securing it in a pipe, manhole, catch basin, or inlet to capture intermittent dry weather flows. The pad is retrieved at a later date and placed under UV light to determine the presence/absence of brighteners during the monitoring period. A second methodology uses handheld fluorimeters to detect optical brighteners in water samples collected from outfalls or ambient surface waters. Use of a fluorometer, while more quantitative, is typically more costly and is not as effective at isolating intermittent discharges as other source isolation techniques.

8.7 IDDE Canines

Dogs specifically trained to smell human related sewage are becoming a cost-effective way to isolate and identify sources of illicit discharges. While not widespread at the moment, the use of IDDE canines is growing as is their accuracy. The use of IDDE canines is not recommended as a standalone practice for source identification; rather it is recommended as a tool to supplement other conventional methods, such as dye testing, in order to fully verify sources of illicit discharges.

Table 8-1. Tips for Successful Dye Testing

Dye Selection

- Green and liquid dyes are the easiest to see.
- Dye test strips can be a good alternative for residential or some commercial applications. (Liquid can leave a permanent stain).
- Check the sanitary sewer before using dyes to get a “base color.” In some cases, (e.g., a print shop with a permitted discharge to the sanitary sewer), the sewage may have an existing color that would mask a dye.
- Choose two dye colors, and alternate between them when testing multiple fixtures.

Selecting Fixtures to Test

- Check the plumbing plan for the site to isolate fixtures that are separately connected.
- For industrial facilities, check most floor drains (these are often misdirected).
- For plumbing fixtures, test a representative fixture (e.g., a bathroom sink).
- Test some locations separately (e.g., washing machines and floor drains), which may be misdirected.
- If conducting dye investigations on multiple floors, start from the basement and work your way up.
- At all fixtures, make sure to flush with plenty of water to ensure that the dye moves through the system.

Selecting a Sewer Manhole for Observations

- Pick the closest manhole possible to make observations (typically a sewer lateral).
- If this is not possible, choose the nearest downstream manhole.

Communications Between Crew Members

- The individual conducting the dye testing calls in to the field person to report the color dye used, and when it is dropped into the system.
- The field person then calls back when dye is observed in the manhole.
- If dye is not observed (e.g., after two separate flushes have occurred), dye testing is halted until the dye appears.

Locating Missing Dye

- The investigation is not complete until the dye is found. Some reasons for dye not appearing include:
- The building is actually hooked up to a septic system.
- The sewer line is clogged.
- There is a leak in the sewer line or lateral pipe.

Source: Center for Watershed Protection. Illicit Discharge Detection and Elimination, A Guidance Manual for Program Development and Technical Assessments. October 2004.

9 Illicit Discharge Removal

When the specific source of an illicit discharge is identified, the Town of Sutton will exercise its authority as necessary to require its removal. The Department of Public Works will collect relevant documentation and records to pursue illicit discharge removal through voluntary elimination or legal enforcement.

9.1 Removal Options

9.1.1 Voluntary Elimination

The voluntary elimination of illicit discharges is strongly encouraged. Through voluntary elimination, the responsible party of an illicit discharge can be contacted directly and informed about the incident. A responsible Town official should make this contact after an illicit discharge has been identified and verified. When a responsible party is contacted, the following information should be provided:

- Details on the identification and verification process;
- Information on the actions that should be implemented to correct the problem and the schedule for performing them; and
- Potential support and incentives that the Town can offer as a result of the voluntary approach.

This approach is the quickest and provides an opportunity for the responsible party to correct the problem in a cost-effective manner, versus a legal enforcement obligation, which is discussed below.

9.1.2 Legal Enforcement

Legal enforcement action may be necessary to completely eliminate illicit discharges in the Town, particularly those that have significant cost implications. Sutton has established legal authority for enforcement of IDDE requirements as outlined in “Illicit Storm Water Connections & Discharges” of the general Town bylaws dated May 11, 2009 as required under the 2016 MS4 Permit and provided in the SWMP Plan. This regulatory mechanism in part allows for enforcement of the regulations, orders, violation notices, and enforcement orders, and may pursue civil and criminal remedies for such violations.

9.2 Reporting

All illicit discharge information should be recorded on the Illicit Discharge Tracking Form in **Appendix H** for each location, with overall actions recorded in the Illicit Discharge Log provided in **Appendix H**. The illicit discharge will be removed within sixty (60) days of its confirmation where possible, otherwise a schedule will be established for its elimination with dates and schedules identified in the MS4 annual report. The annual report will also include the status of IDDE investigation and removal activities including the following information for each confirmed source:

- The location of the discharge and its source(s);
- A description of the discharge;
- The method of discovery;
- Date of discovery;
- Date of elimination, mitigation or enforcement action OR planned corrective measures and a schedule for completing the illicit discharge removal; and
- Estimate of the volume of flow removed.

9.3 Confirmatory Outfall Screening

Confirmatory outfall screening will be completed within one year of removal of all identified illicit discharges within a catchment area and include confirmatory outfall or interconnection screening. The confirmatory screening will be conducted in dry weather unless System Vulnerability Factors have been identified, in which case both dry weather and wet weather confirmatory screening will be conducted. Procedures will follow those outlined earlier in this chapter and in the appendices of this IDDE Plan. If confirmatory screening indicates evidence of additional illicit discharges, the catchment will be scheduled for additional investigation.

9.4 Ongoing Screening

Upon completion of all catchment investigations and illicit discharge removal and confirmation (if necessary), each outfall or interconnection will be re-prioritized for screening, as needed, and scheduled for ongoing screening once every five years. Ongoing screening will consist of dry weather screening and sampling consistent with the procedures described in Section 6 of this plan. Ongoing wet weather screening and sampling will also be conducted at outfalls where wet weather screening was required due to System Vulnerability Factors and will be conducted in accordance with the procedures described in Section 7.2. All sampling results will be reported in the annual report.

9.5 IDDE Prevention

Preventing future illicit discharges is also critically important. Prevention of illicit discharges is achieved through education, outreach, and advocacy. Education and advocacy programs that identify where and when possible illicit discharges and connections occur are good long-term prevention activities. The following activities can be used to help prevent illicit discharges to the drainage system:

- Integrate IDDE information into public education and outreach components;
- Encourage awareness and promote stewardship of the storm drain system in neighborhoods, emphasizing the cause and effect relationship between non-stormwater inputs to the drainage system and water quality of receiving waters;
- Utilize the annual IDDE program evaluation results to promote and support the program throughout the Town; and
- Use the Town's website and provide a phone number for citizens to report suspected illicit discharges.

10 Training

Annual IDDE training will be made available to all employees involved in the IDDE program. This training will at a minimum include information on how to identify illicit discharges and may also include additional training specific to the functions of particular personnel and their function within the framework of the IDDE program. Training records will be maintained in the IDDE Employee Training Record provided in **Appendix J**. The frequency and type of training will be included in the annual report.

11 Progress Reporting

11.1 Program Activity and Timeline

A summary of the required IDDE activities and timelines are provided below:

<u>Activity</u>	<u>Timeline</u>
Sanitary Sewer Overflow Inventory	Complete by June 30, 2019
Initial Catchment Ranking	Complete by June 30, 2019
Mapping:	
• Outfalls and Interconnections	Complete by June 30, 2020
• Initial Catchment Delineation	Complete by June 30, 2020
• Remaining Mapping	Complete by June 30, 2028
Dry Weather Outfall Inspections	Complete by June 30, 2021
Catchment Investigations:	
• Problem Catchments	Begin by July 1, 2020 Complete by June 30, 2025
• All w/Potential Illicit Discharges	Complete by June 30, 2025
• All Outfalls Complete	Complete by June 30, 2028
Source Investigation	As soon as sampling results indicating an illicit discharge are obtained and evaluated
Source Elimination	Within 60 days of its identification or, if not possible, in accordance with schedule established by the Town (refer to Section 9)
Confirmatory Samples	Within 1 year of illicit discharge elimination.
Follow-Up Screening	Reprioritize and resample all outfalls for weather conditions as per the first round within 5 years
Employee Training	Perform annually
Recordkeeping	At all times for all activities

11.2 Annual Recordkeeping

The progress and success of the IDDE program will be evaluated on an annual basis. The evaluation will be documented in the annual report and will include the following indicators of program progress:

- Number of illicit discharges identified and removed;
- Number and percent of total outfall catchments served by the MS4 evaluated using the catchment investigation procedure;
- Number of dry weather outfall inspections/screenings;
- Number of wet weather outfall inspections/sampling event;
- Number of enforcement notices issued;
- All dry weather and wet weather screening and sampling results;
- Estimate of the volume of sewage removed, as applicable; and
- Number of employees trained annually.

The success of the IDDE program will be measured by the IDDE activities completed within the required permit timelines.

Appendix A

Stormwater System Mapping

Status of Stormwater System Mapping as of August 2021



Requirement Summary	Status
Phase I – Must be Complete by July 1, 2020	
1. Outfalls and receiving waters	Complete
2. Open channel conveyances	Not started
3. Interconnections with other MS4s	Not started
4. Municipally owned structural BMPs	Not started
5. Waterbody names and impairments	Complete
6. Initial catchment delineations by topography	Complete (updates ongoing)
Phase II – Must be Complete by July 1, 2028	
1. Outfalls with spatial accuracy +/-30 feet	Complete
2. Pipe connectivity	Not started
3. Manholes	Partially Complete
4. Catch basins	Complete
5. Refined catchment delineations	Not Started
6. Municipal sanitary system	Complete (updates ongoing)
7. Municipal combined sewer system	Not Applicable

Additional outfalls may be found while completing the field inspections and should be added to the drainage map, and ranking and monitored.



Legend

- ▲ Outfall
- Catch Basin
- Sewer Force Main
- Sewer Pipe
- Roads
- Lake, Pond, Reservoir
- Wetland, Marsh, Swamp
- Stream, Brook
- Non-Urban Area

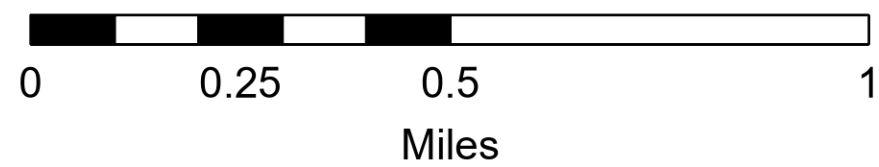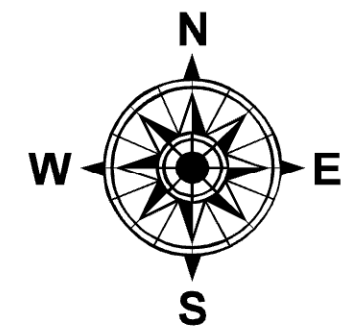


Stormwater Infrastructure Map

Sutton, MA

Comprehensive
Environmental
Incorporated





Data Sources: CEI, MassGIS, Town of Sutton

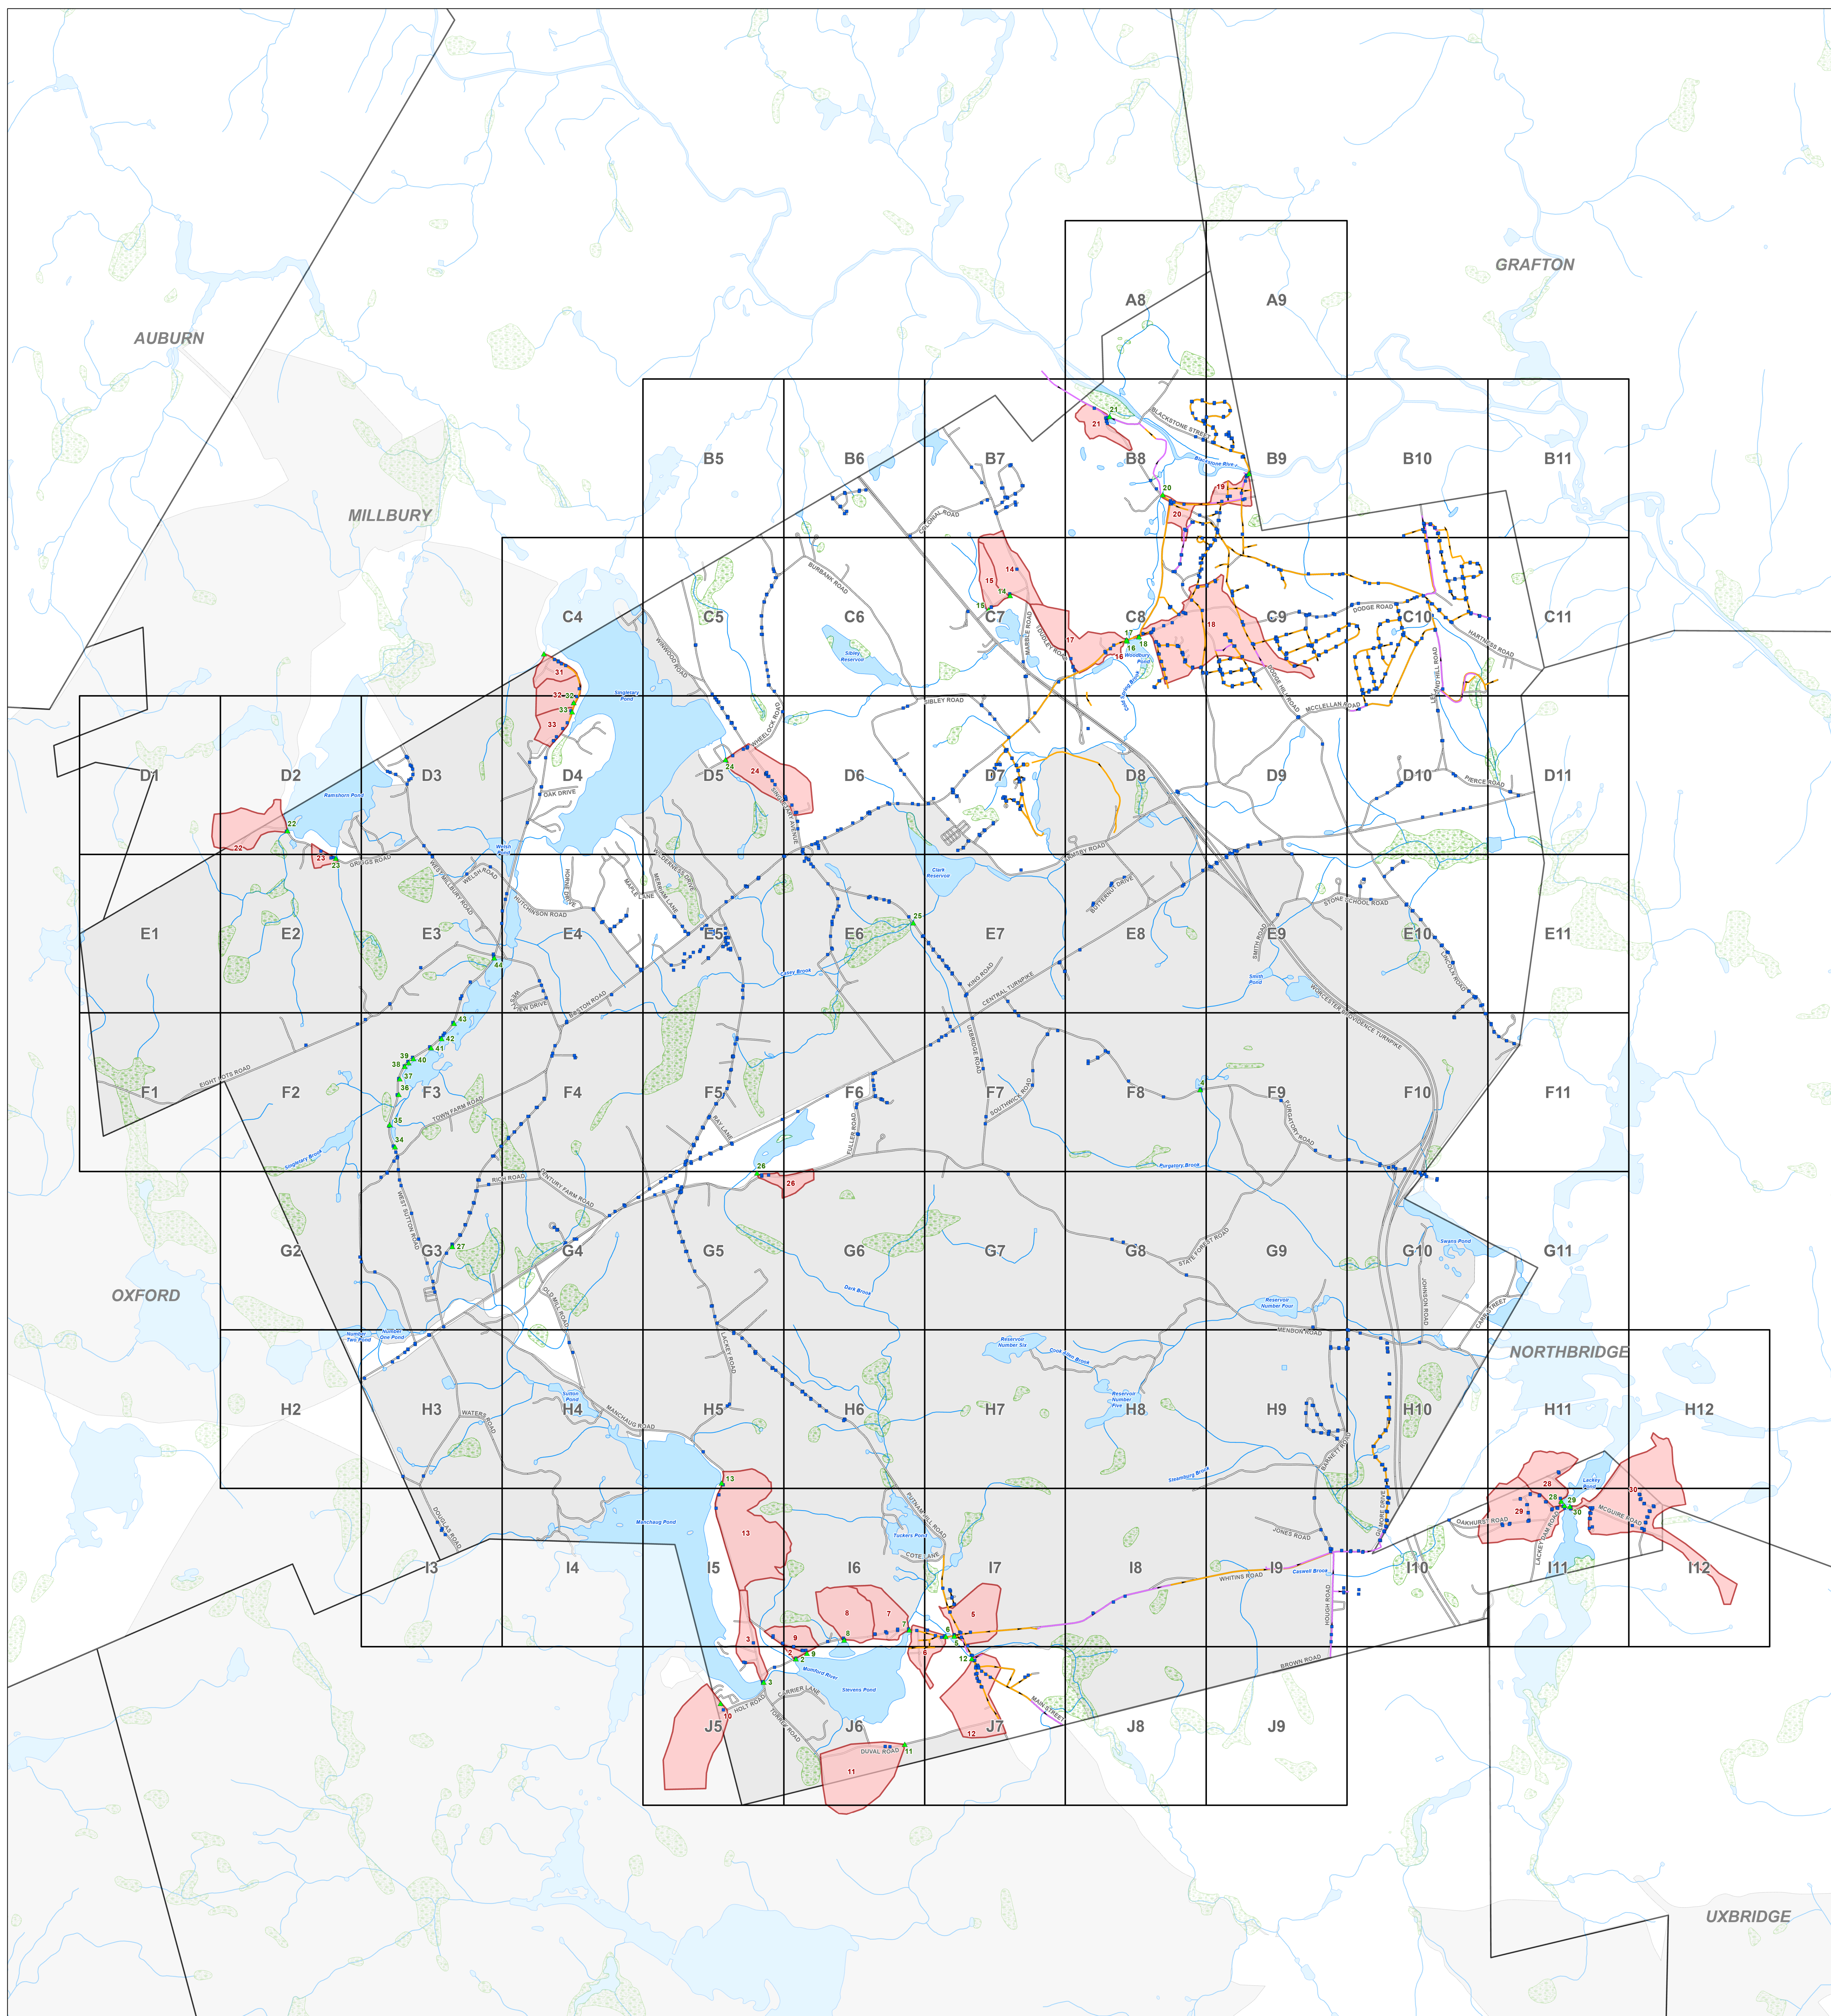

Legend

- ▲ Outfall
- Catch Basin
- Sewer Force Main
- Sewer Pipe
- Catchments
- Roads
- Lake, Pond, Reservoir
- Wetland, Marsh, Swamp
- Stream, Brook
- Non-Urban Area

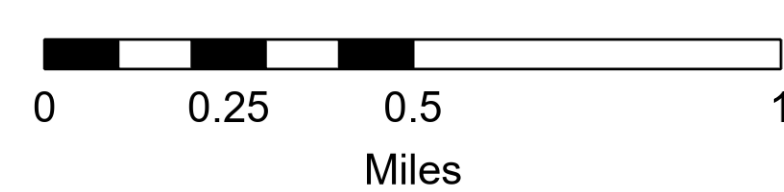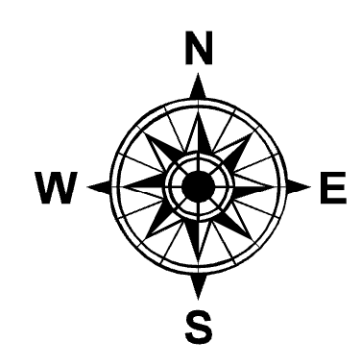


Stormwater Master Tile Map

Sutton, MA

Comprehensive
Environmental
Incorporated



Data Sources: CEI, MassGIS, Town of Sutton

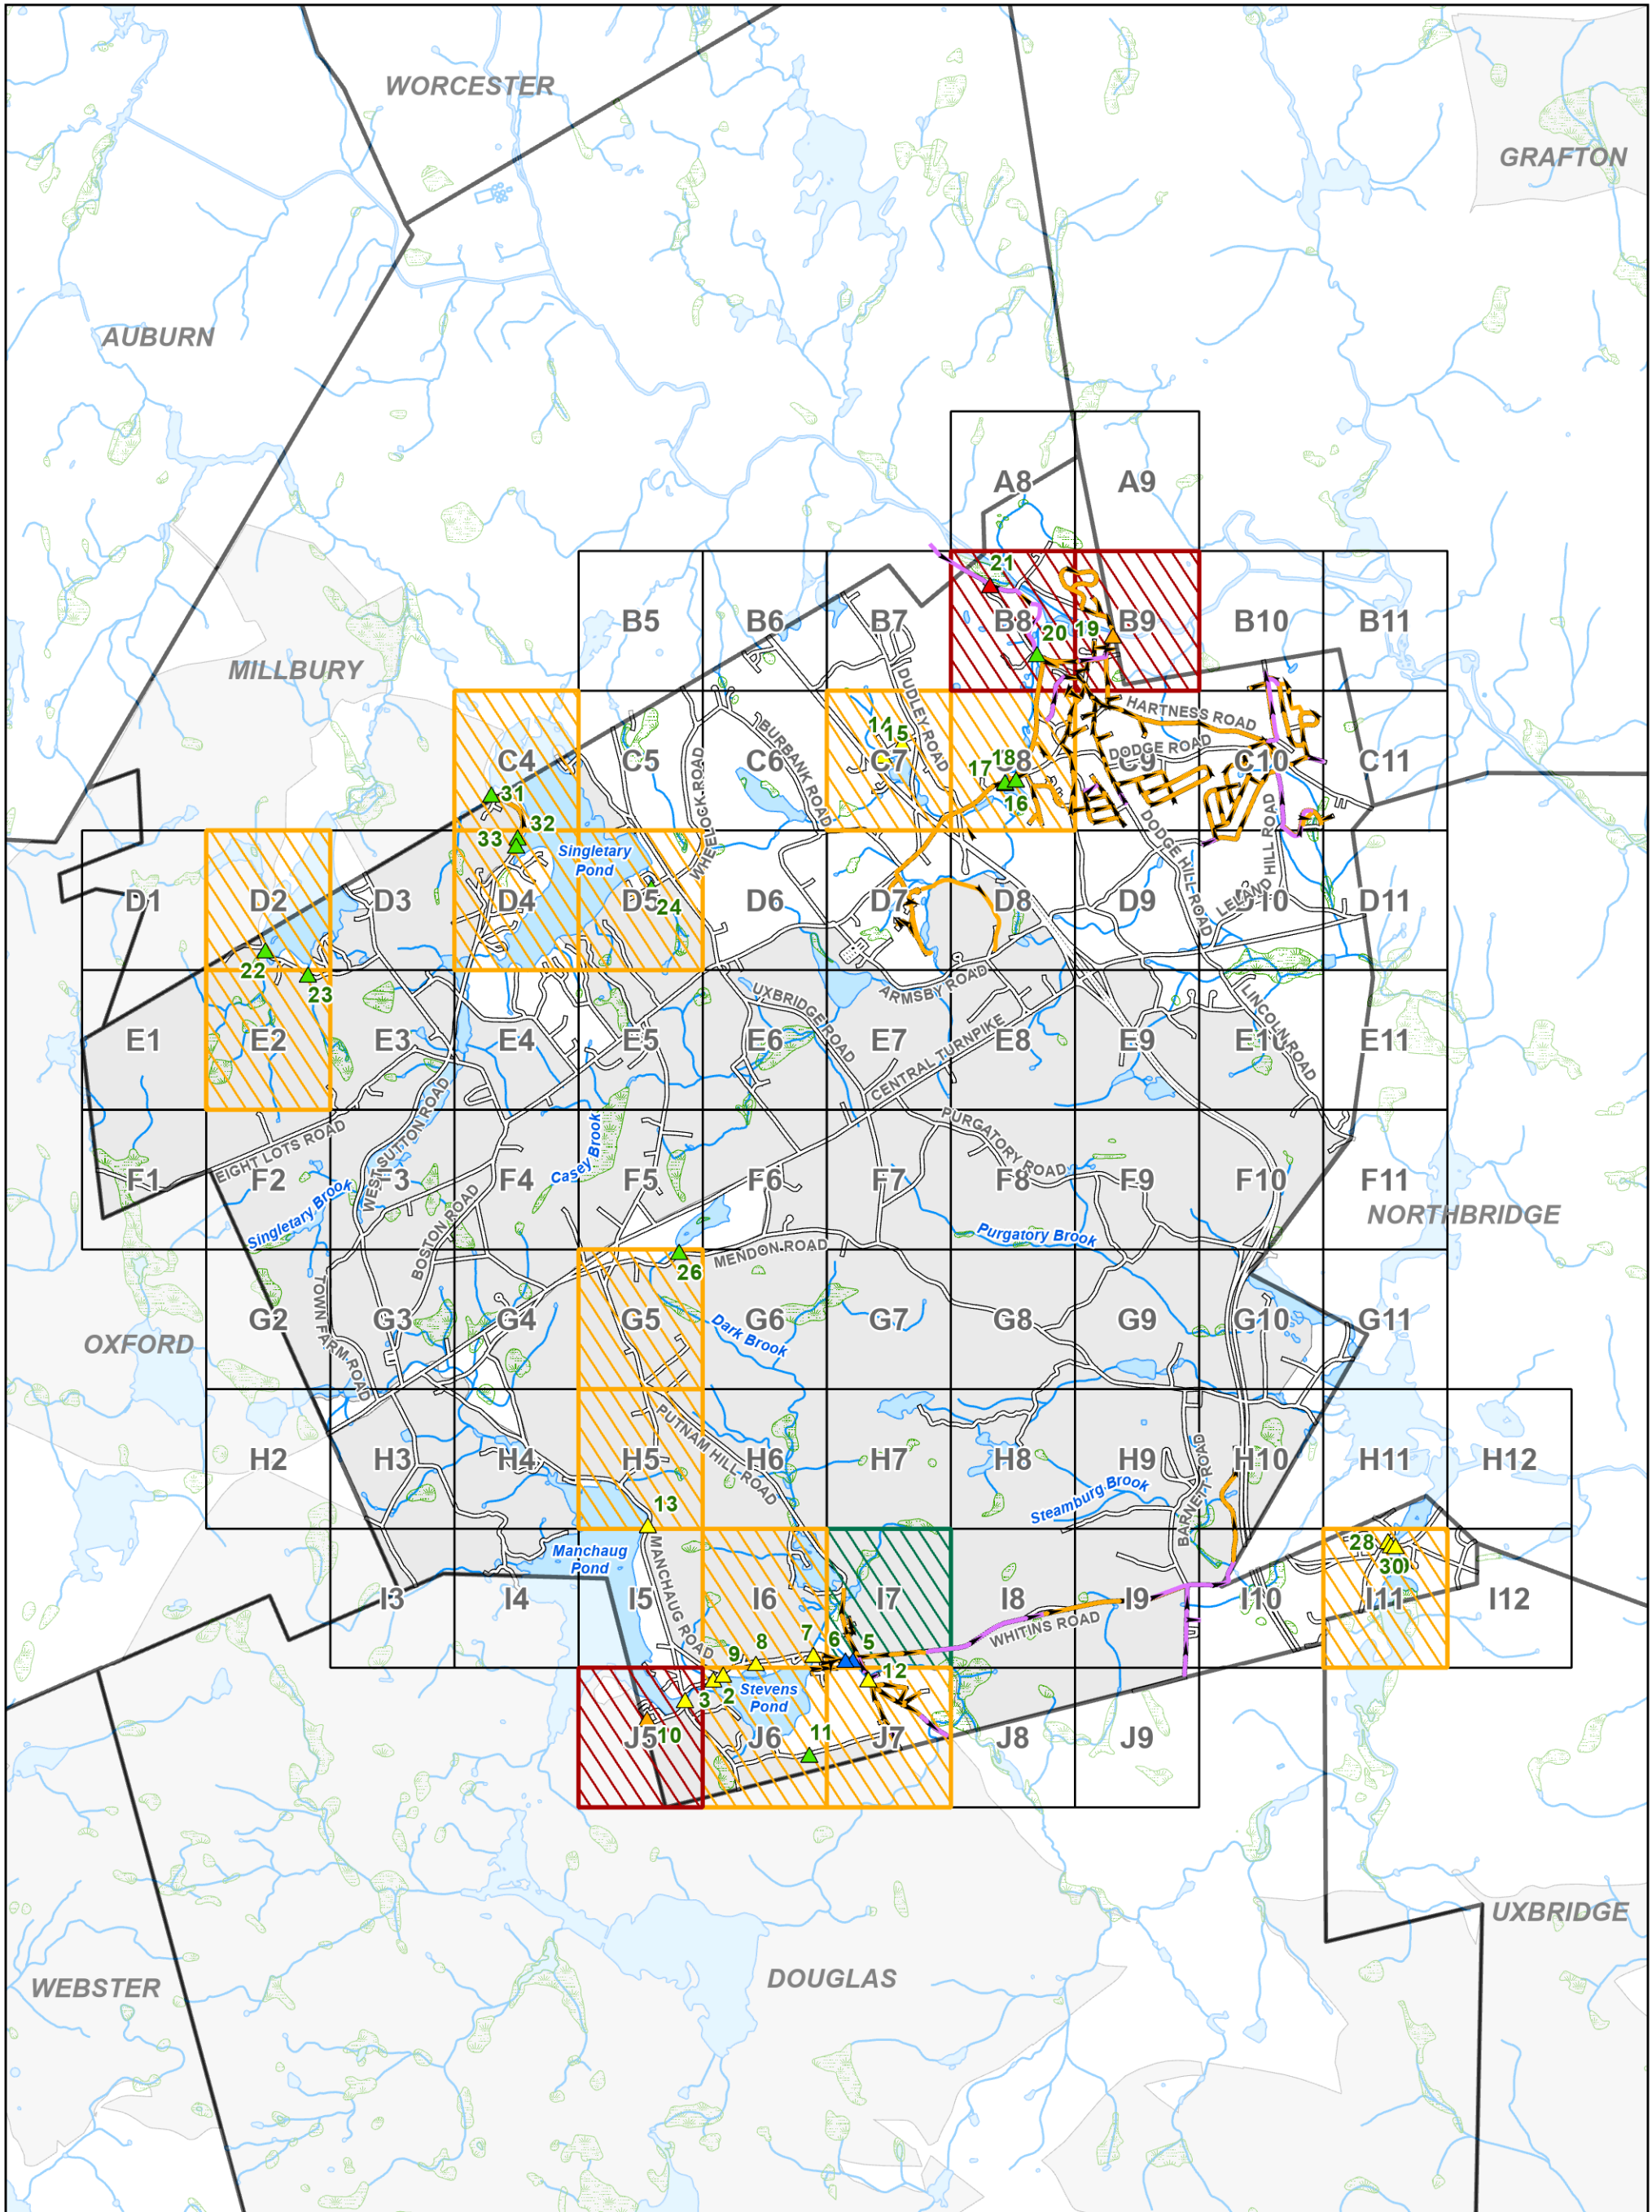

Prioritized Outfalls:

- ▲ 6
- ▲ 3
- ▲ 2
- ▲ 1
- ▲ Low Priority Outfalls

Prioritized Tiles:

- High
- Medium
- Low

- Sewer Force Main
- Sewer Pipe
- Lake, Pond, Reservoir
- Wetland, Marsh, Swamp
- Stream, Brook
- Non-Urban Area




**Stormwater Map with
Prioritized Outfalls and Areas
Sutton, MA**









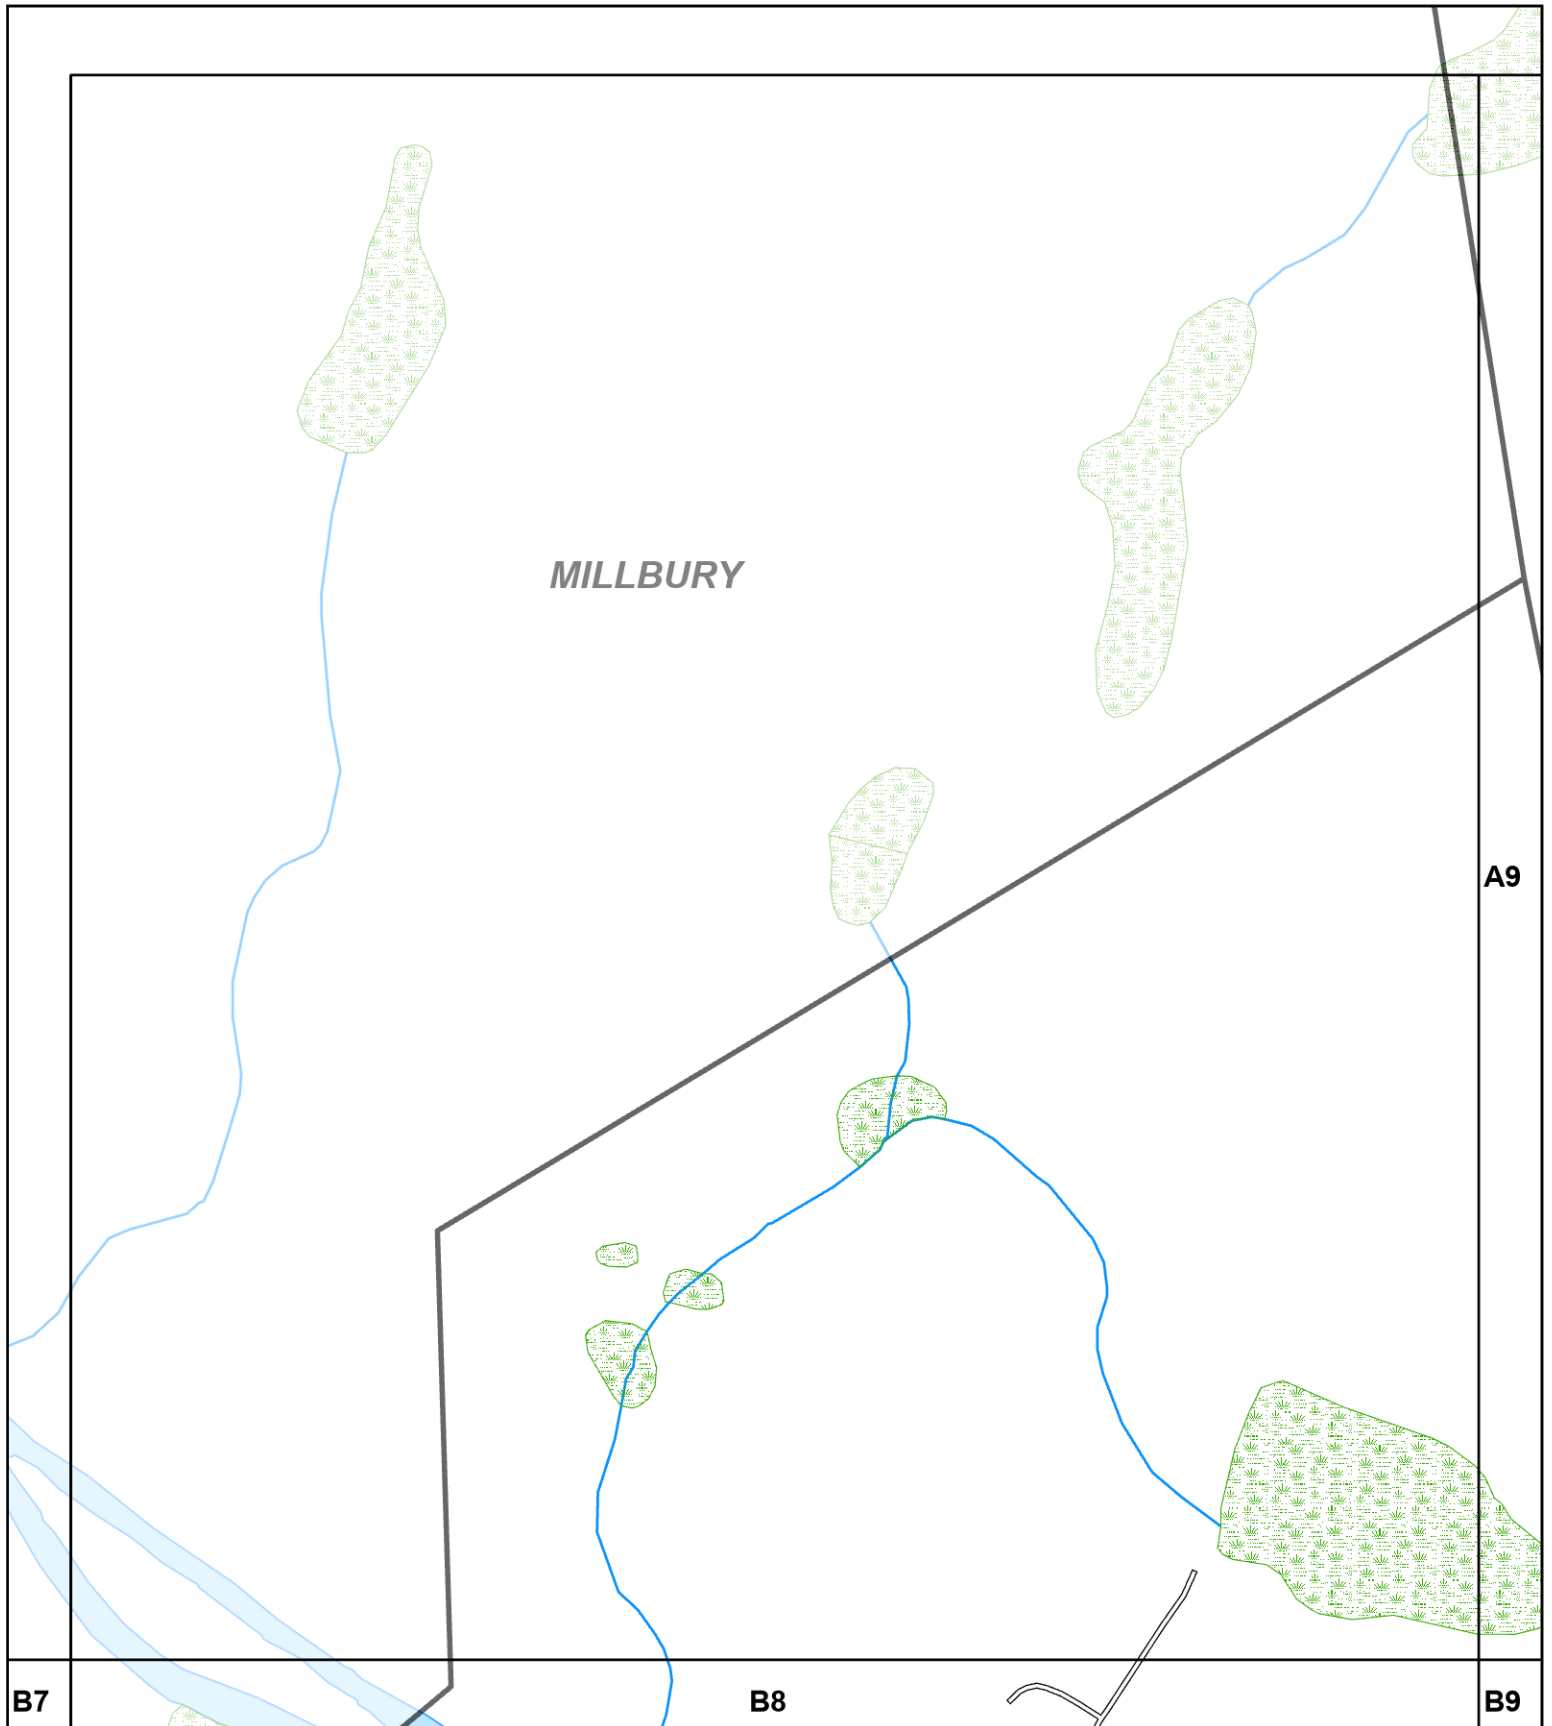


Comprehensive
Environmental
Incorporated

Note: Priority outfalls are ranked 1-6 with 6 being the highest priority


Data Sources: MassGIS, Town of Sutton, CEI



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







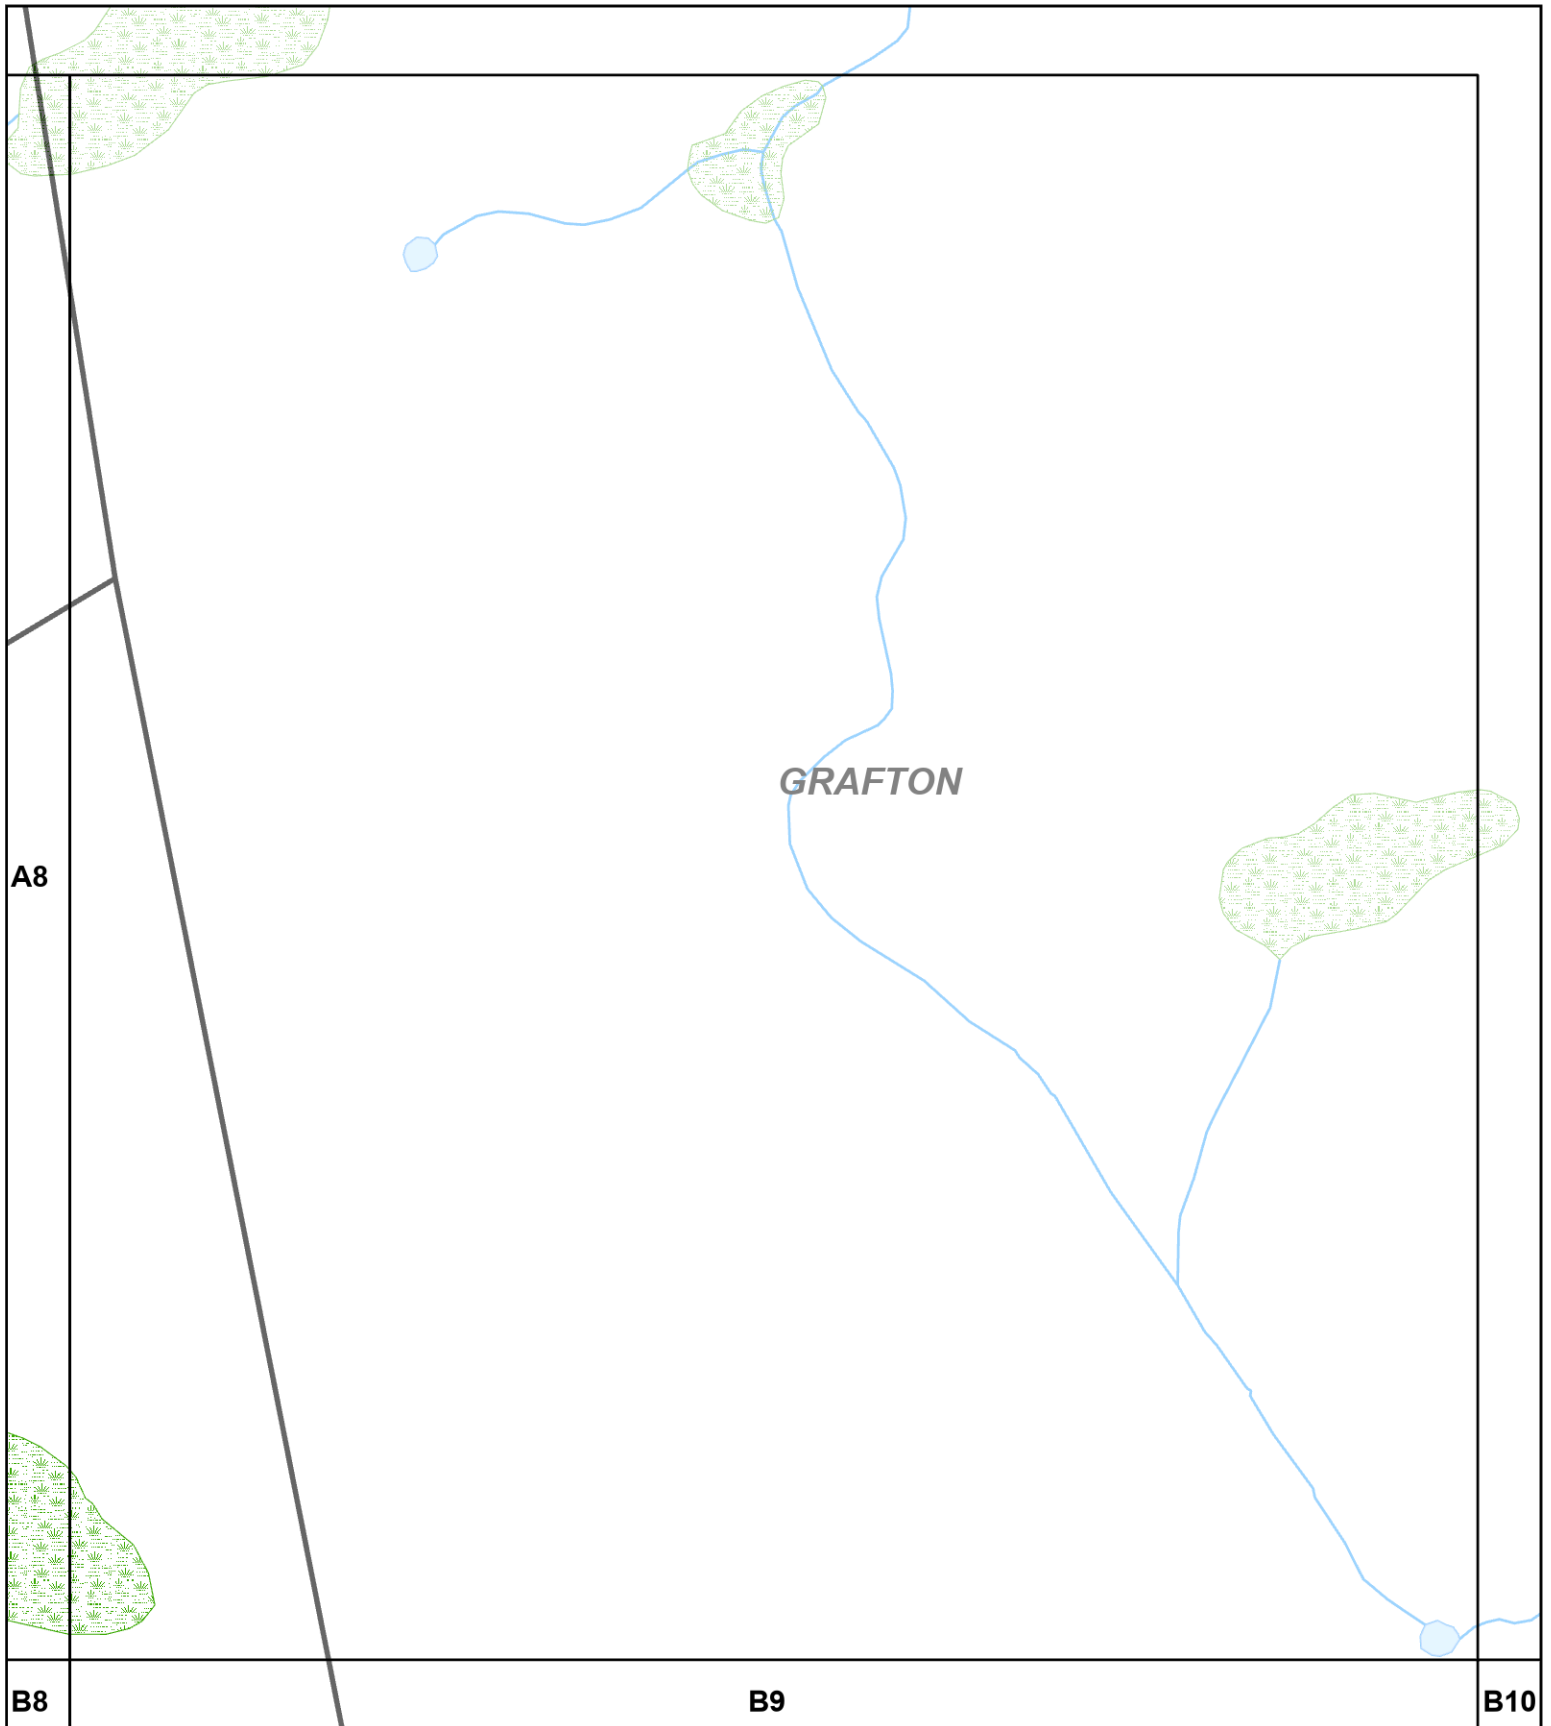


A8




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







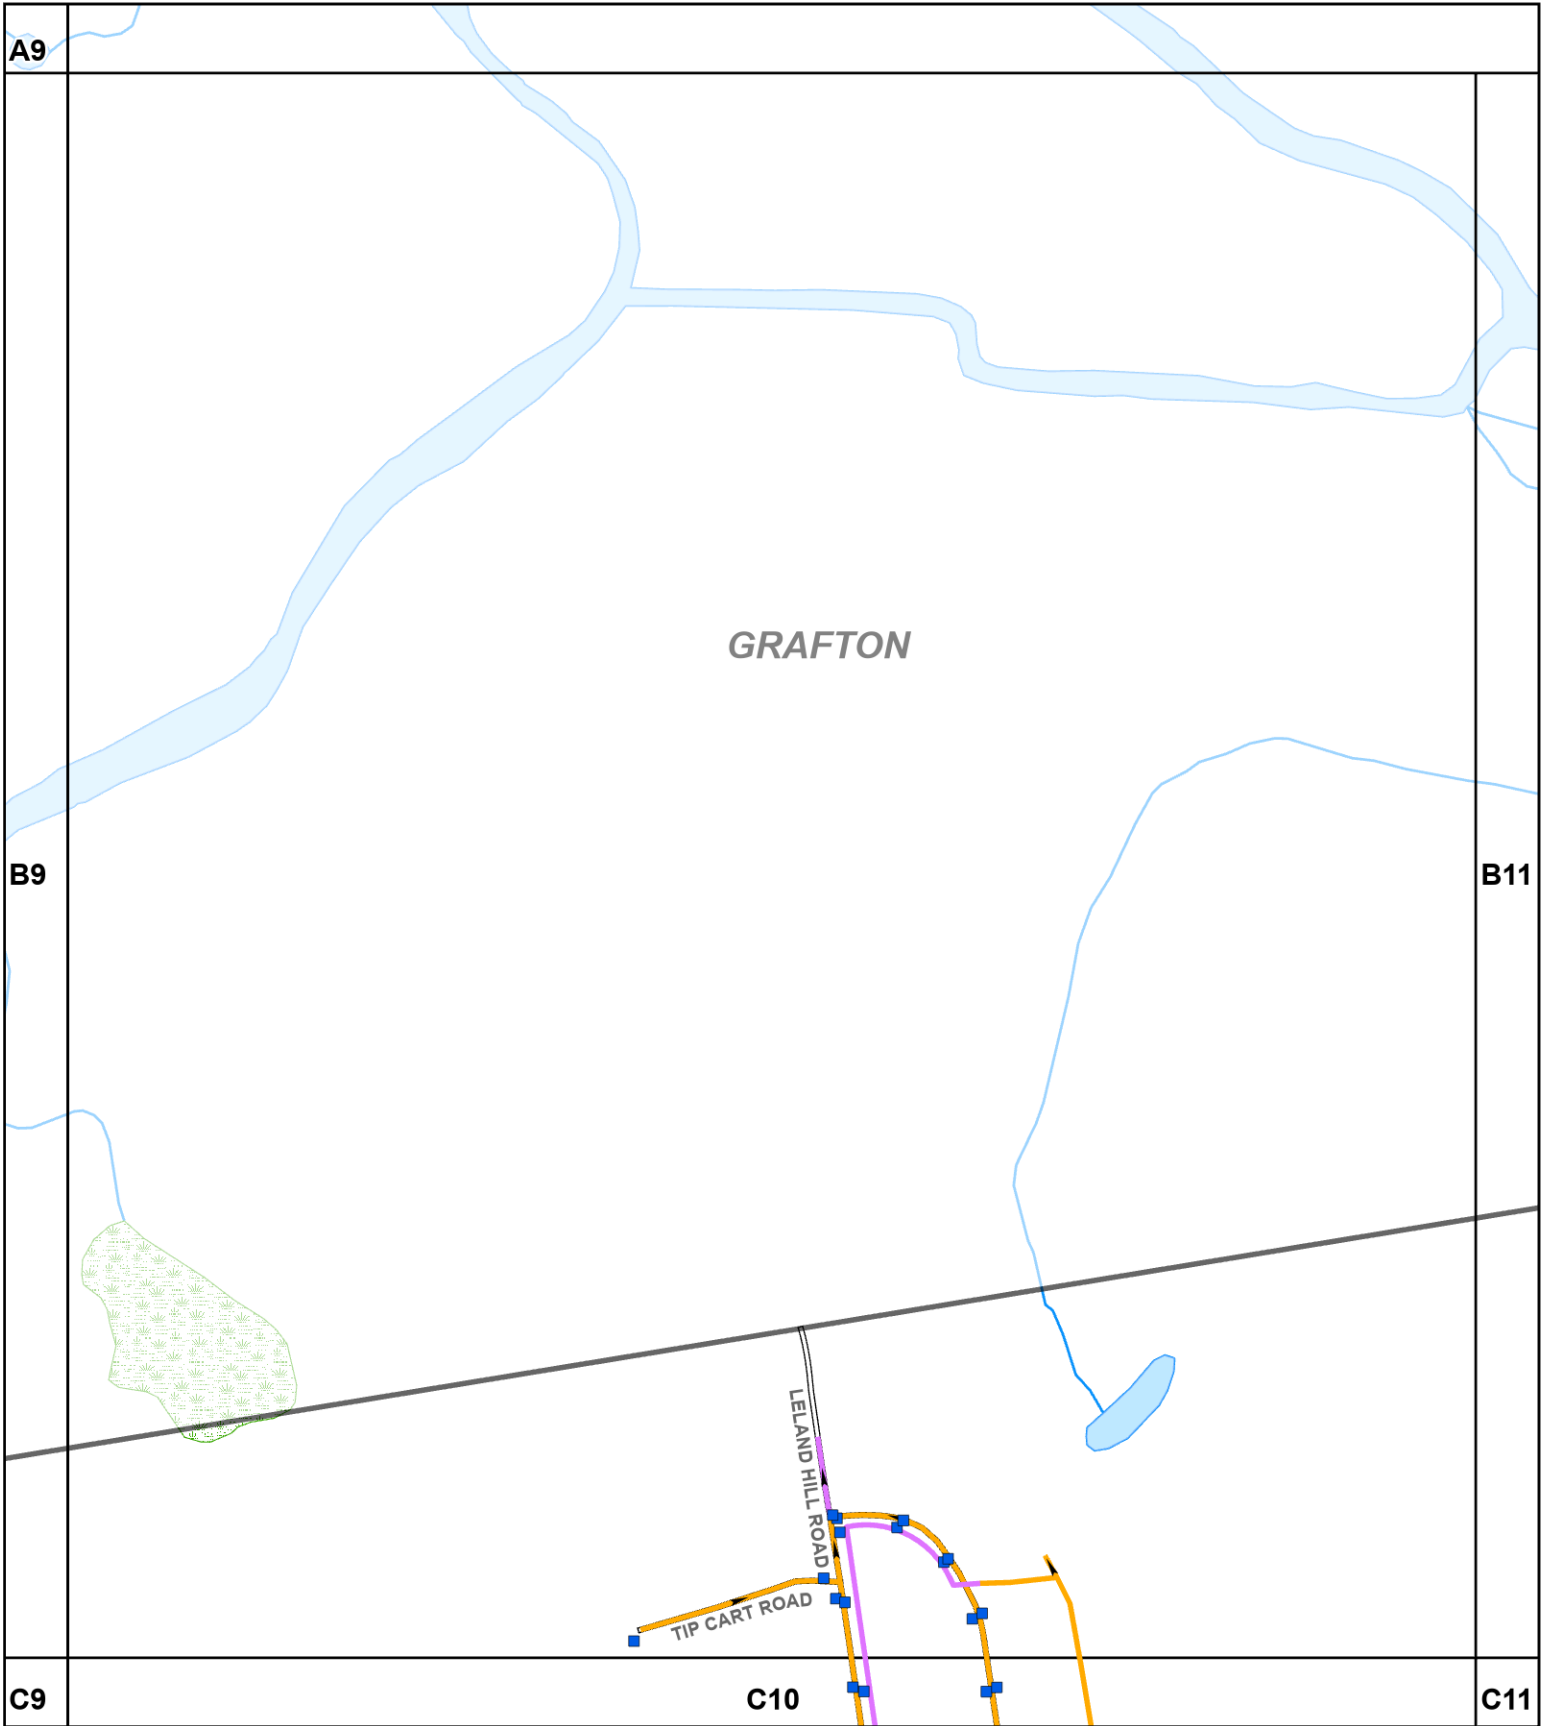


A9



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI









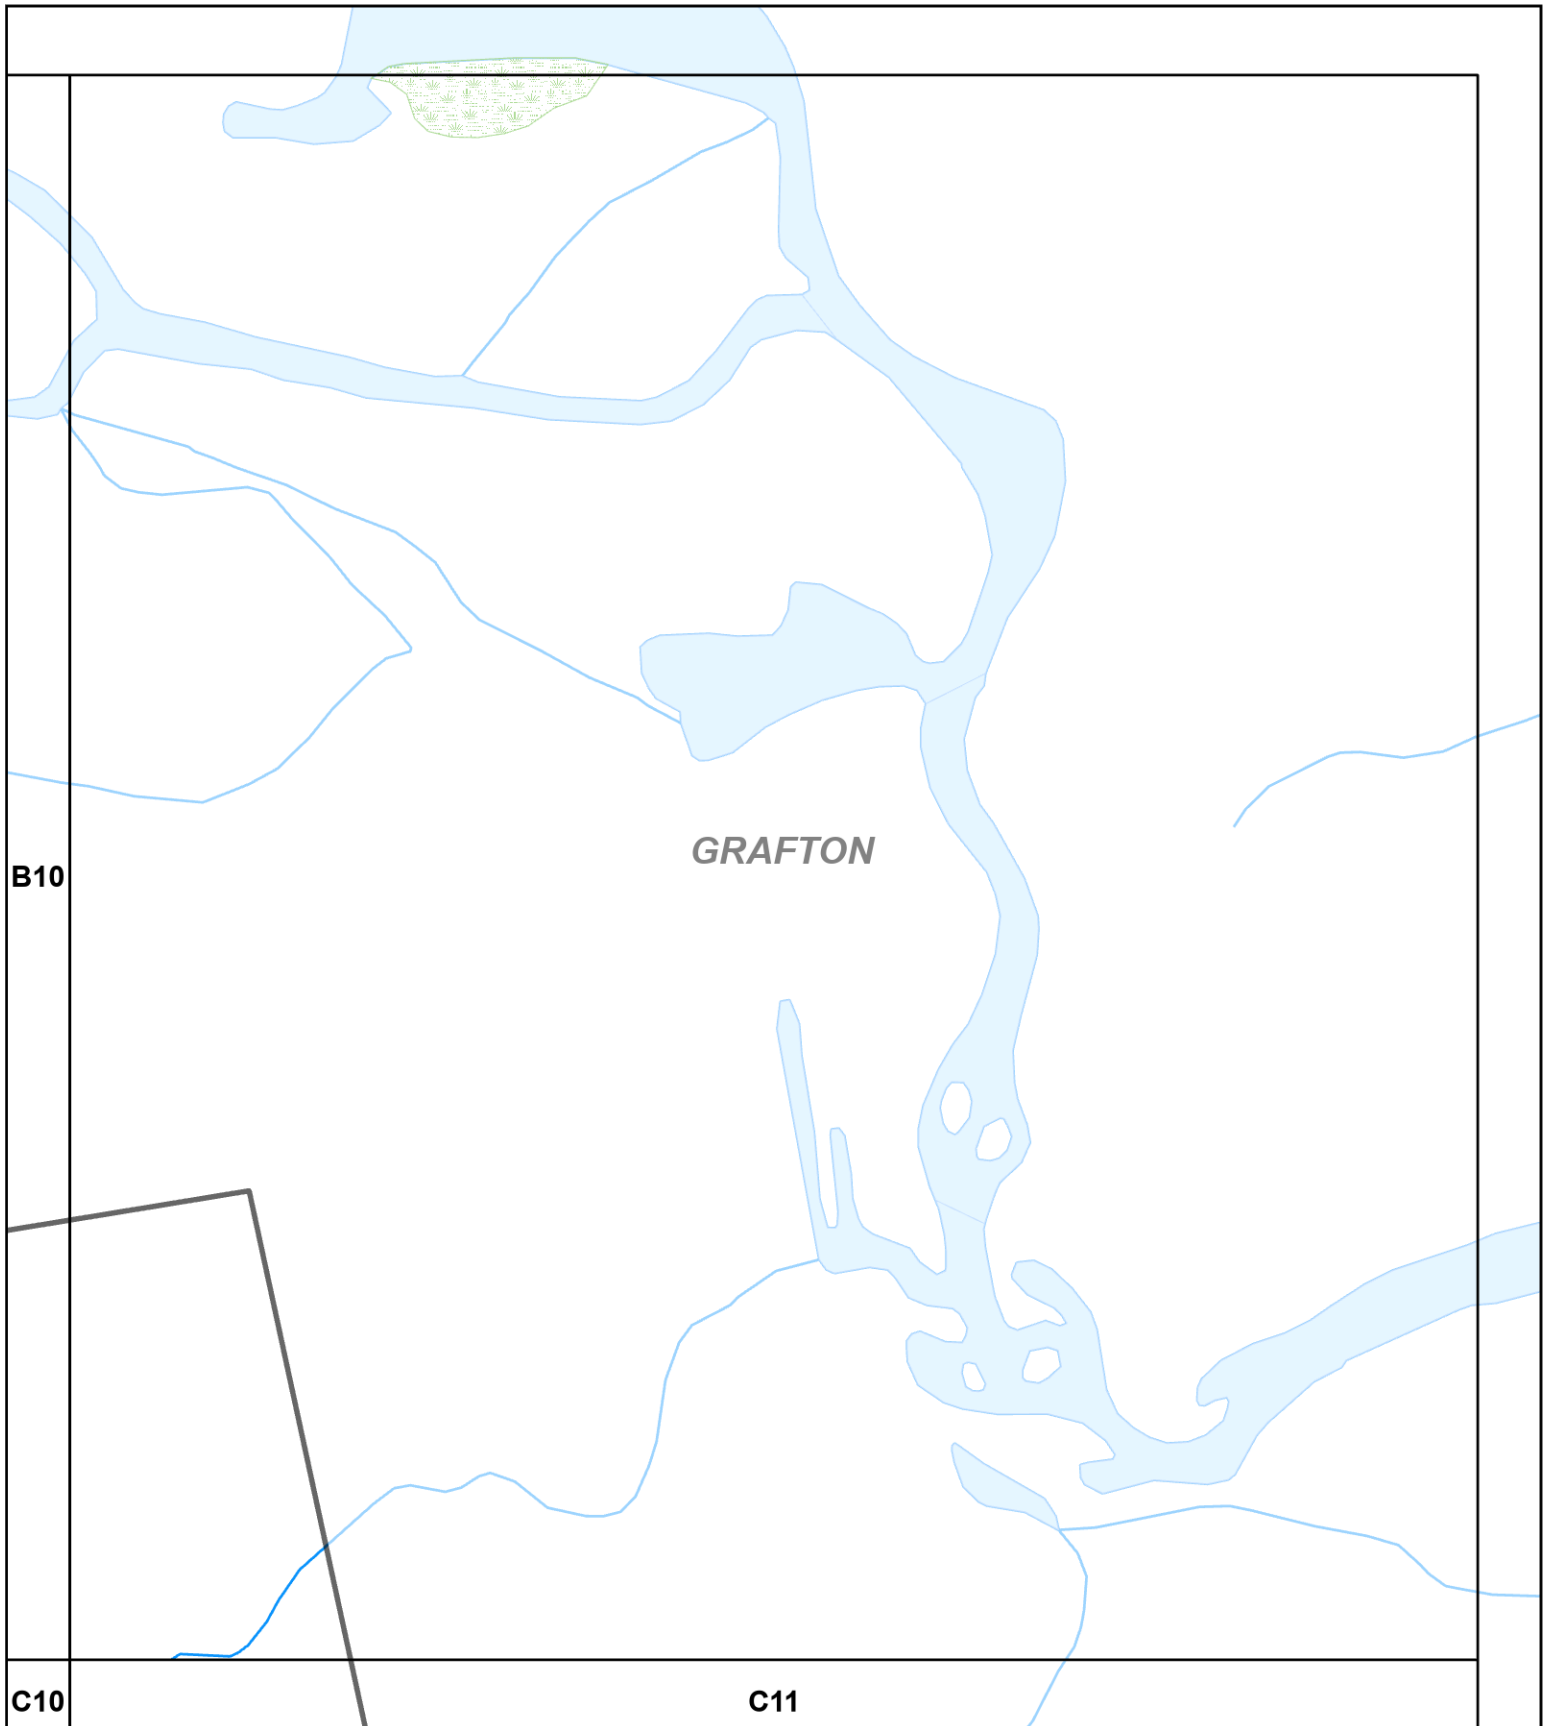


**SHEET
B10**




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







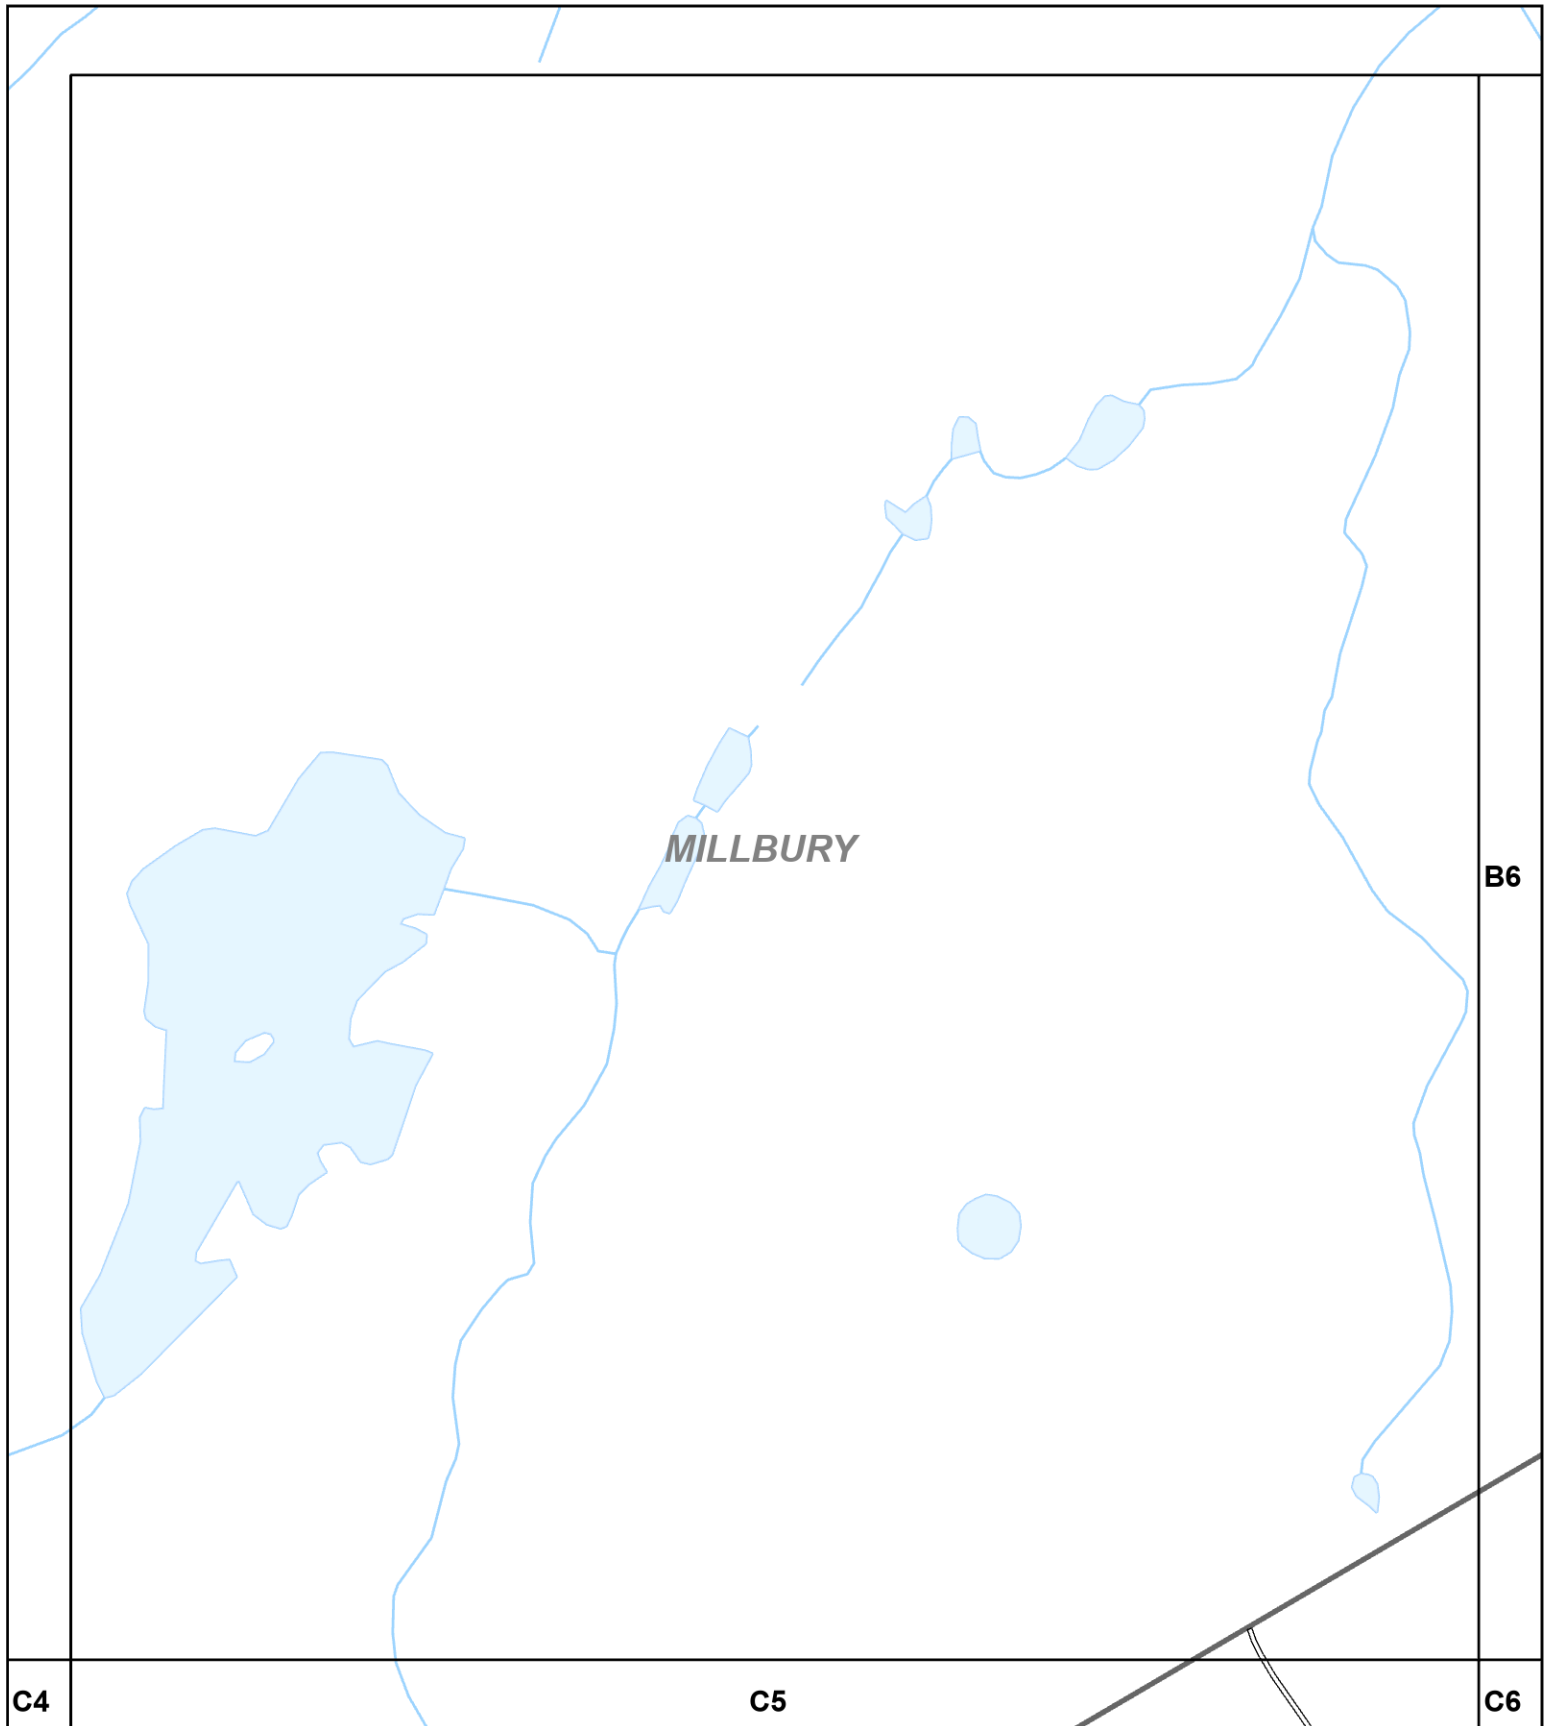


B11




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

B5




**Comprehensive
Environmental
Incorporated**

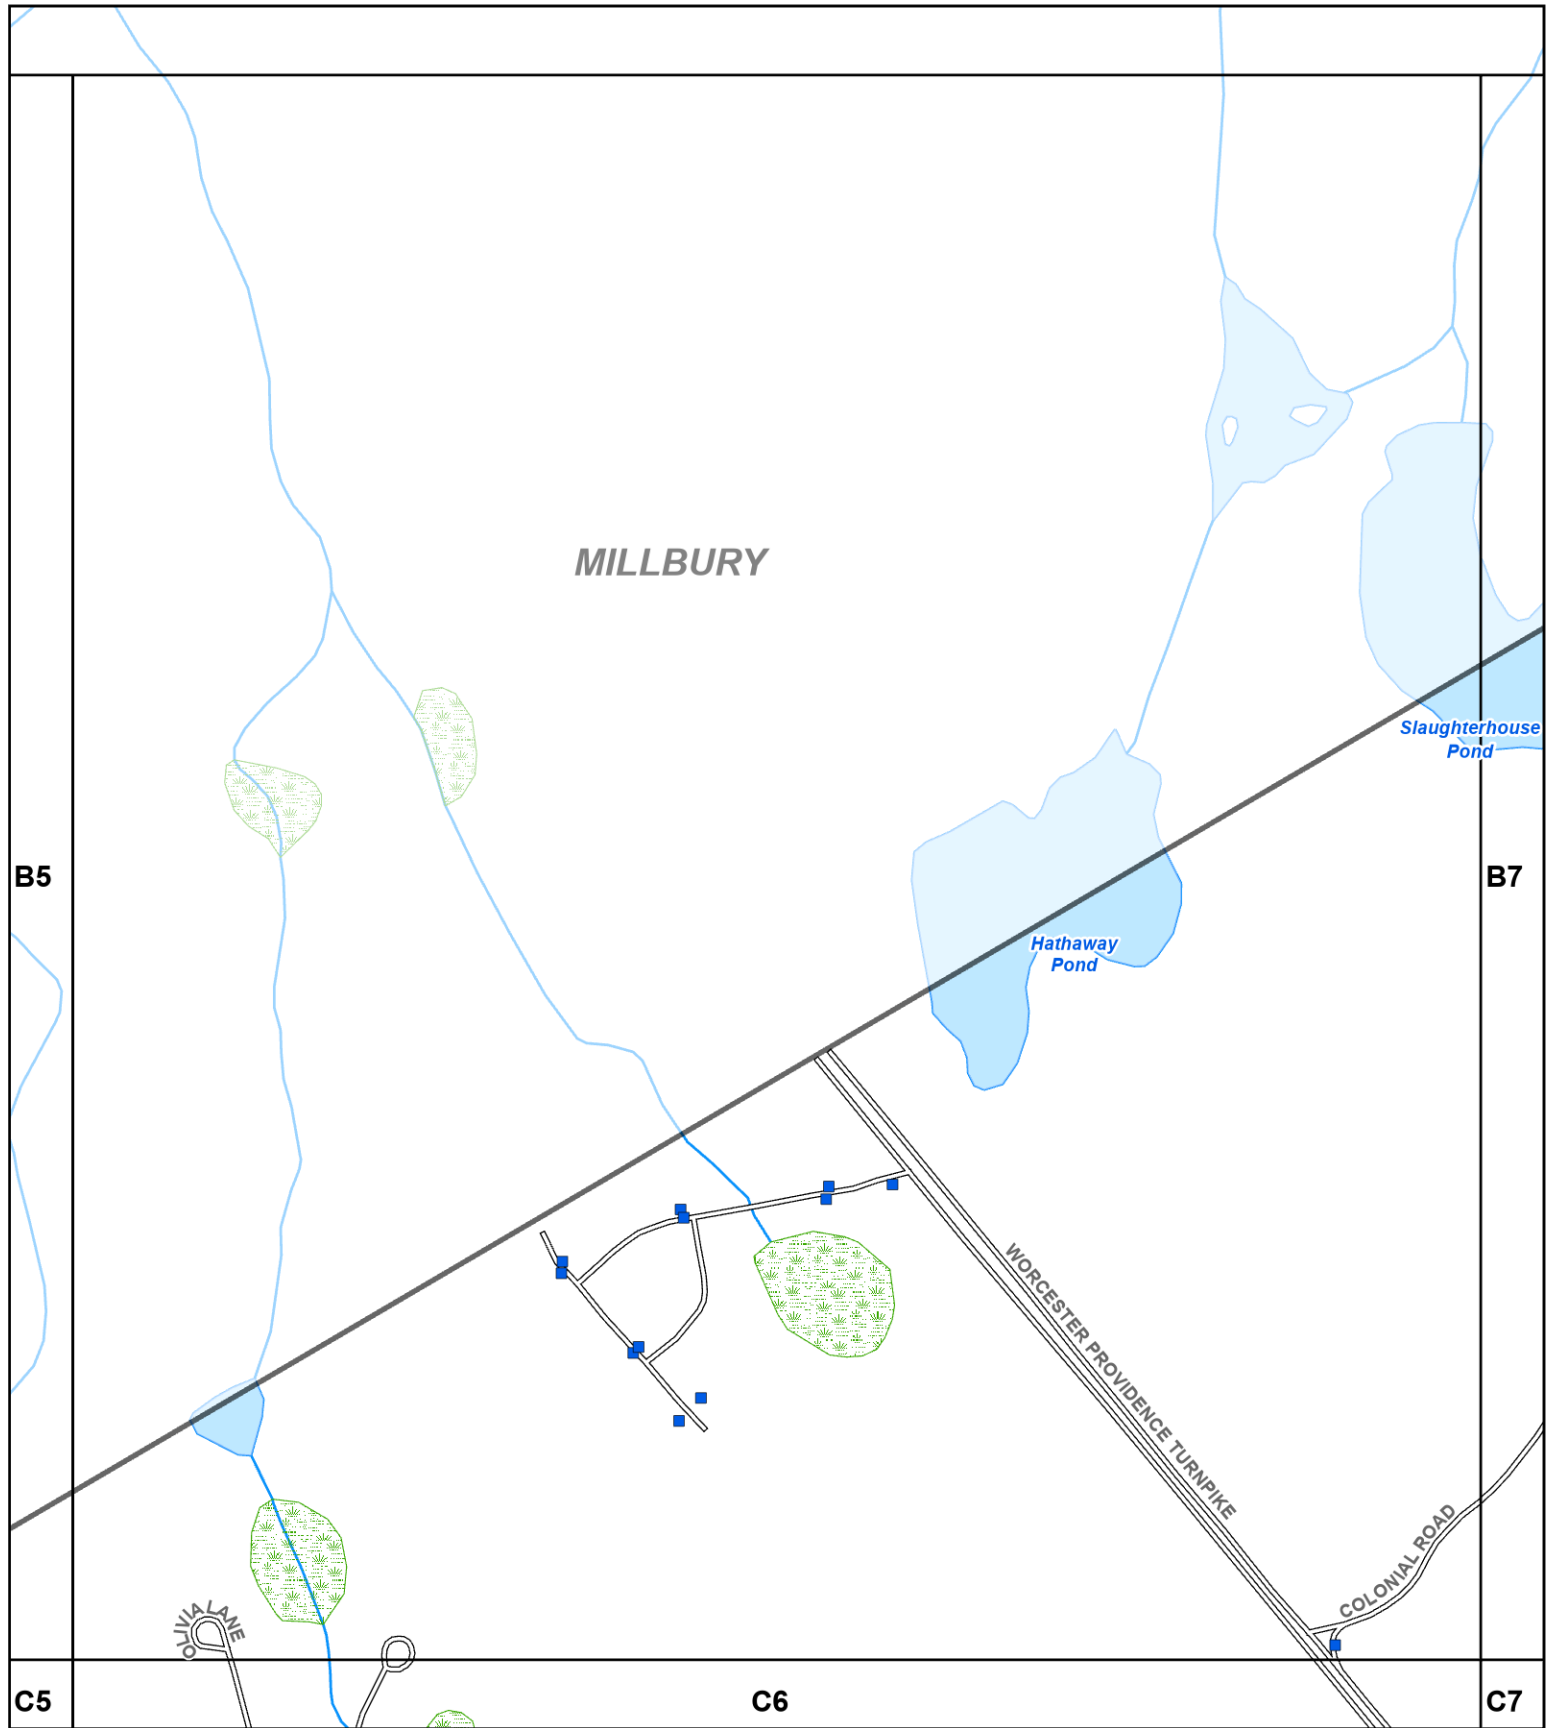

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









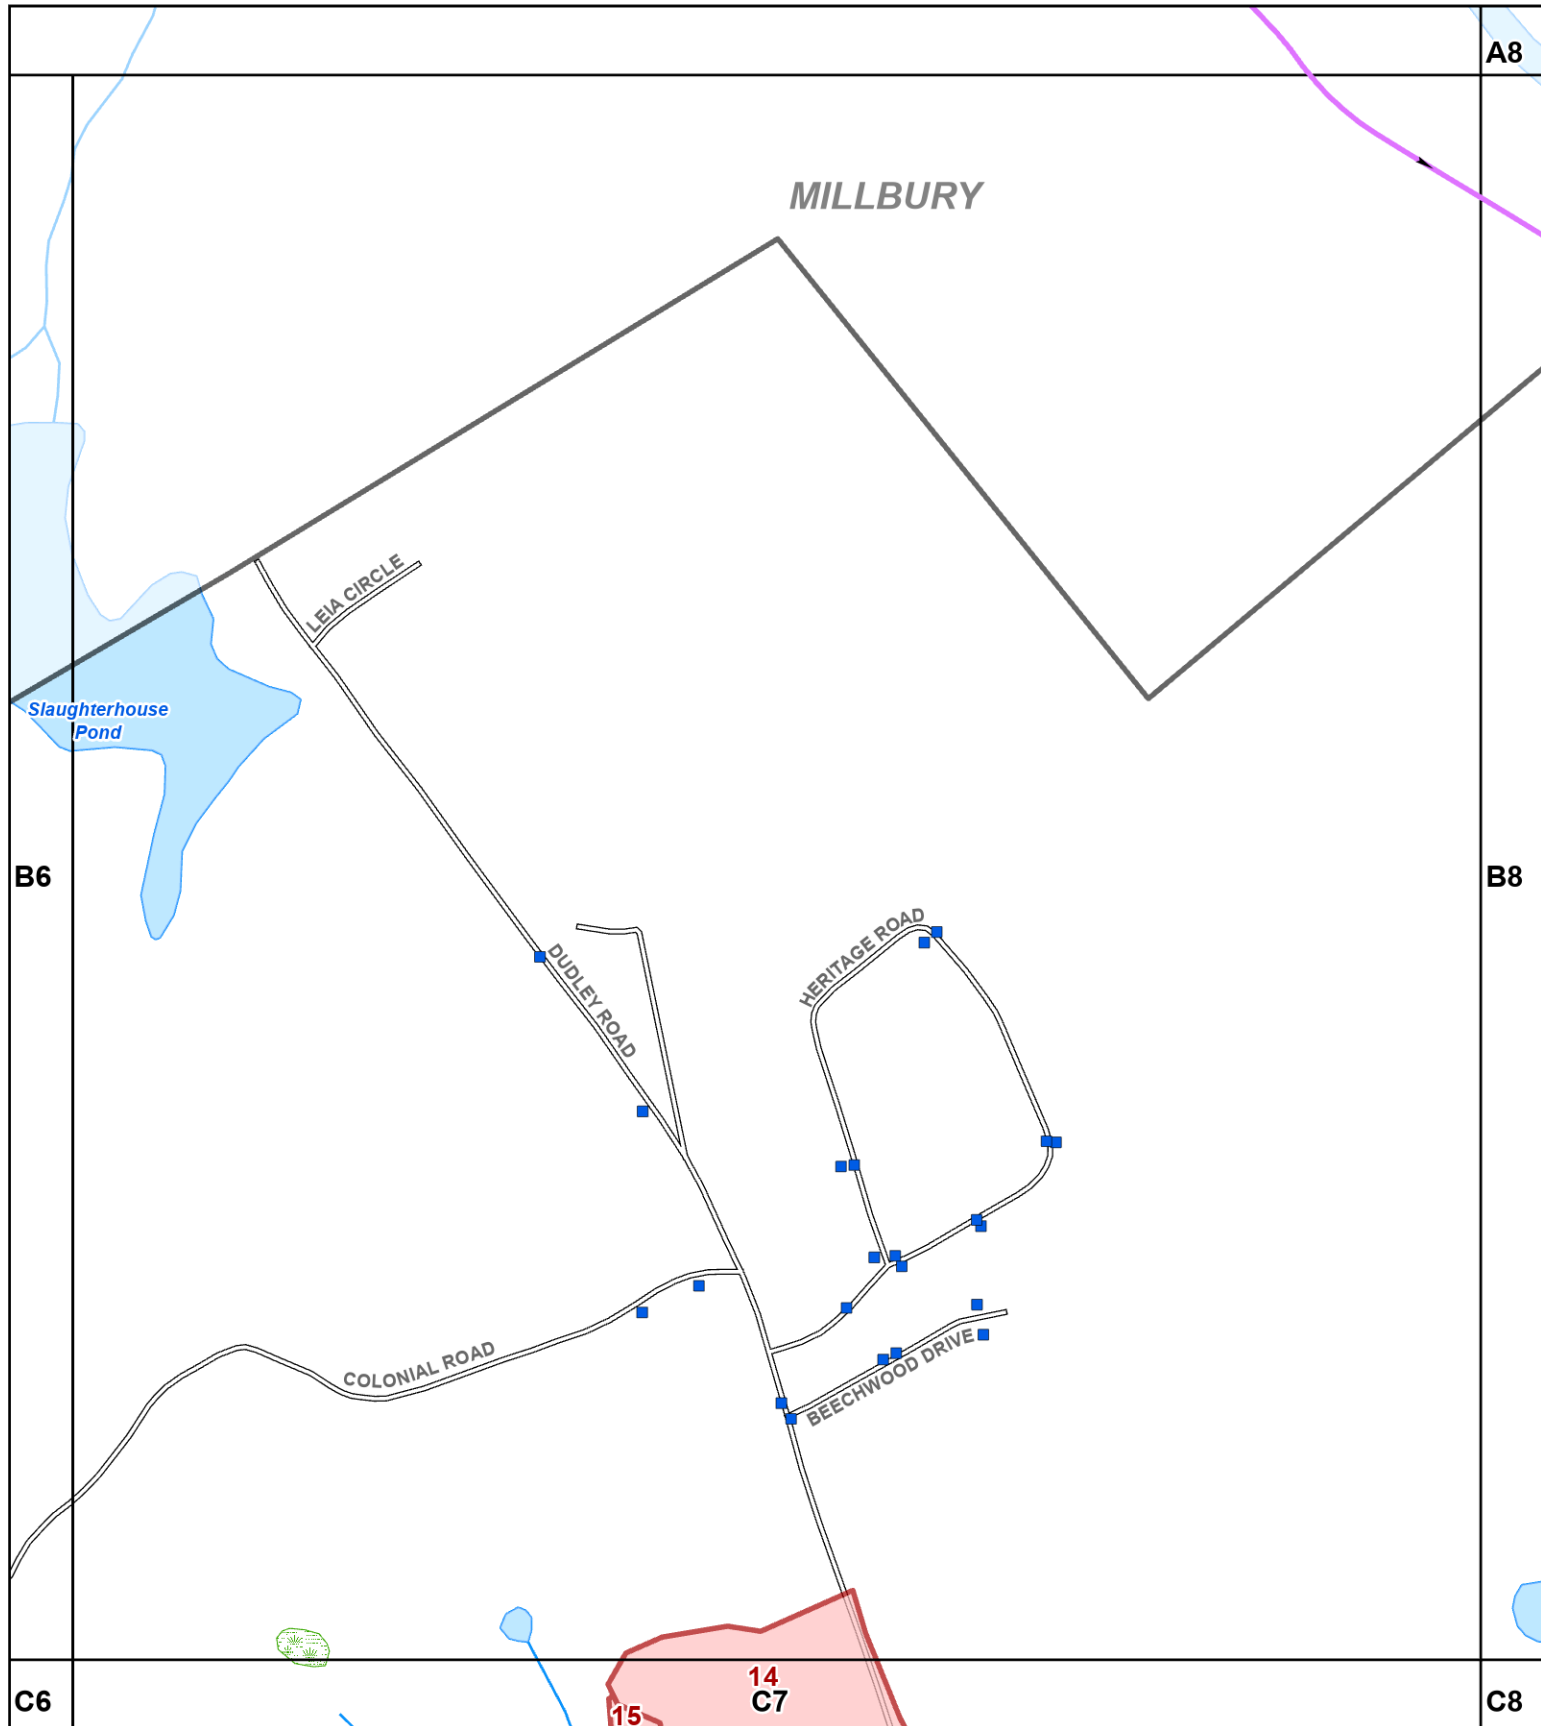


SHEET
B6



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









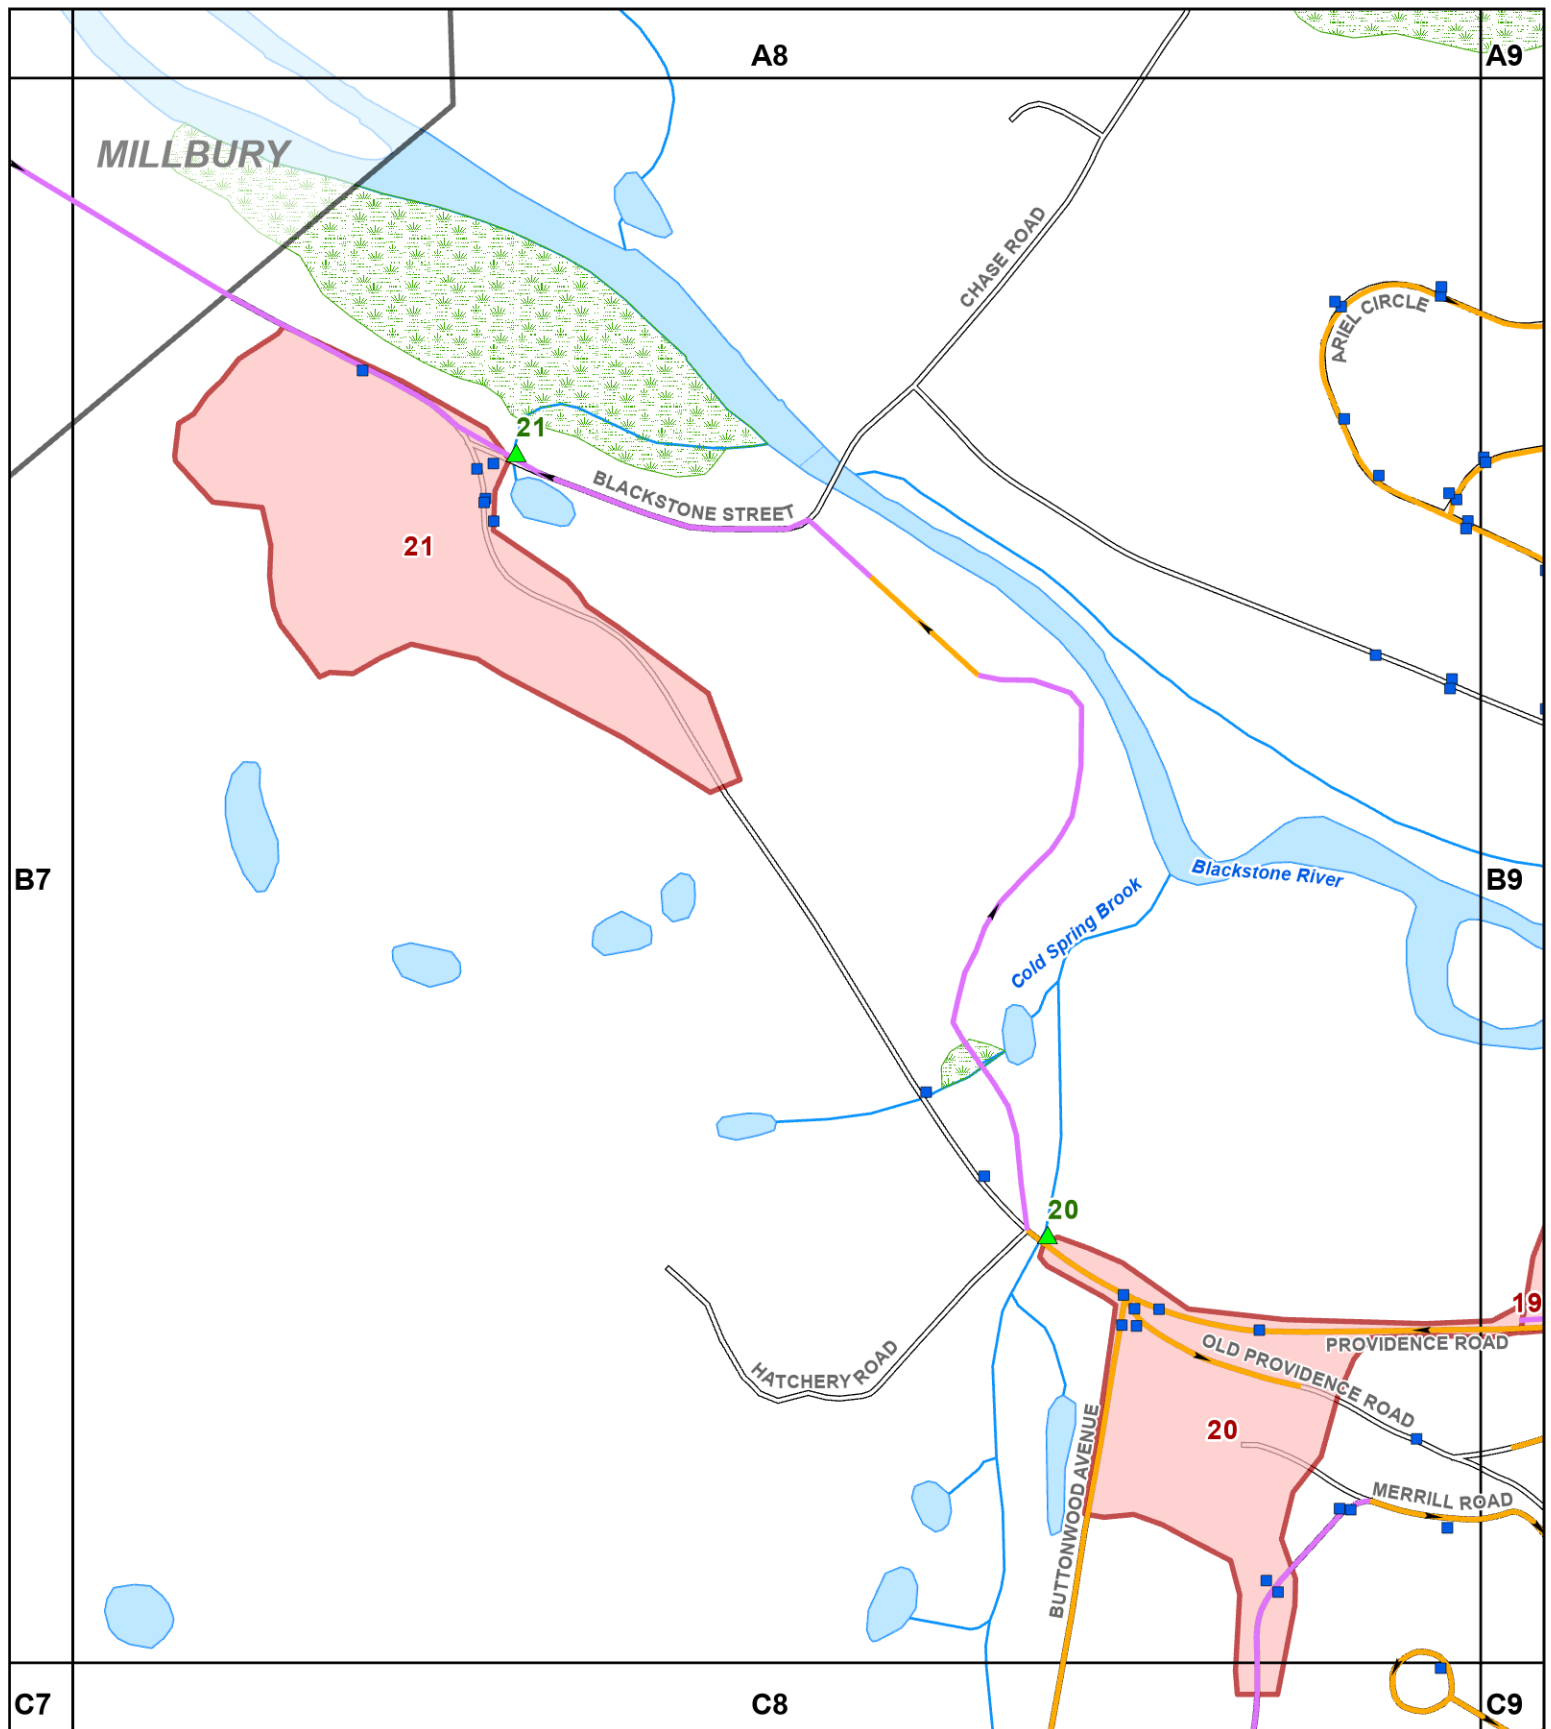


SHEET
B7



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI










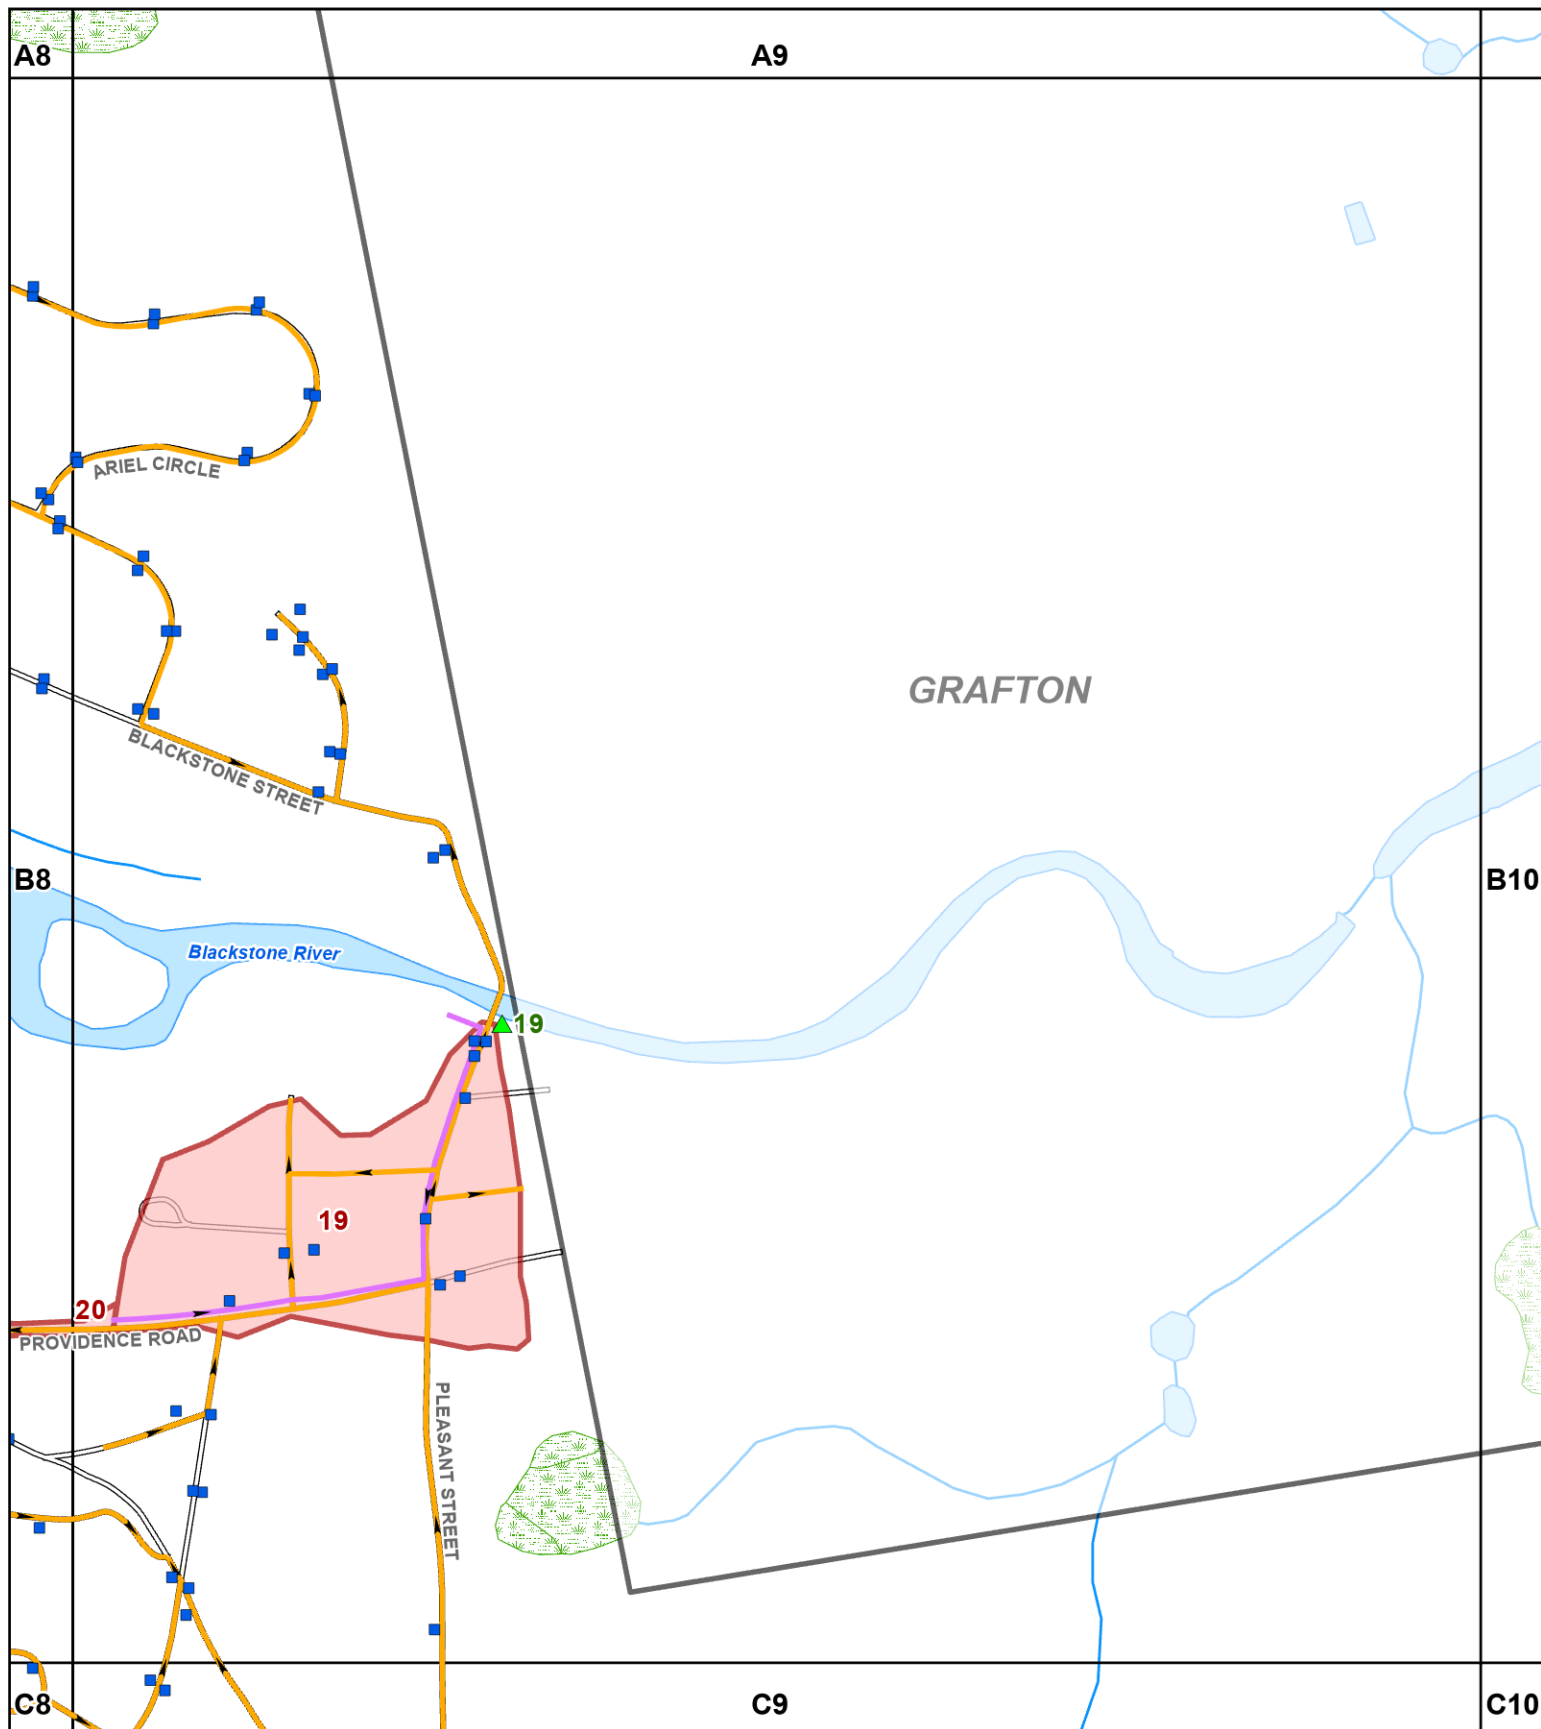

SHEET
B8



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI



SHEET
B9



**Comprehensive
Environmental
Incorporated**

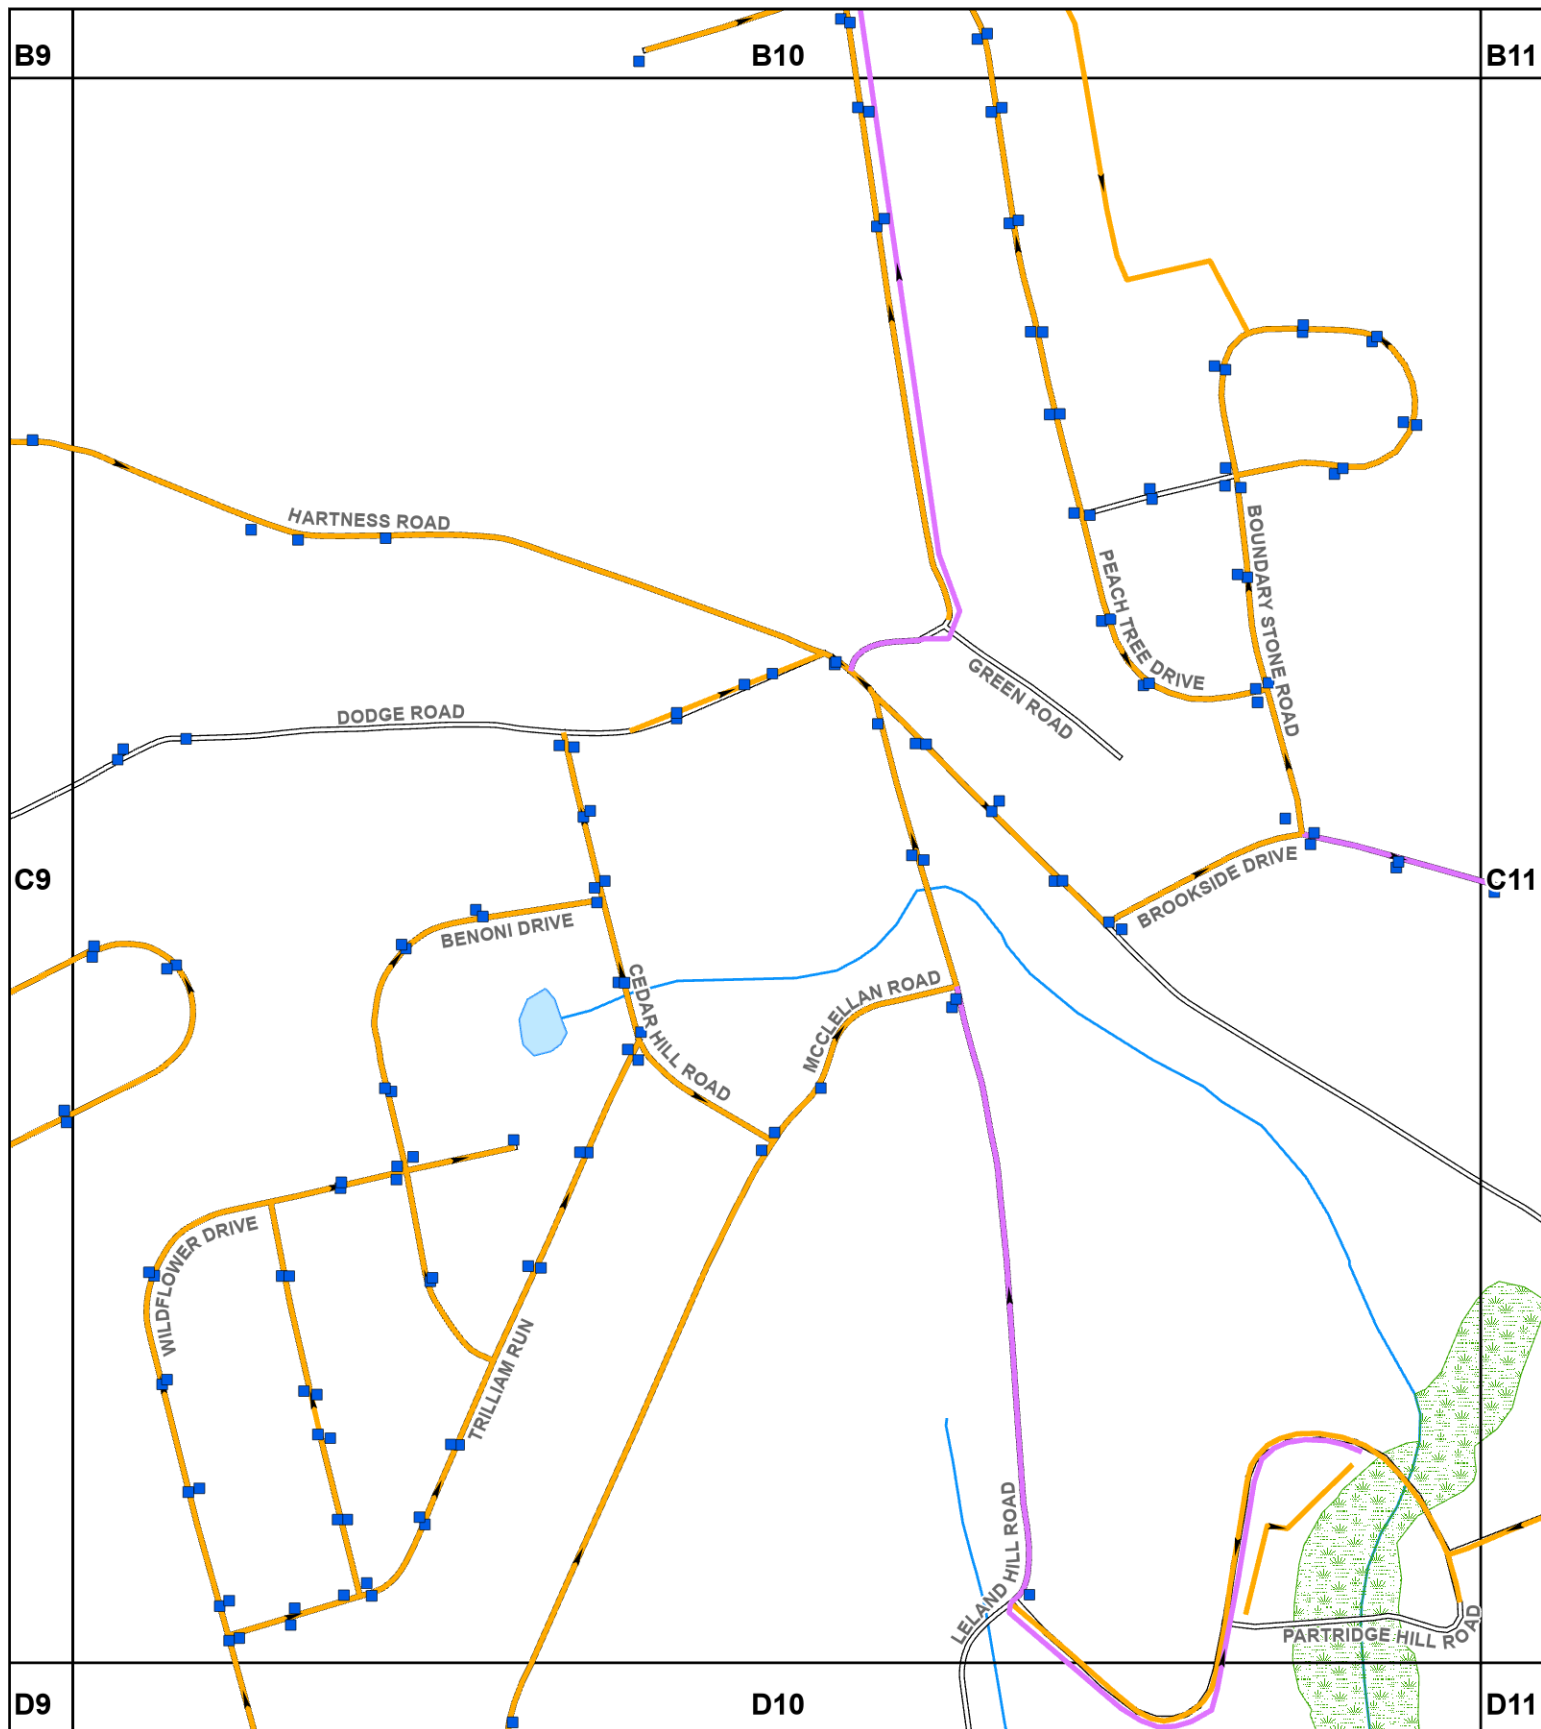

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









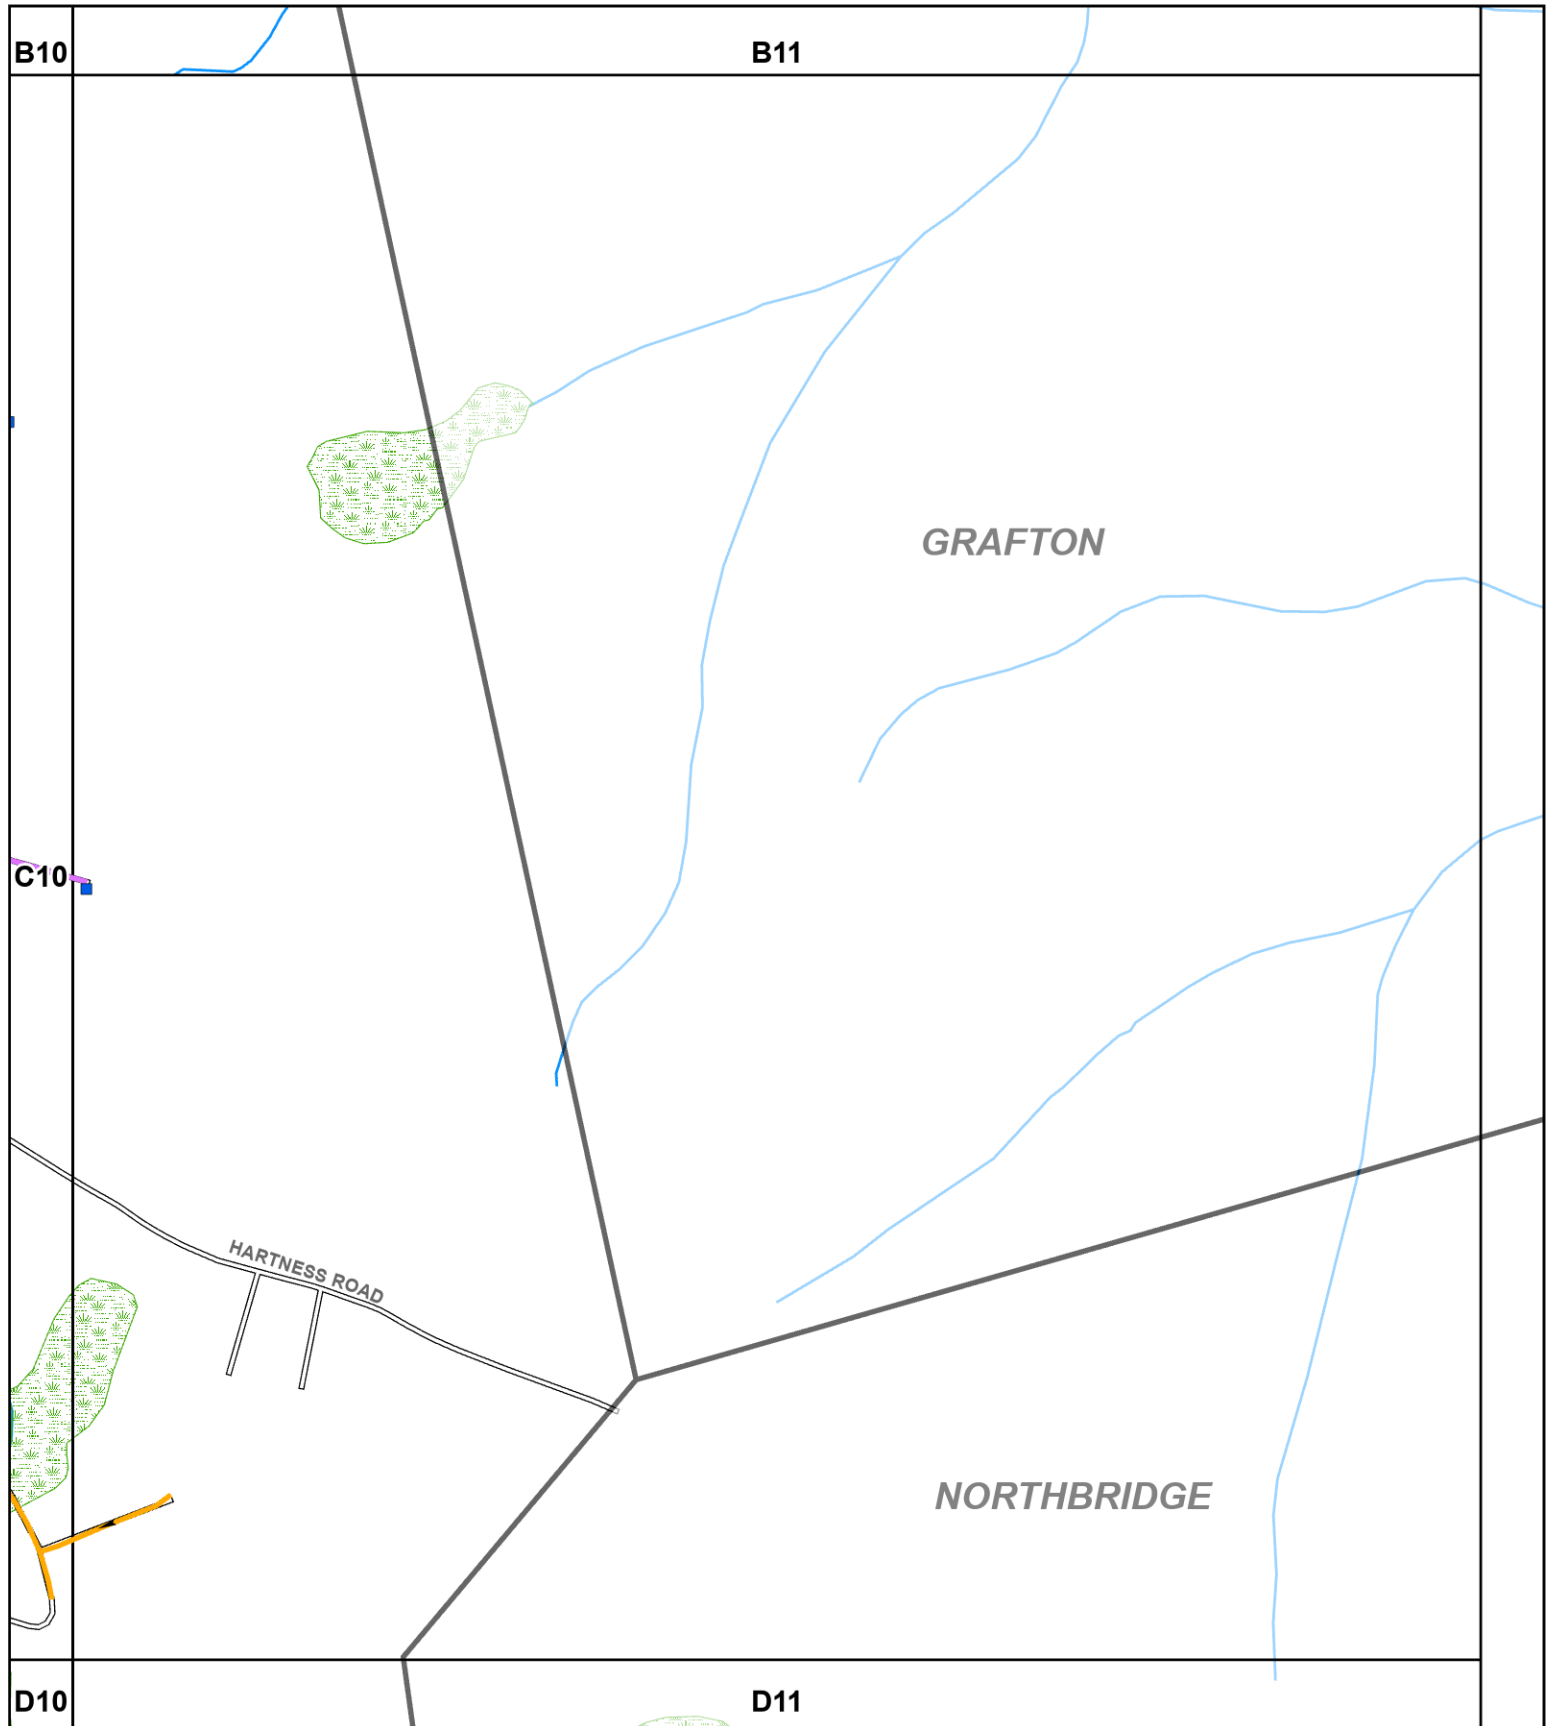


SHEET
C10




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

C11




**Comprehensive
Environmental
Incorporated**

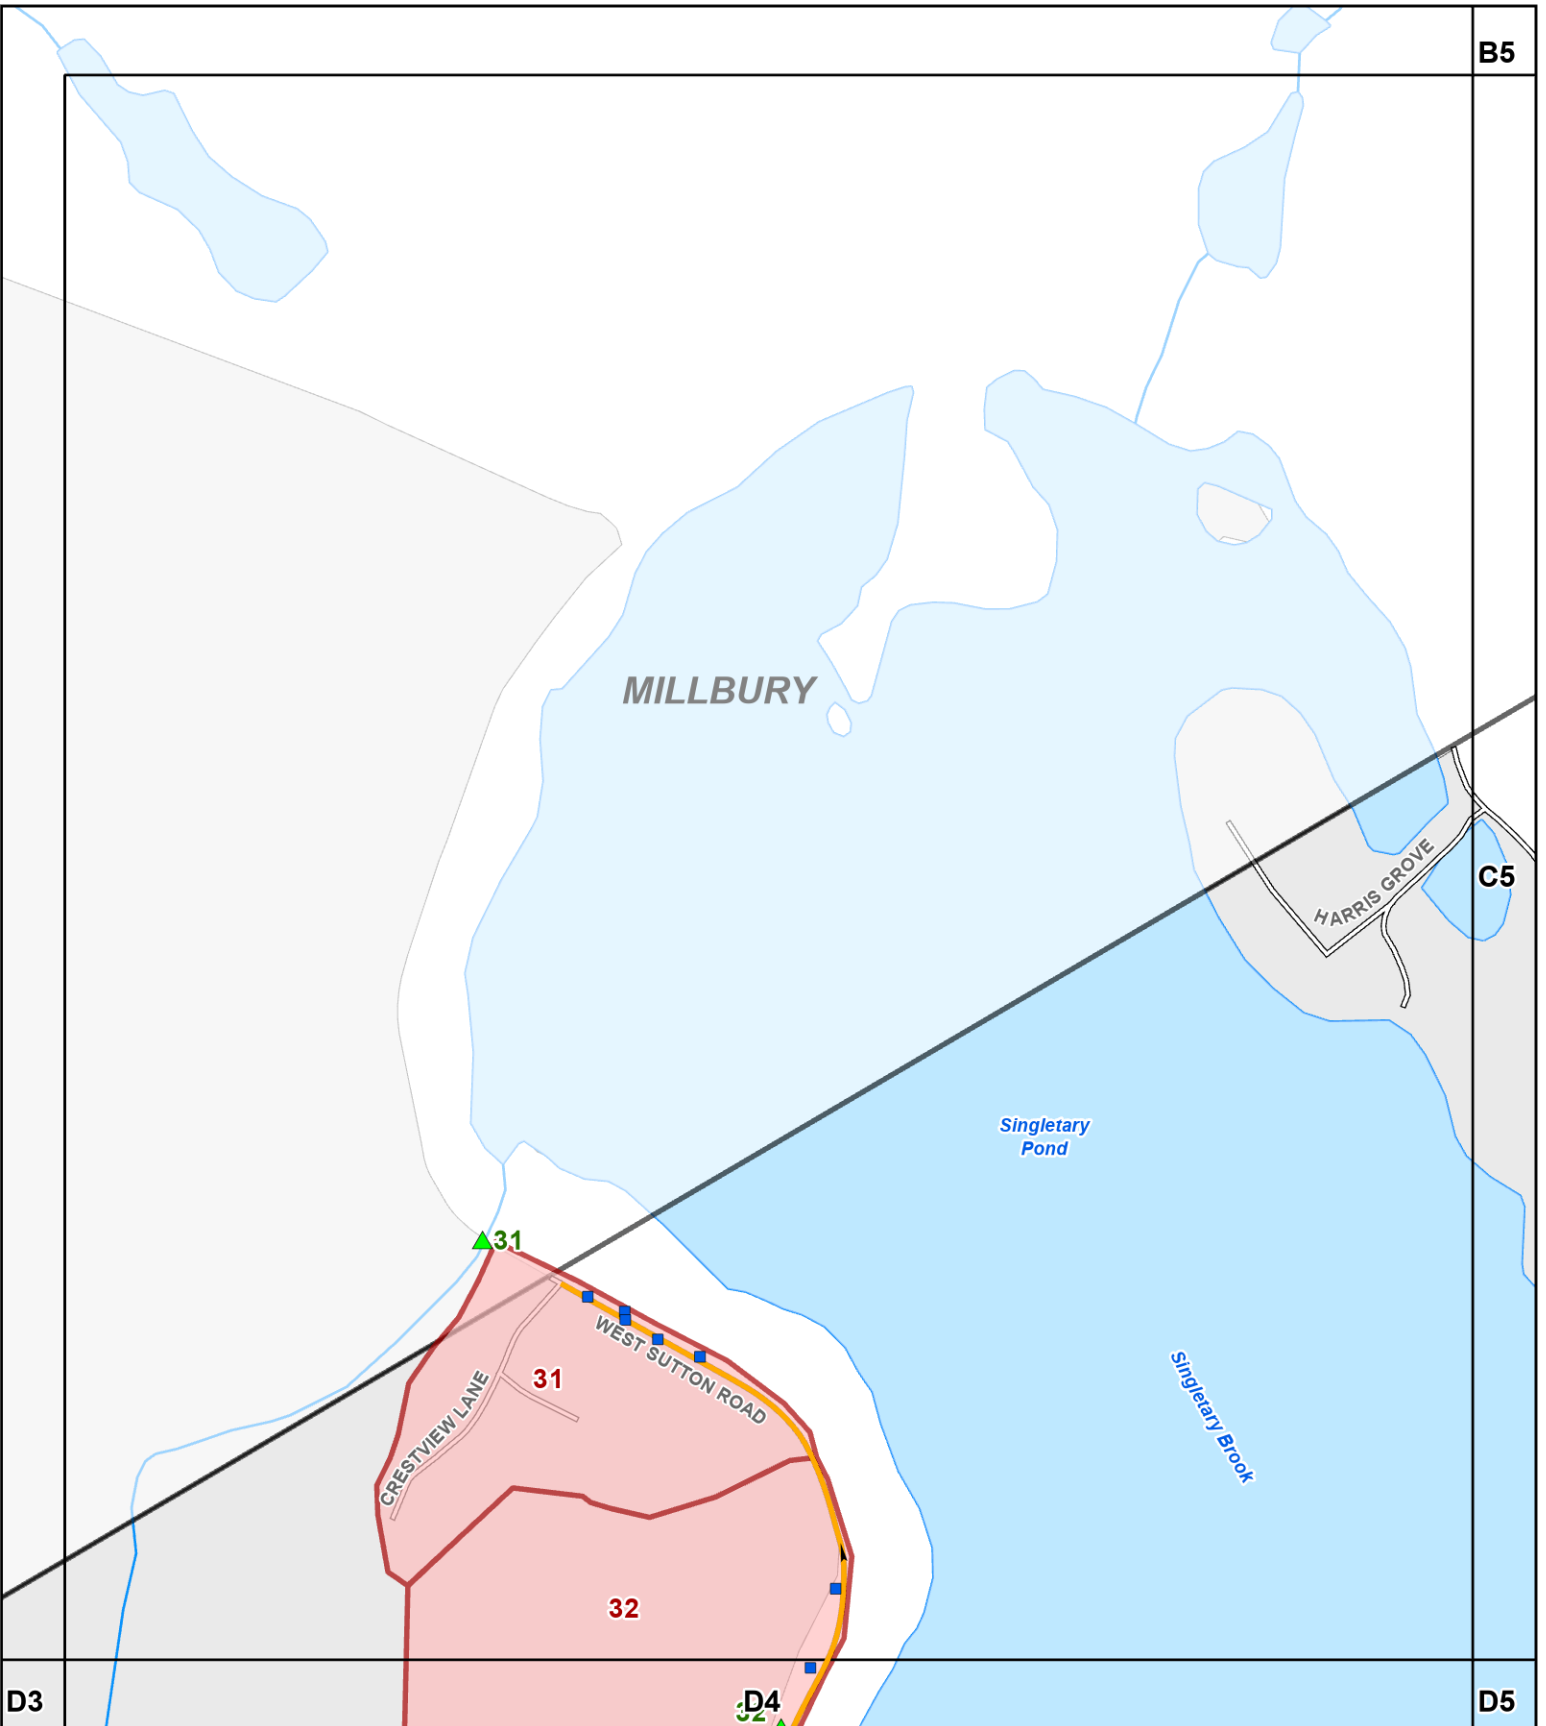

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







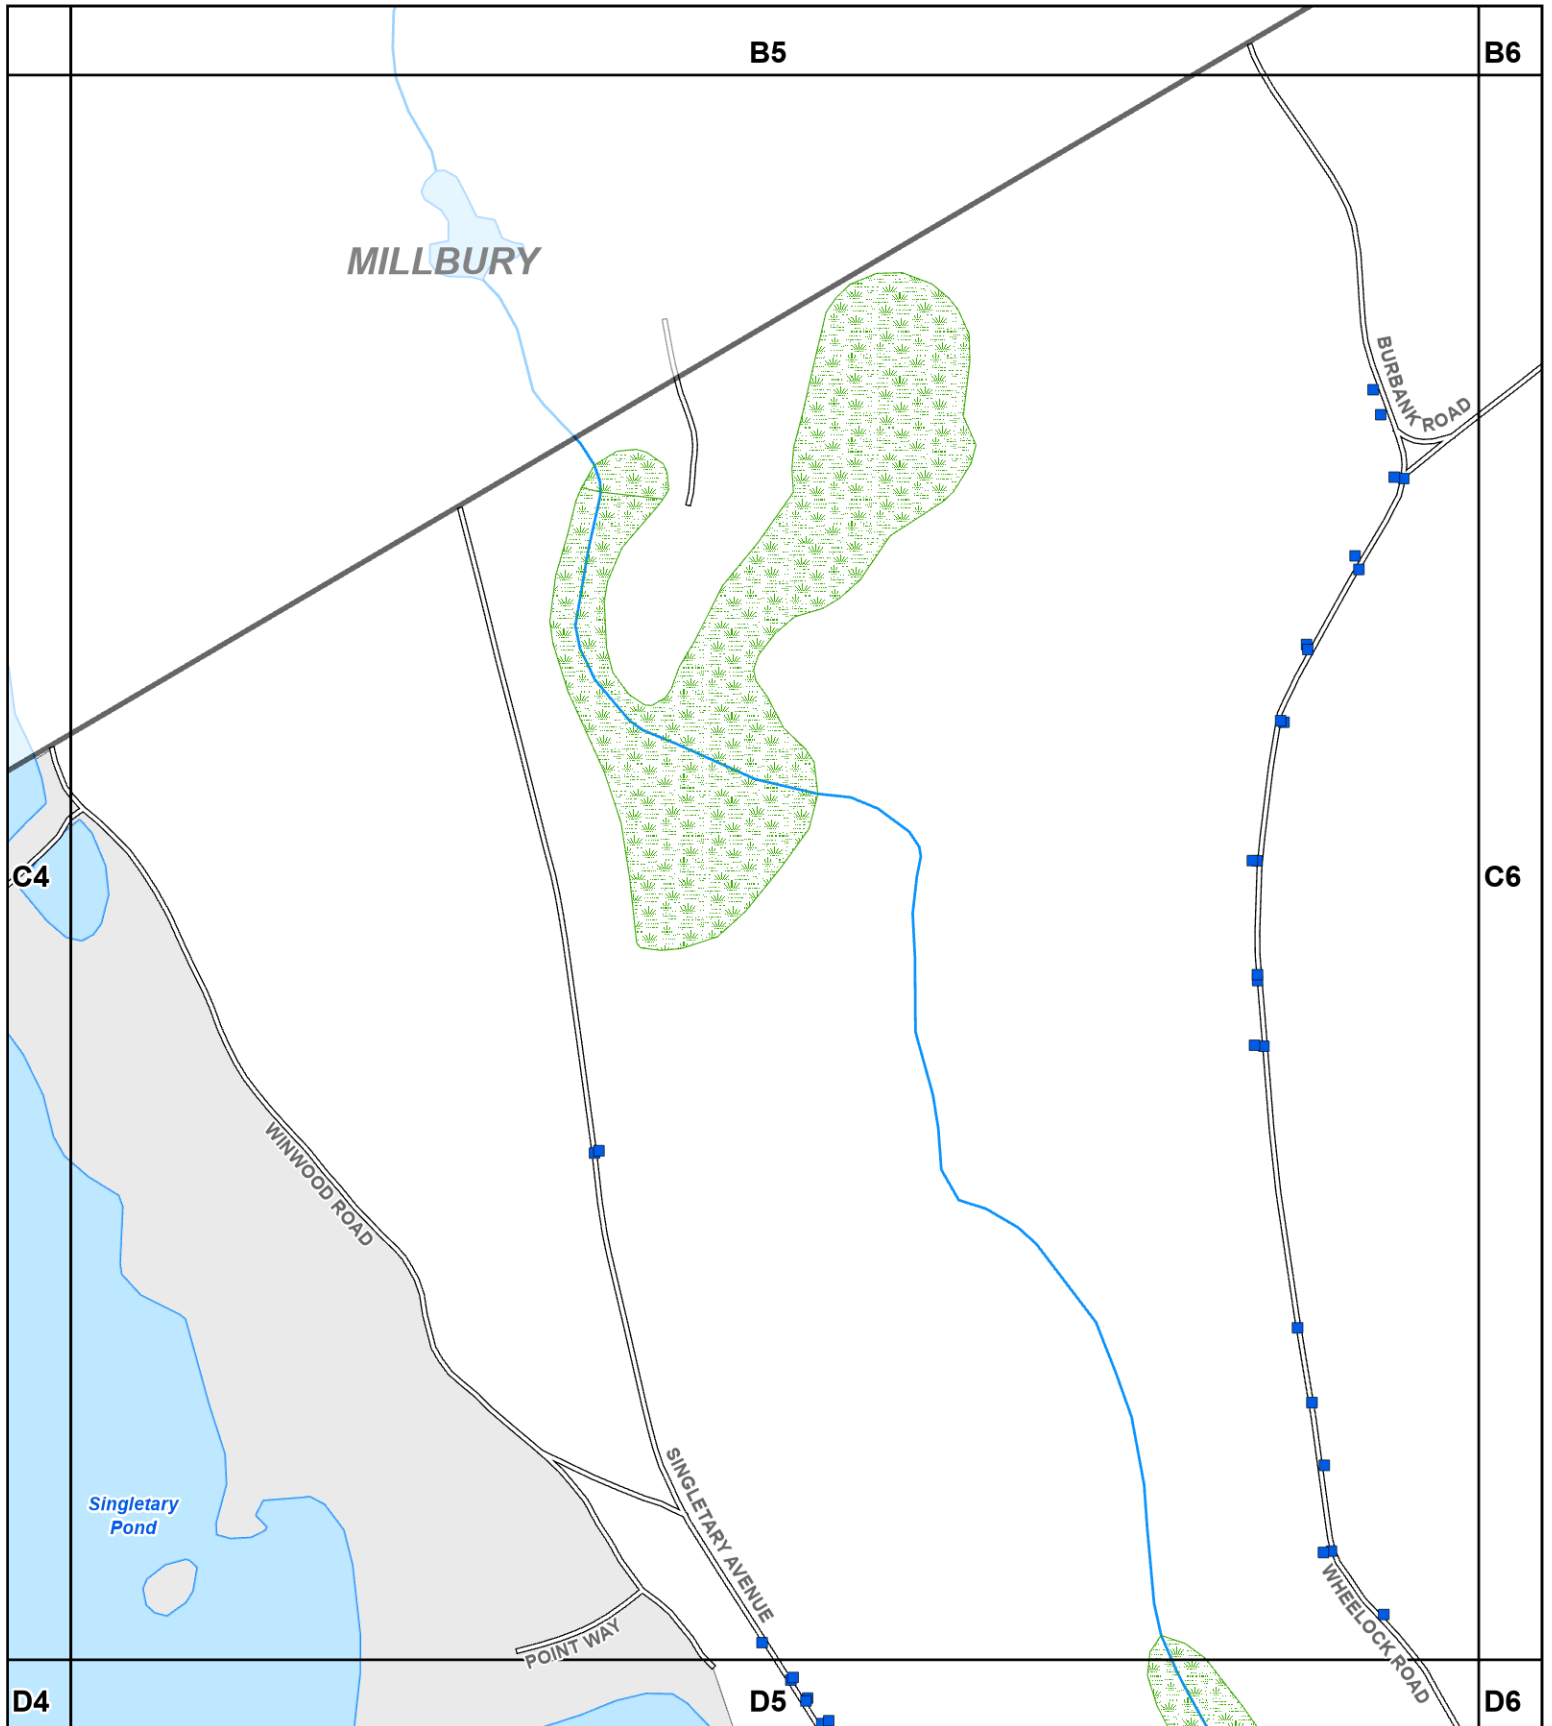


C4



**Comprehensive
Environmental
Incorporated**



Legend

- | | | | |
|---|------------------|---|-----------------------|
|  | Outfall |  | Lake, Pond, Reservoir |
|  | Catch Basin |  | Wetland, Marsh, Swamp |
|  | Sewer Force Main |  | Stream, Brook |
|  | Sewer Pipe |  | Non-Urban Area |
|  | Catchments | | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







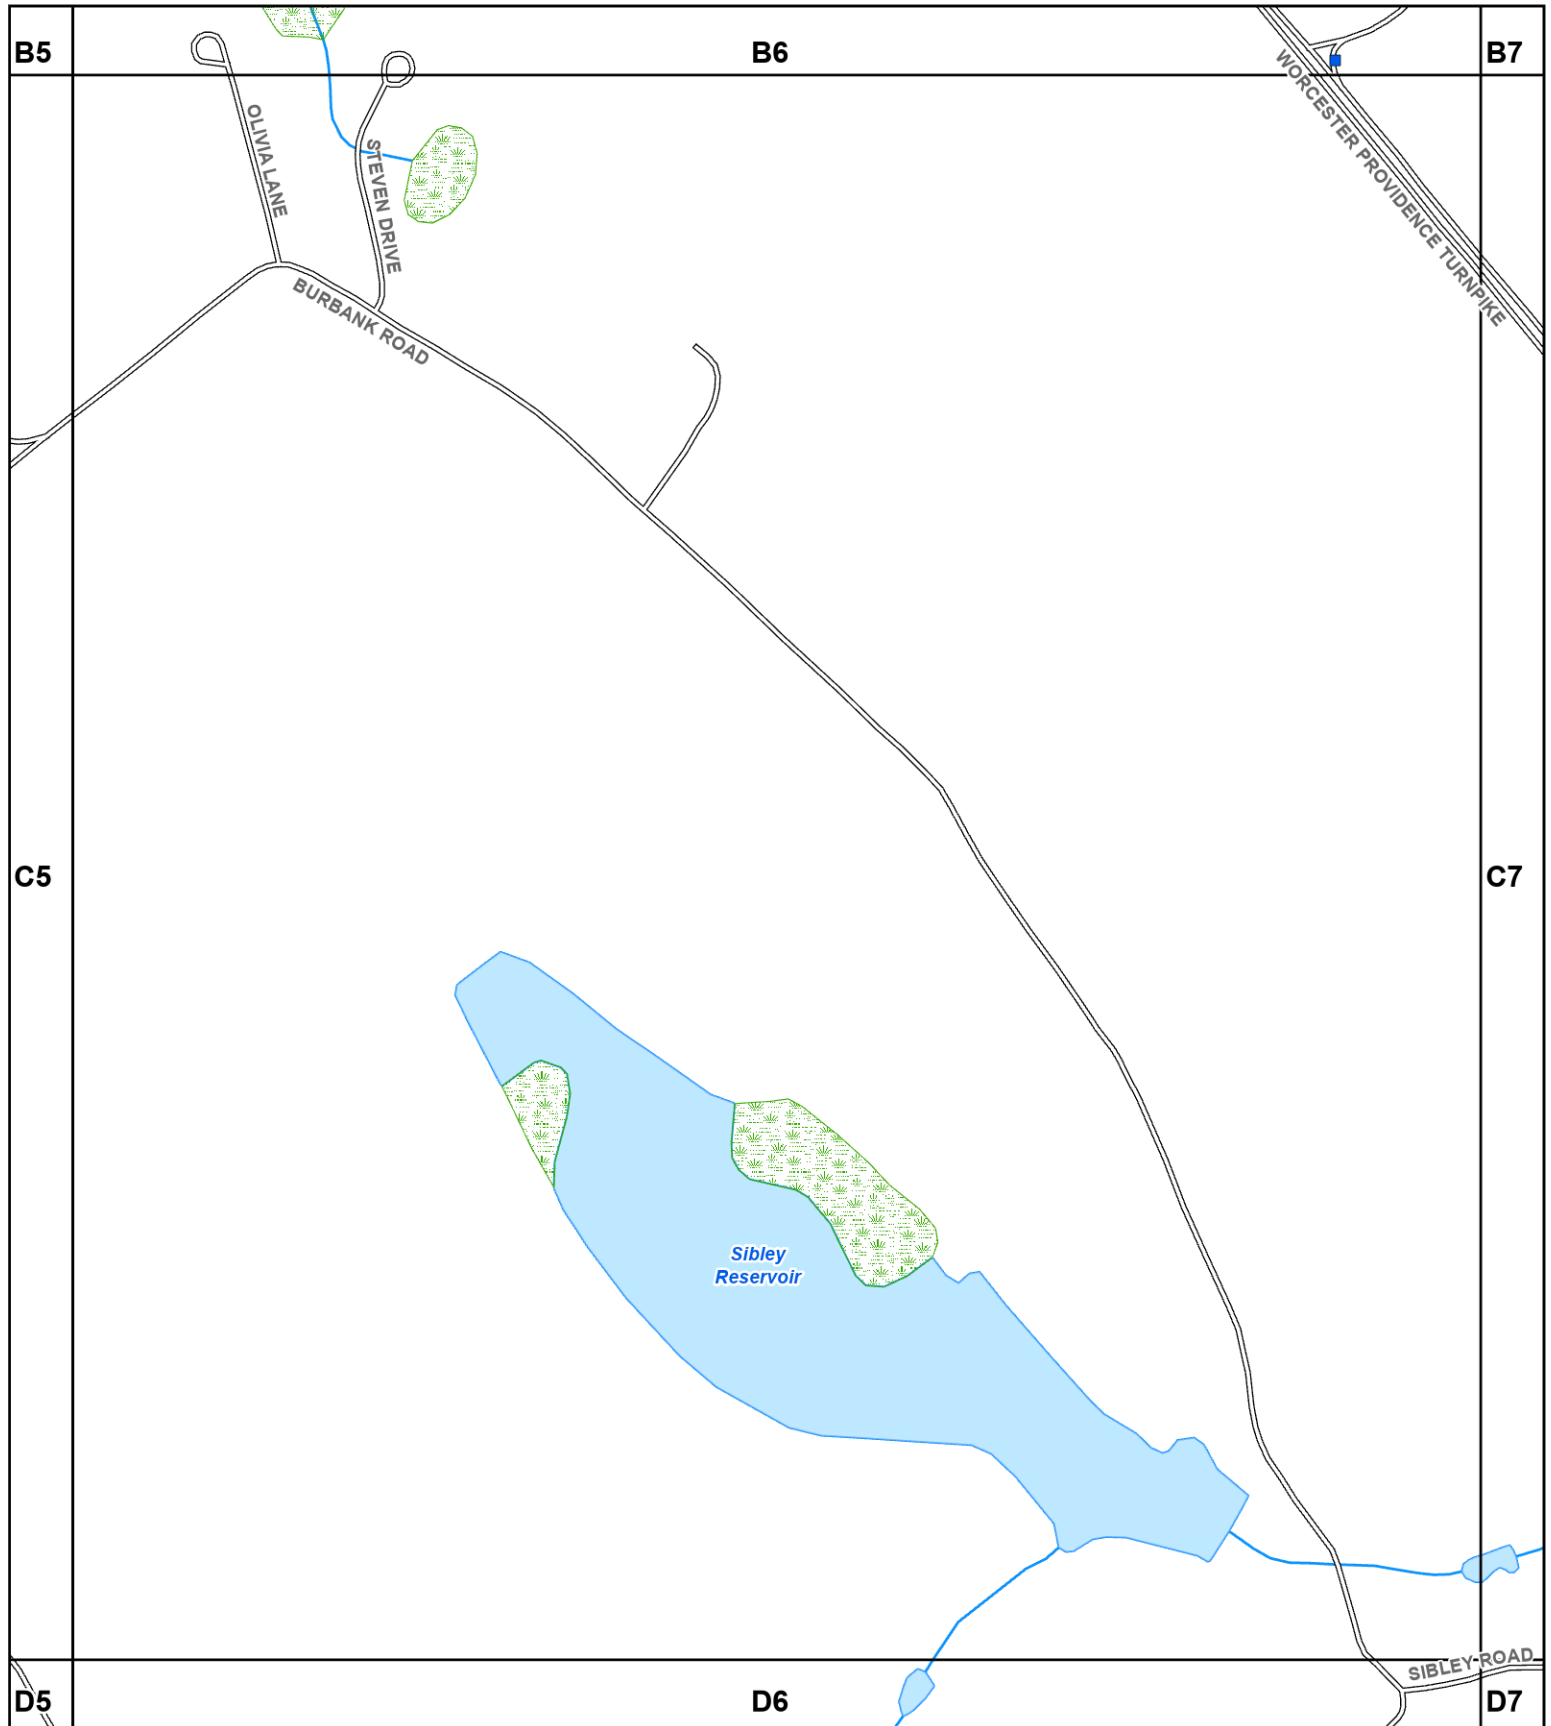


C5




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

C6




**Comprehensive
Environmental
Incorporated**

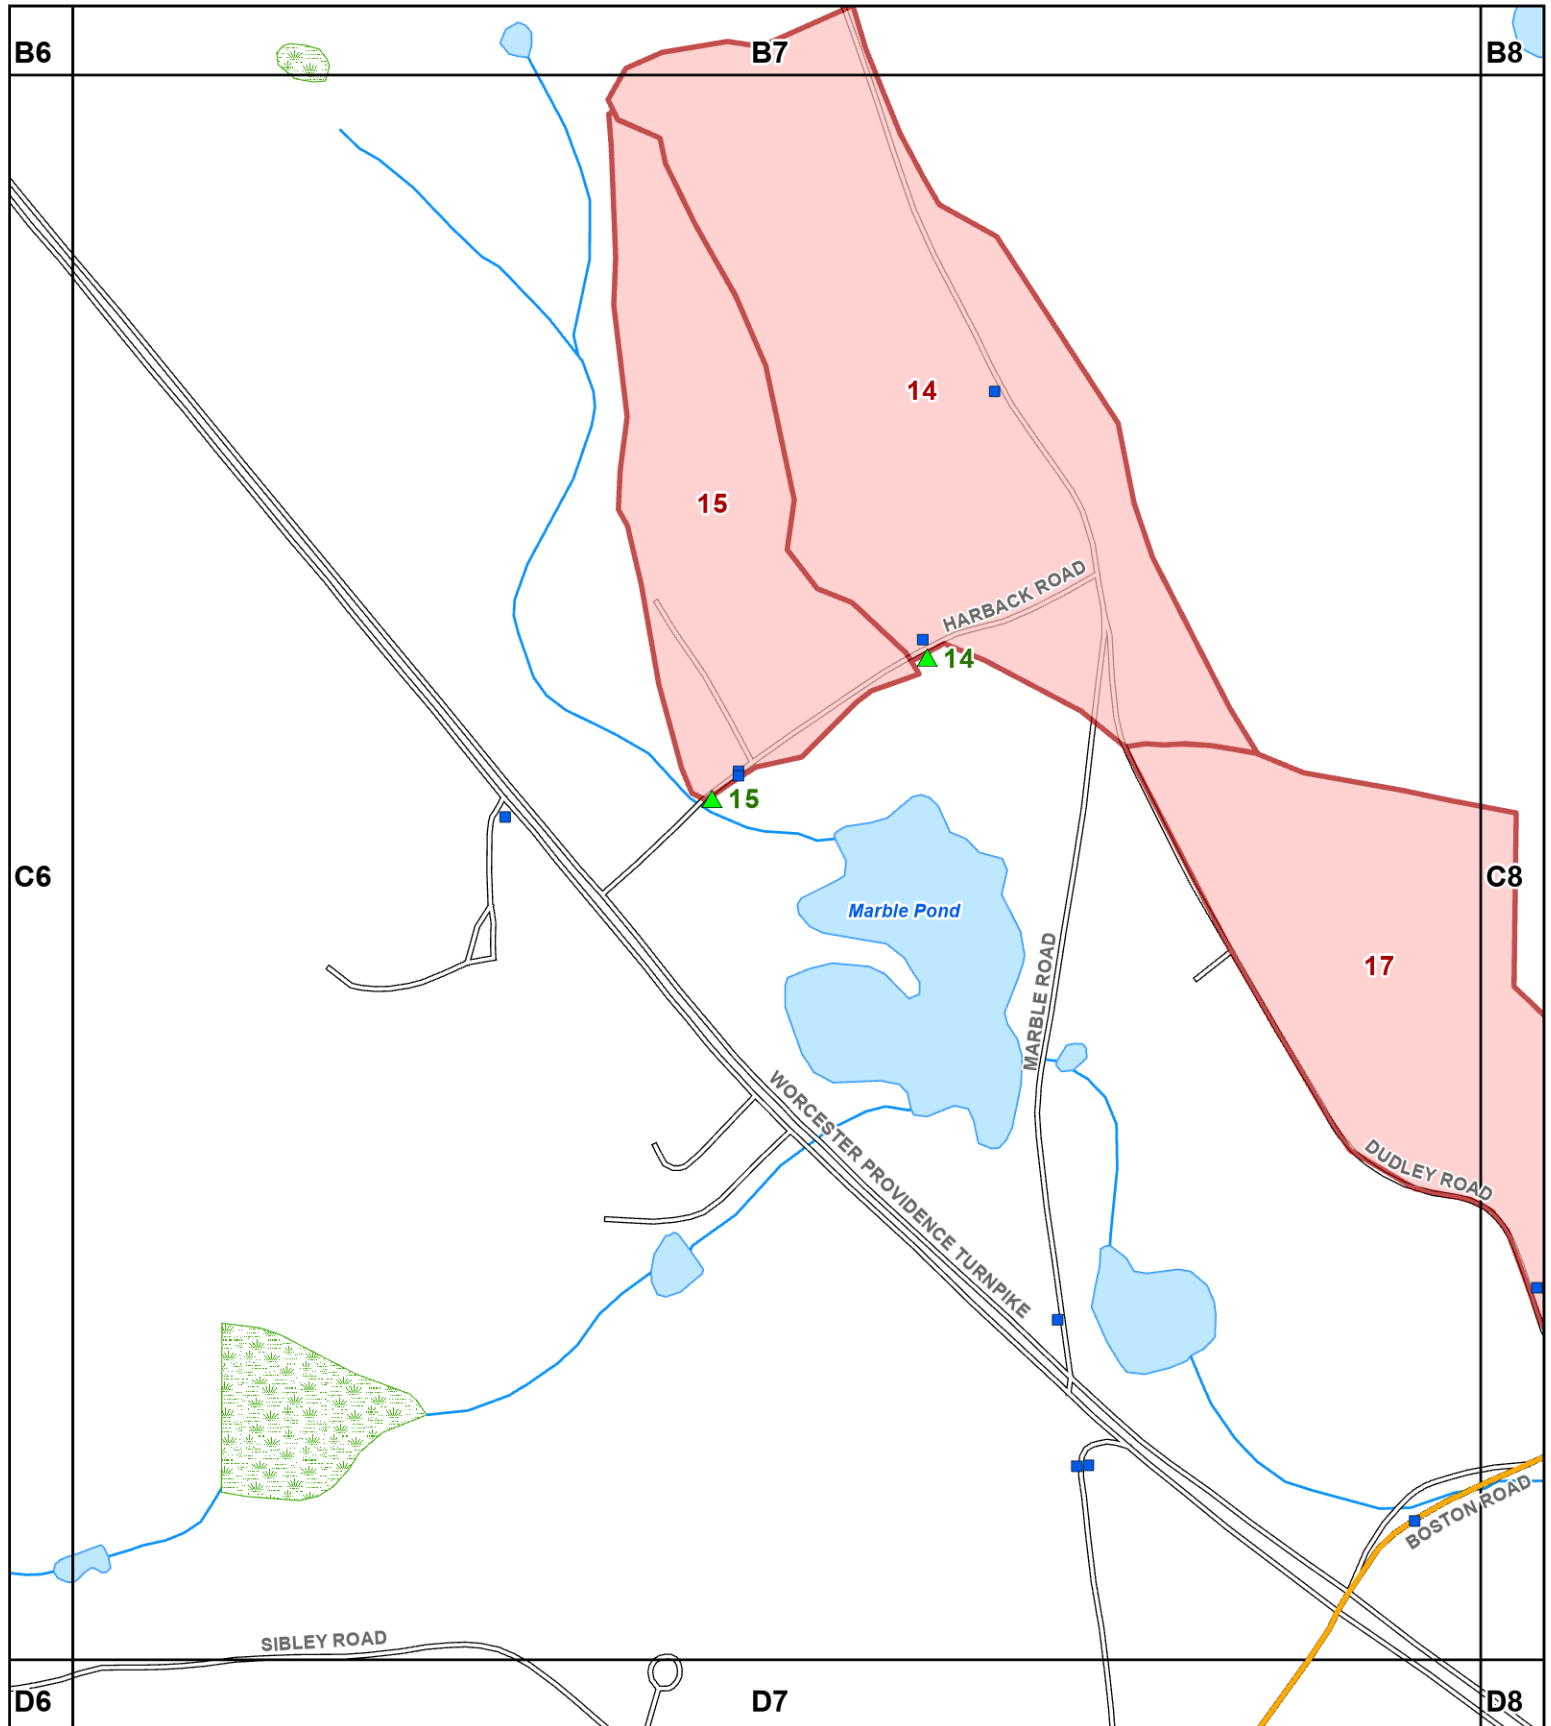

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI



SHEET
C7



Comprehensive
Environmental
Incorporated

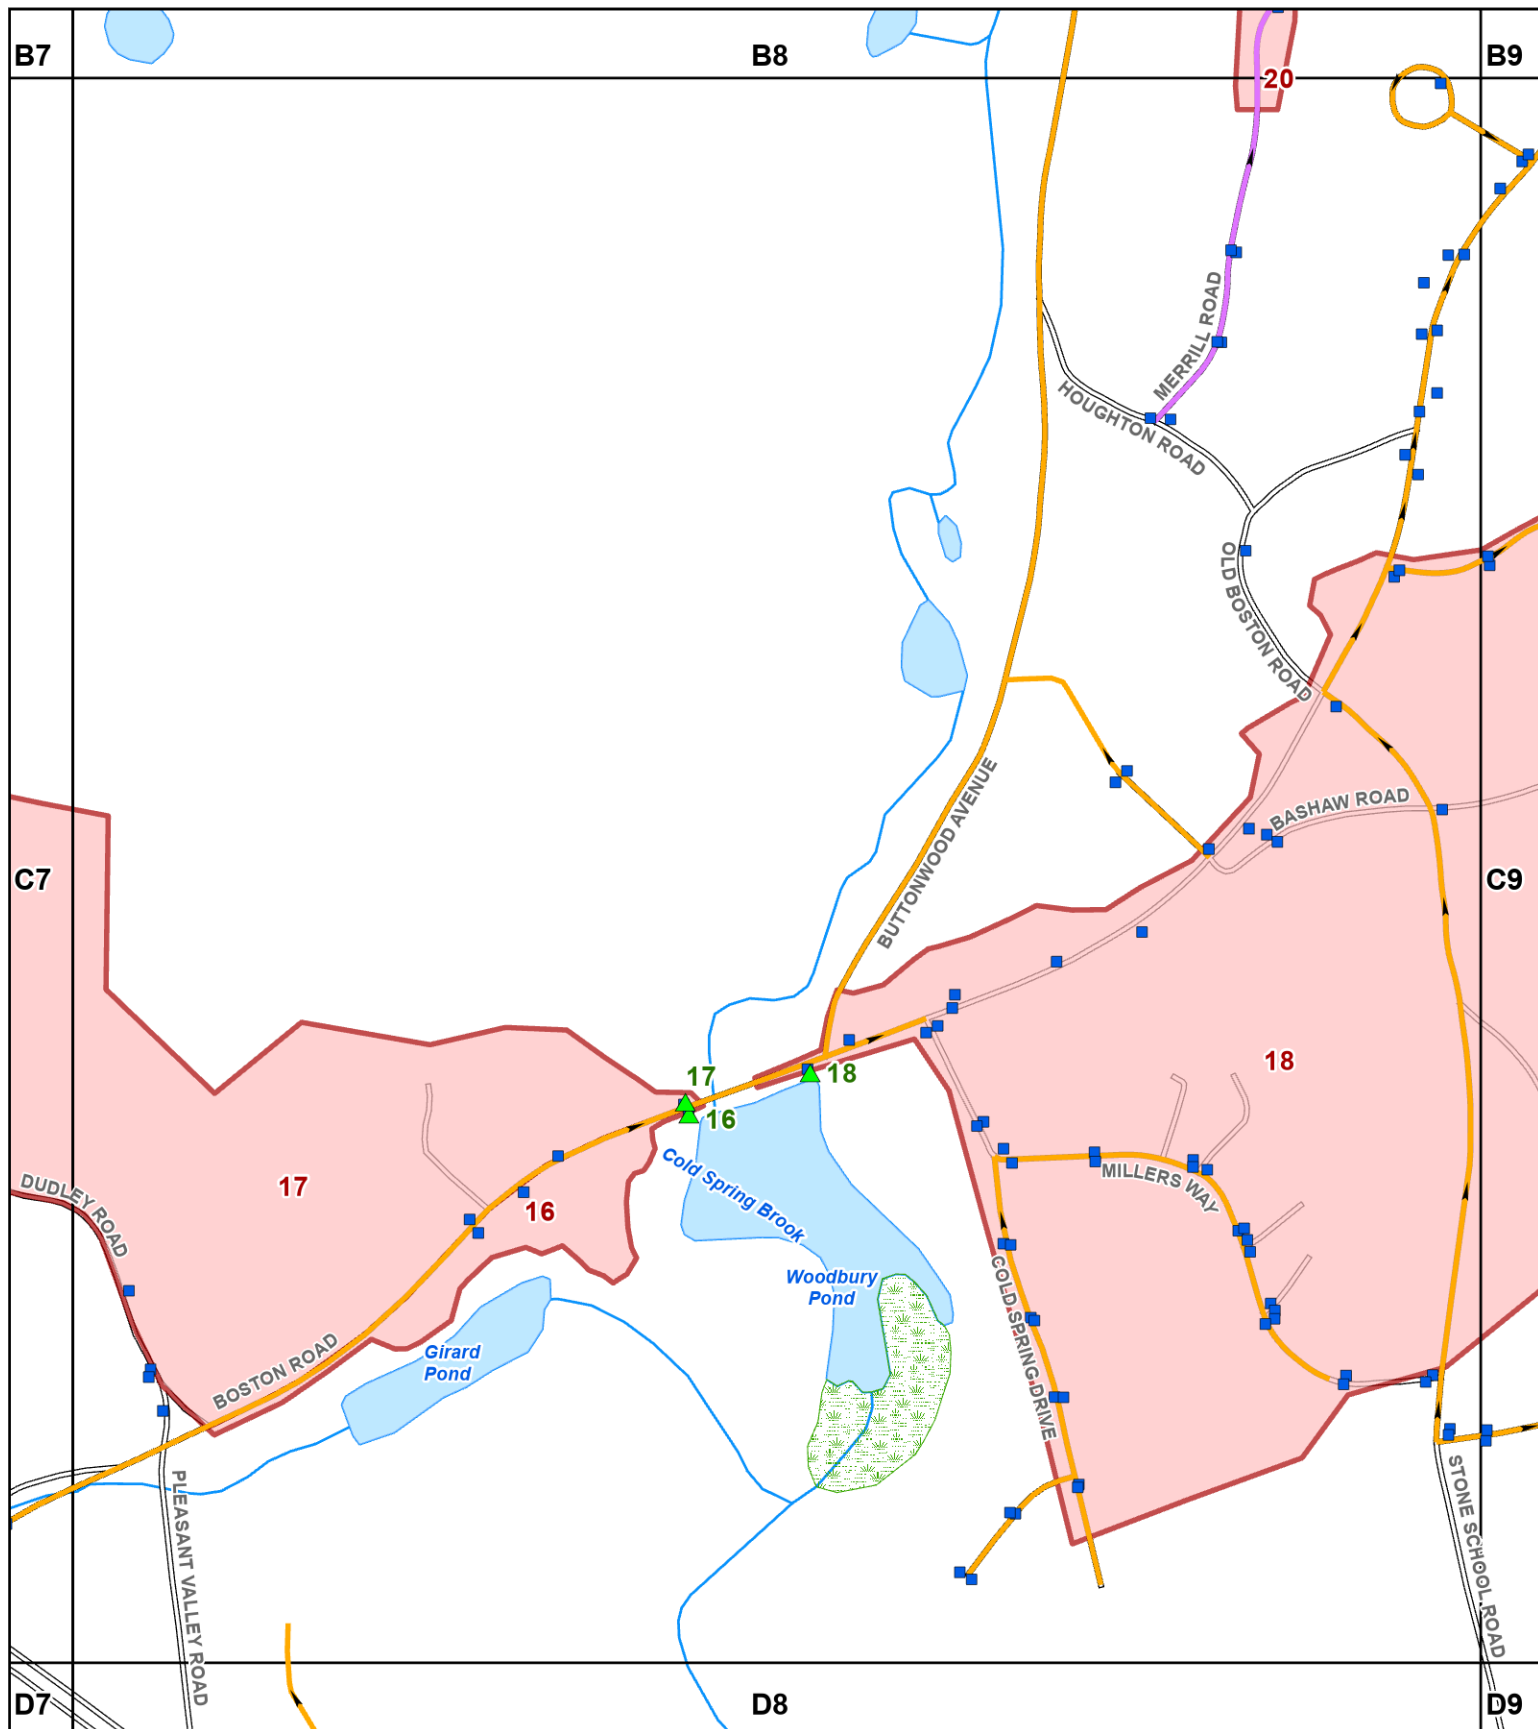

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









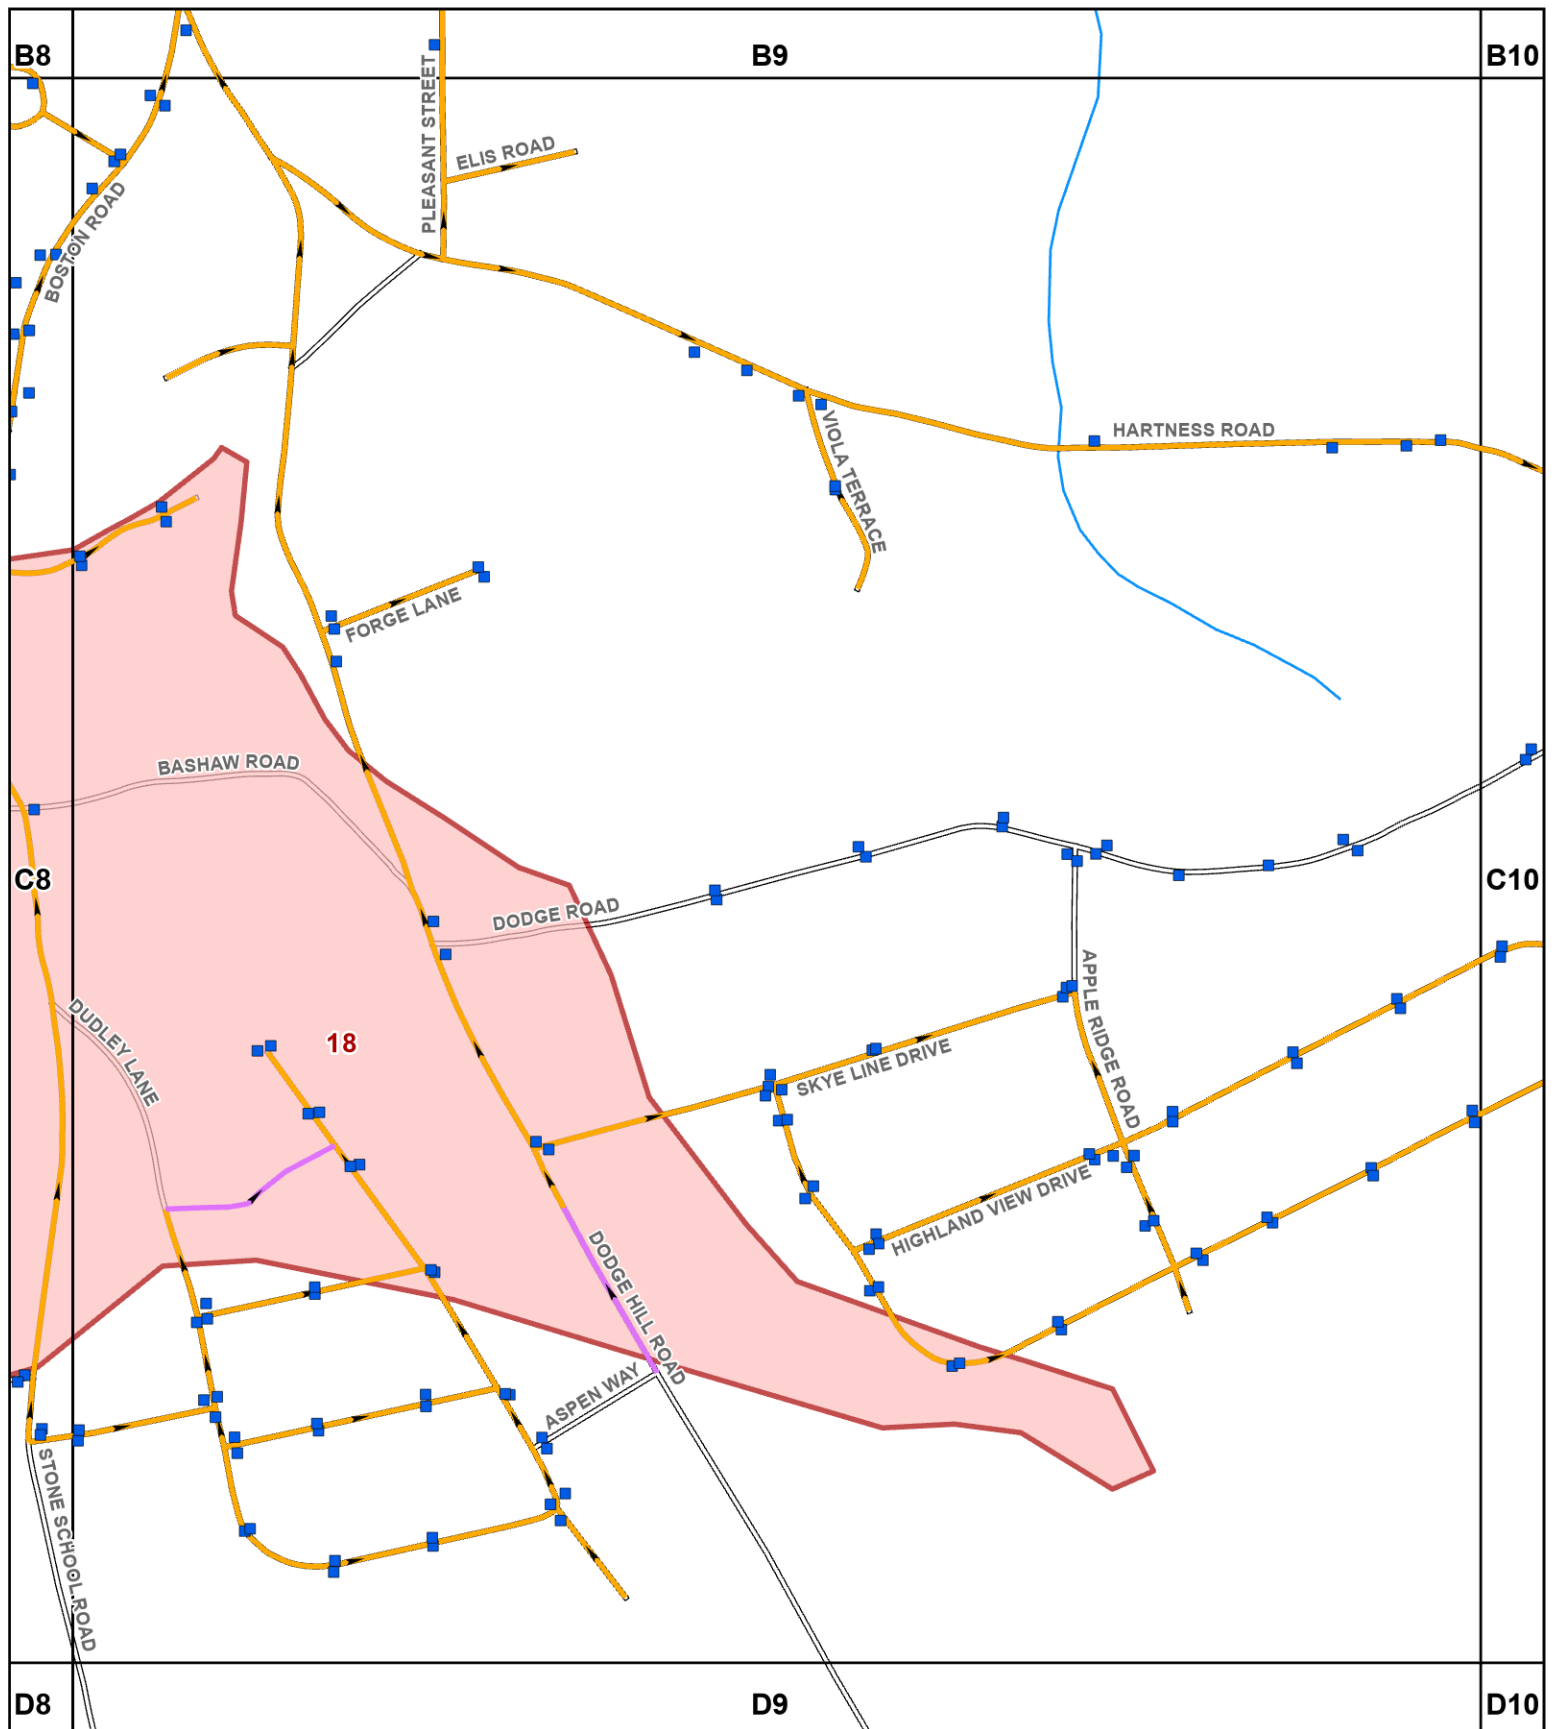


SHEET
C8



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







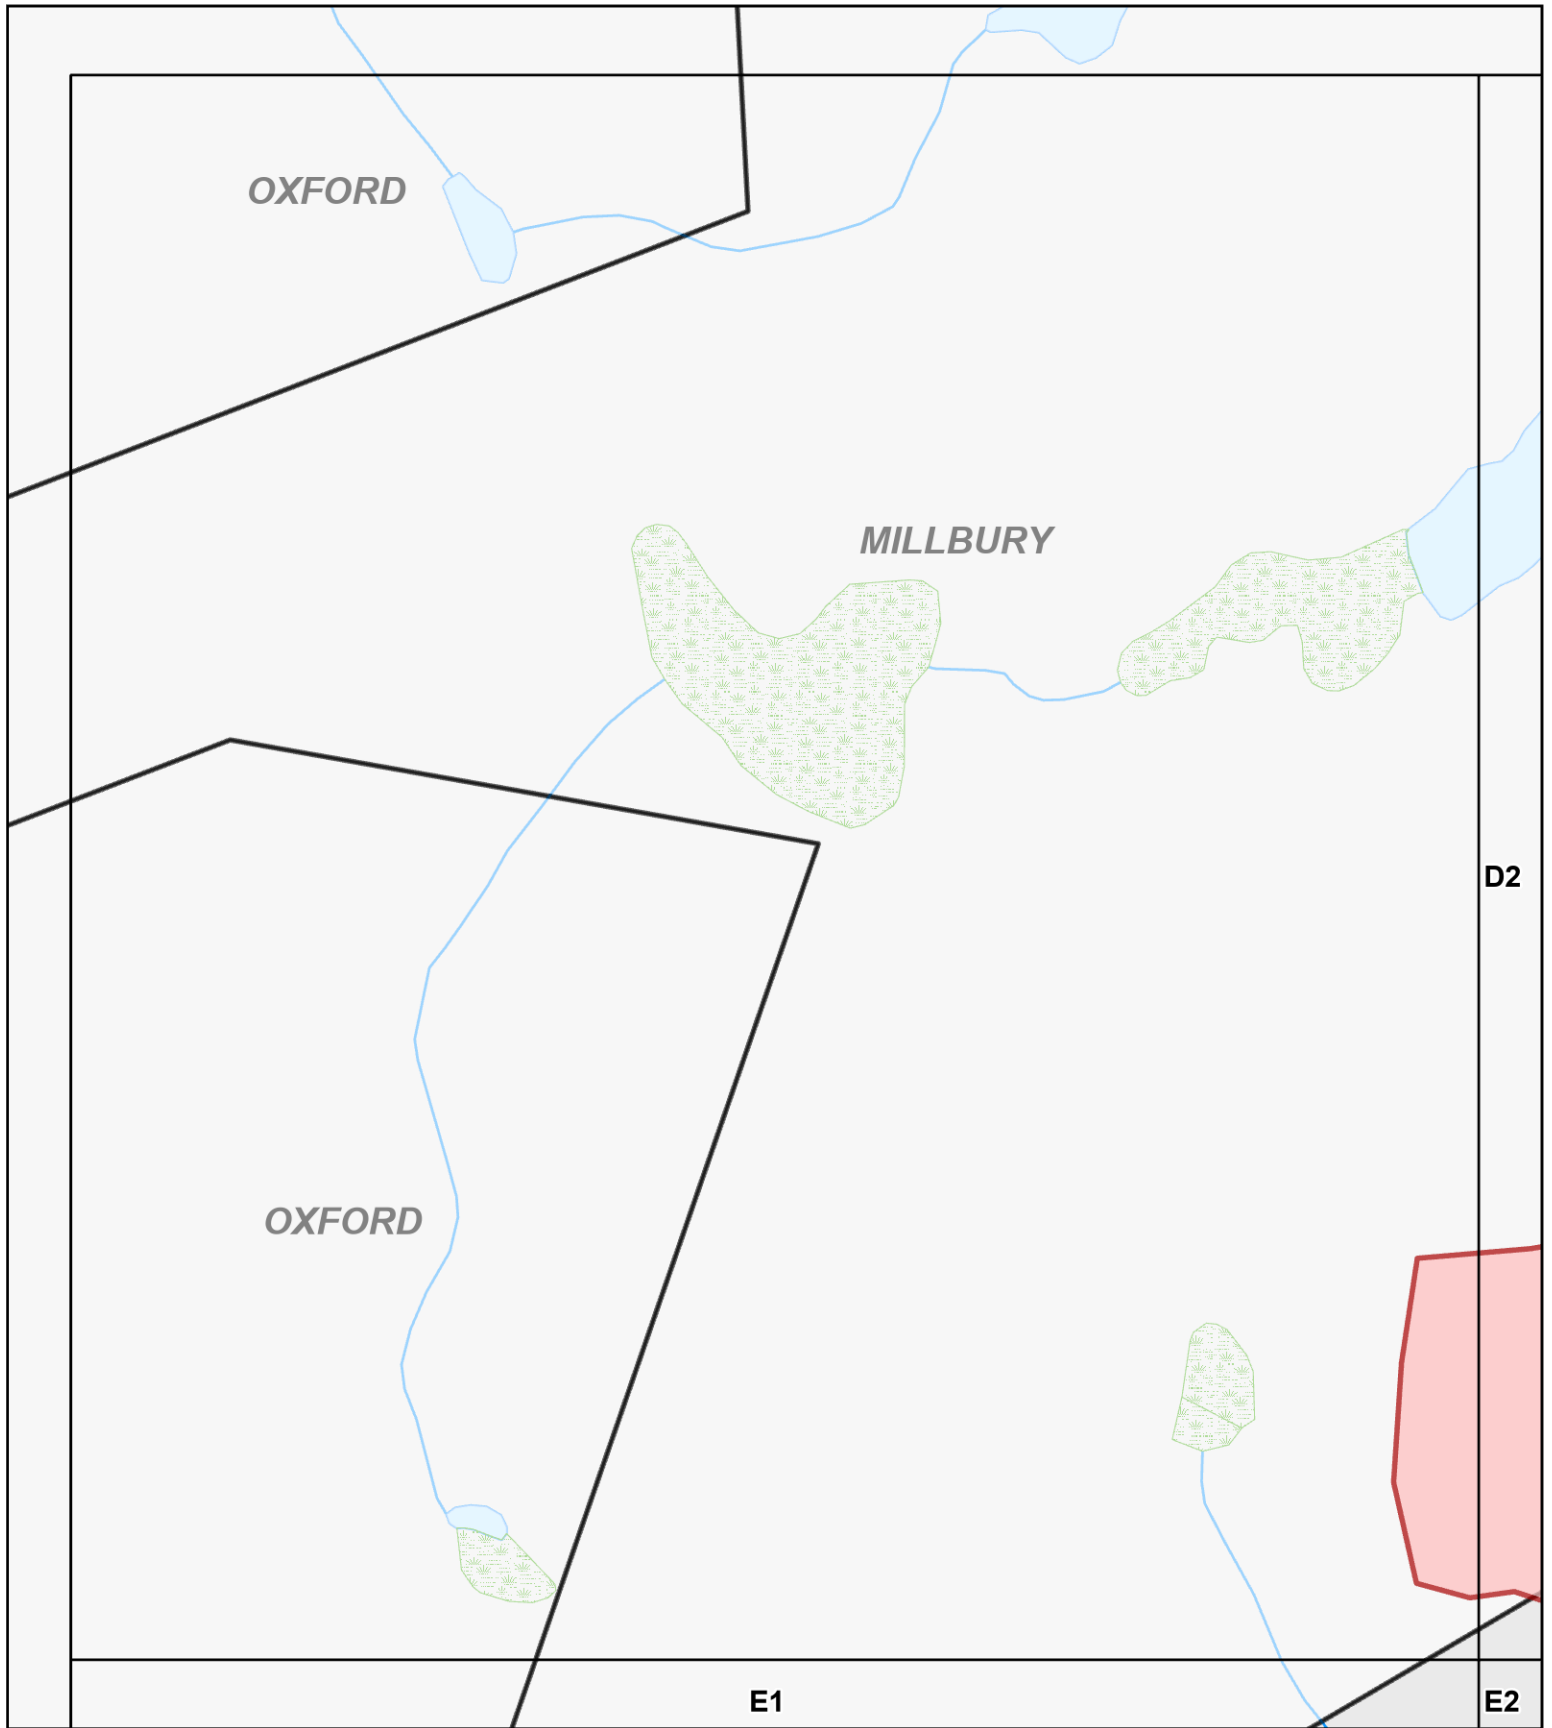


C9



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI









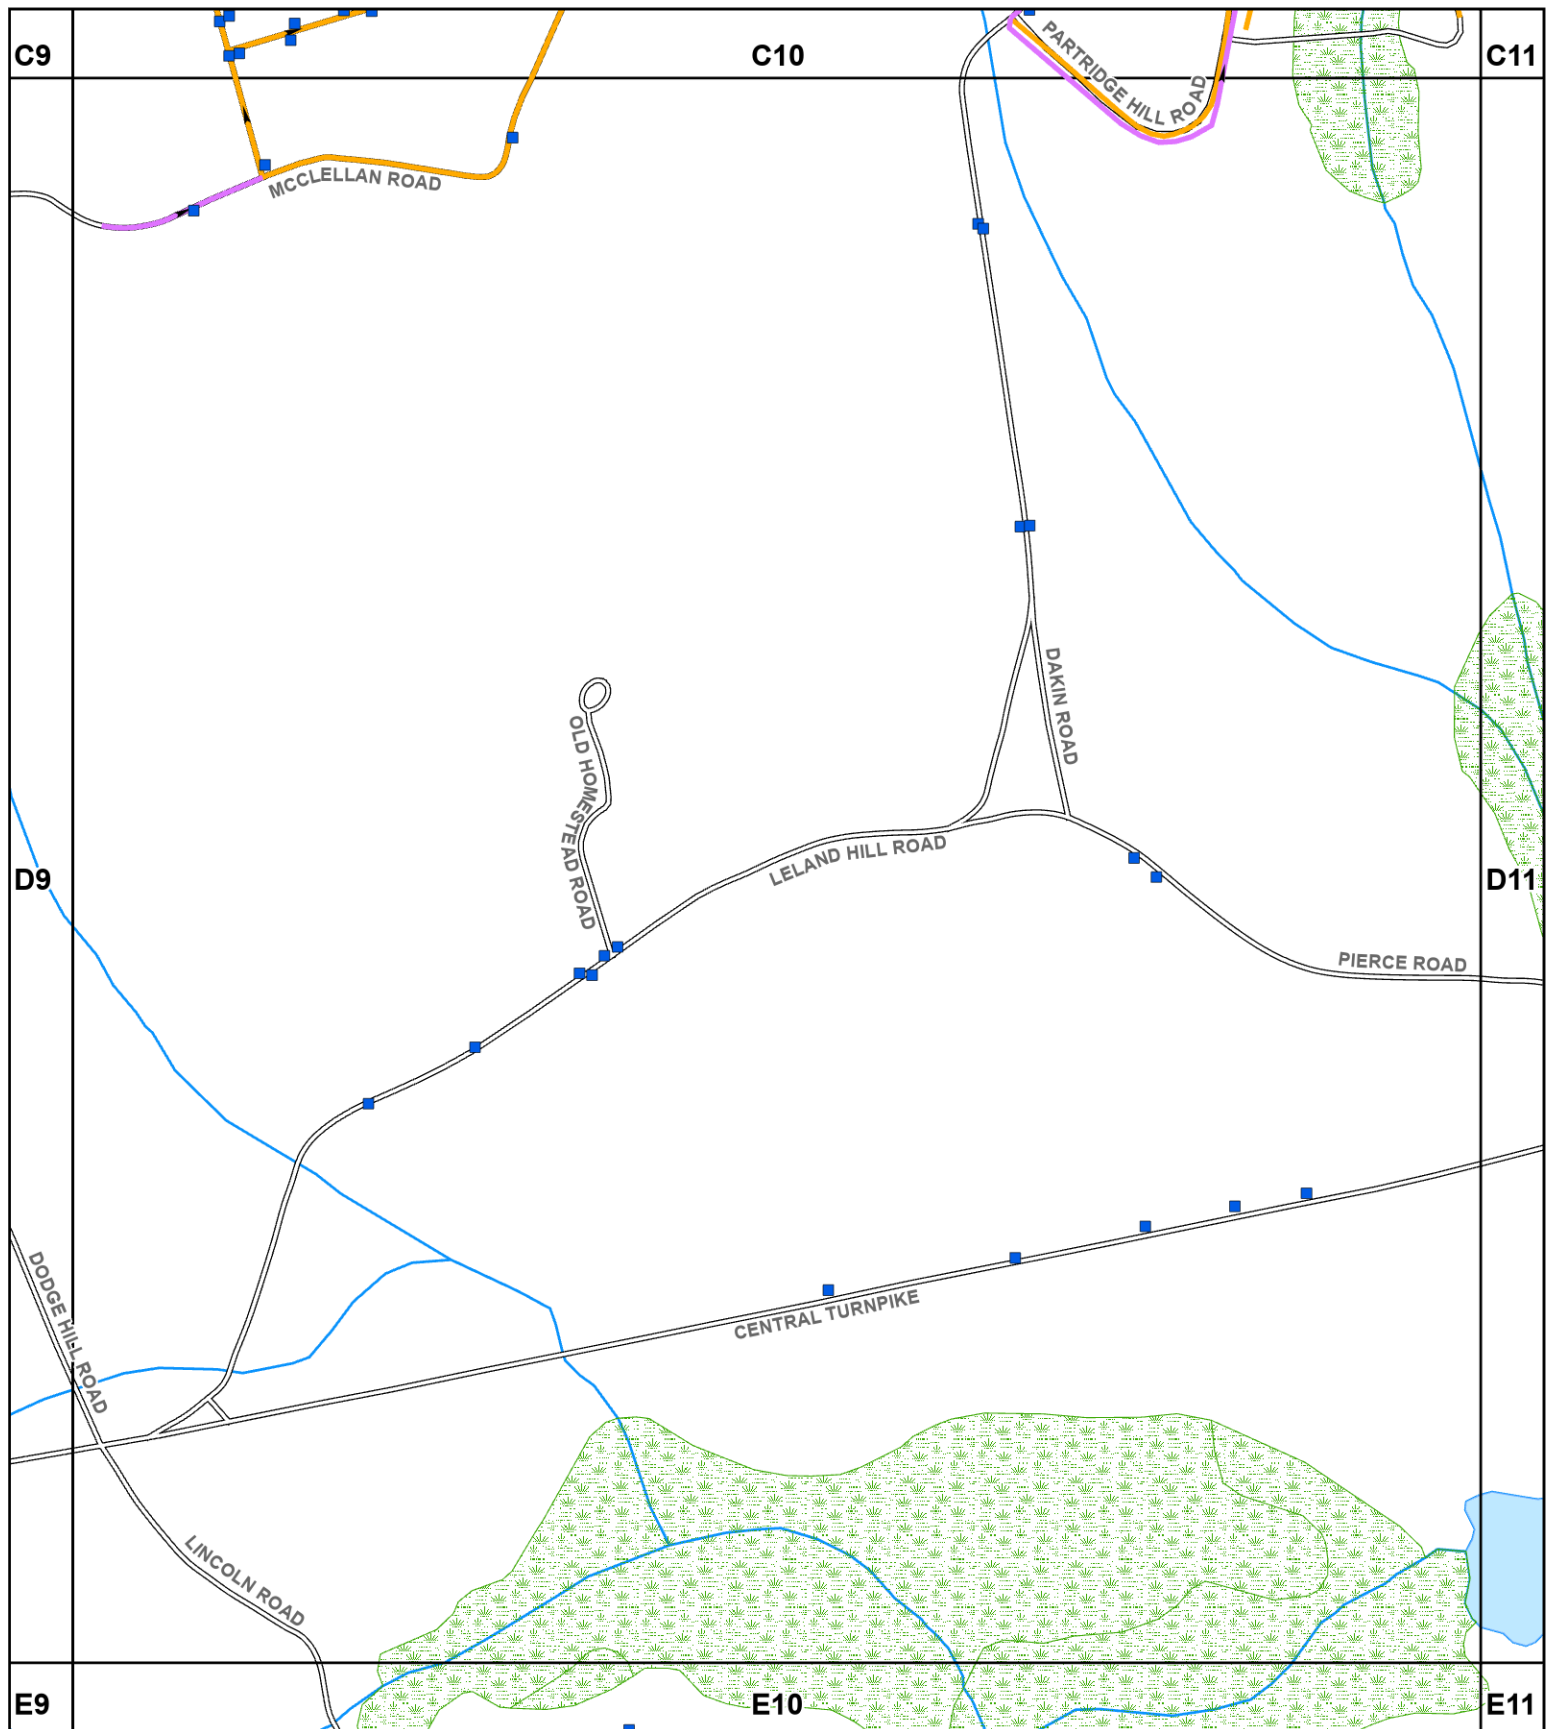


SHEET
D1



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI



SHEET
D10



**Comprehensive
Environmental
Incorporated**

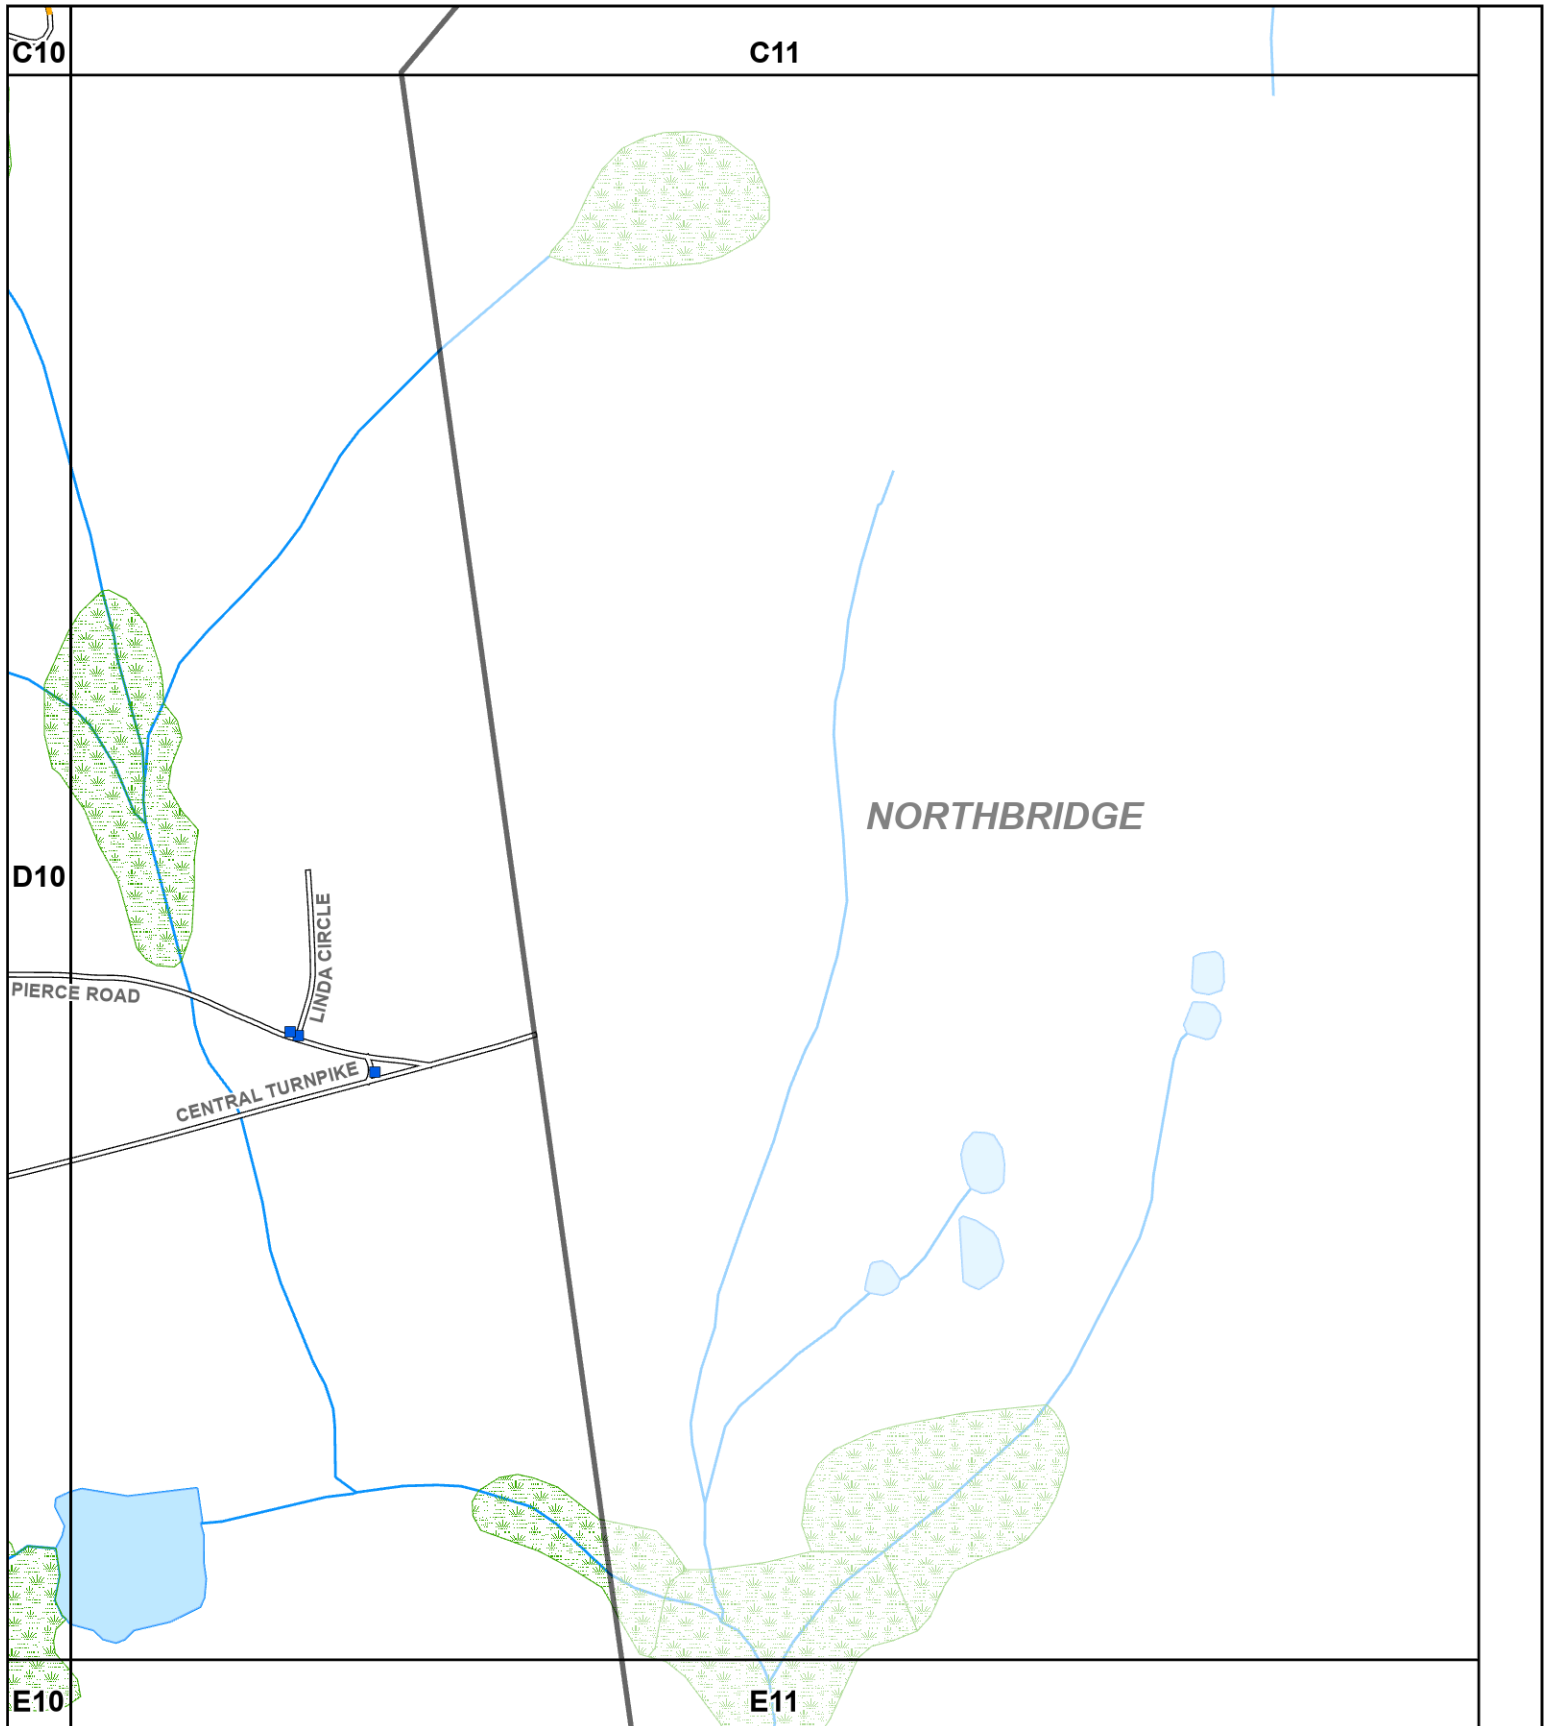

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI





SHEET

D11





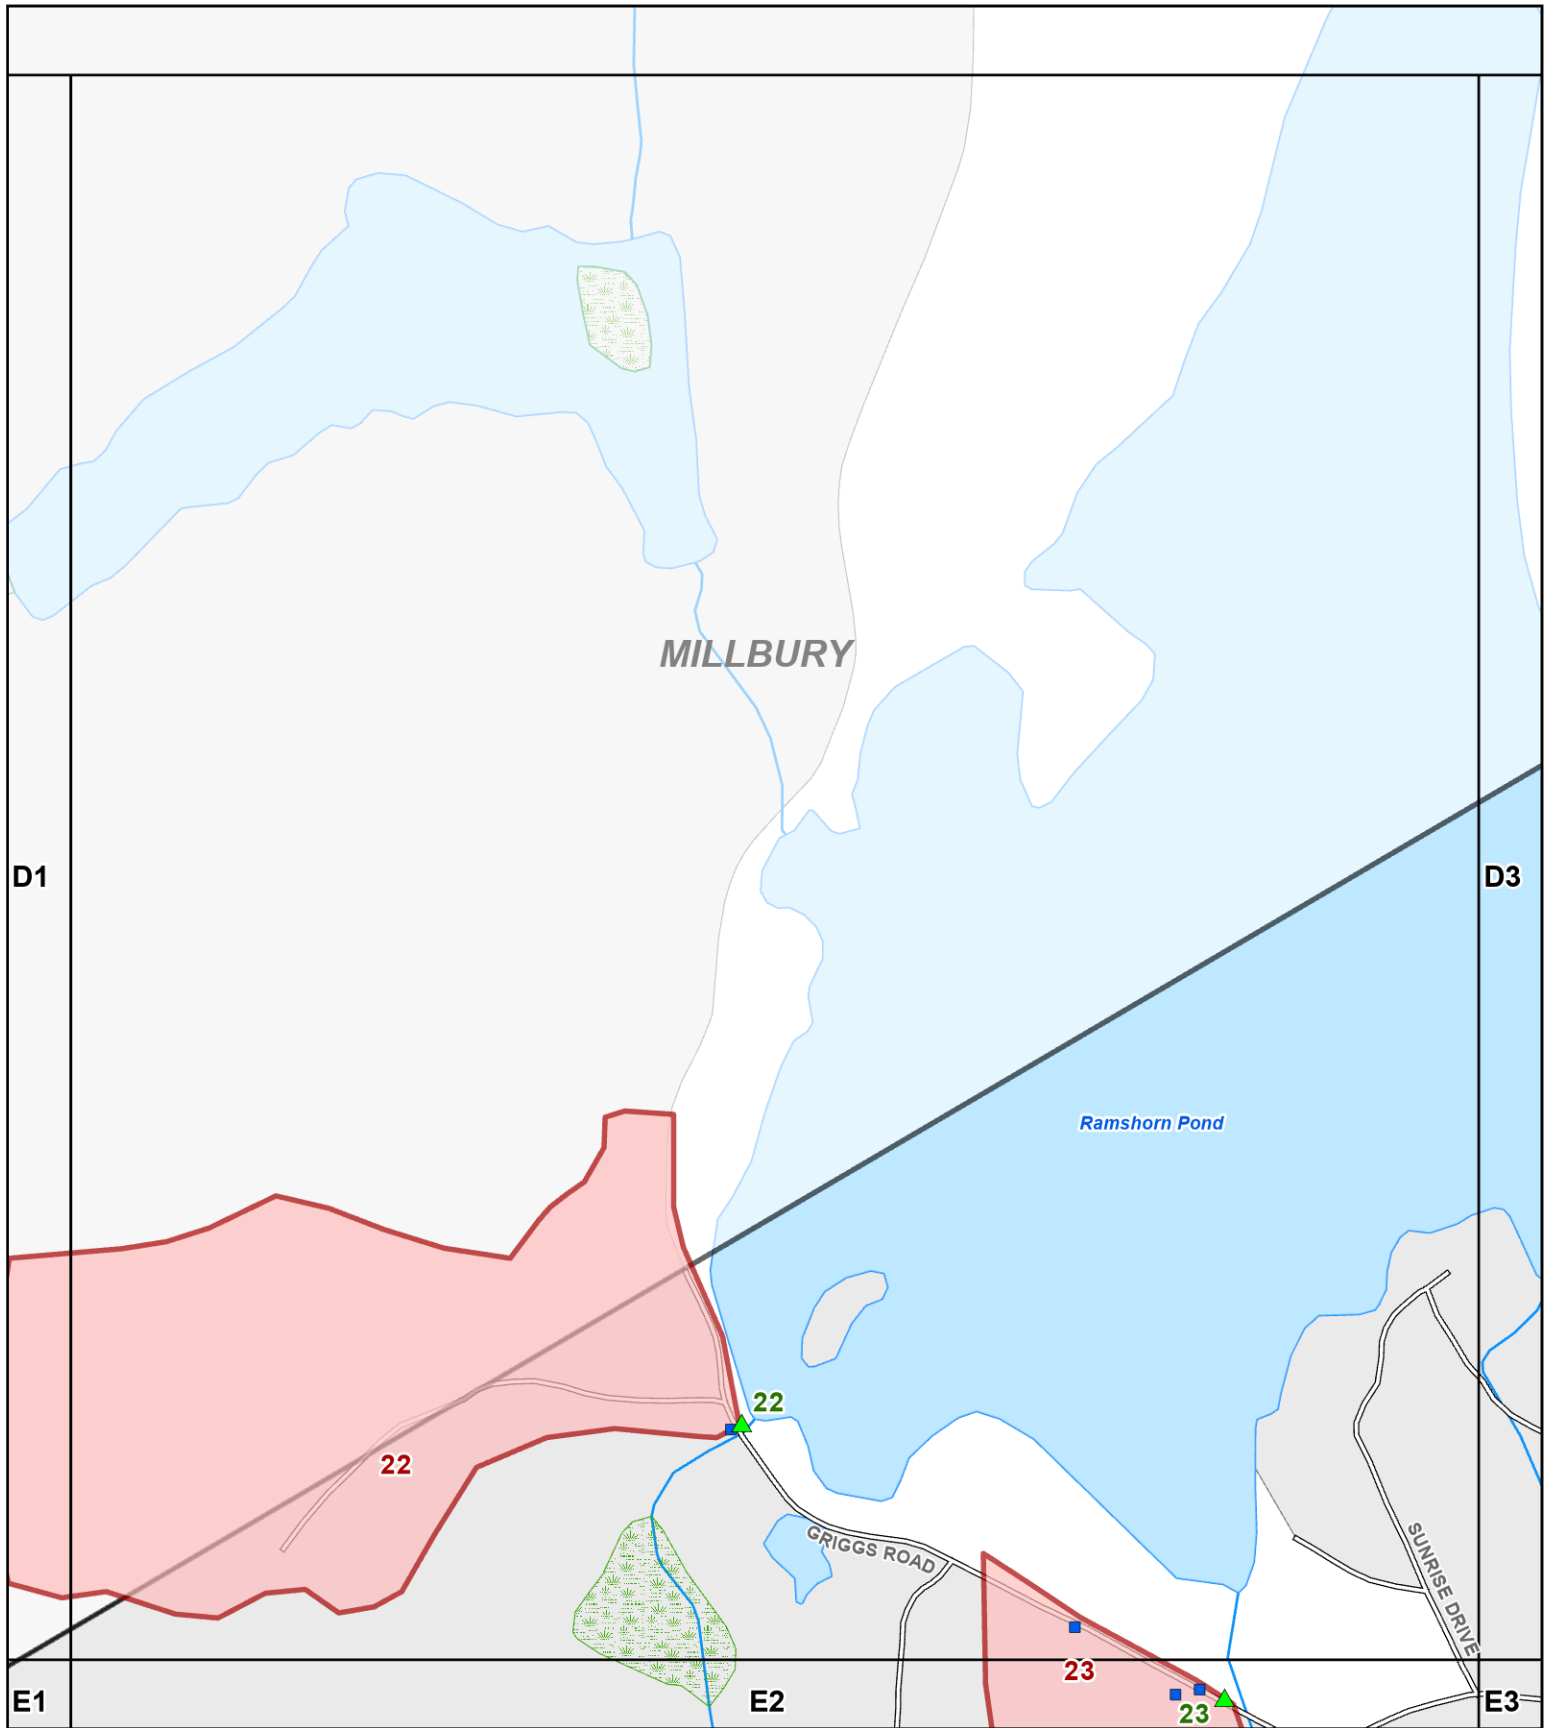

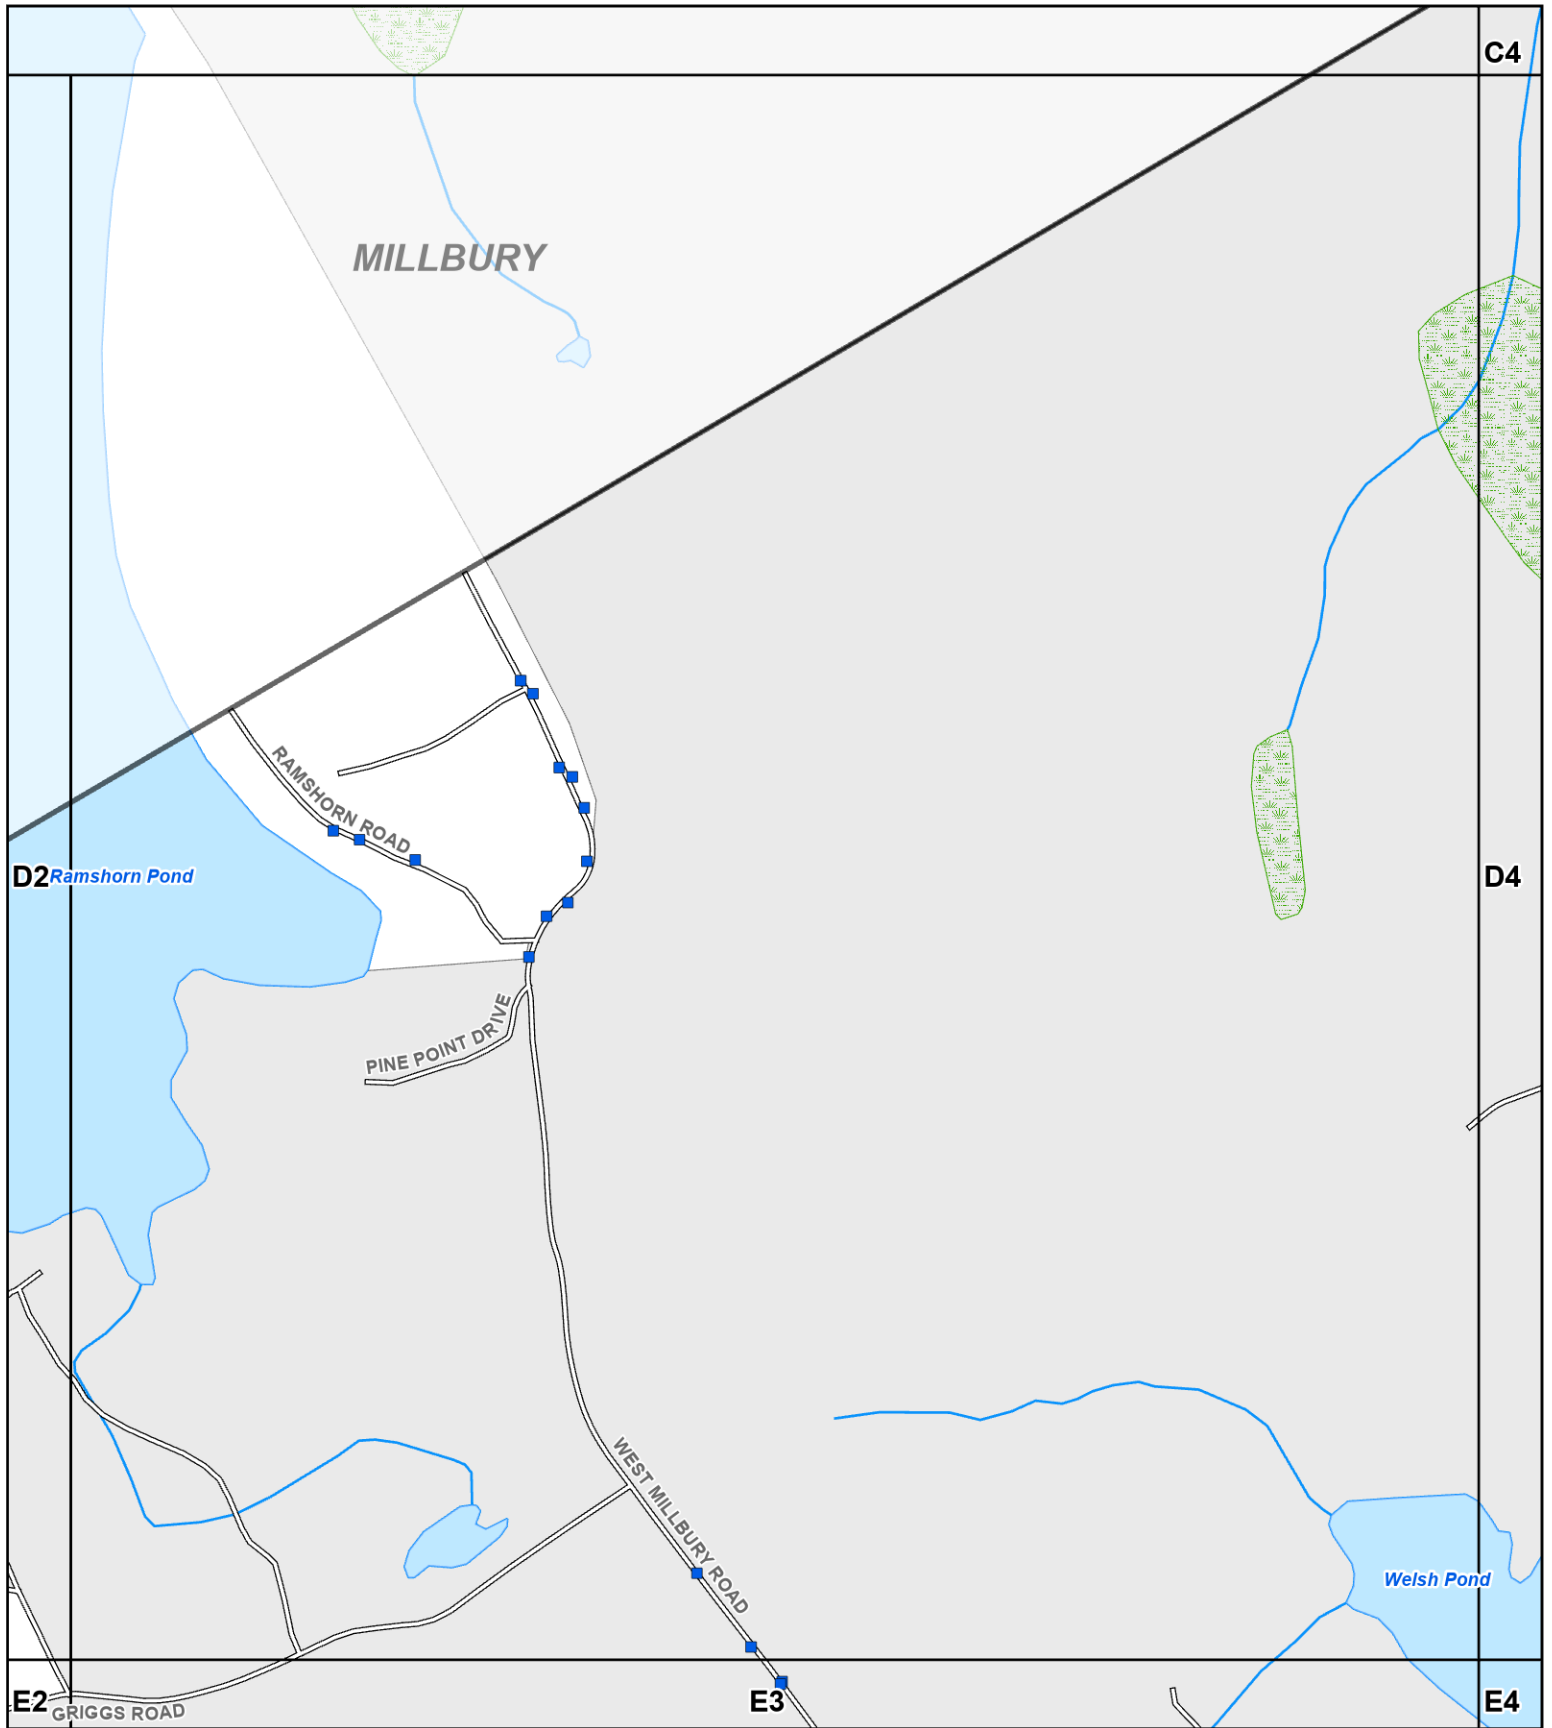




**Comprehensive
Environmental
Incorporated**






Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

D3




**Comprehensive
Environmental
Incorporated**

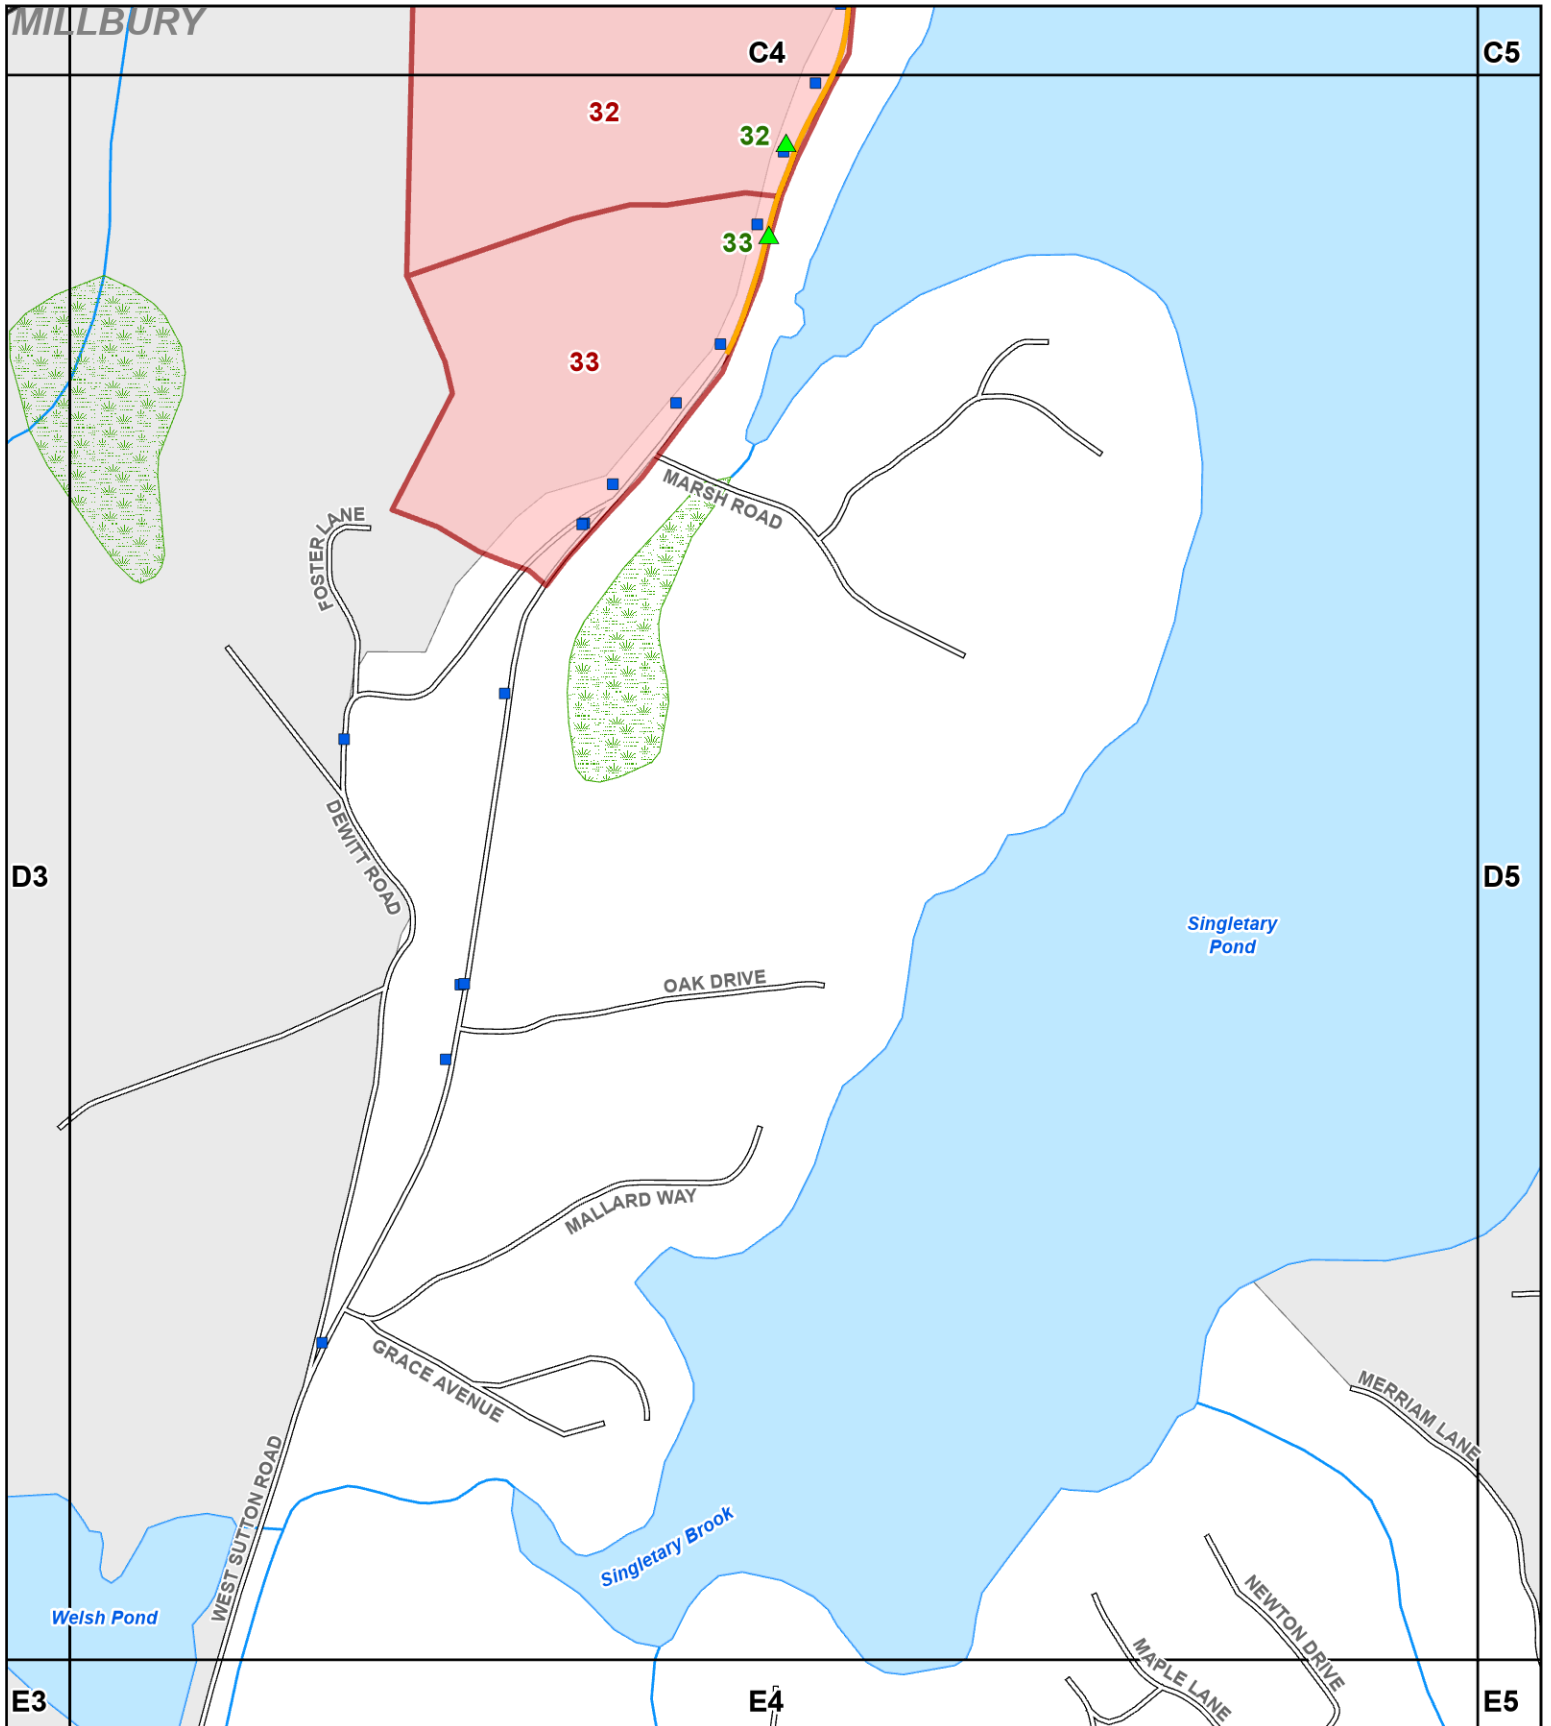

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

D4



Comprehensive
Environmental
Incorporated

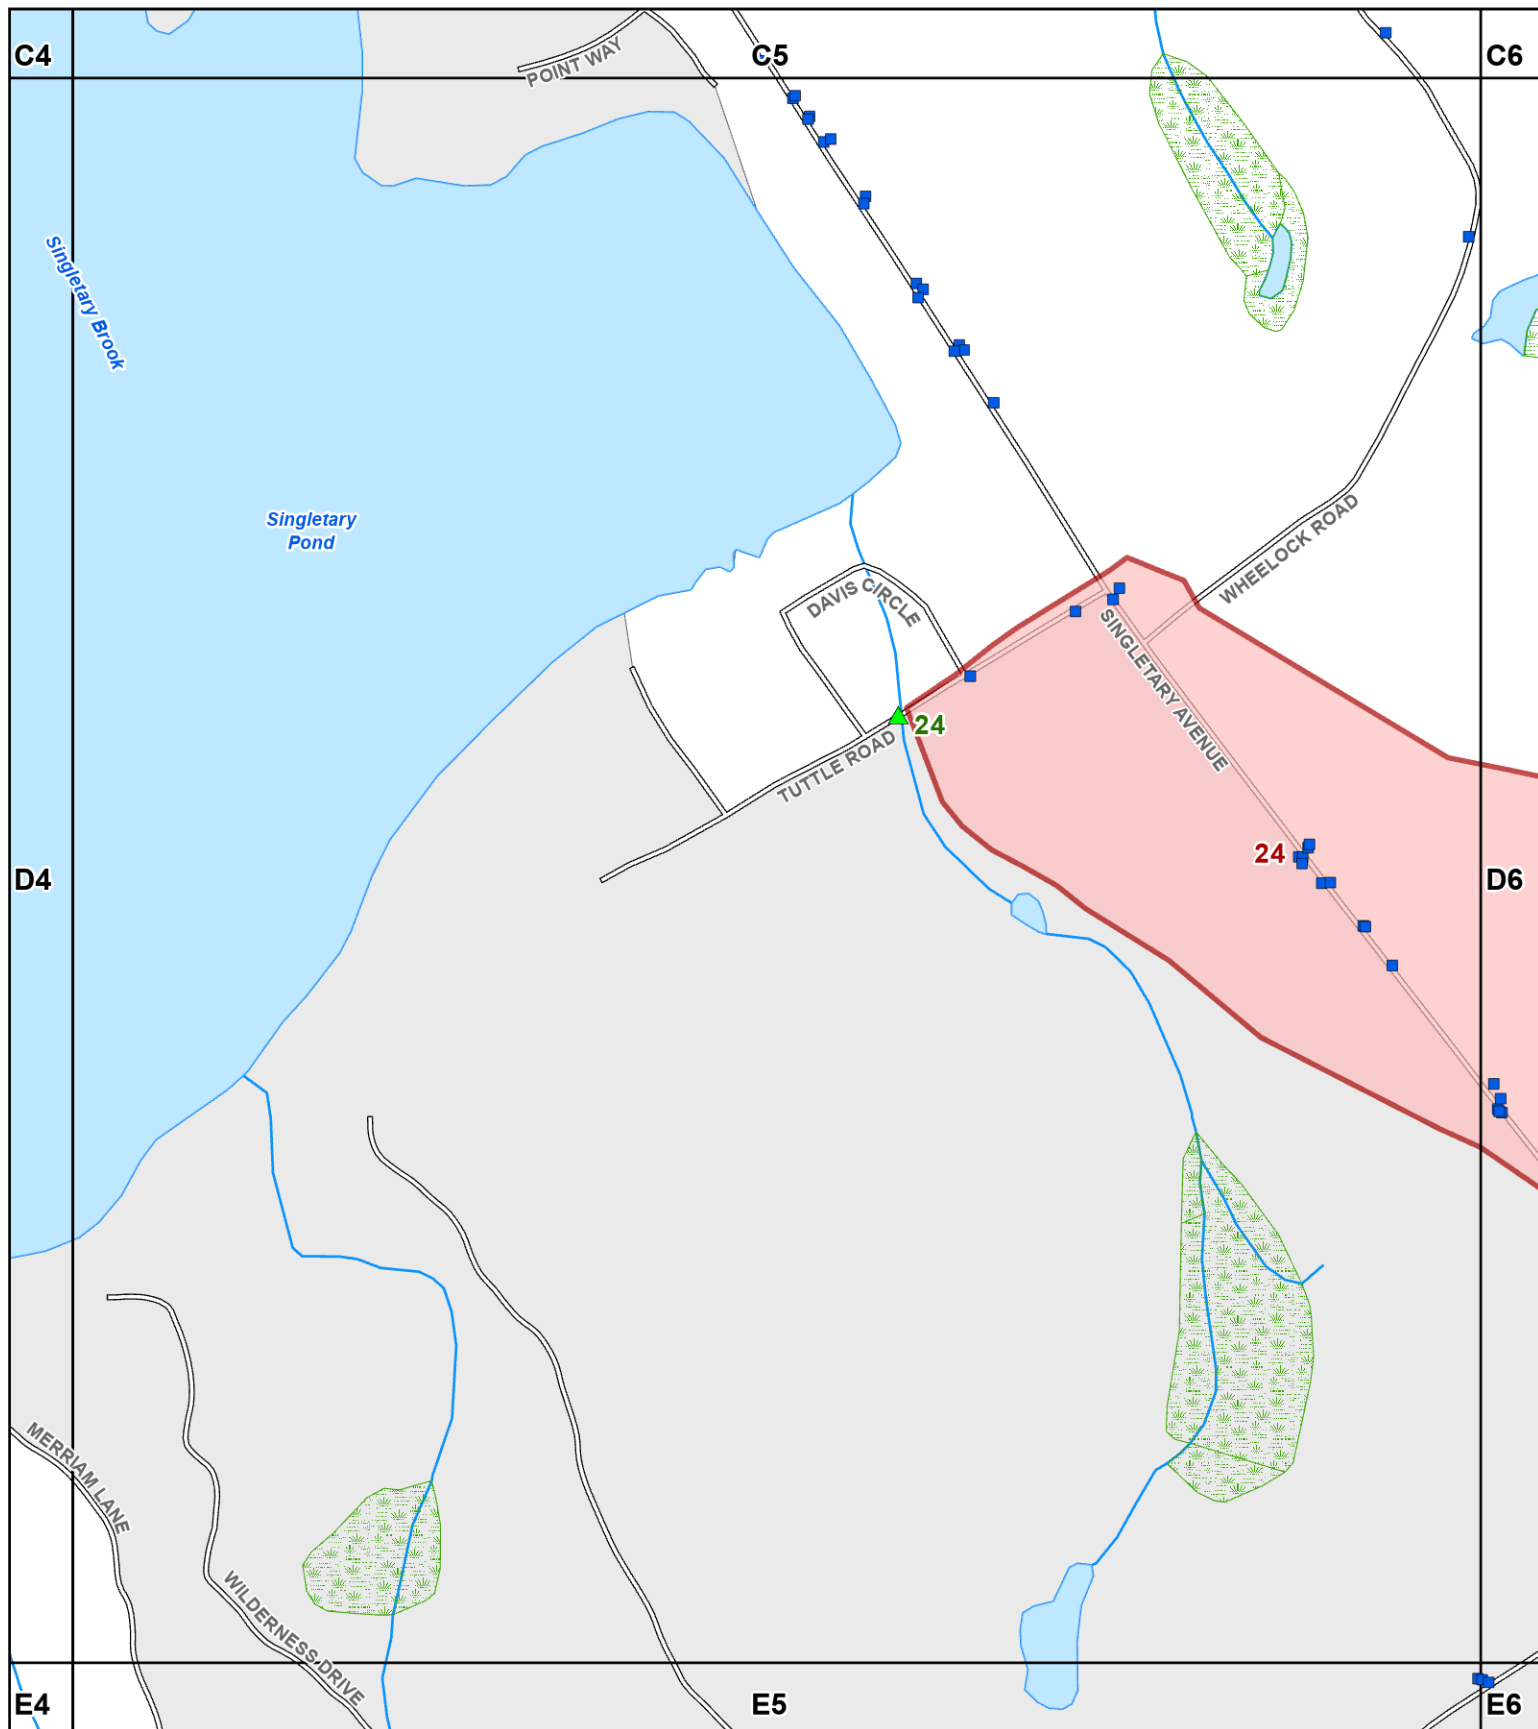

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









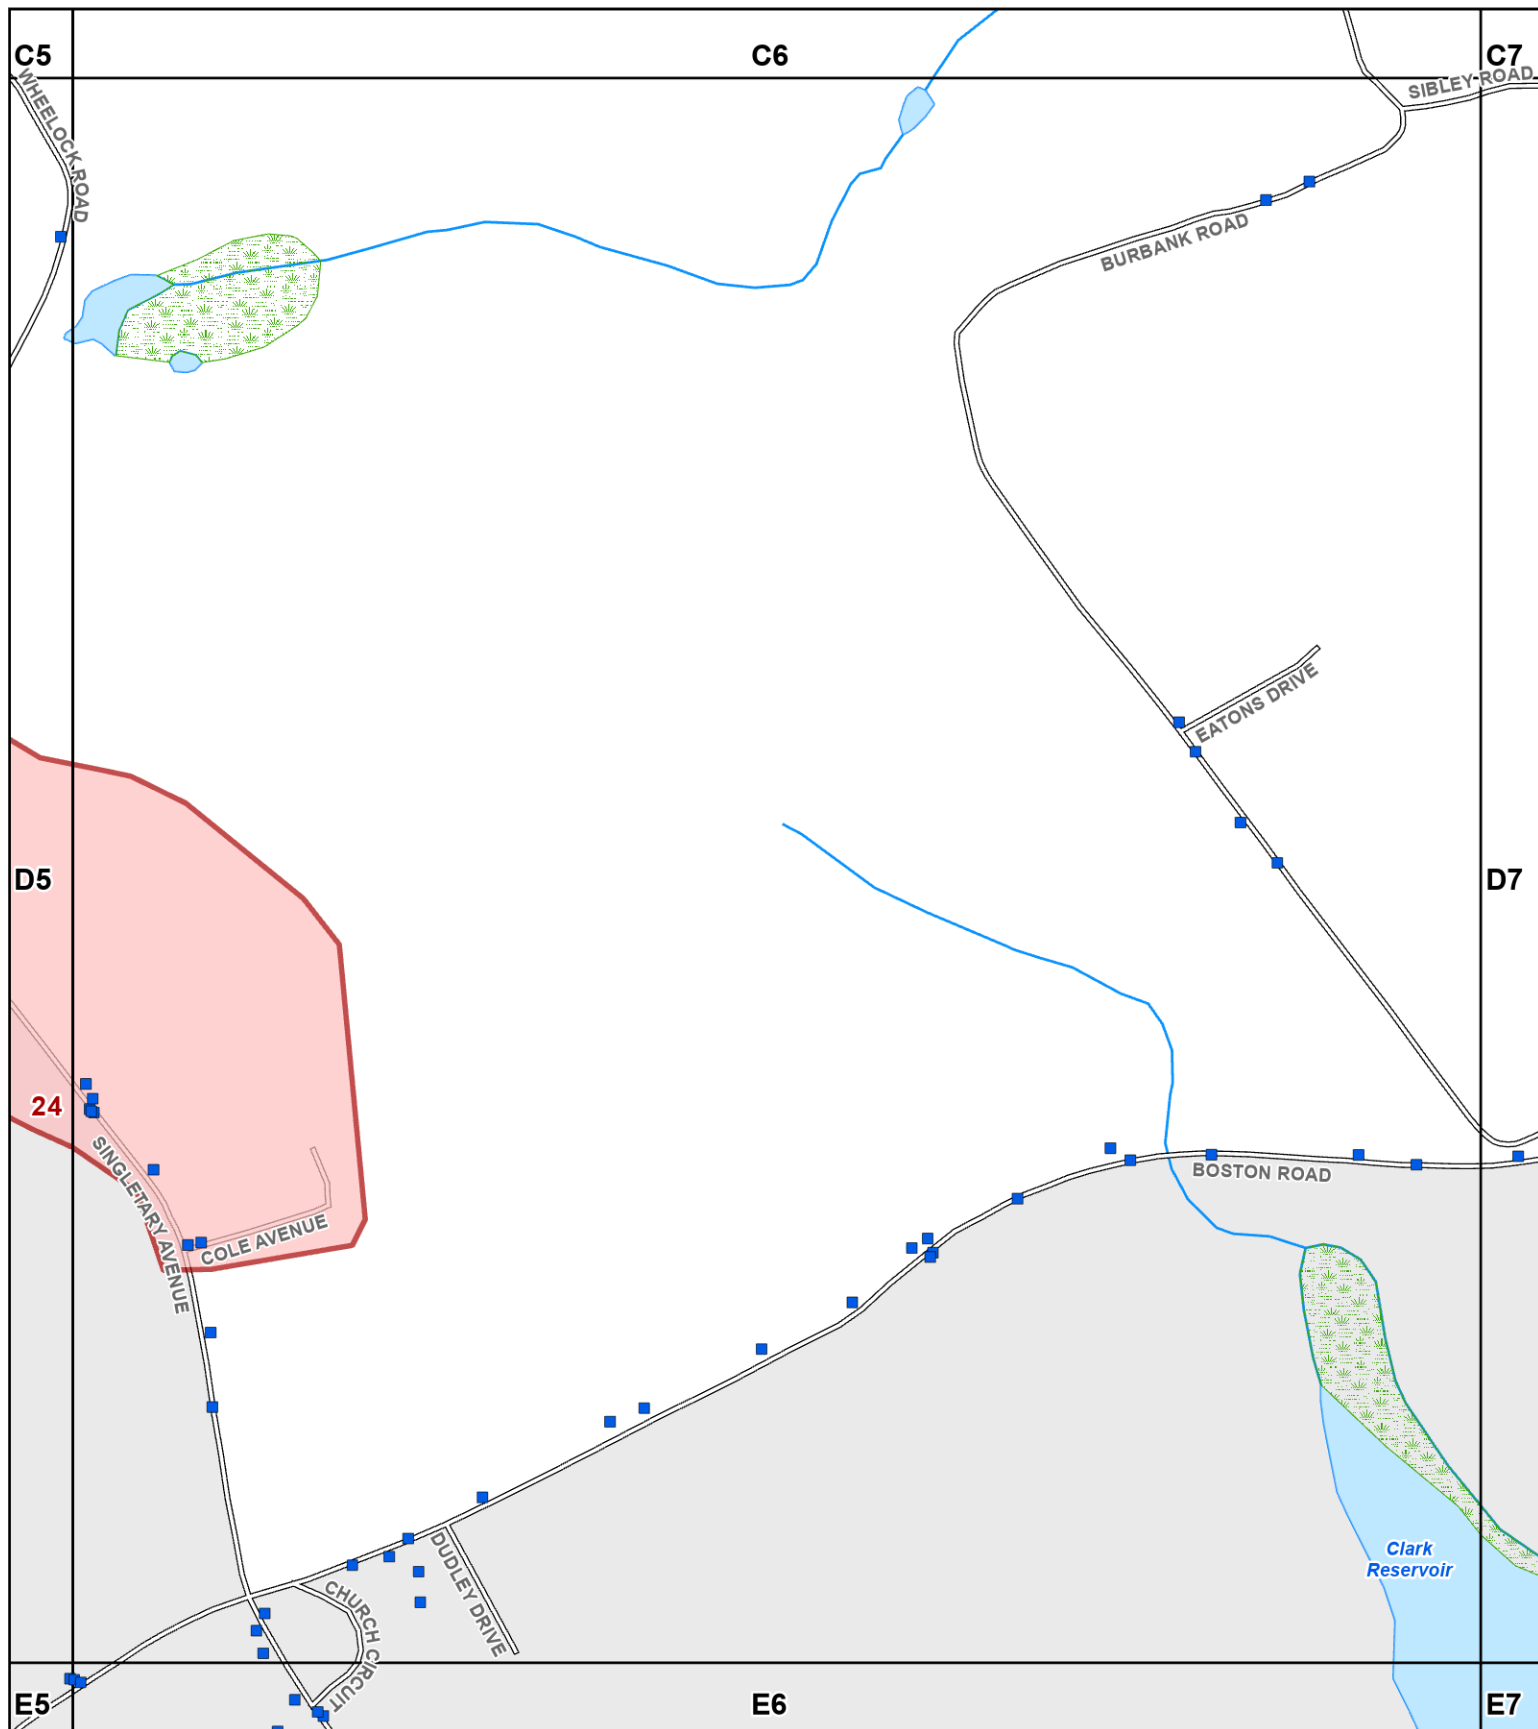


SHEET
D5



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

D6



**Comprehensive
Environmental
Incorporated**

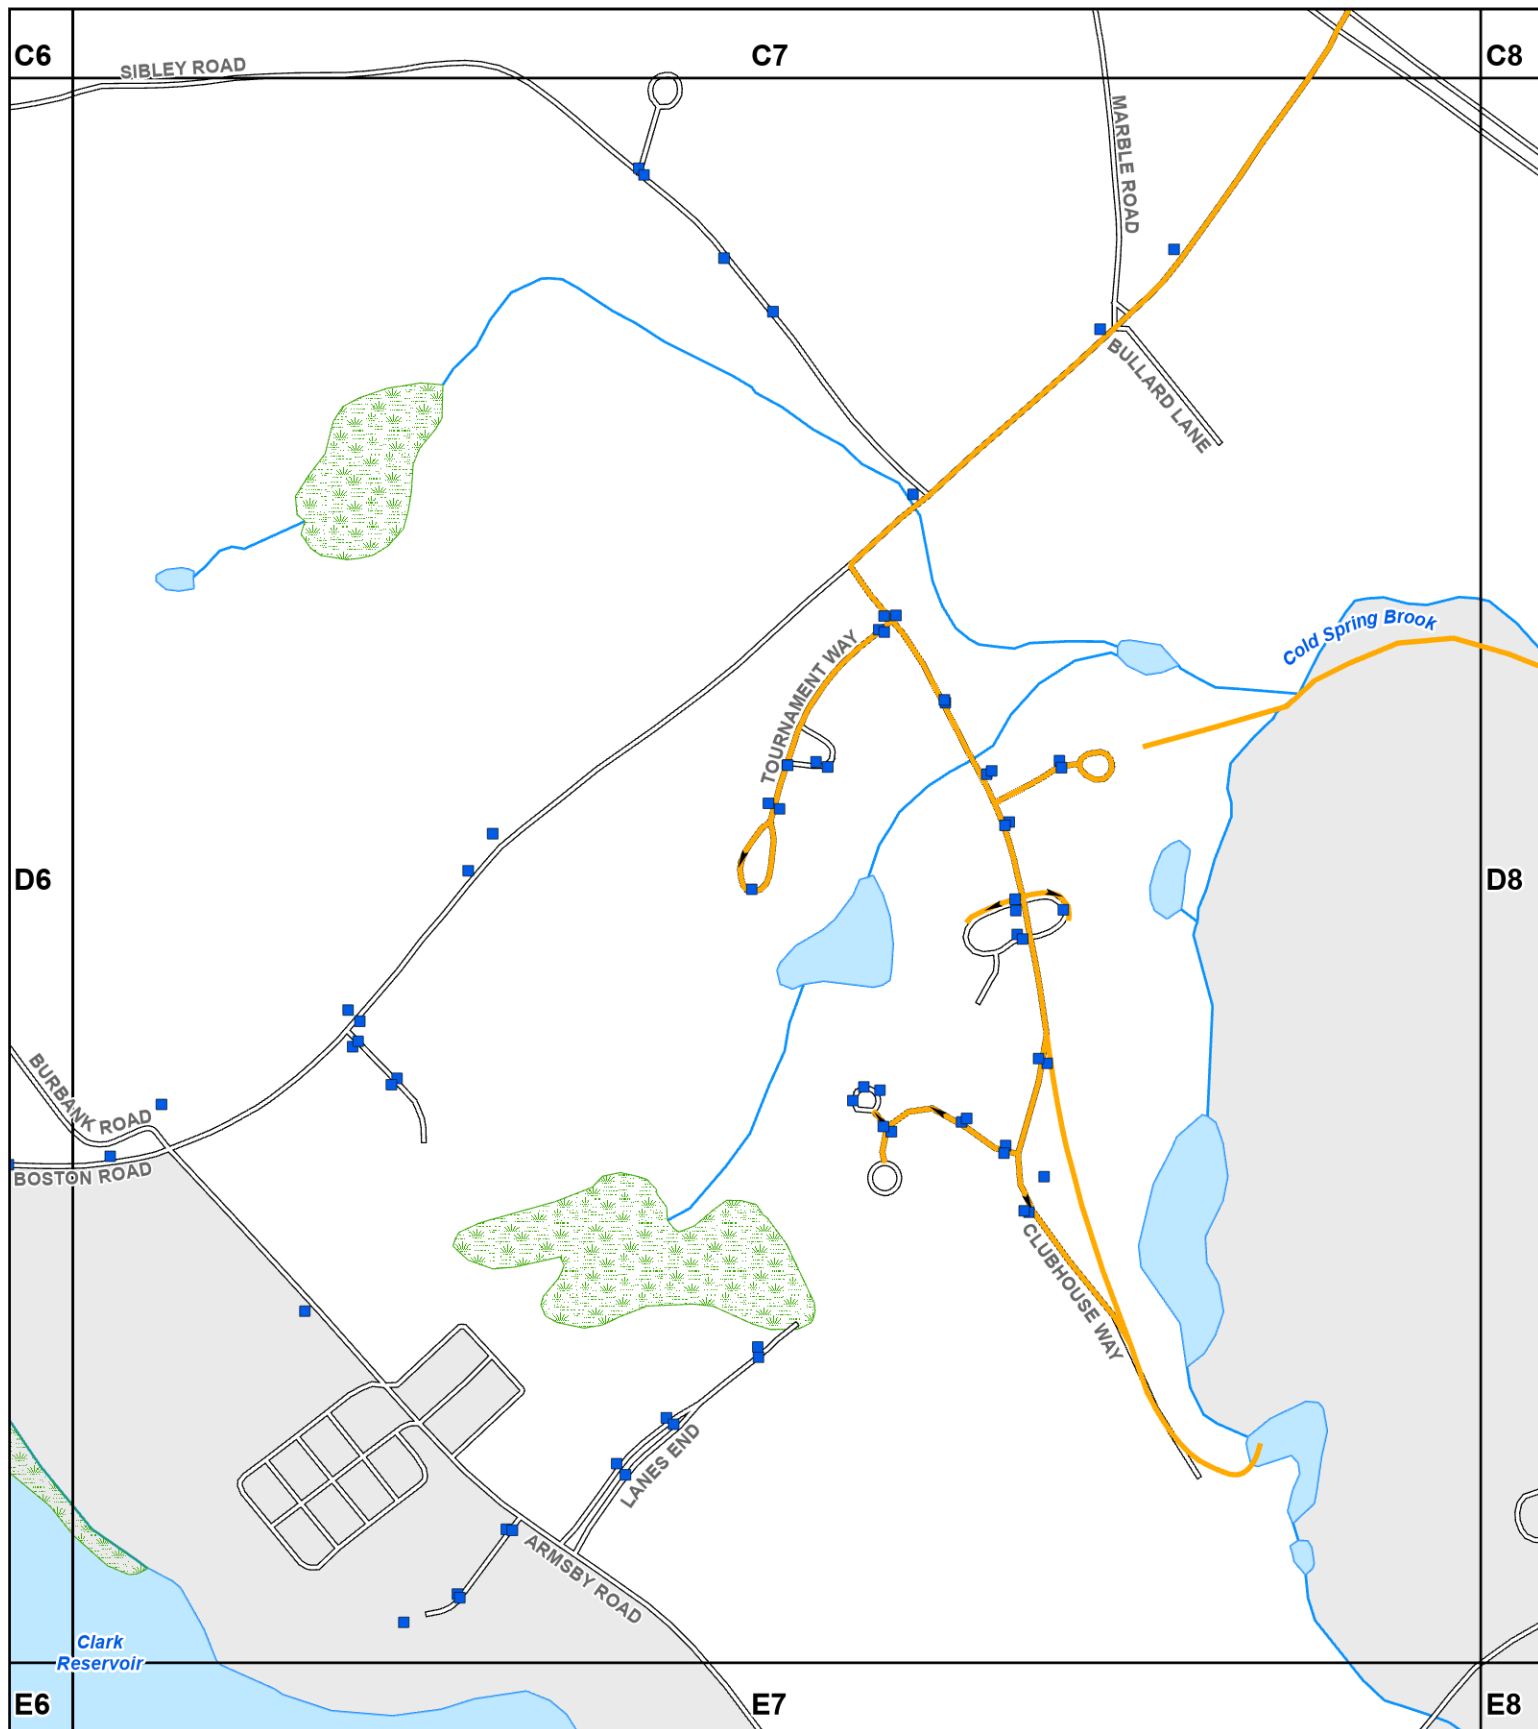

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







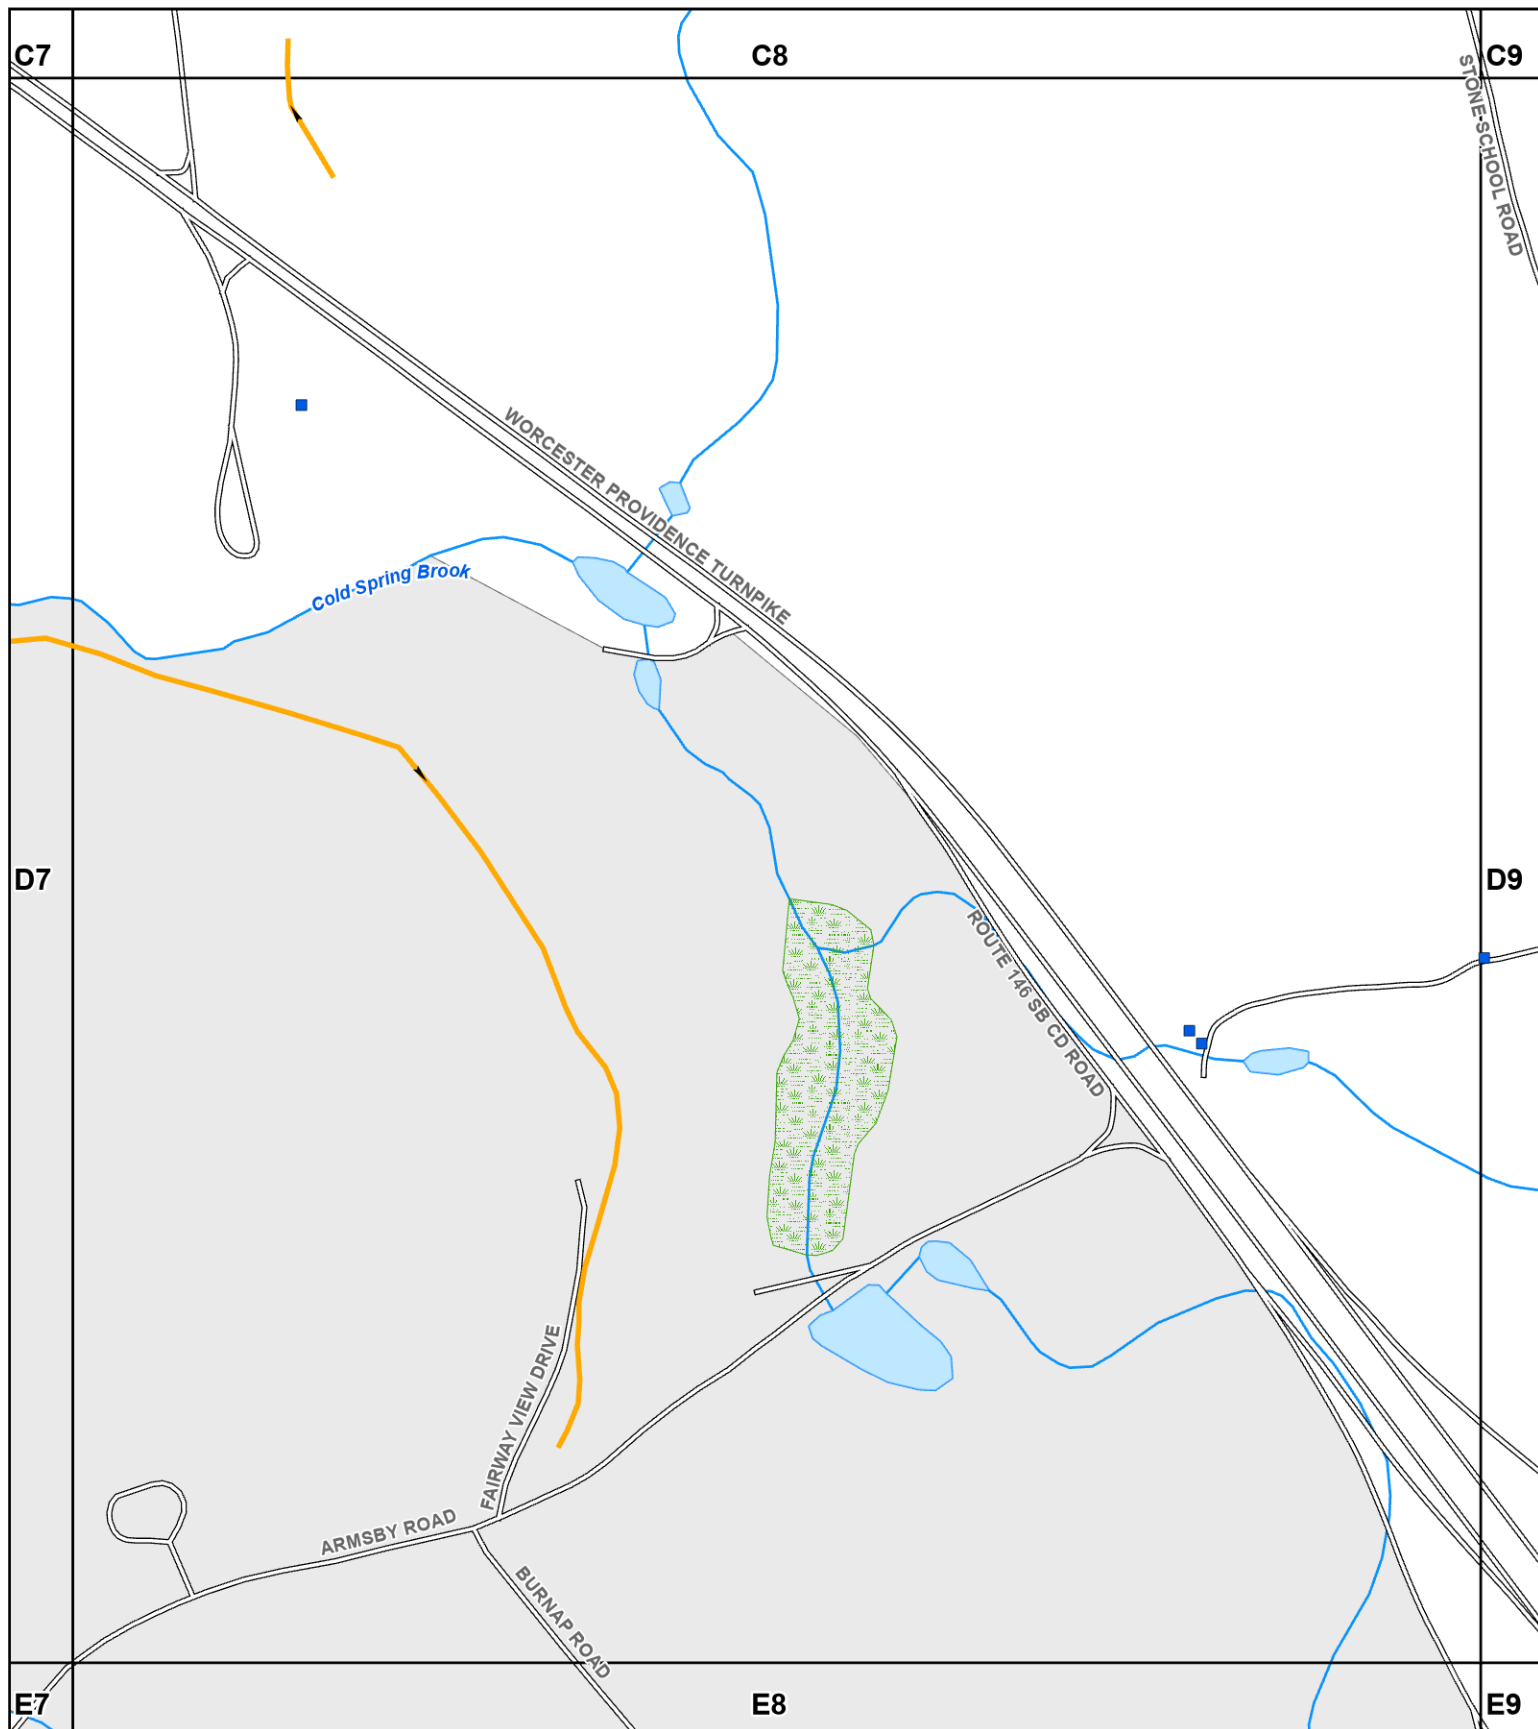


D7



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







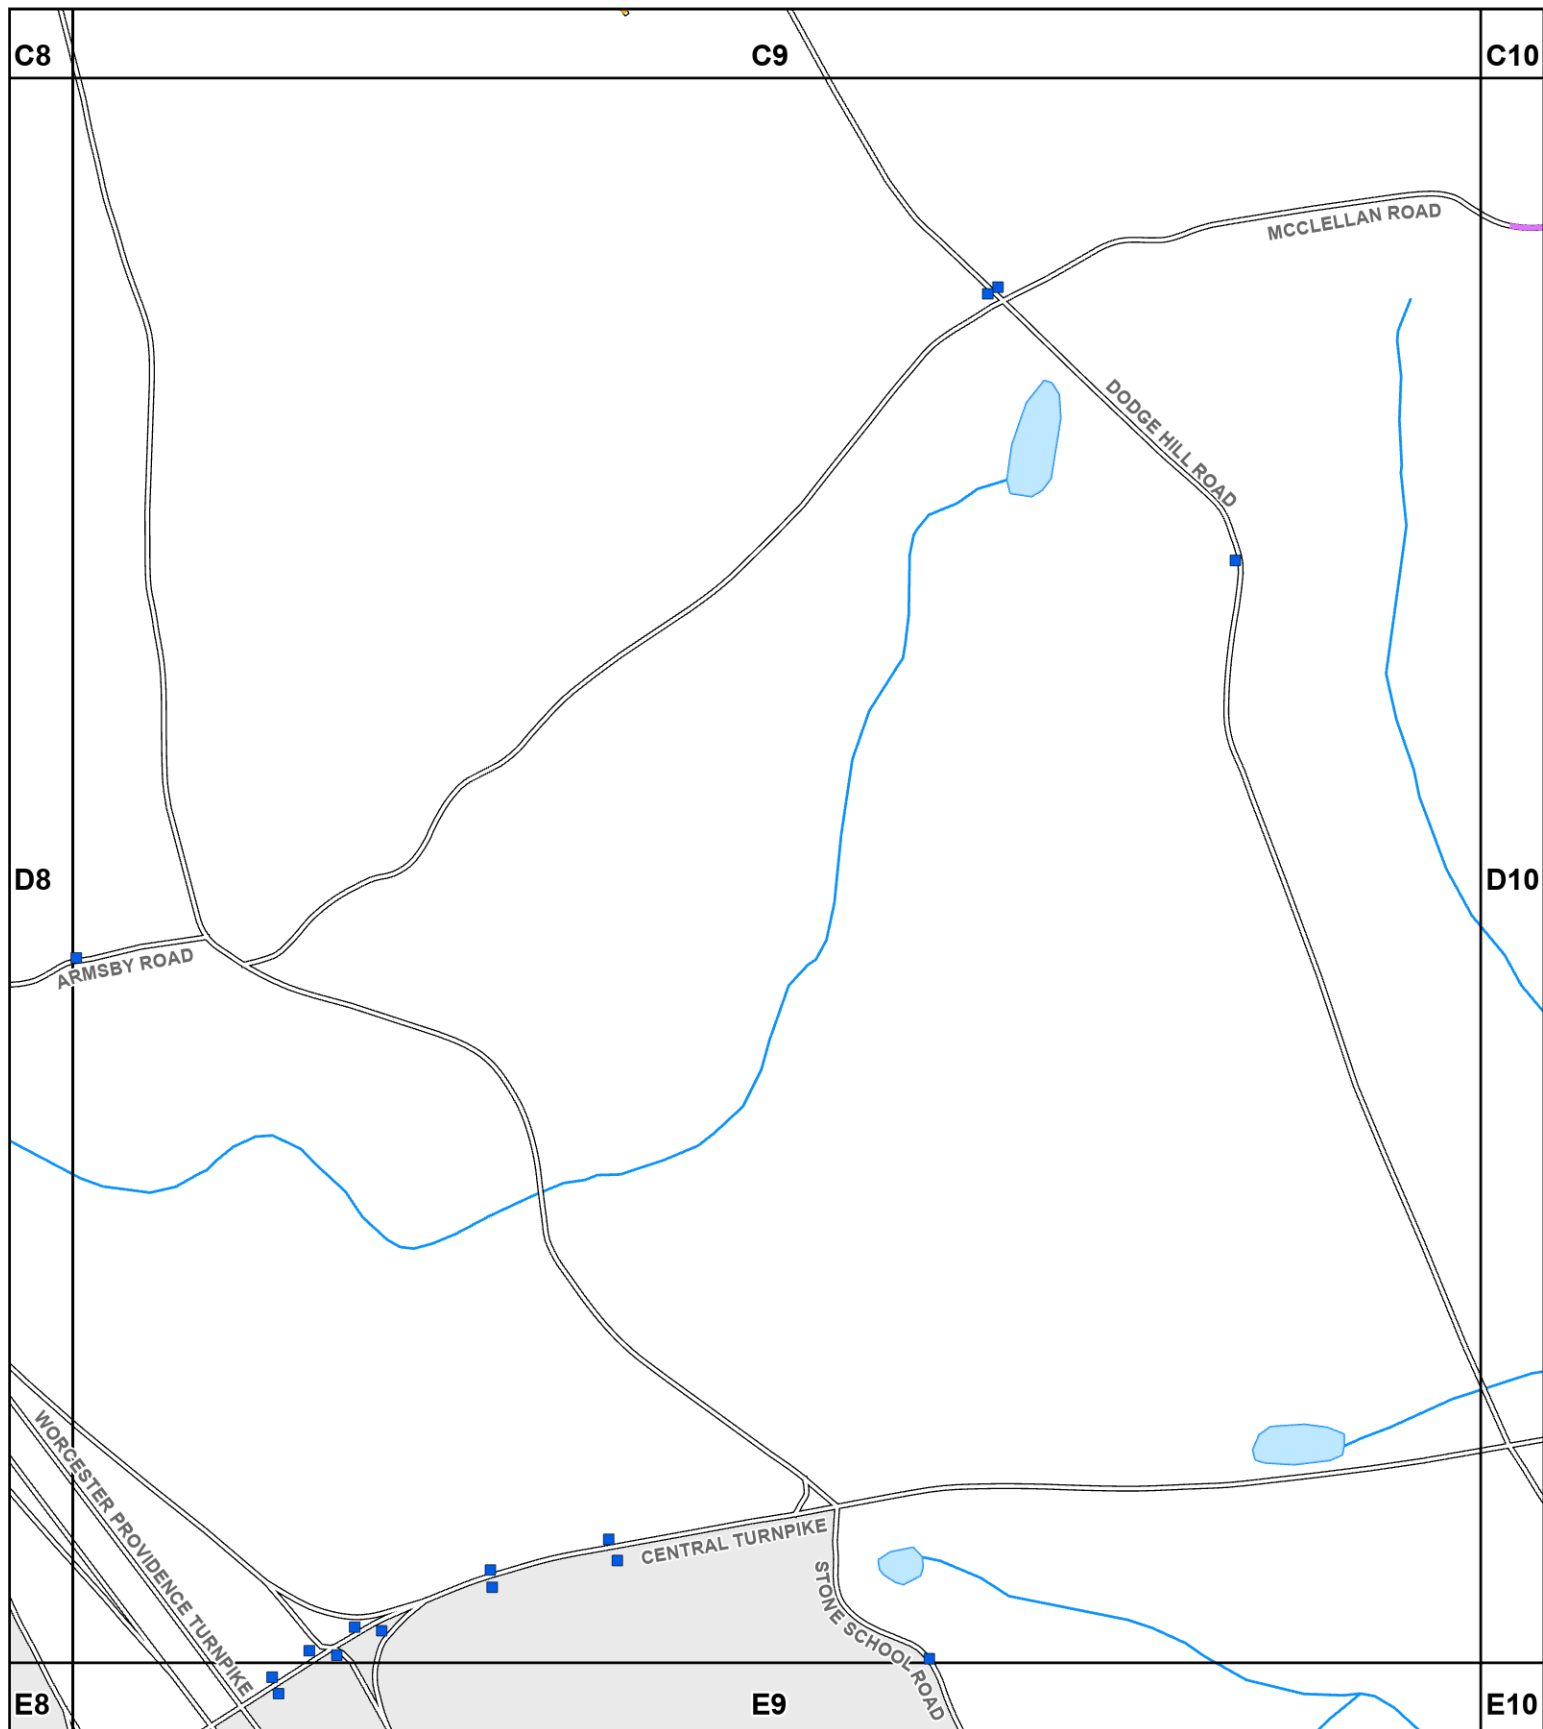


D8



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







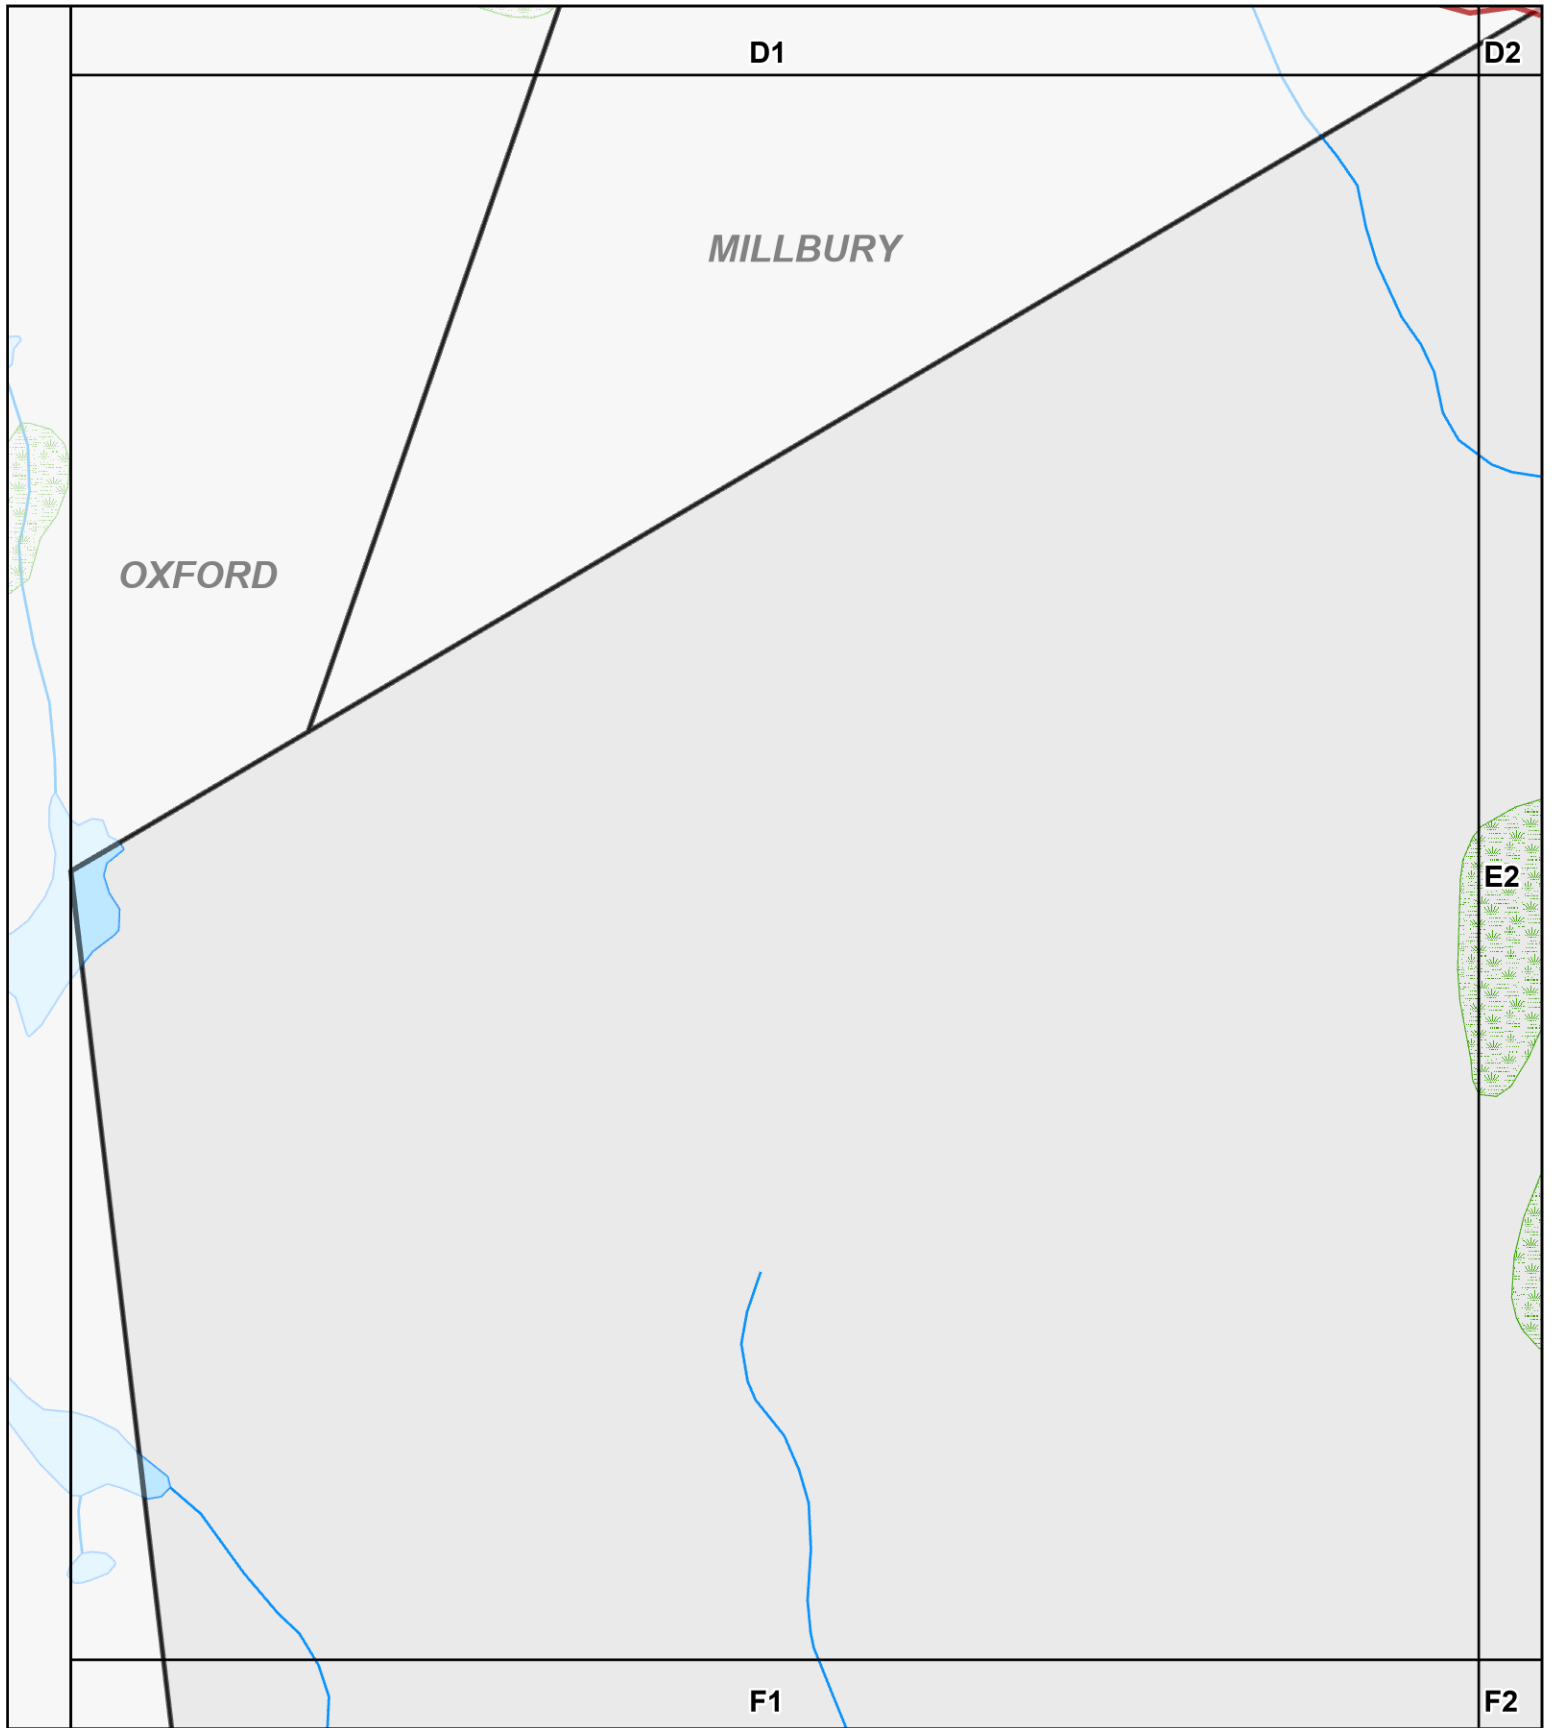


D9




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







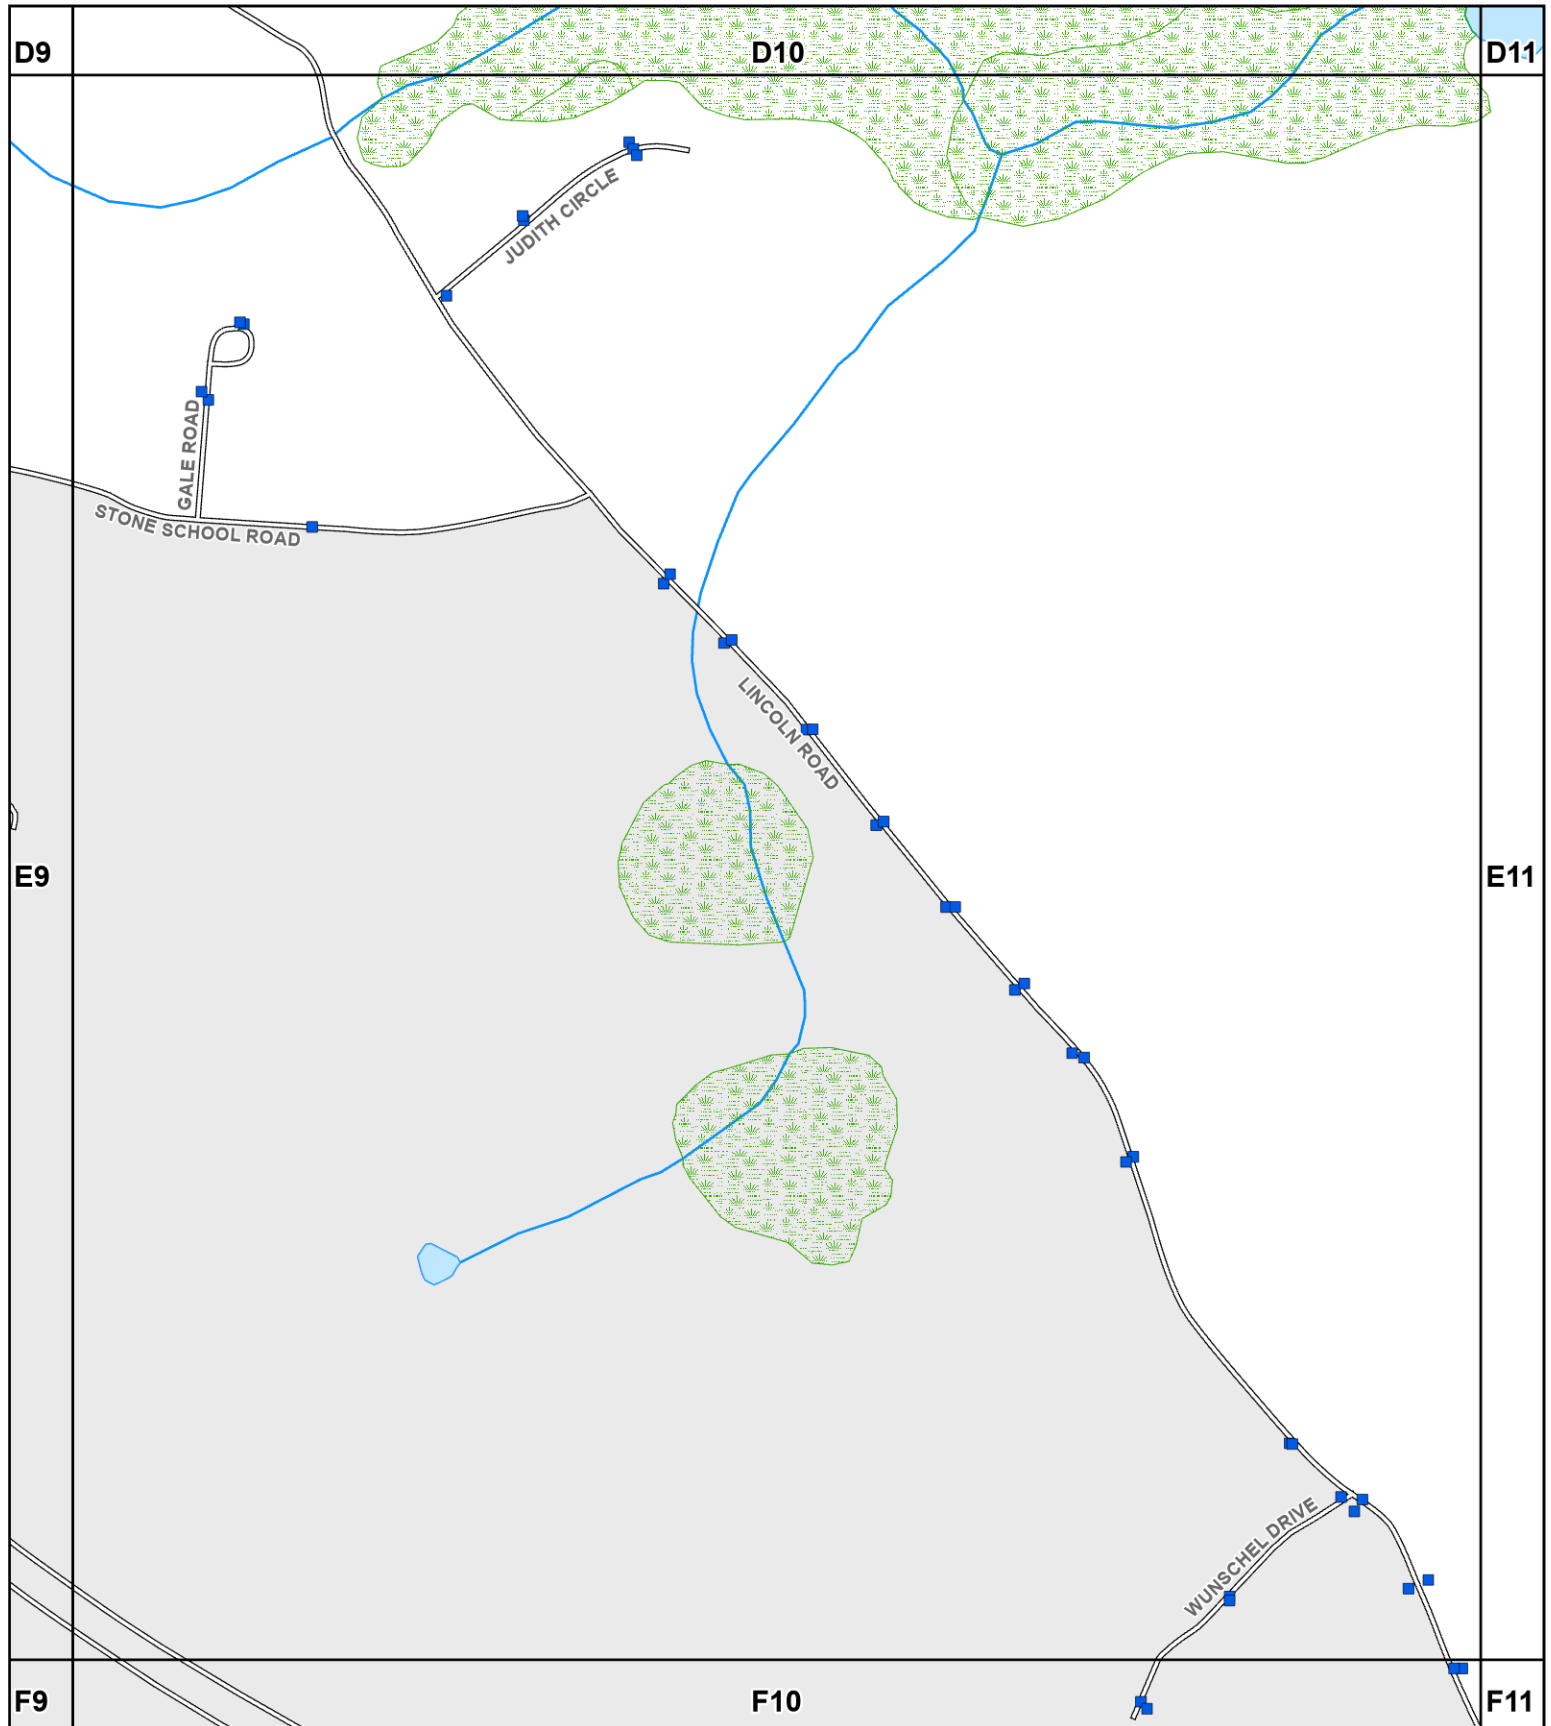


E1




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









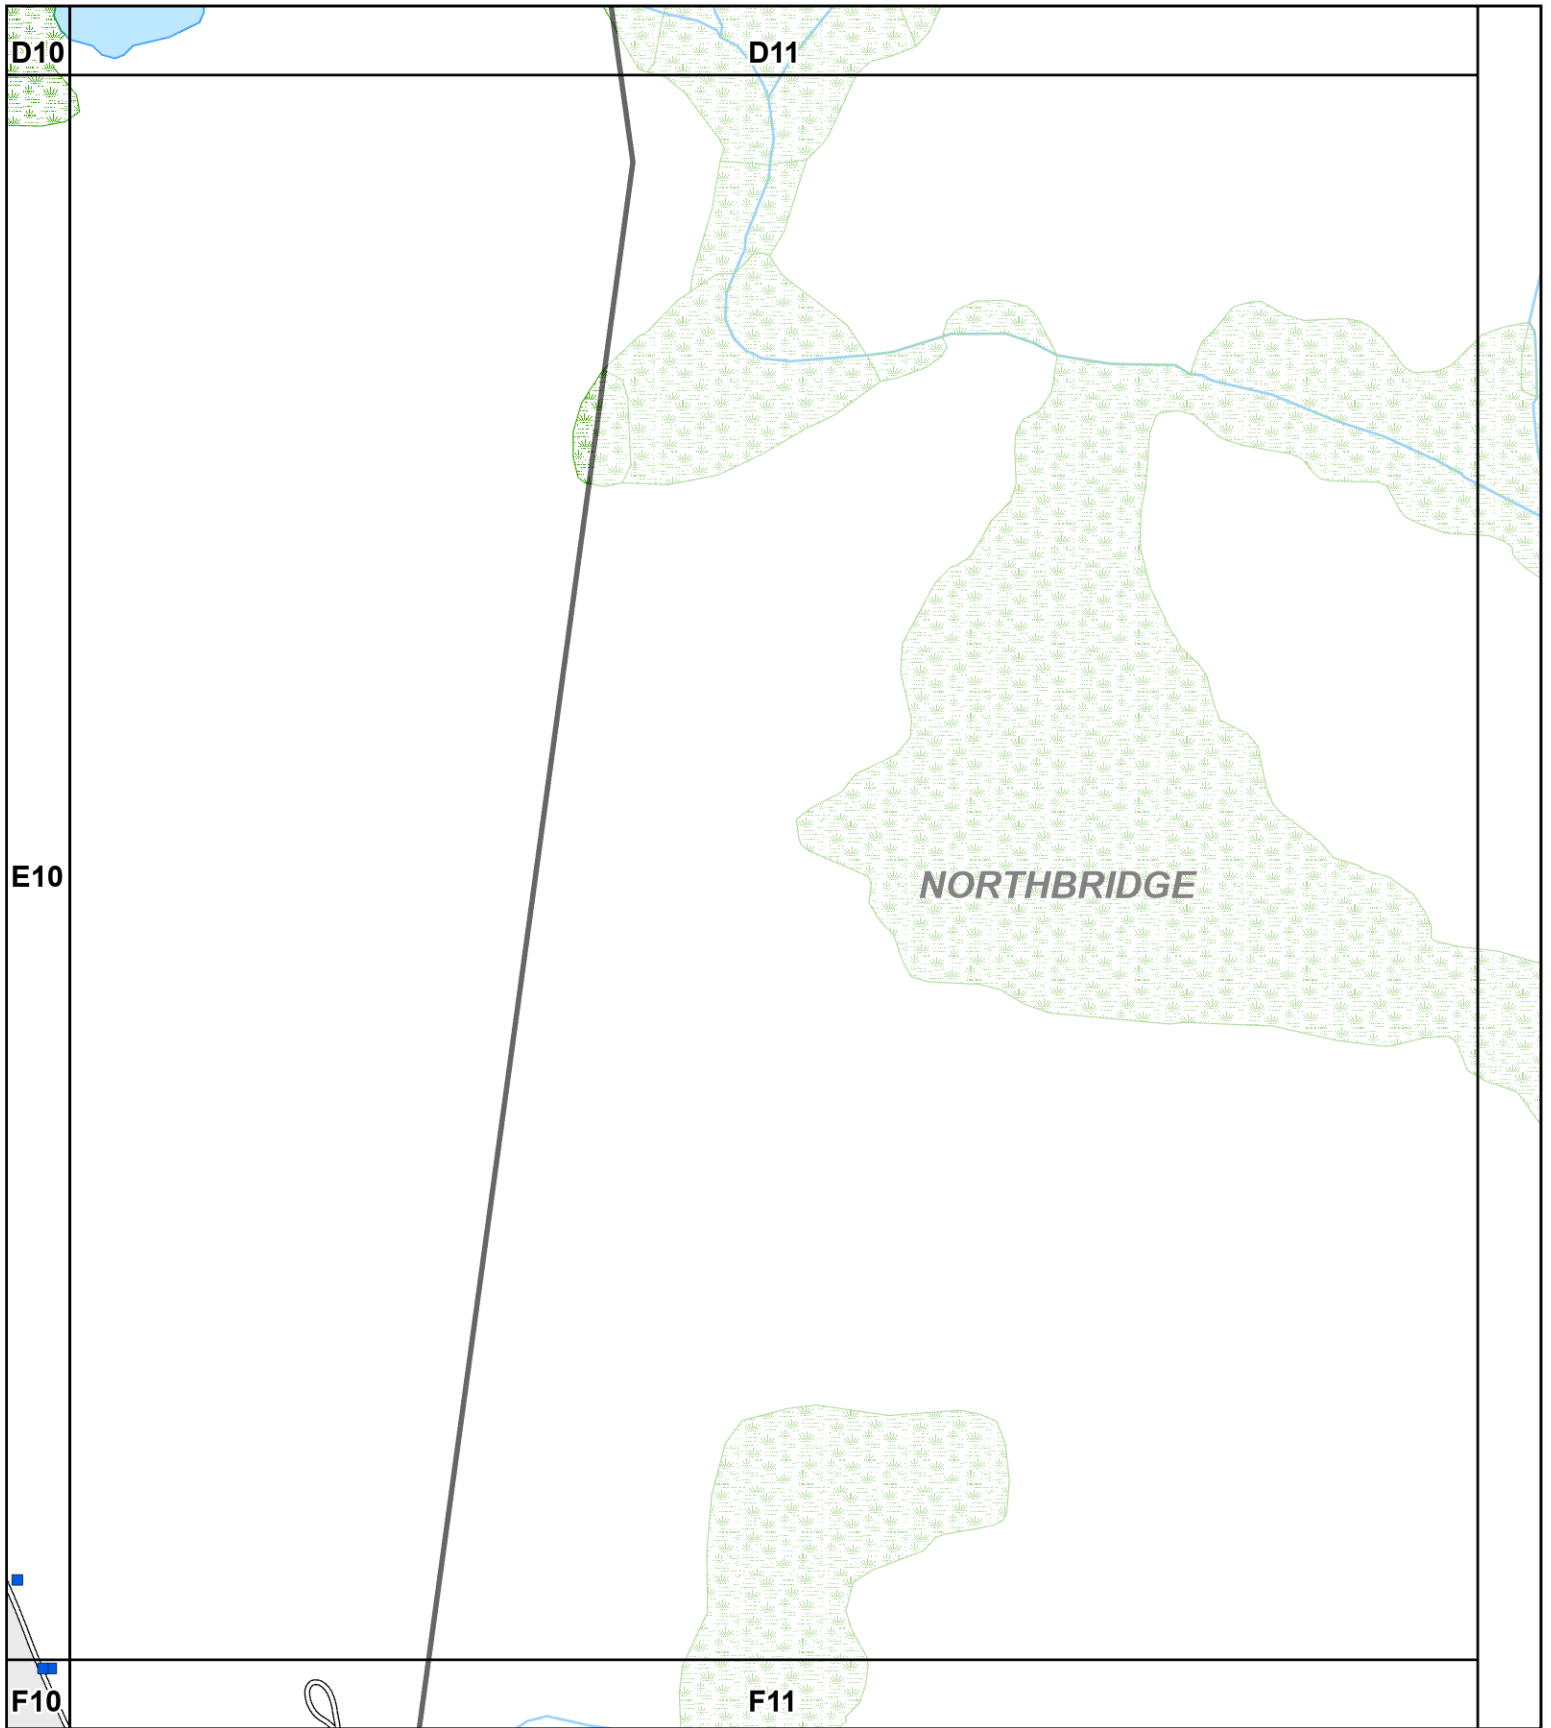


SHEET
E10




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

E11



**Comprehensive
Environmental
Incorporated**

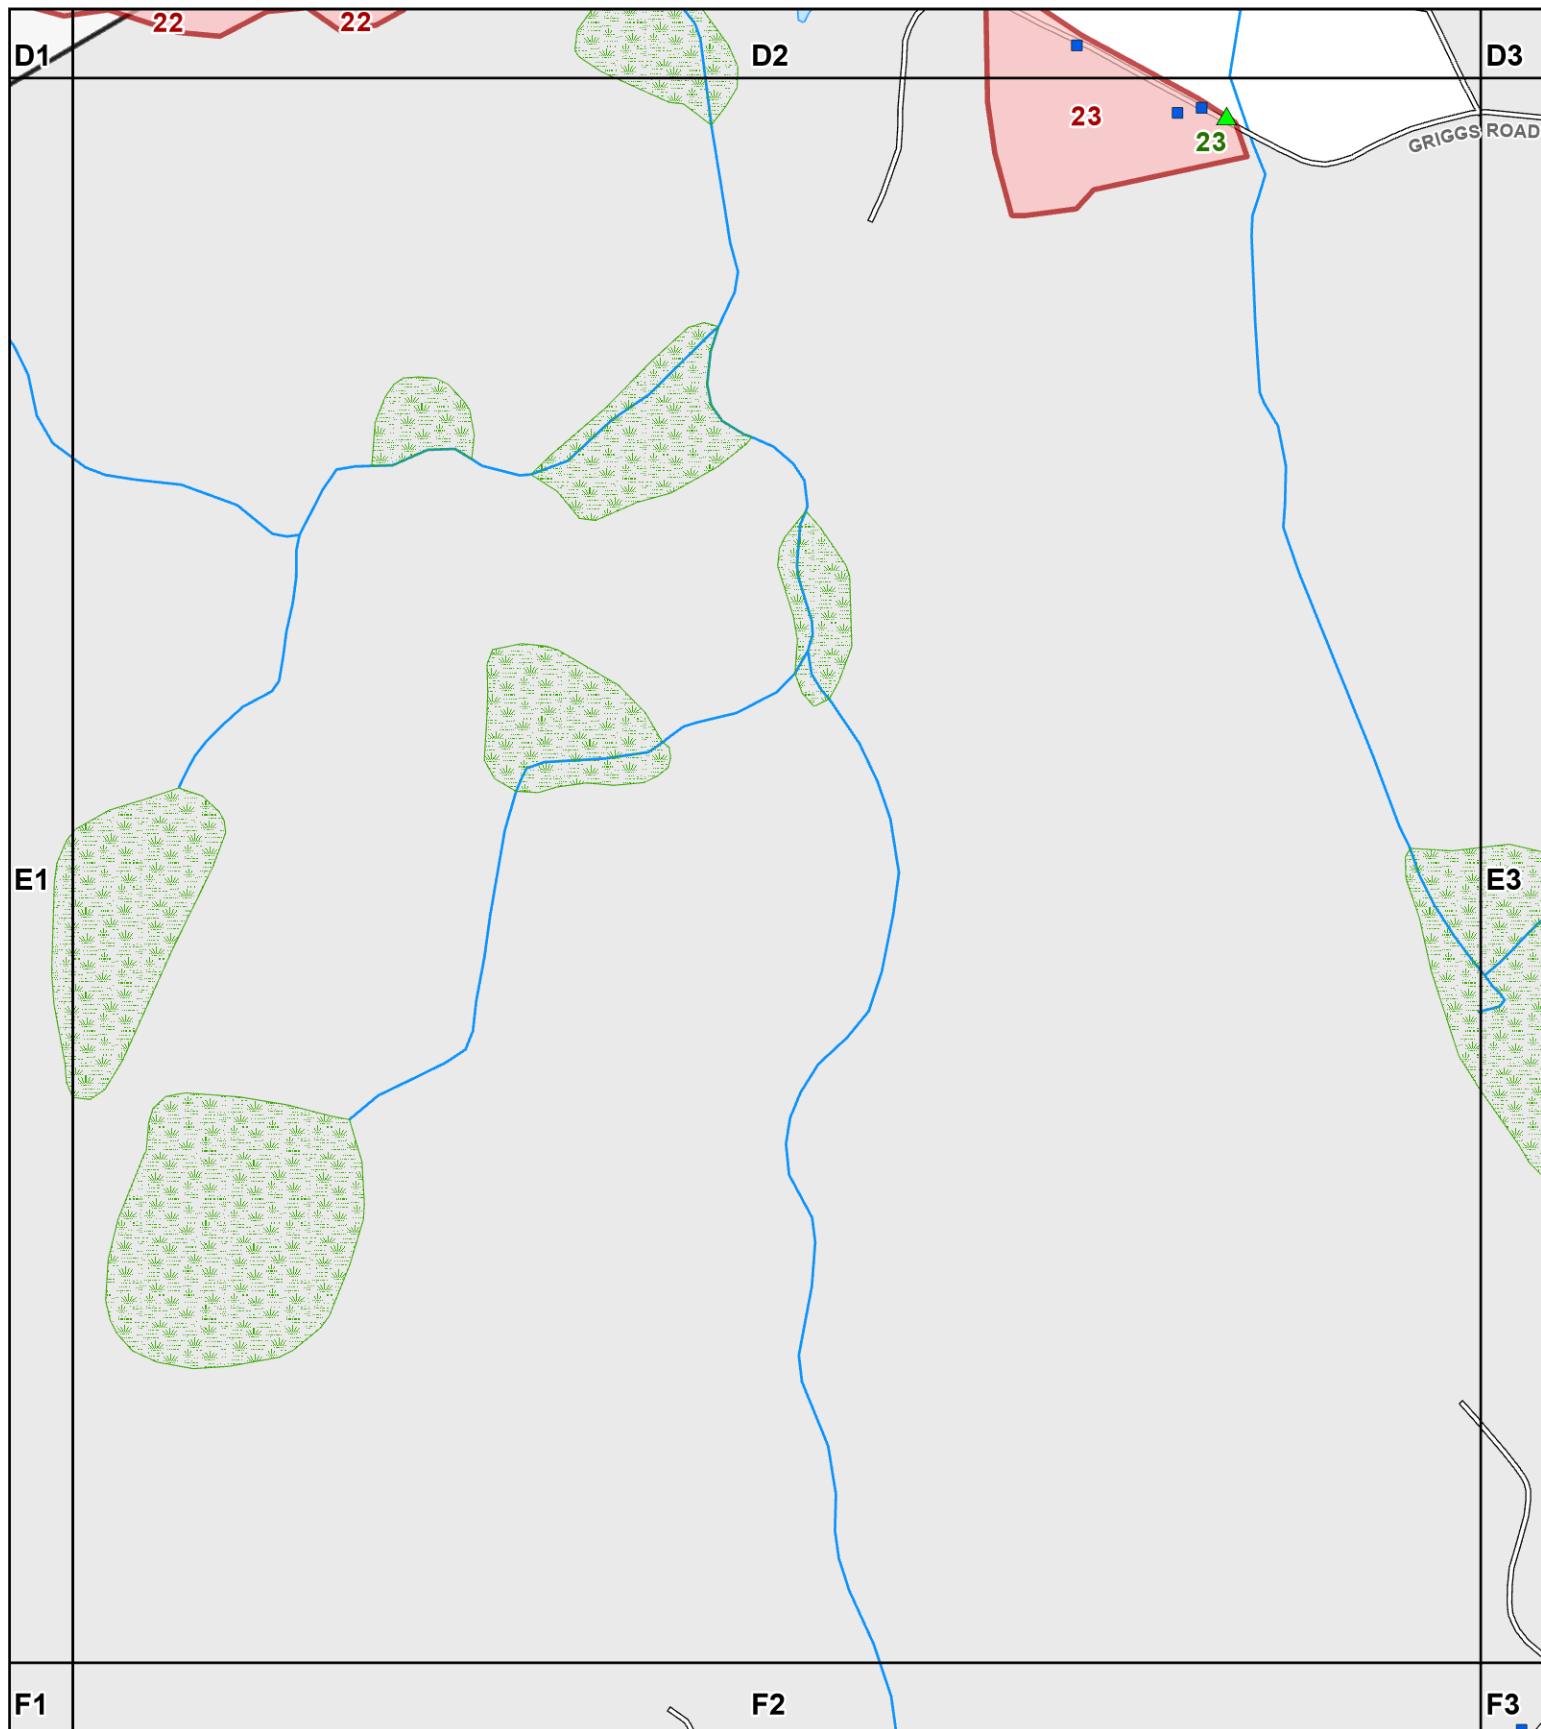

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







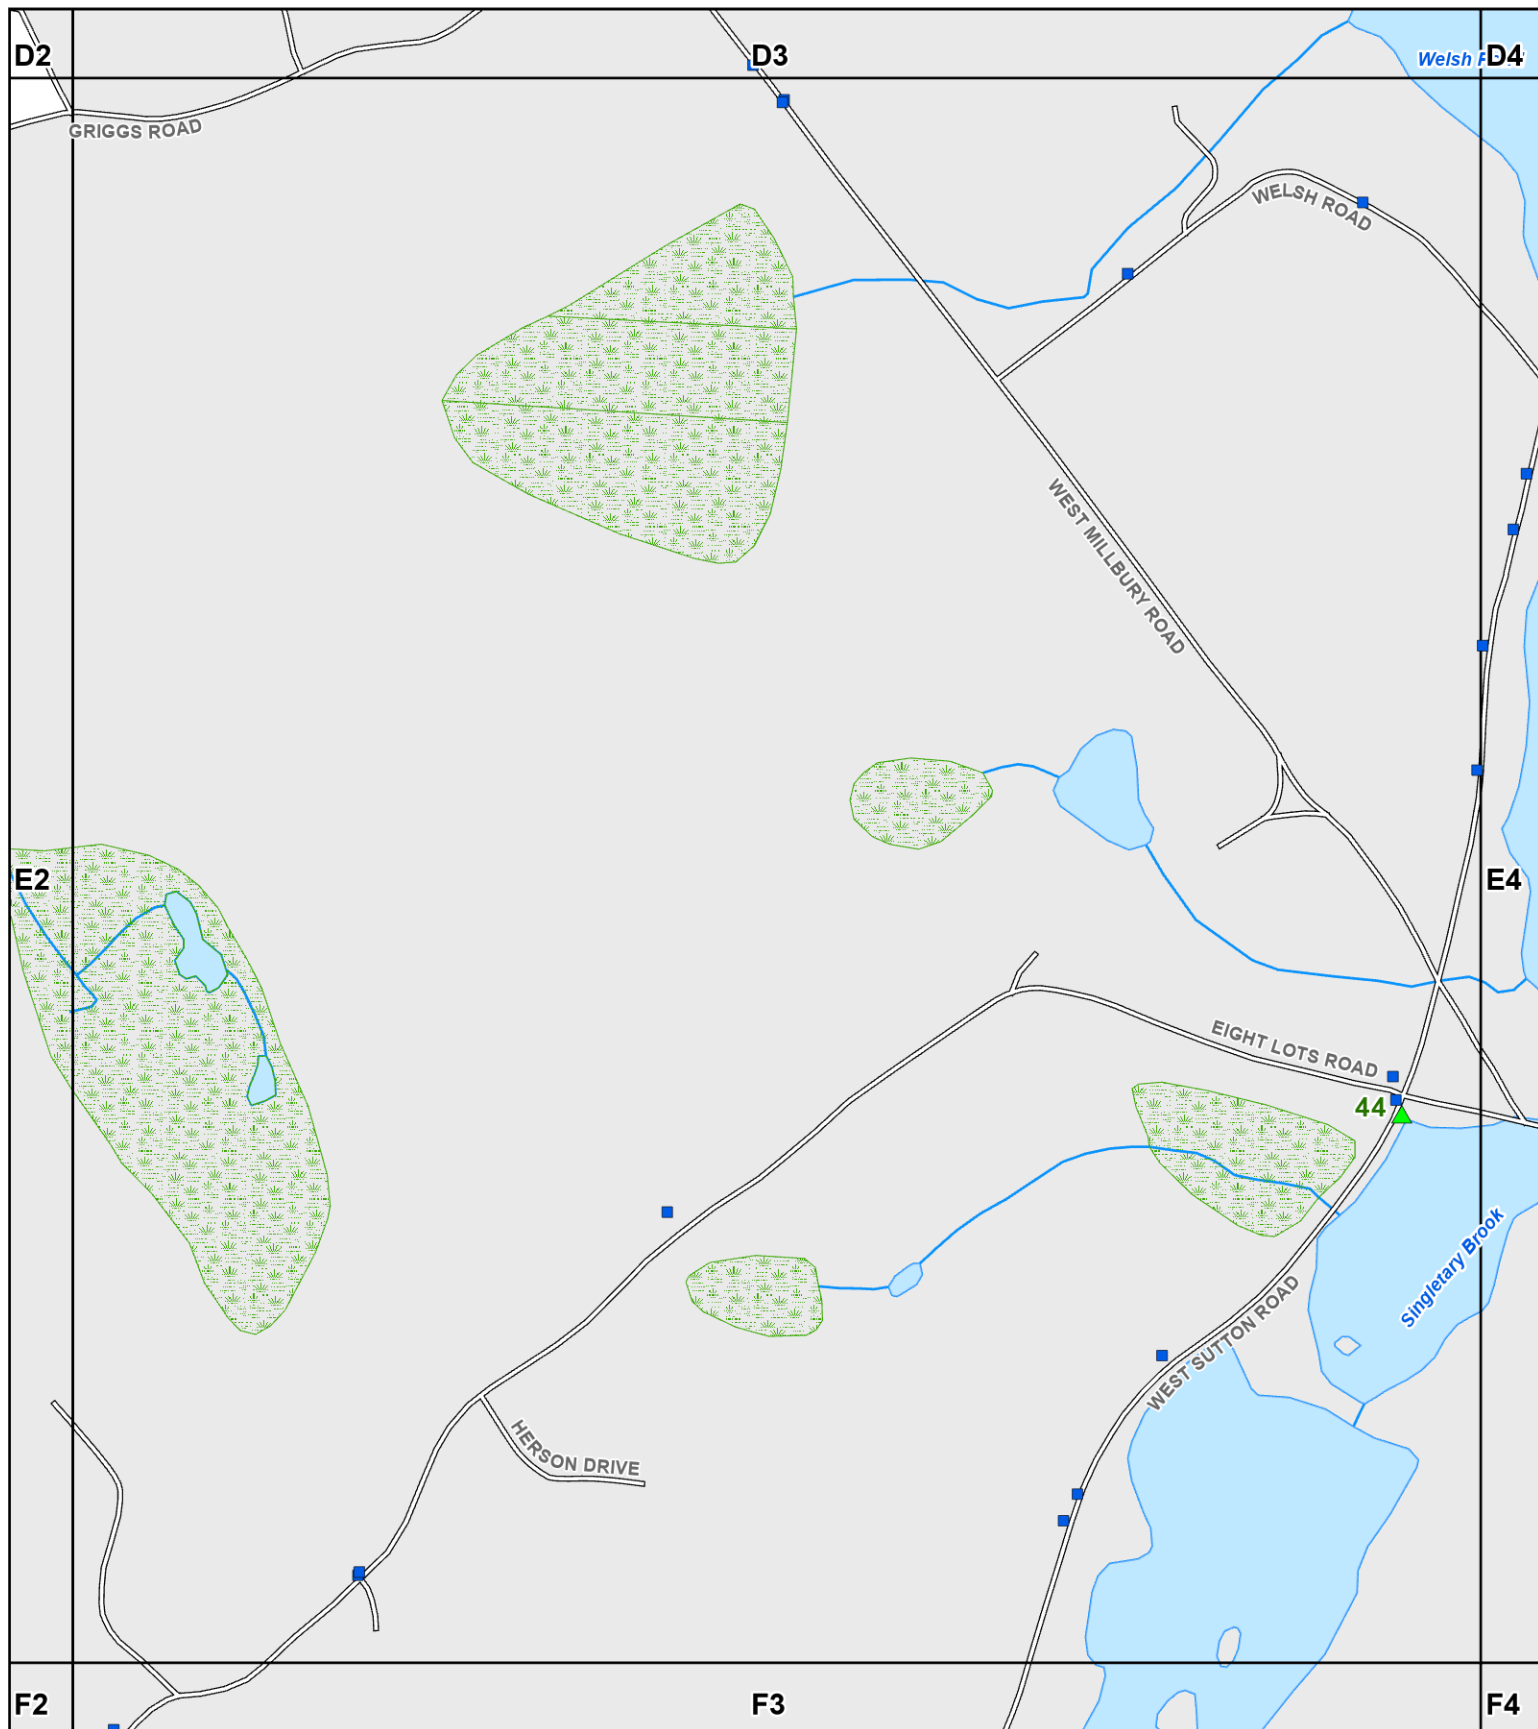


E2



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







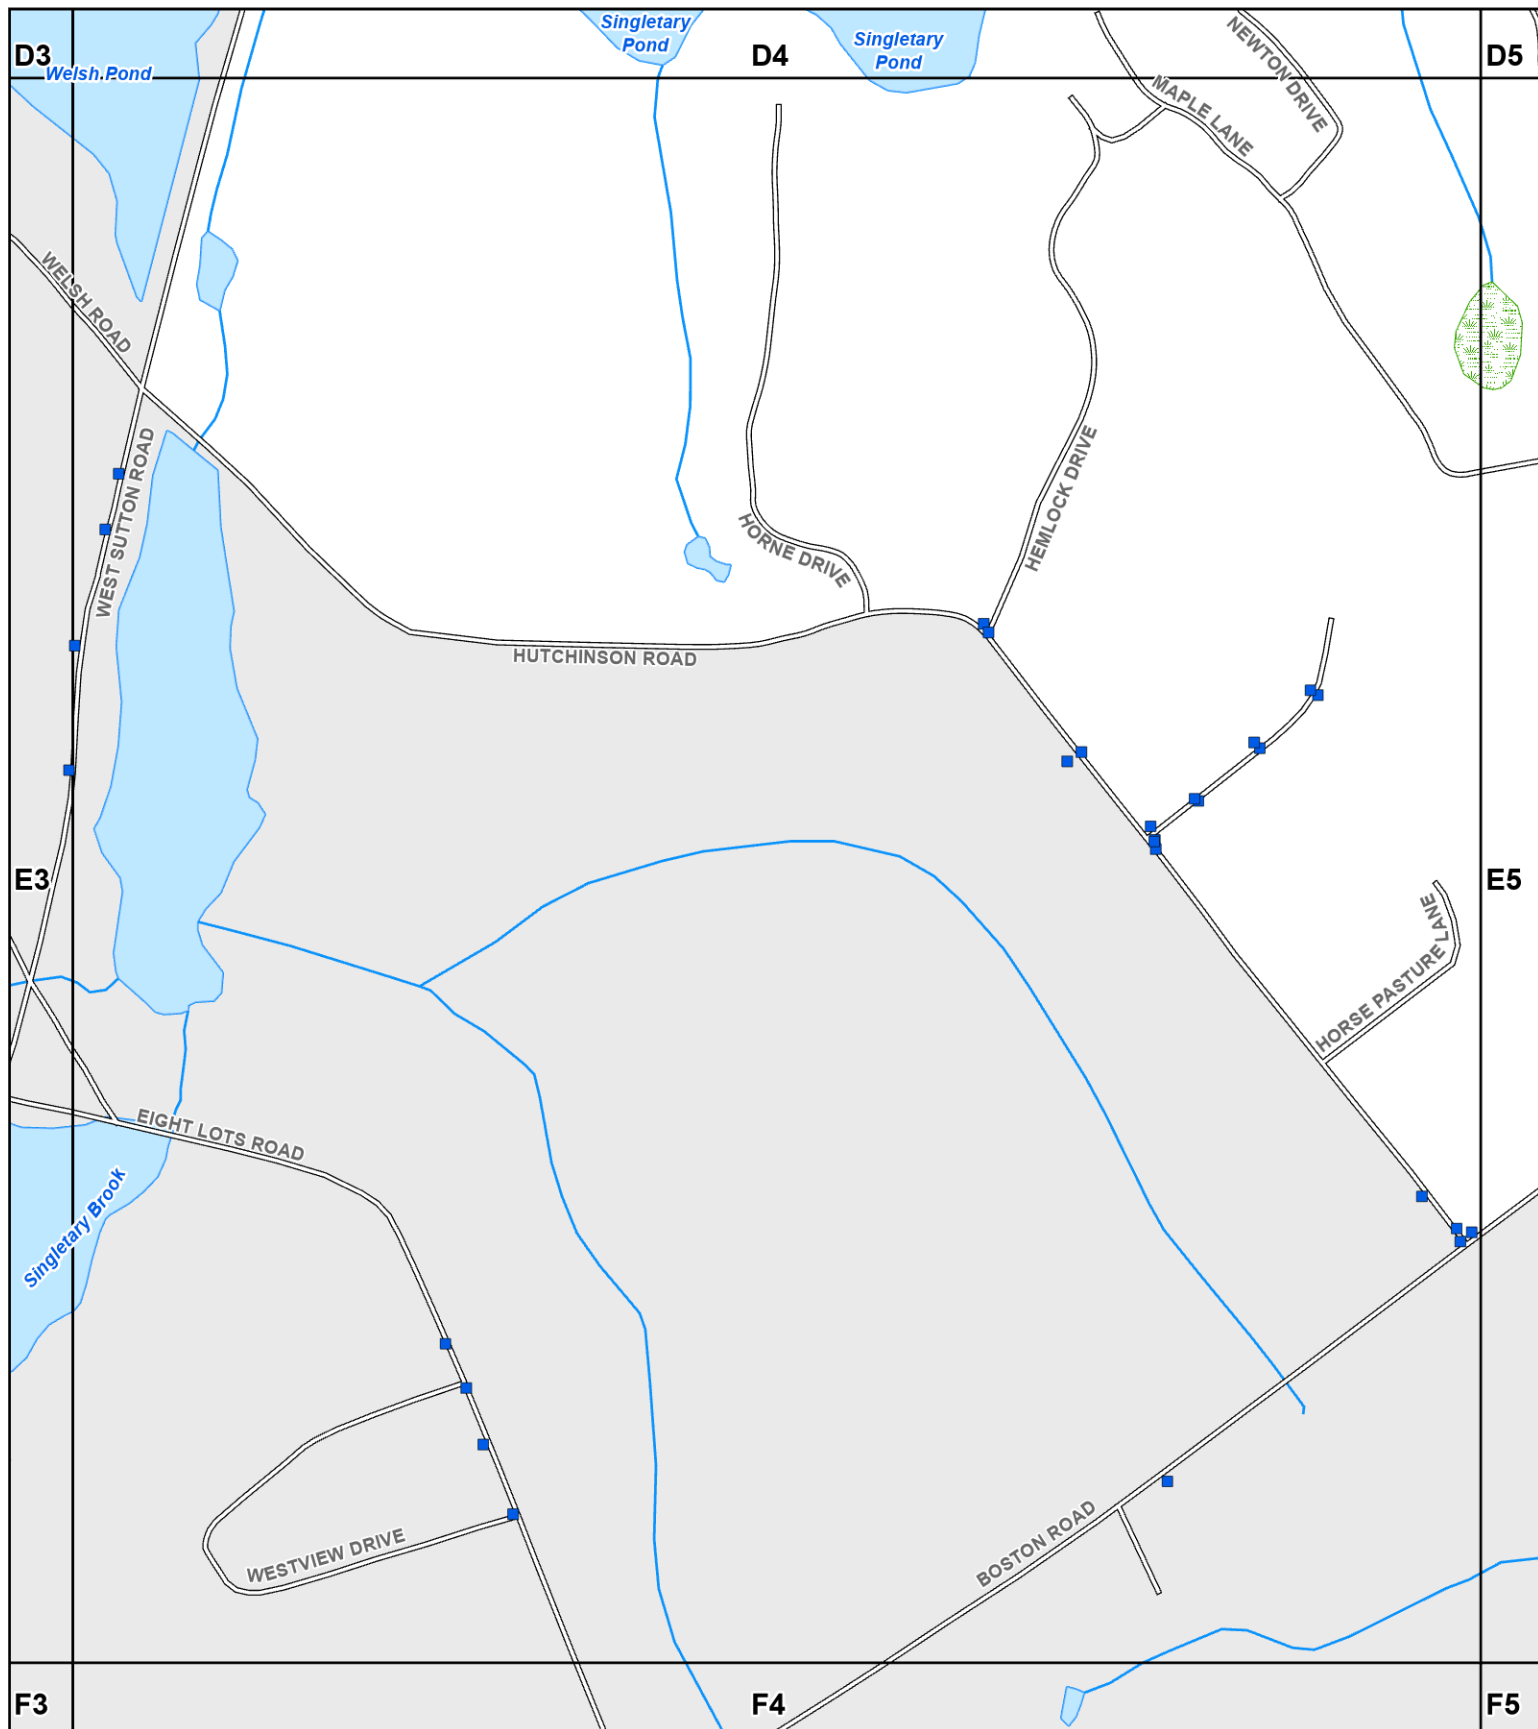


E3



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









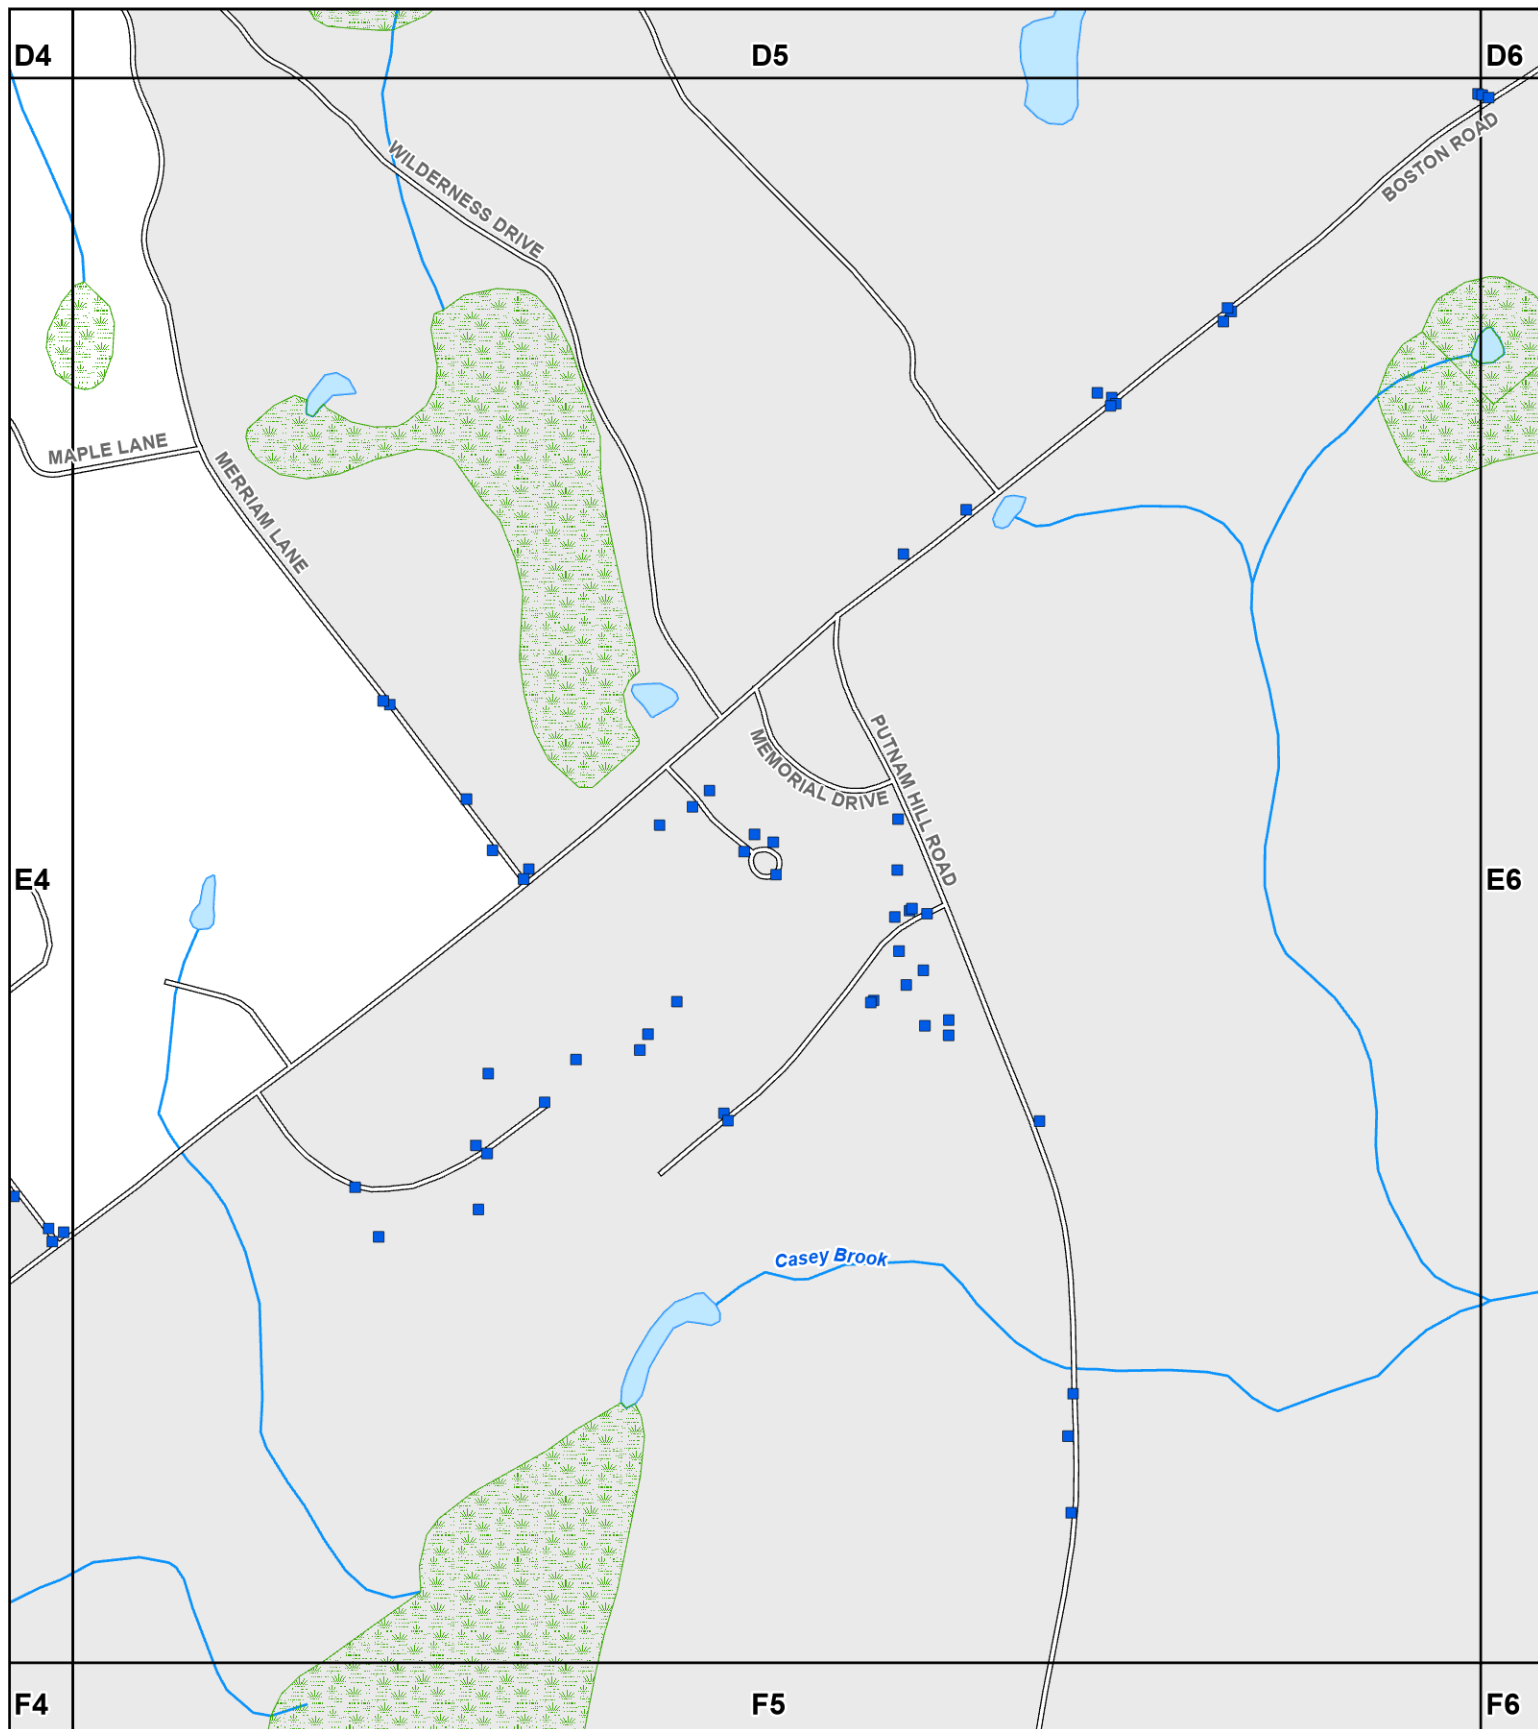


SHEET
E4



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA

0 100 200 300
Yards


Data Sources: MassGIS, Town of Sutton, CEI



SHEET
E5




**Comprehensive
Environmental
Incorporated**

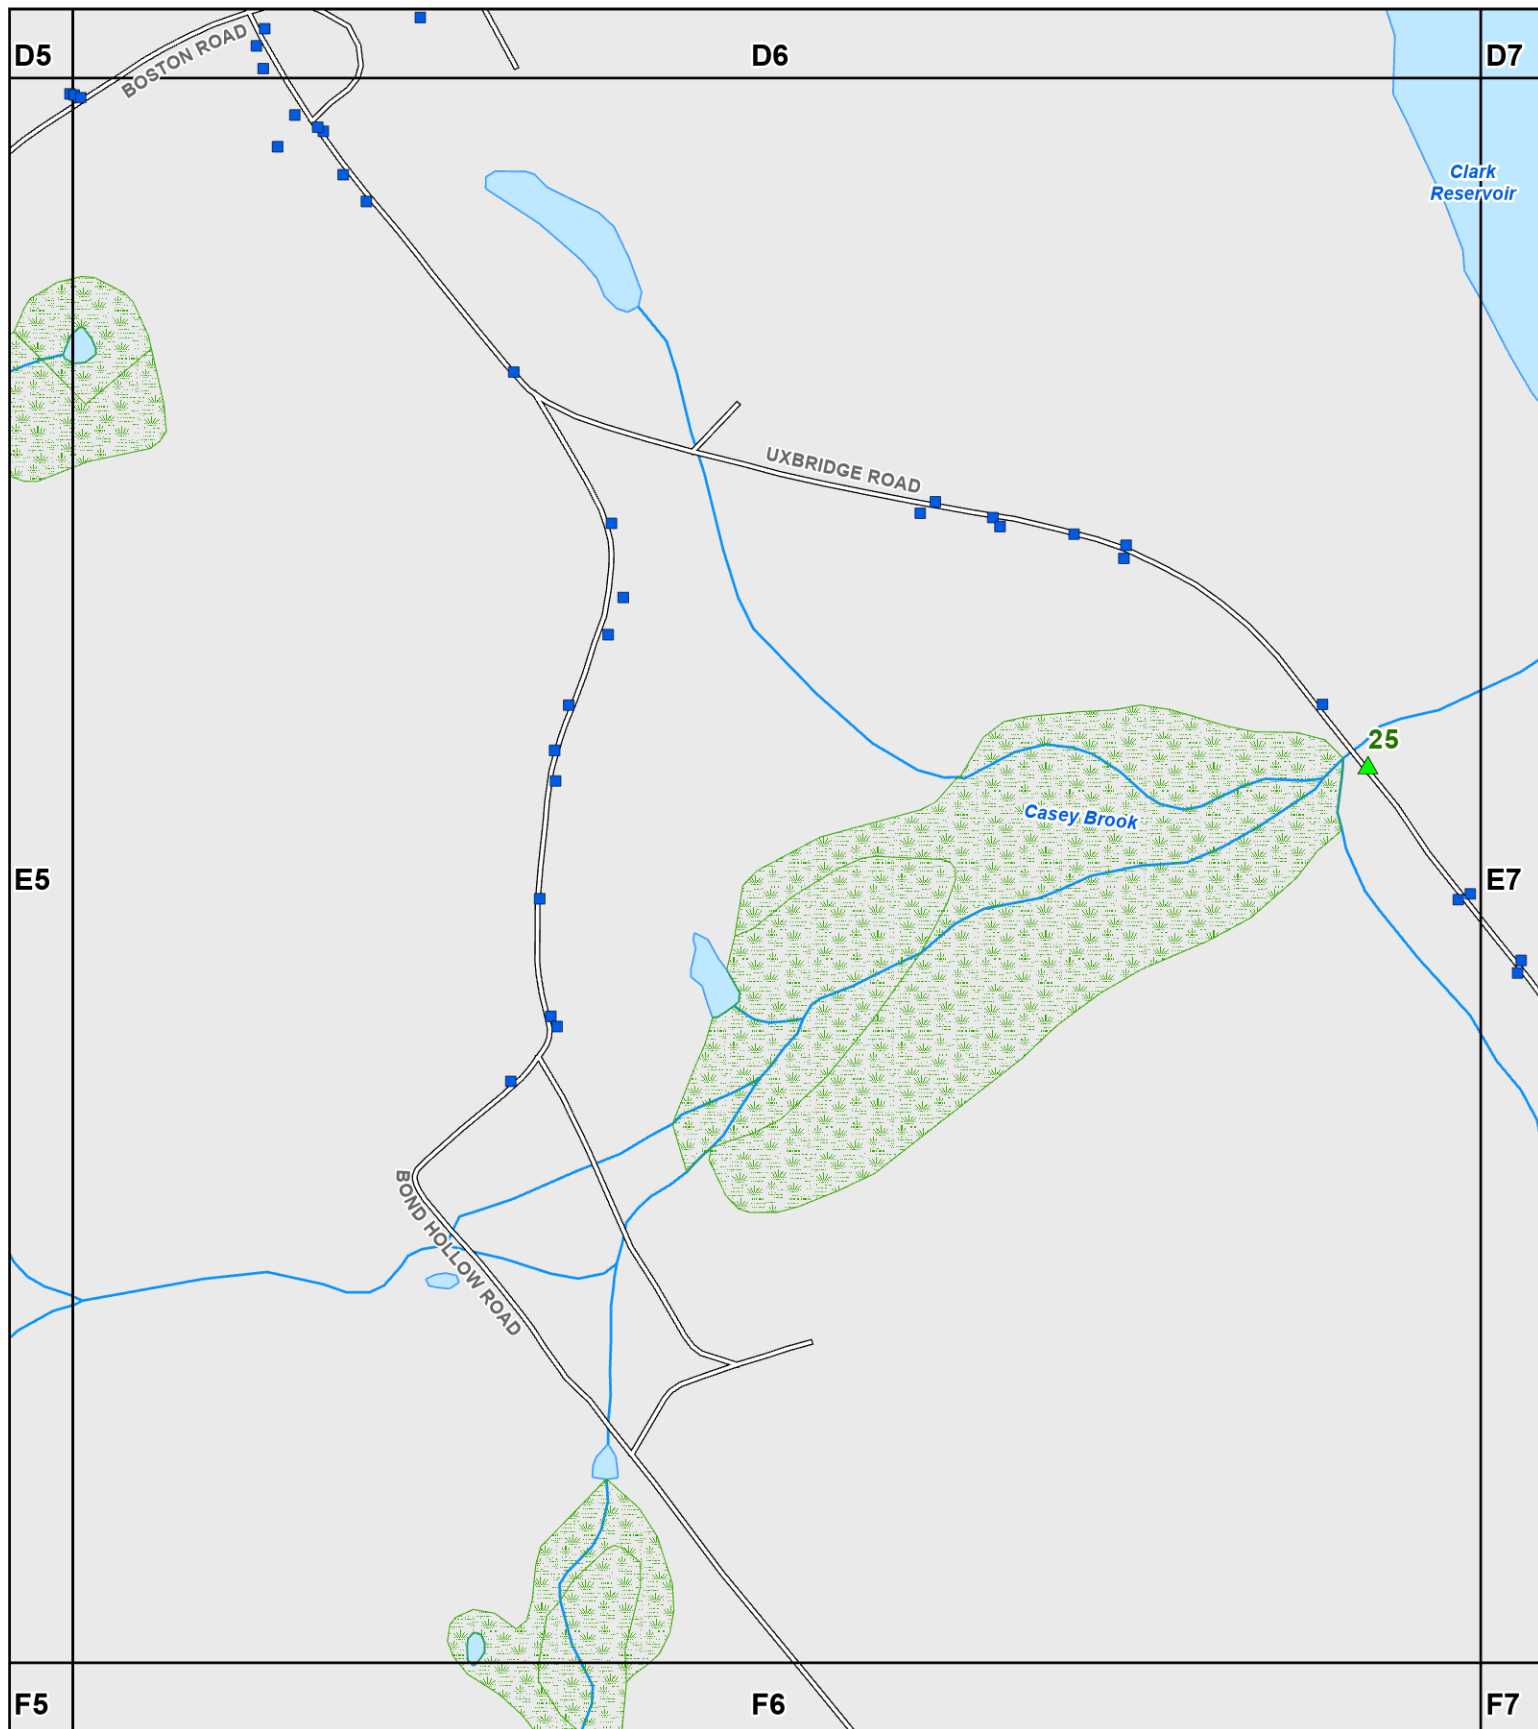

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







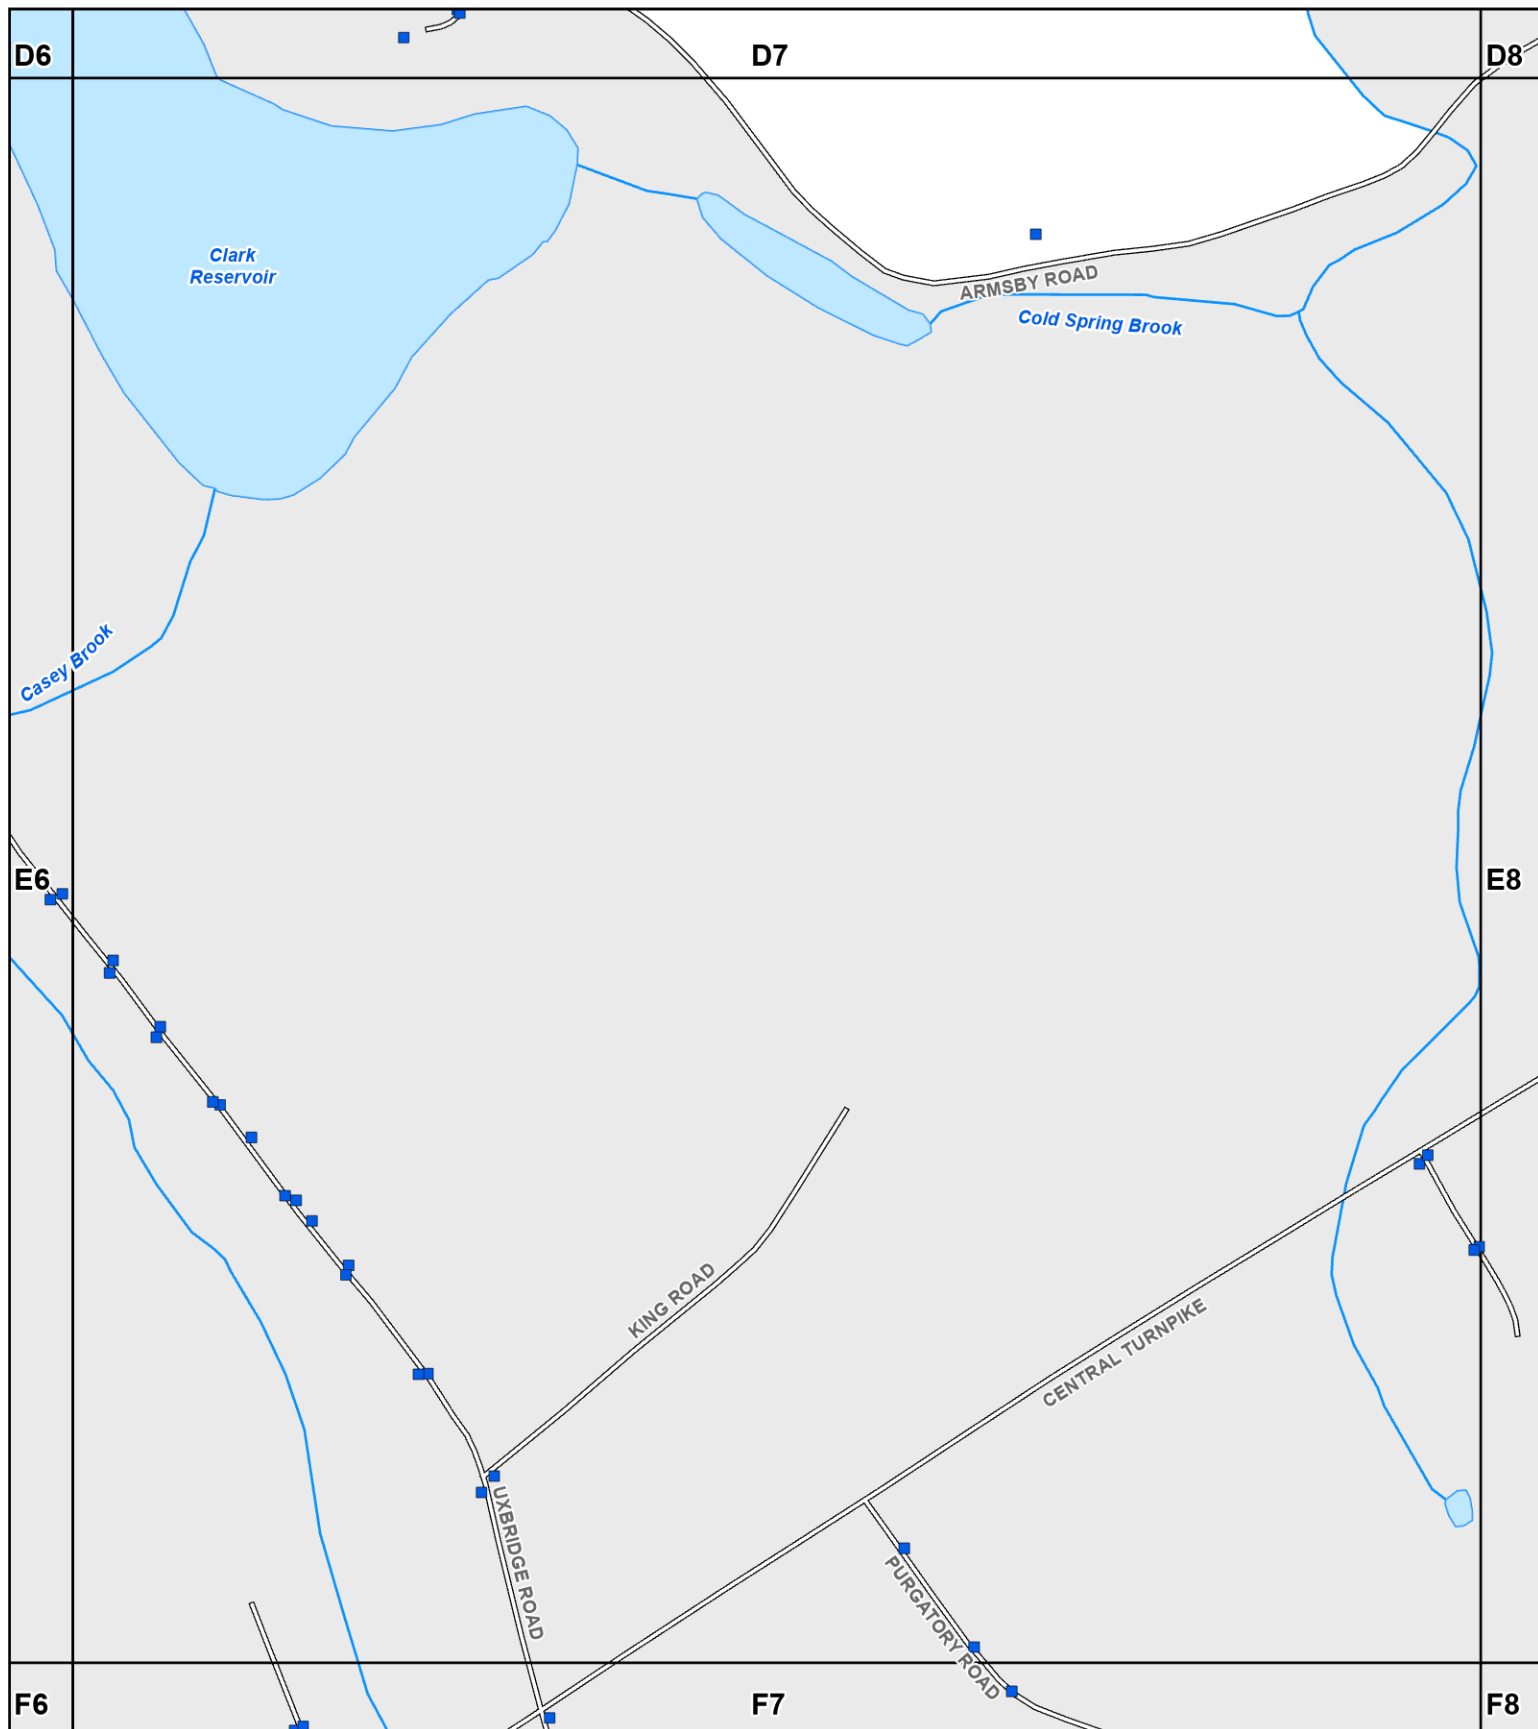


E6



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI












SHEET
E7



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA

0 100 200 300
Yards

Data Sources: MassGIS, Town of Sutton, CEI




SHEET







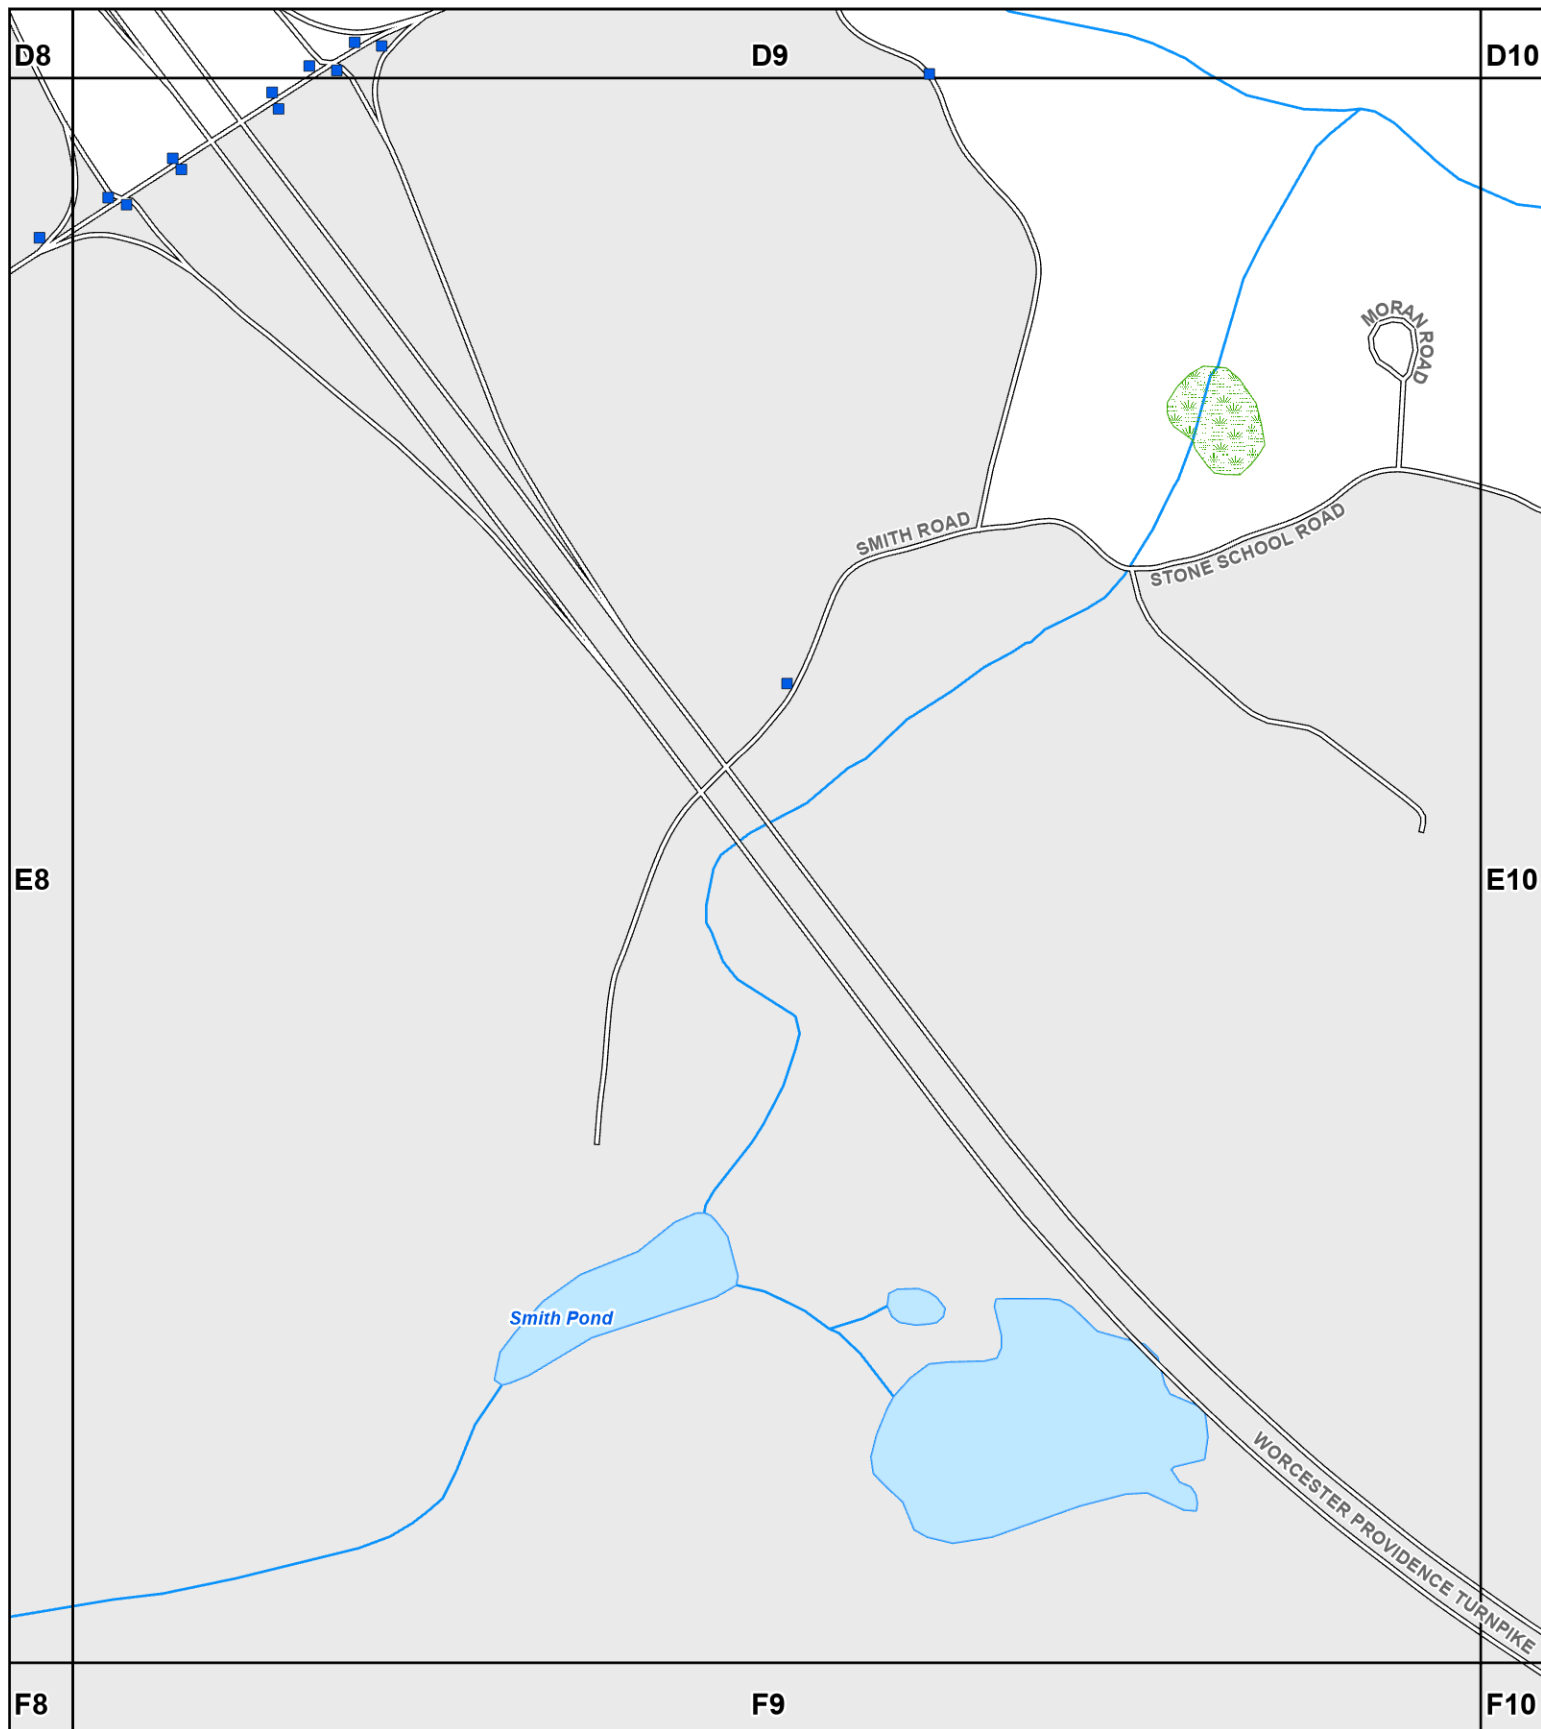


E8



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

E9



**Comprehensive
Environmental
Incorporated**

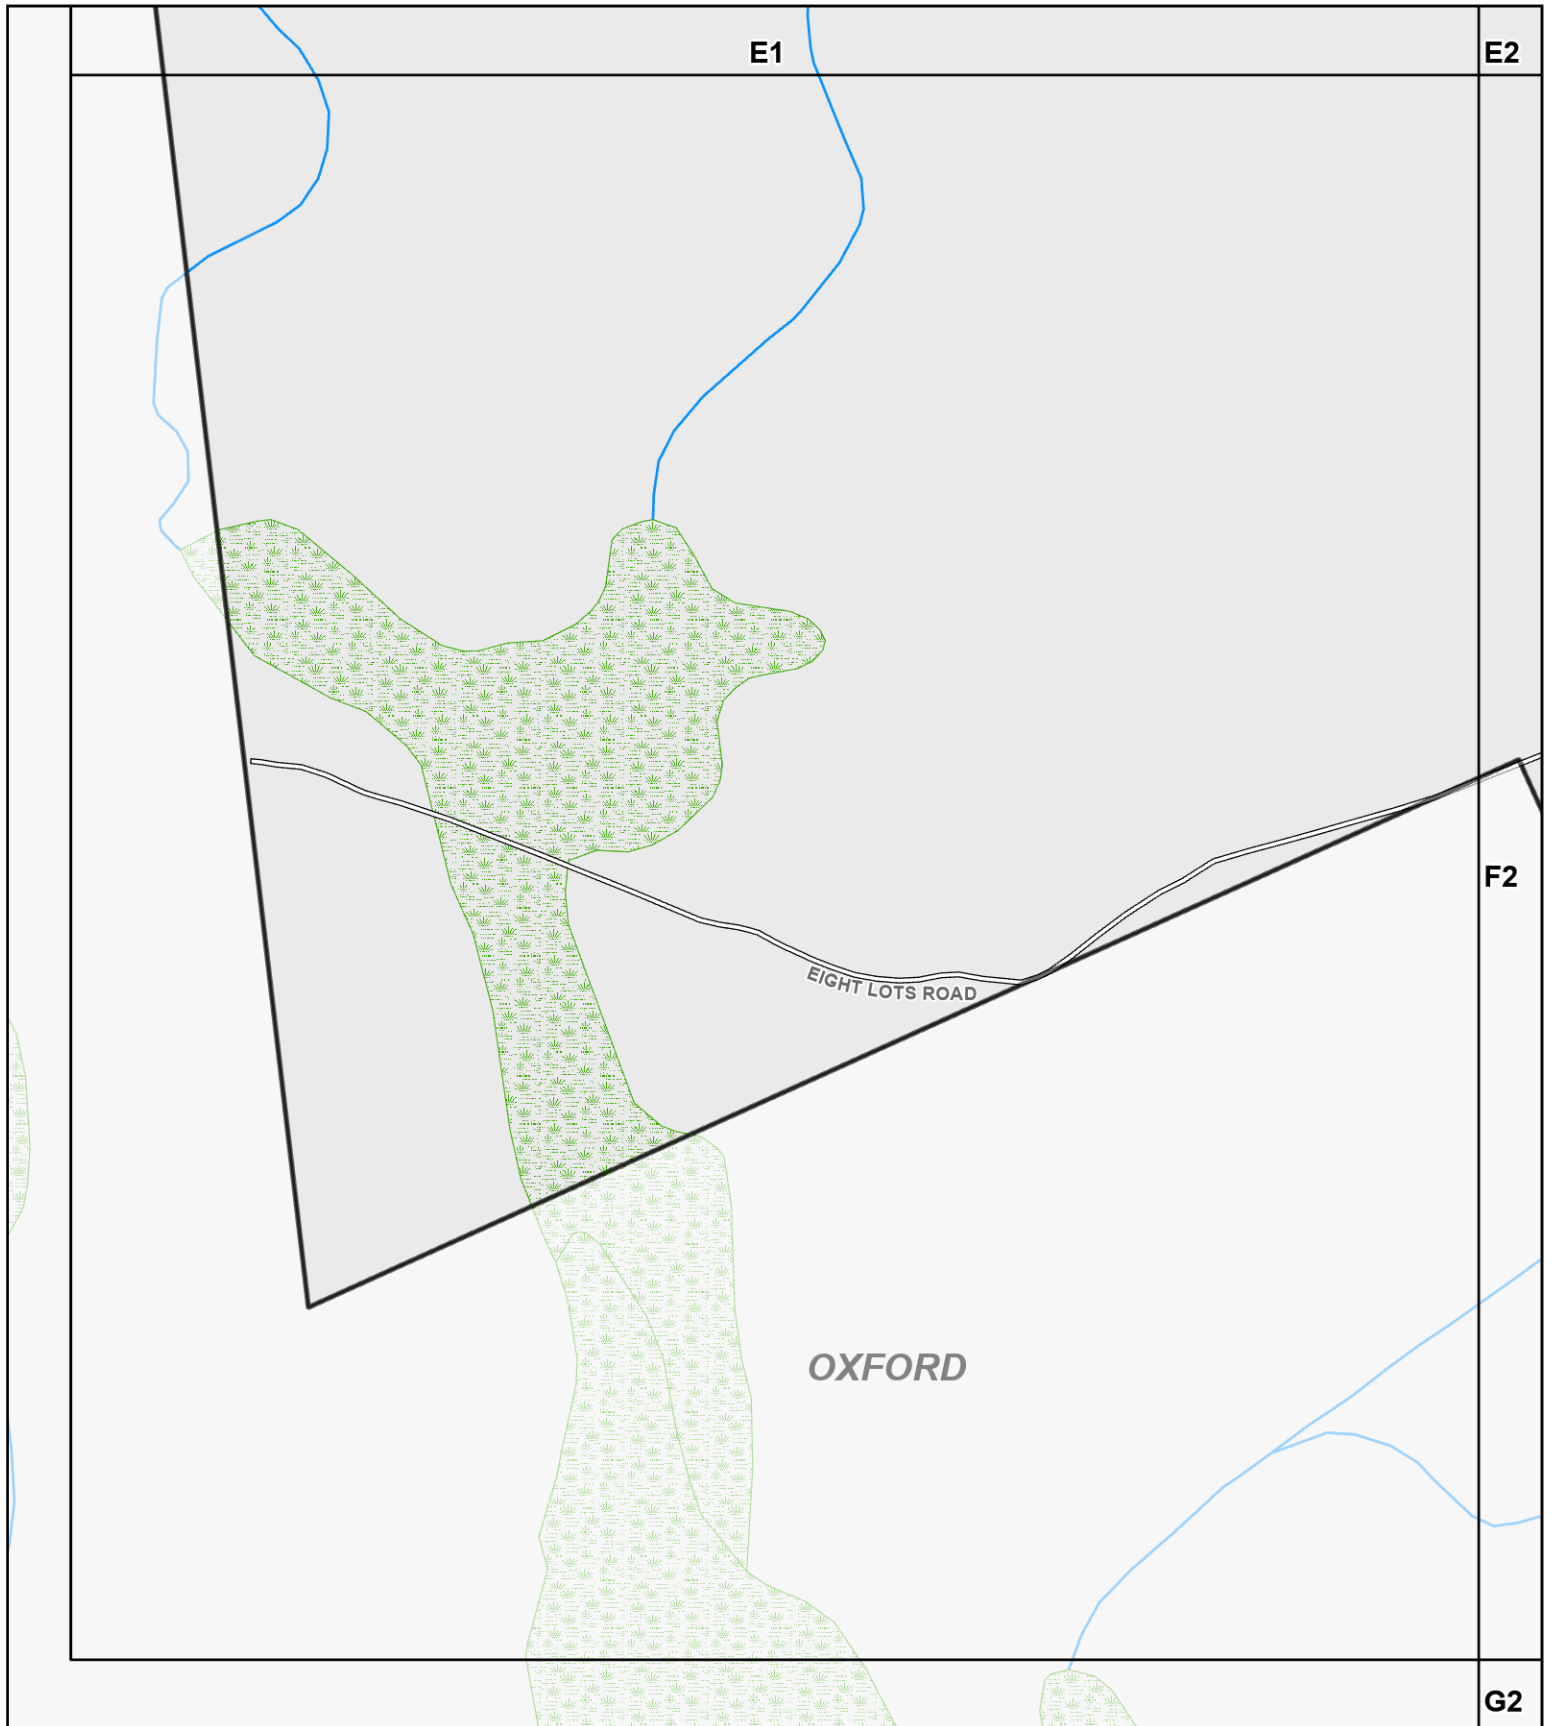

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







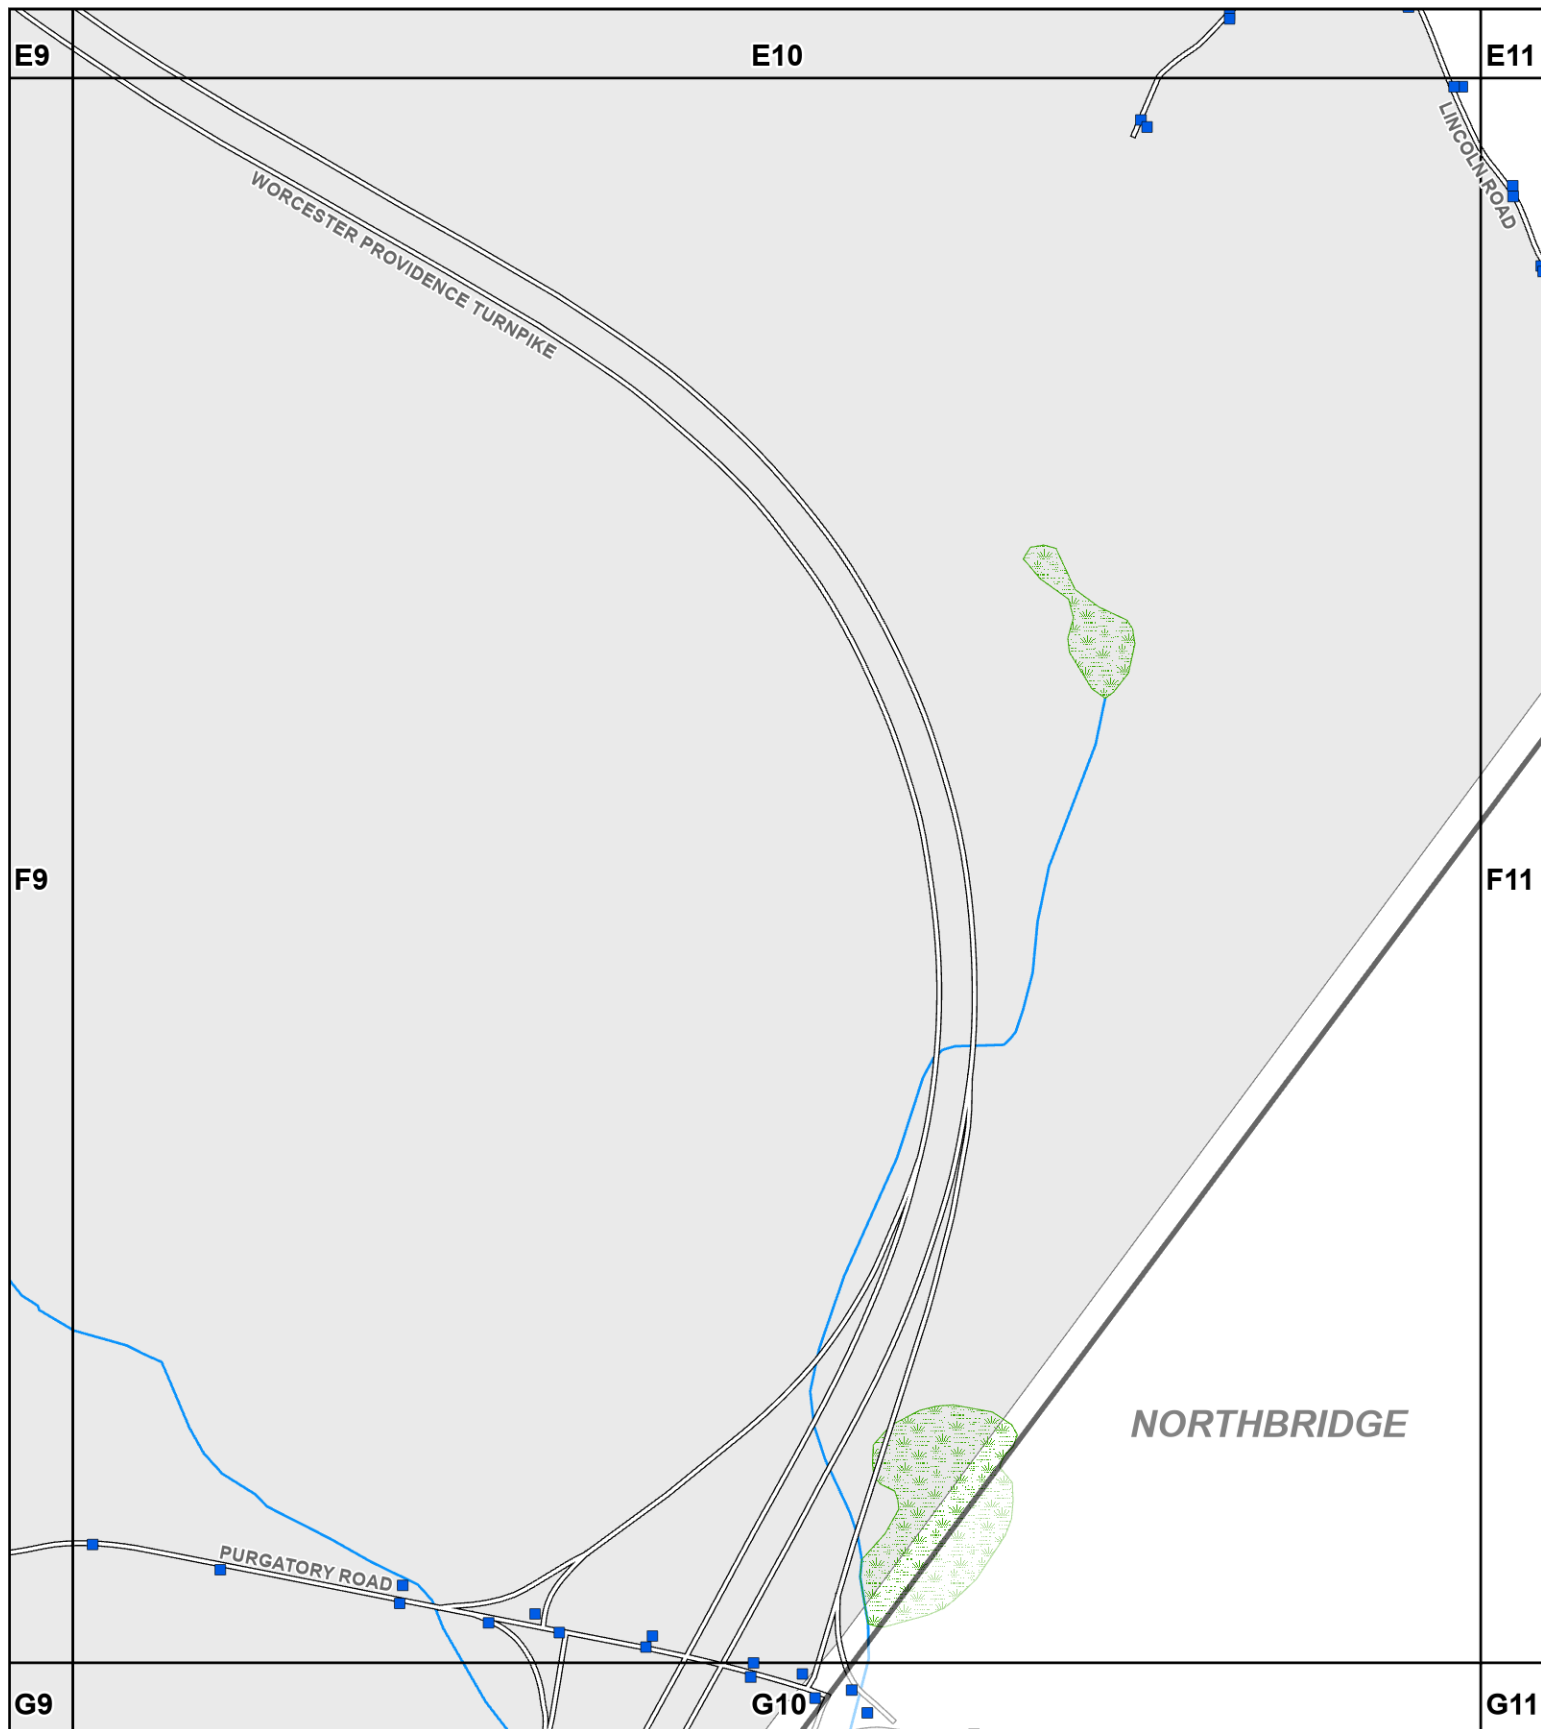


F1



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







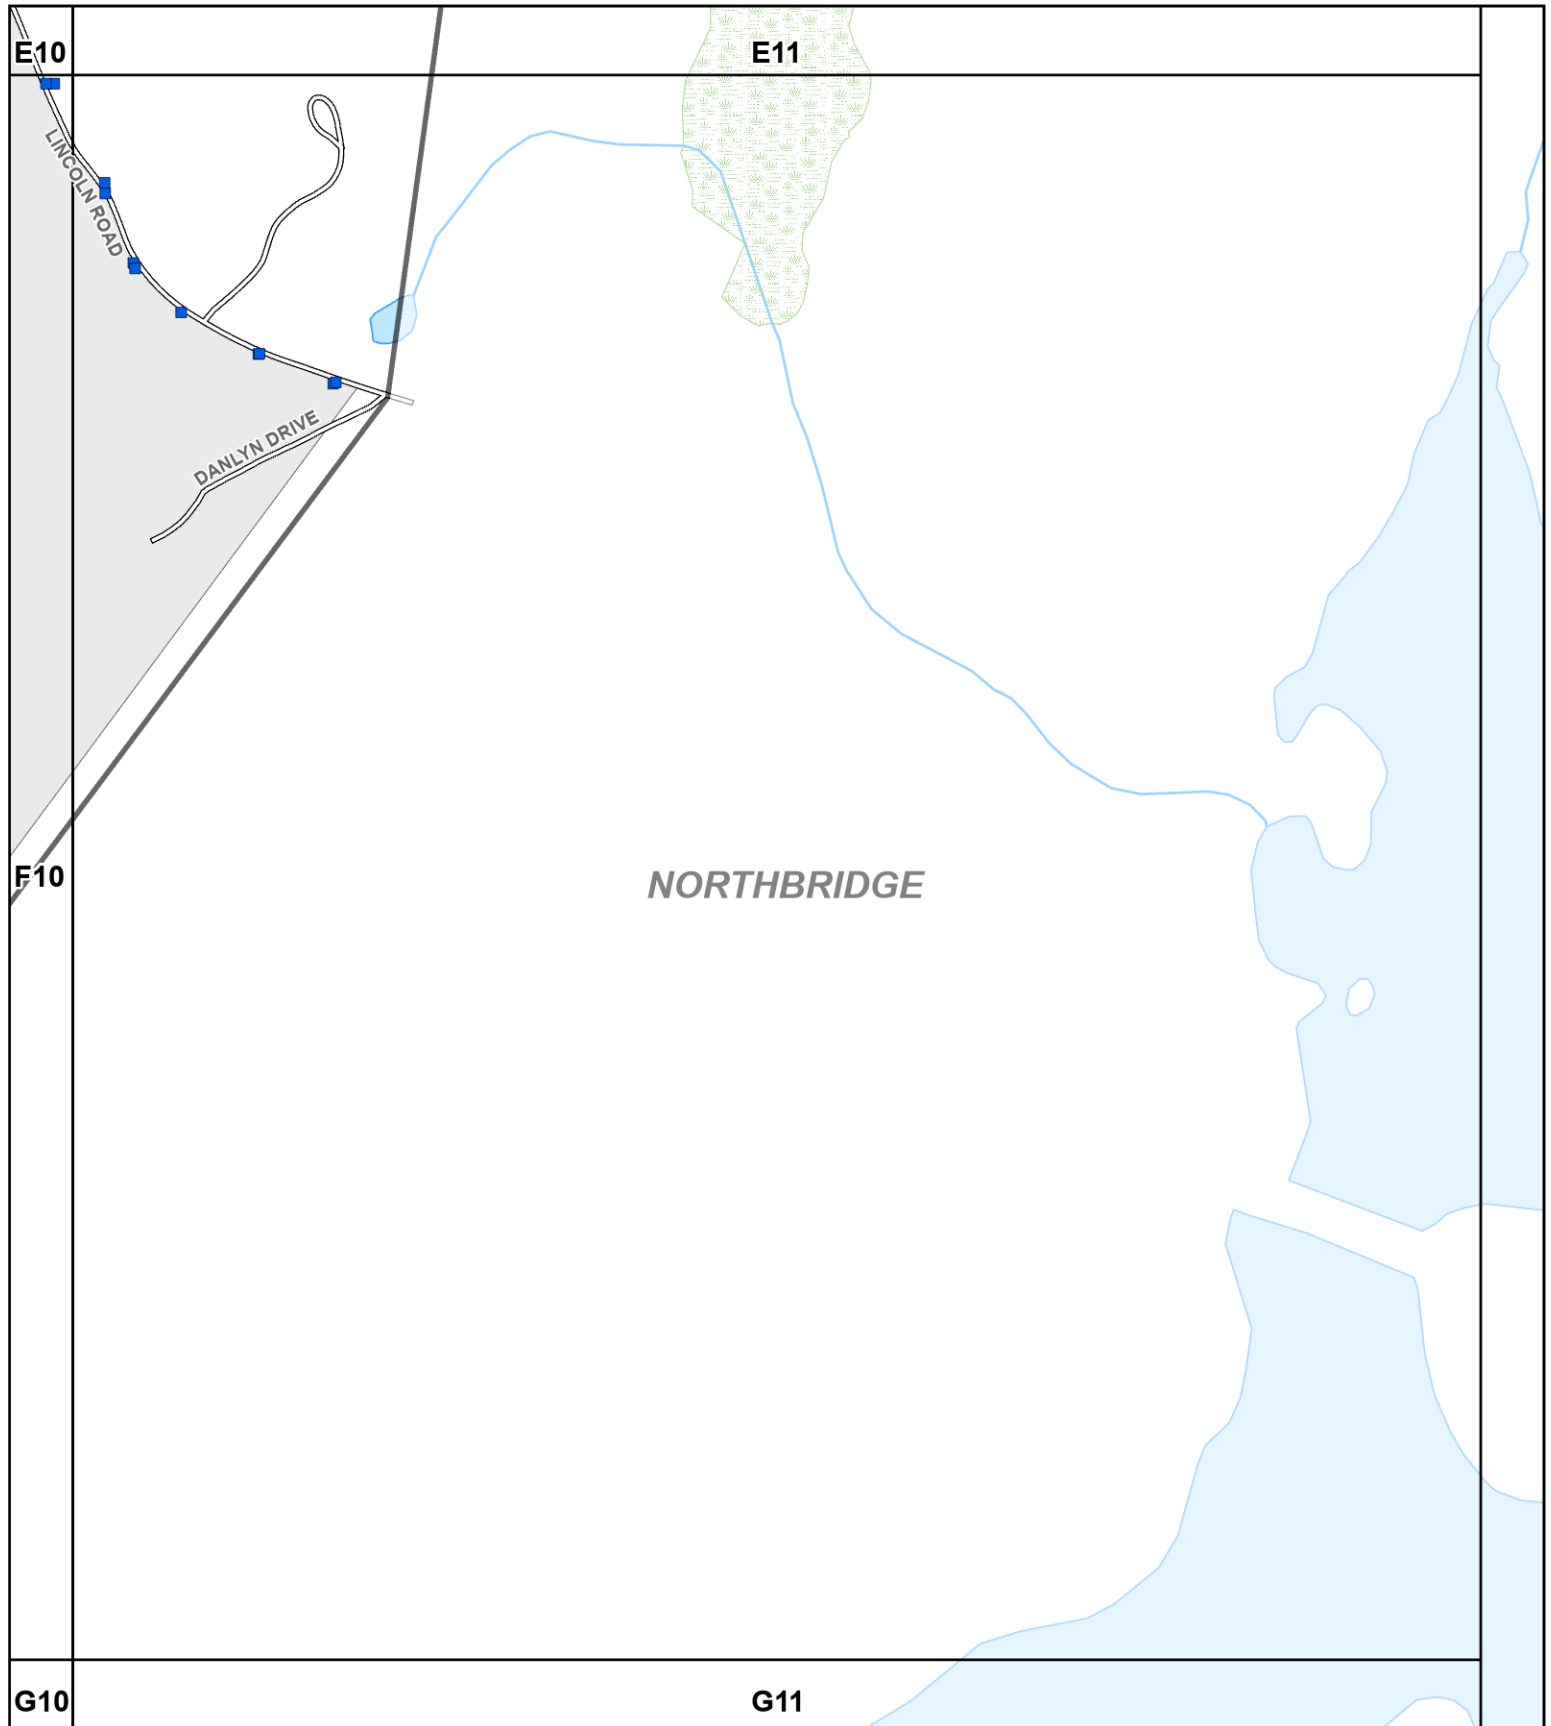


F10




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







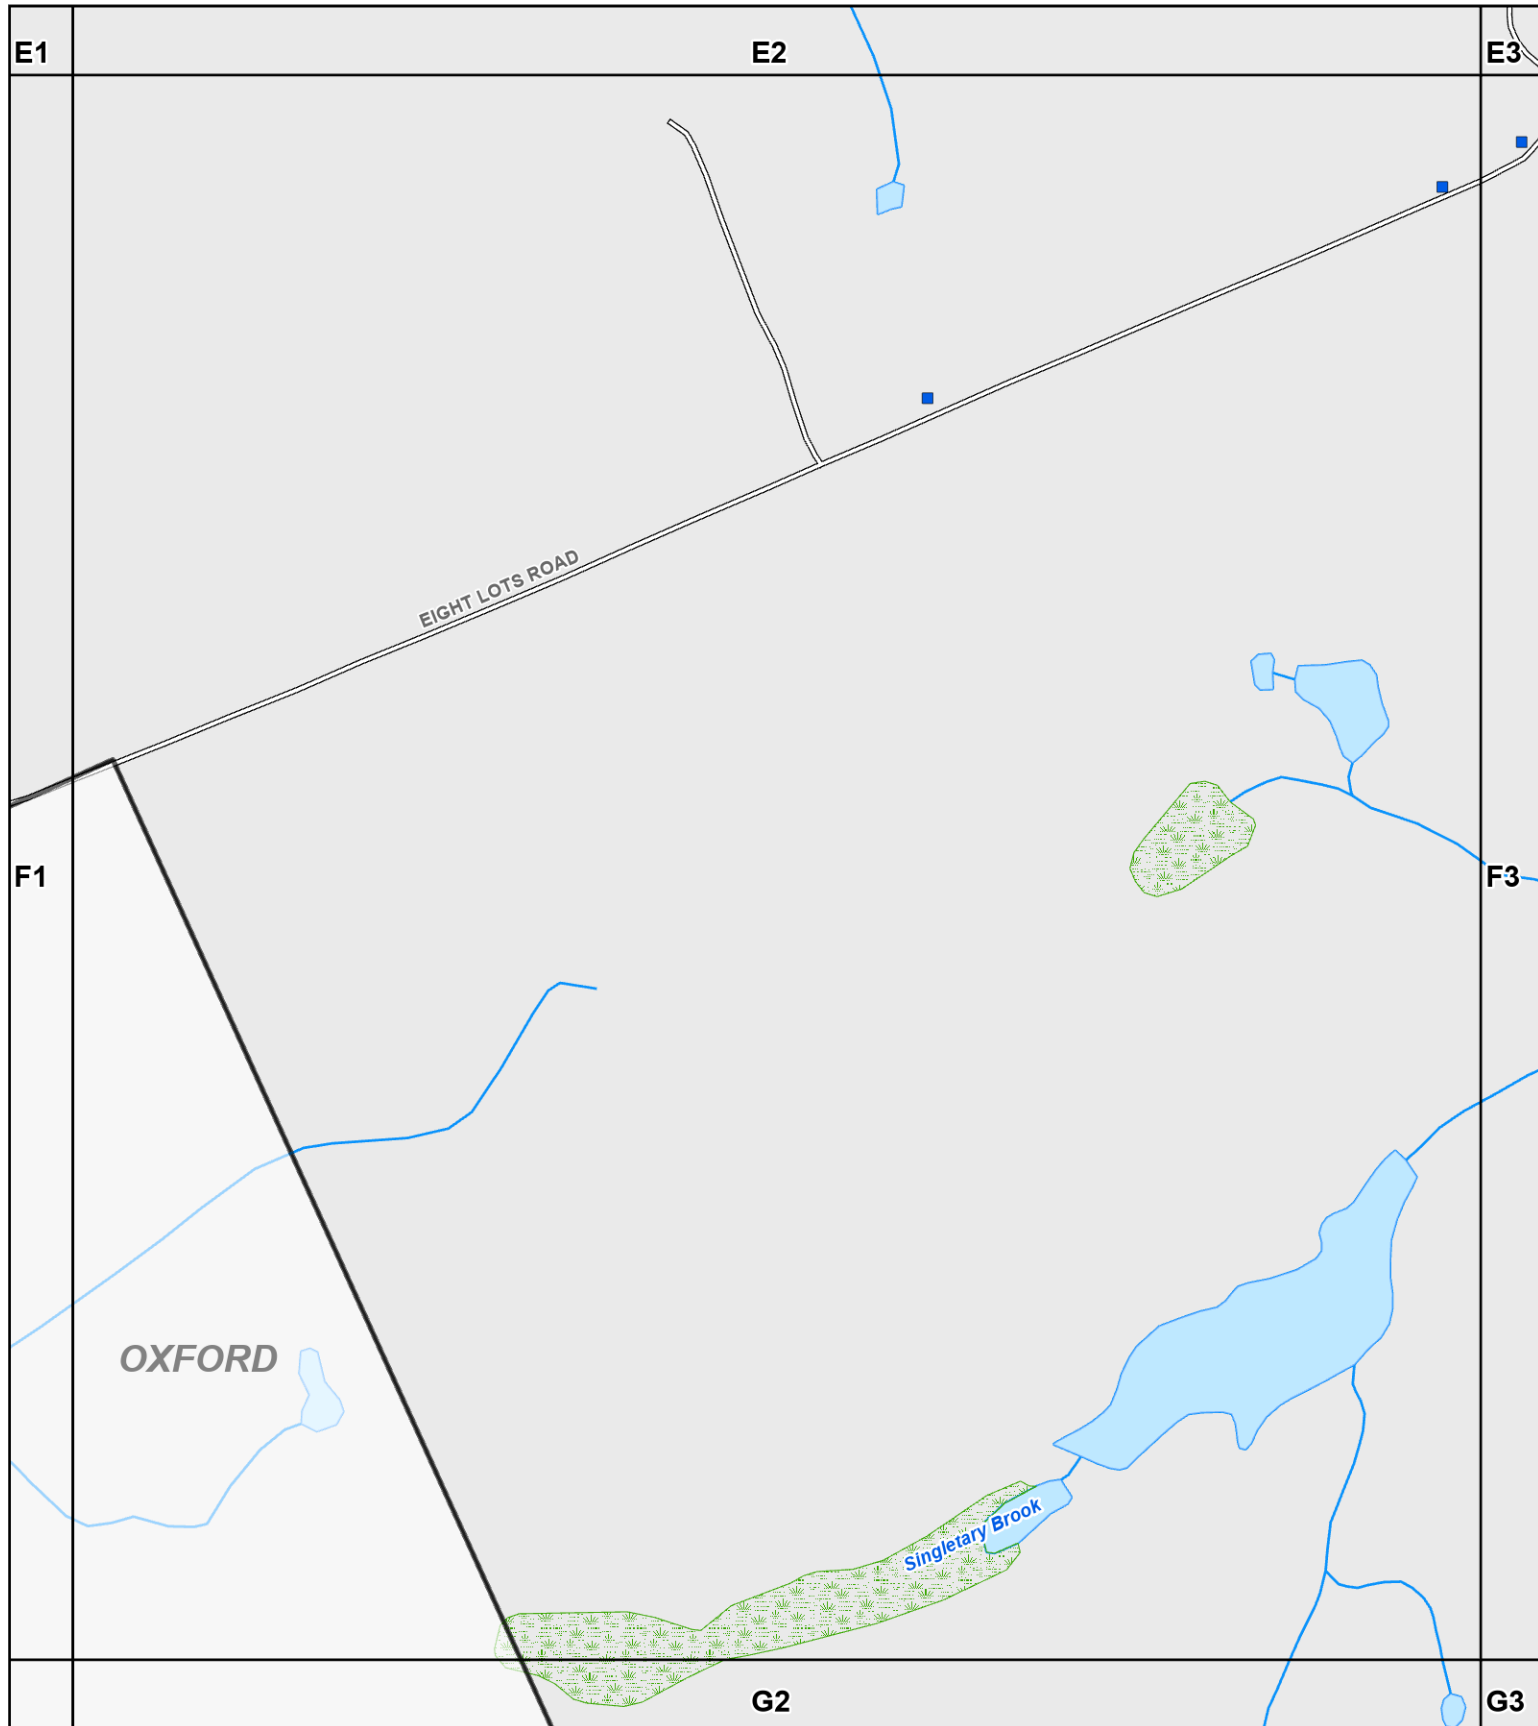


F11




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

F2



**Comprehensive
Environmental
Incorporated**

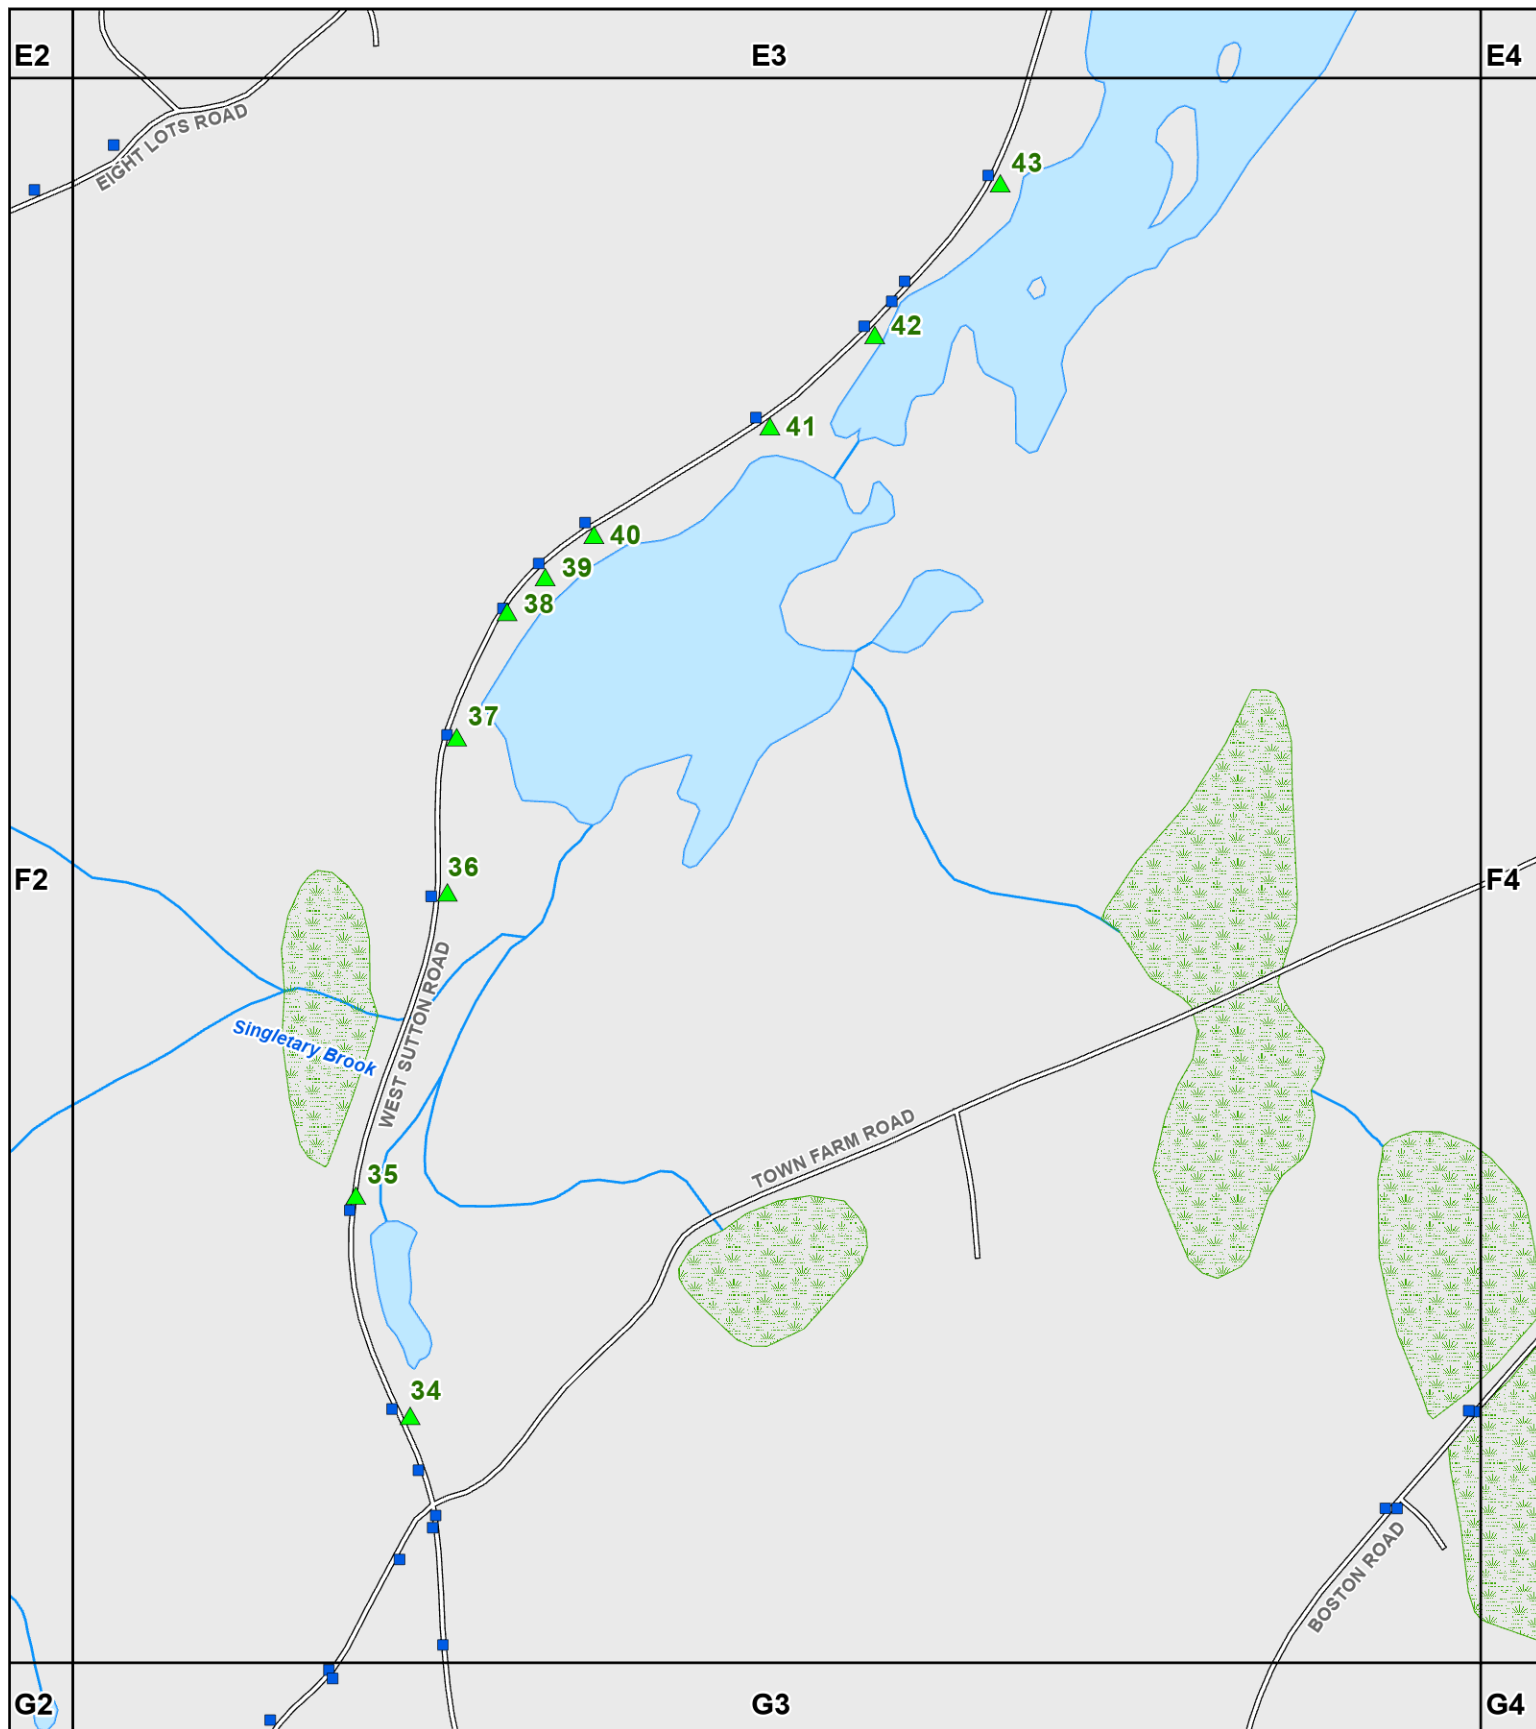

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA

0 100 200 300
Yards


Data Sources: MassGIS, Town of Sutton, CEI









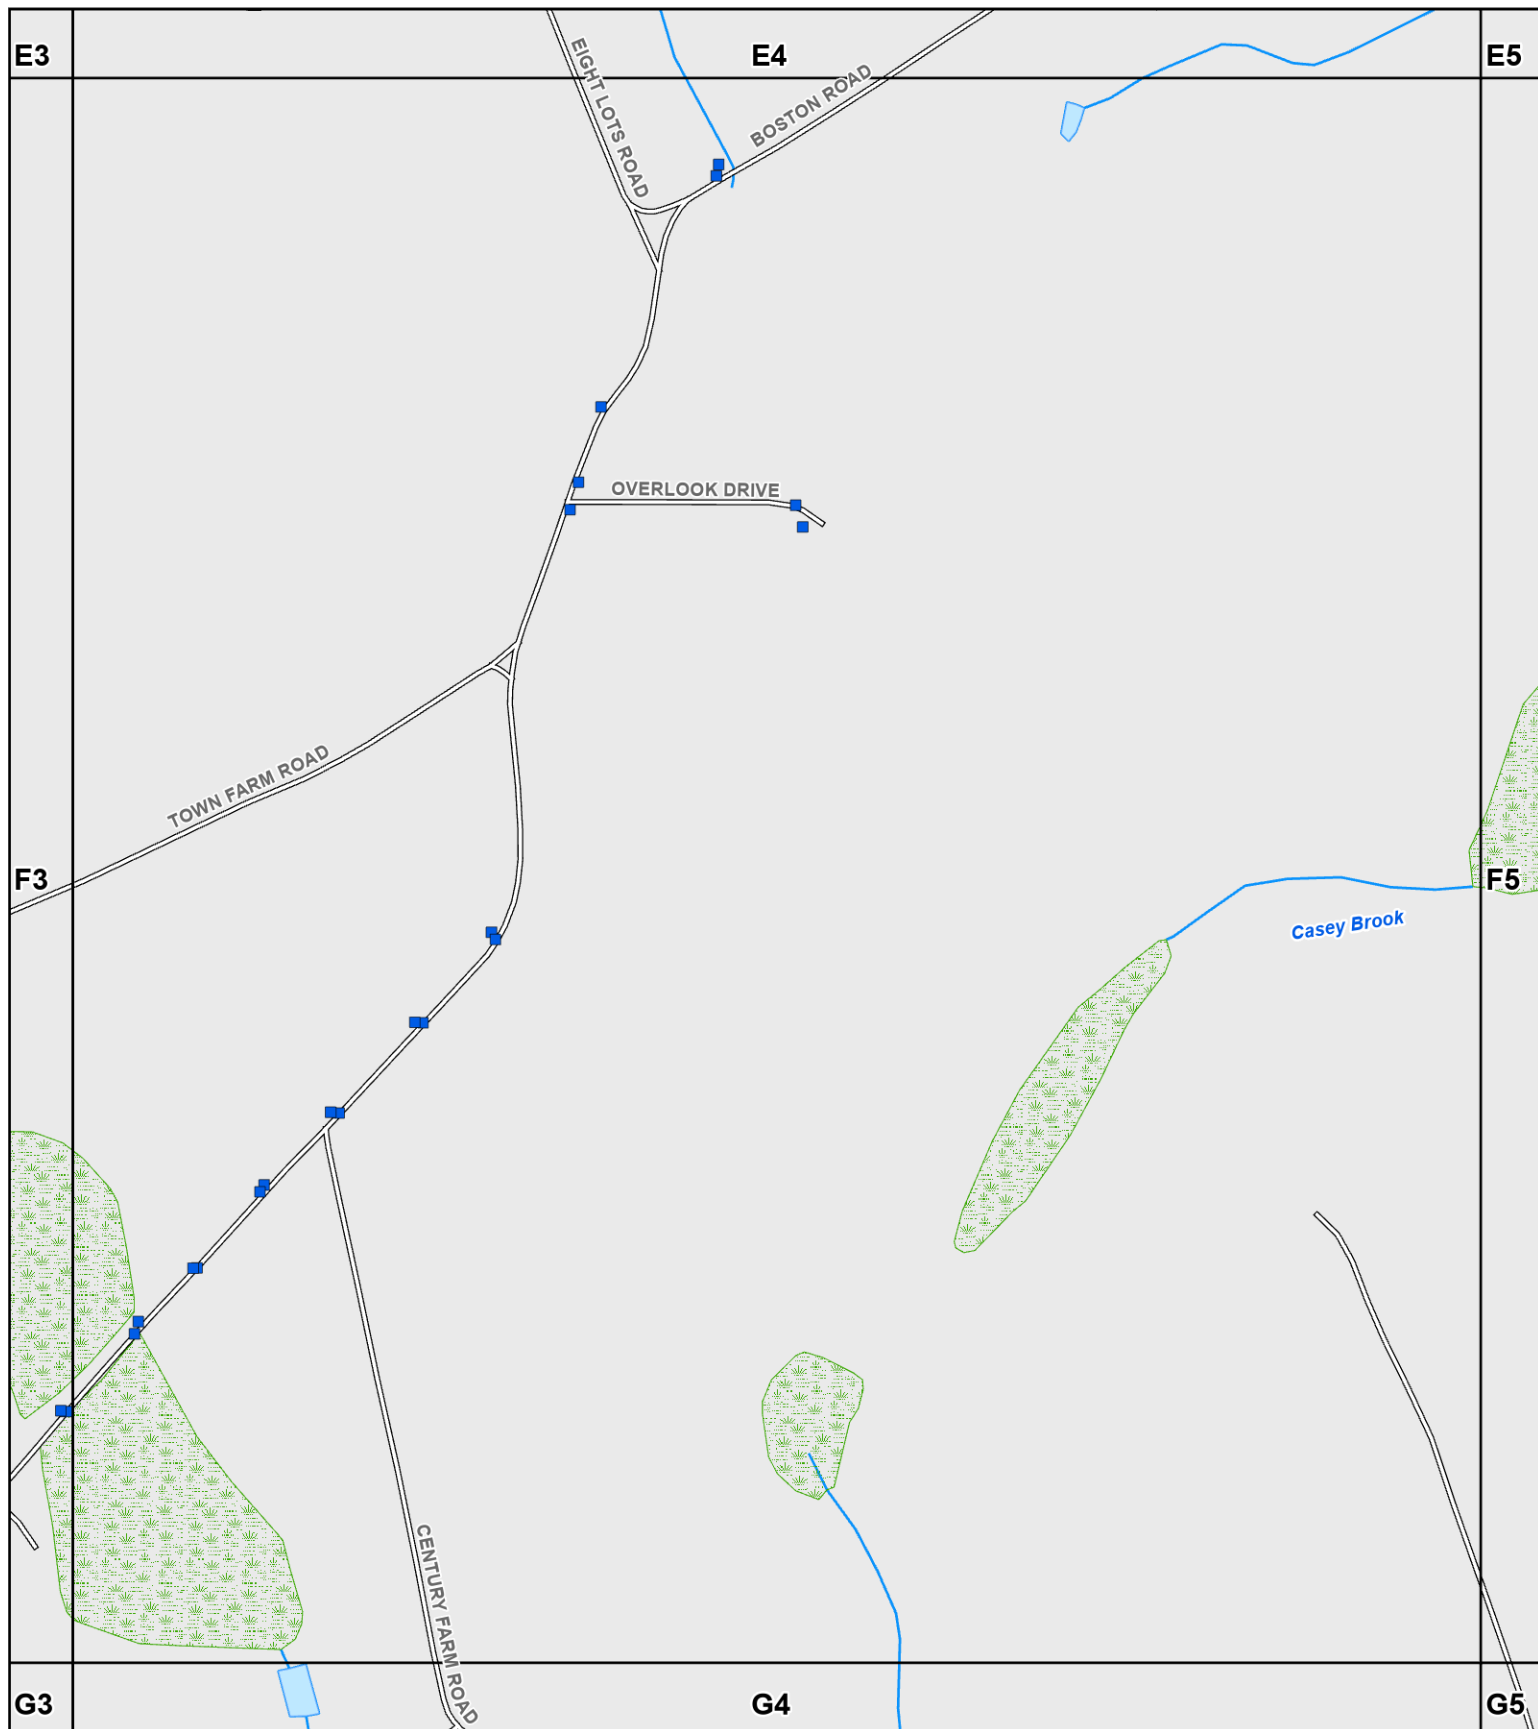


SHEET
F3



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

F4



Comprehensive
Environmental
Incorporated

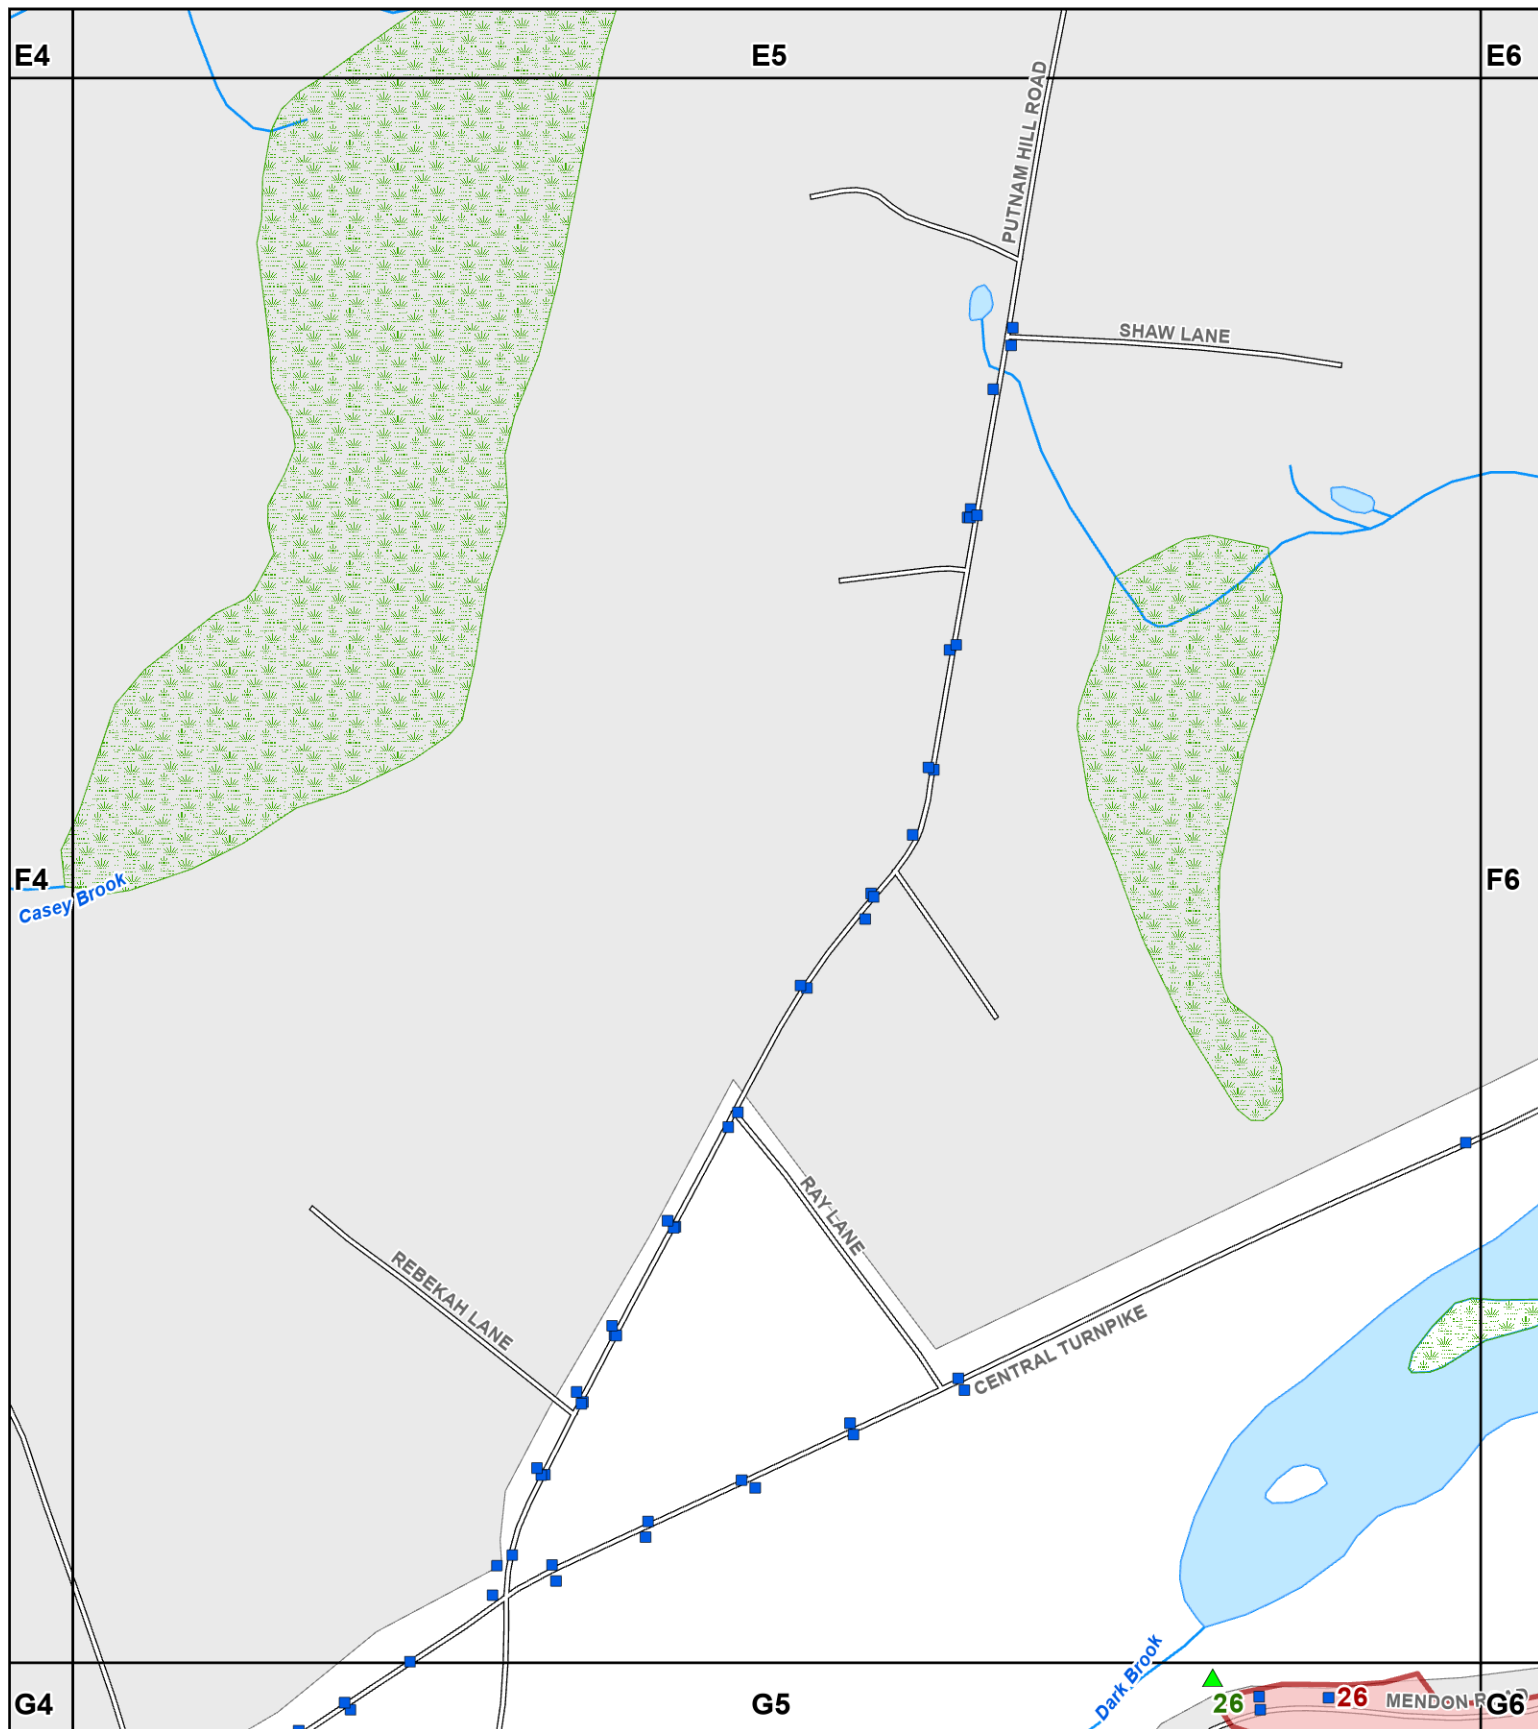

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









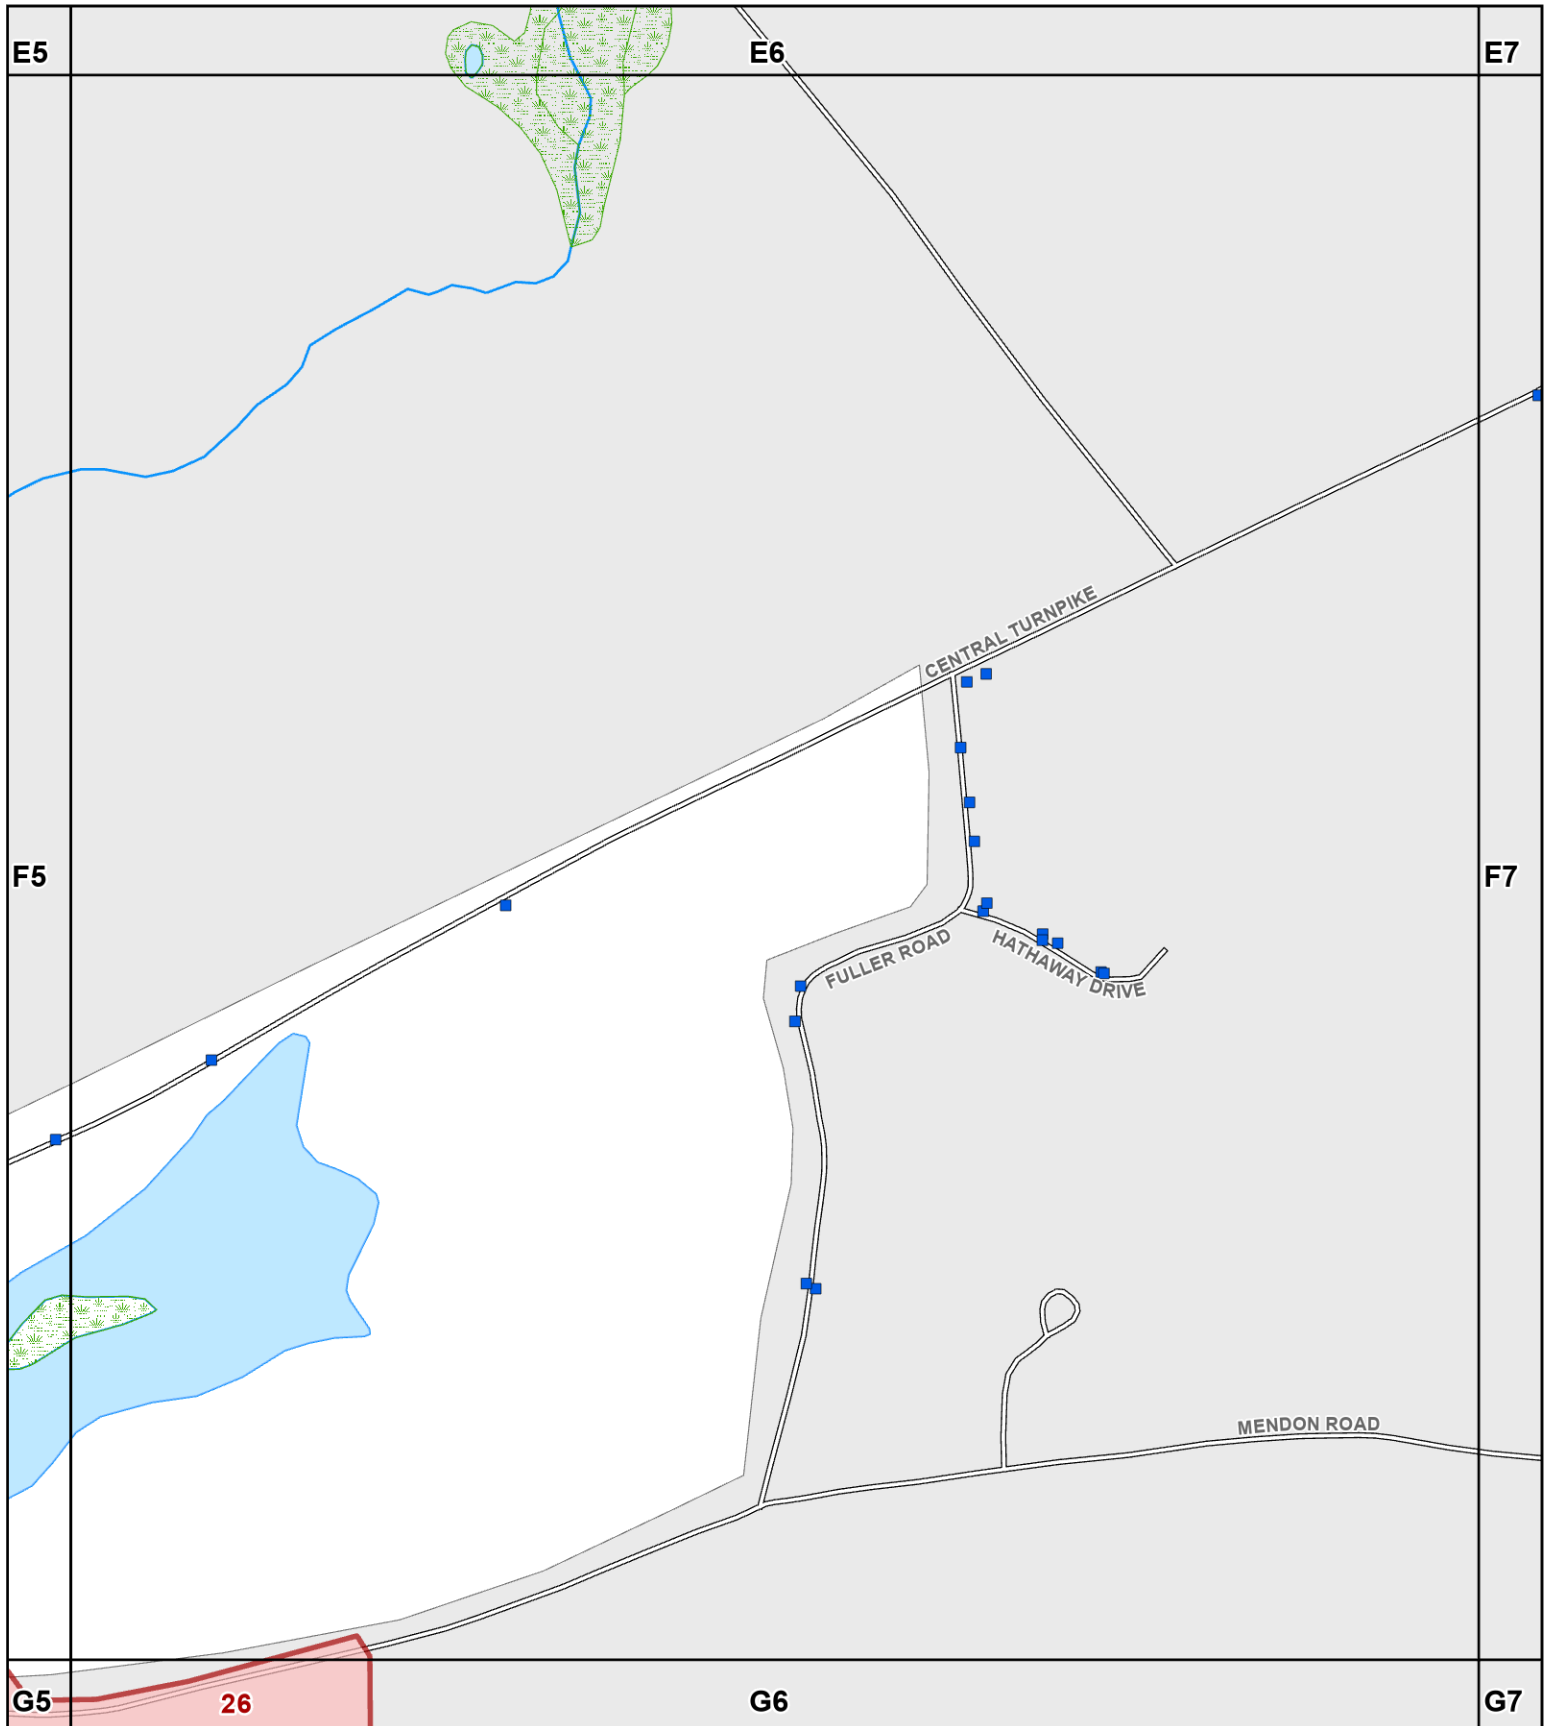


SHEET
F5



**Comprehensive
Environmental
Incorporated**



Legend

- | | | | |
|---|------------------|---|-----------------------|
|  | Outfall |  | Lake, Pond, Reservoir |
|  | Catch Basin |  | Wetland, Marsh, Swamp |
|  | Sewer Force Main |  | Stream, Brook |
|  | Sewer Pipe |  | Non-Urban Area |
|  | Catchments | | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







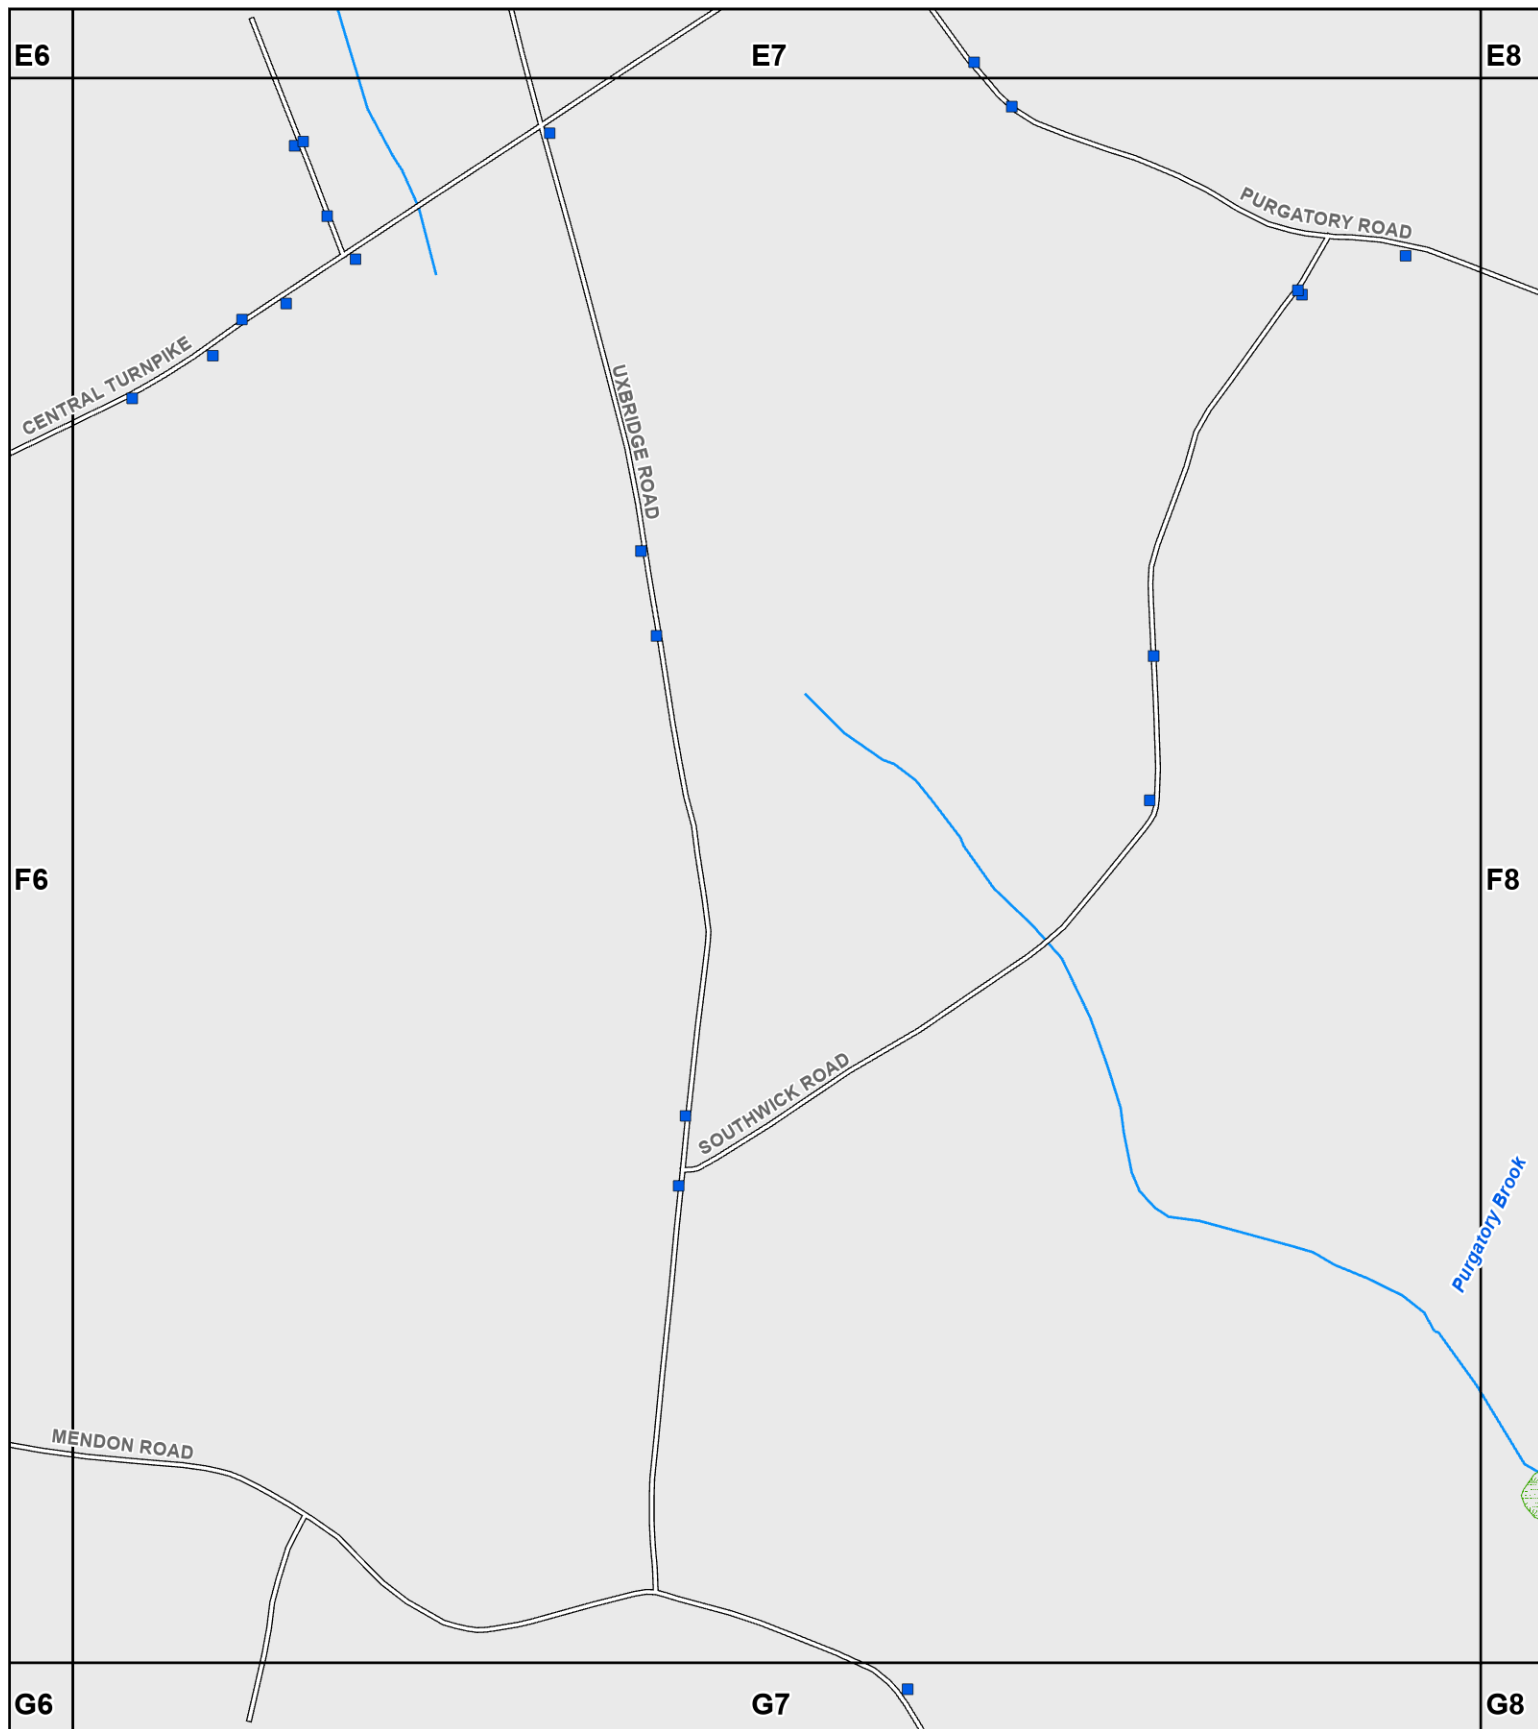


F6



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







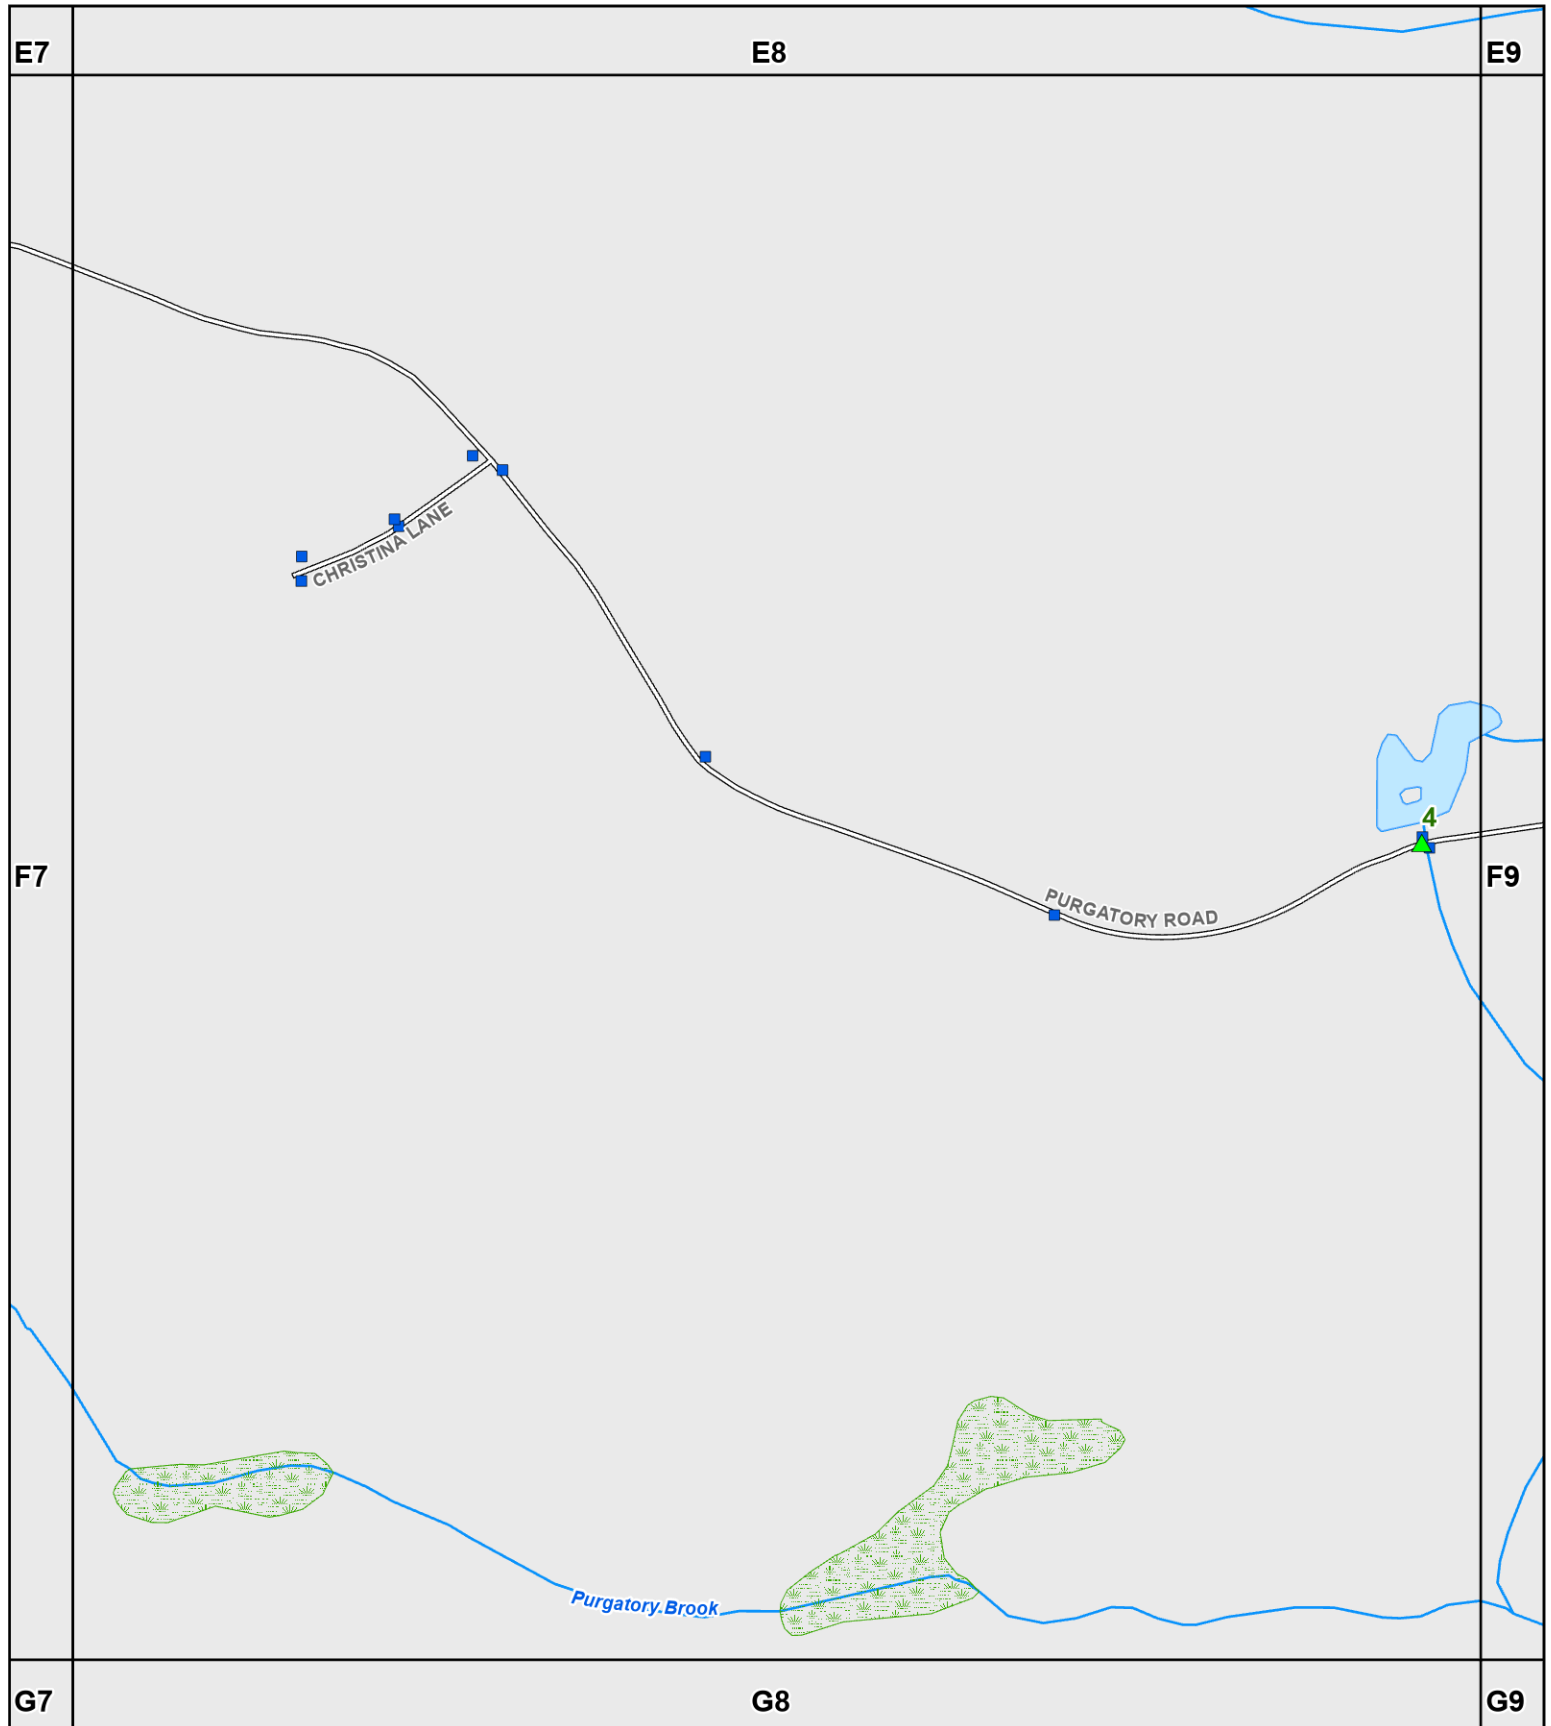


F7



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

F8




**Comprehensive
Environmental
Incorporated**

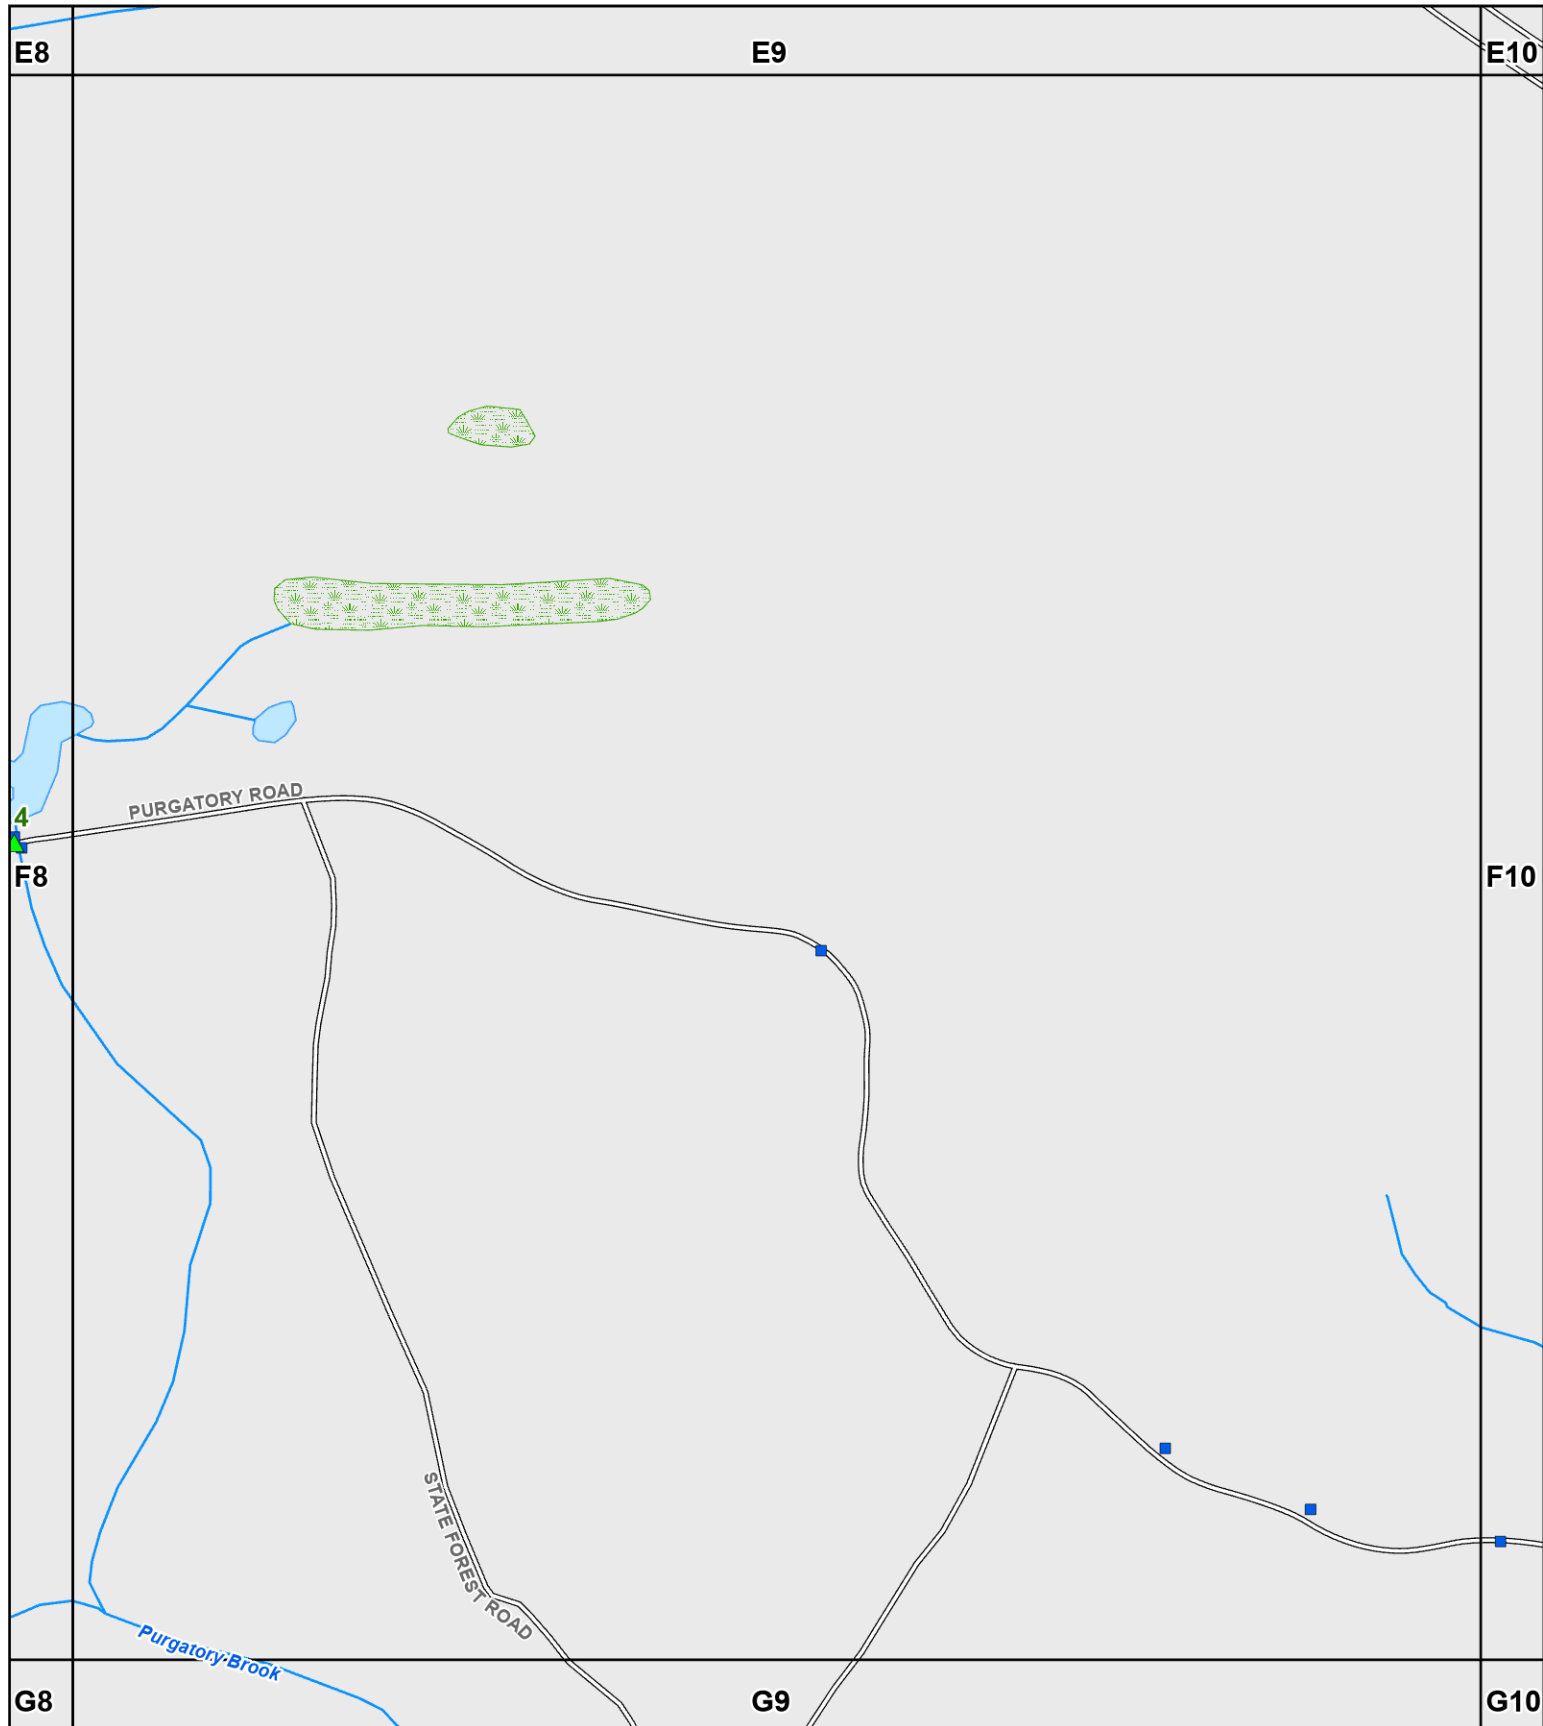

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







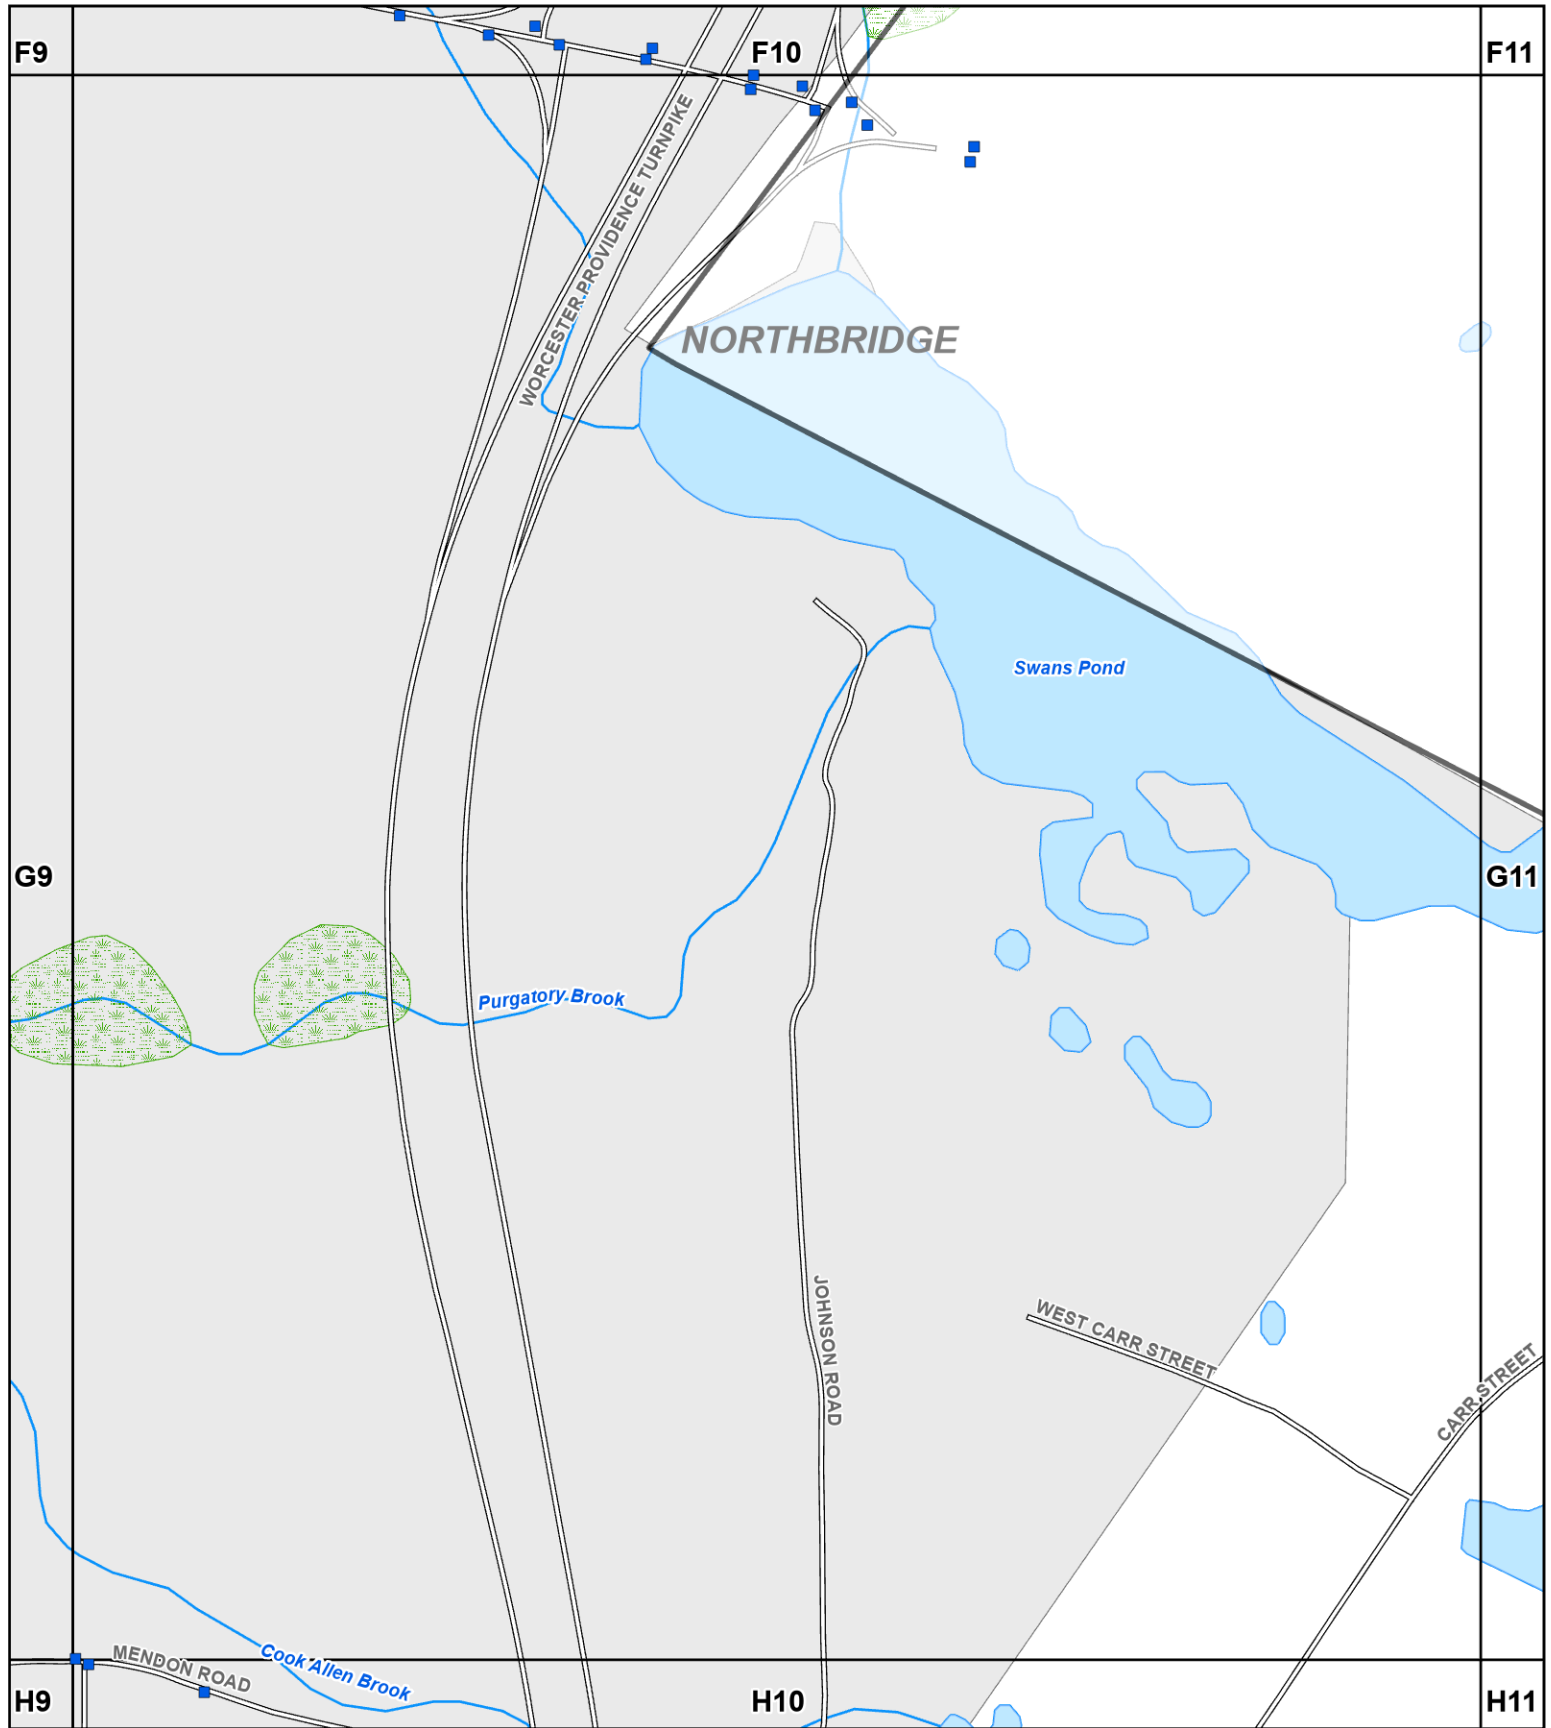


F9



**Comprehensive
Environmental
Incorporated**



Legend

- | | | | |
|---|------------------|---|-----------------------|
|  | Outfall |  | Lake, Pond, Reservoir |
|  | Catch Basin |  | Wetland, Marsh, Swamp |
|  | Sewer Force Main |  | Stream, Brook |
|  | Sewer Pipe |  | Non-Urban Area |
|  | Catchments | | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI









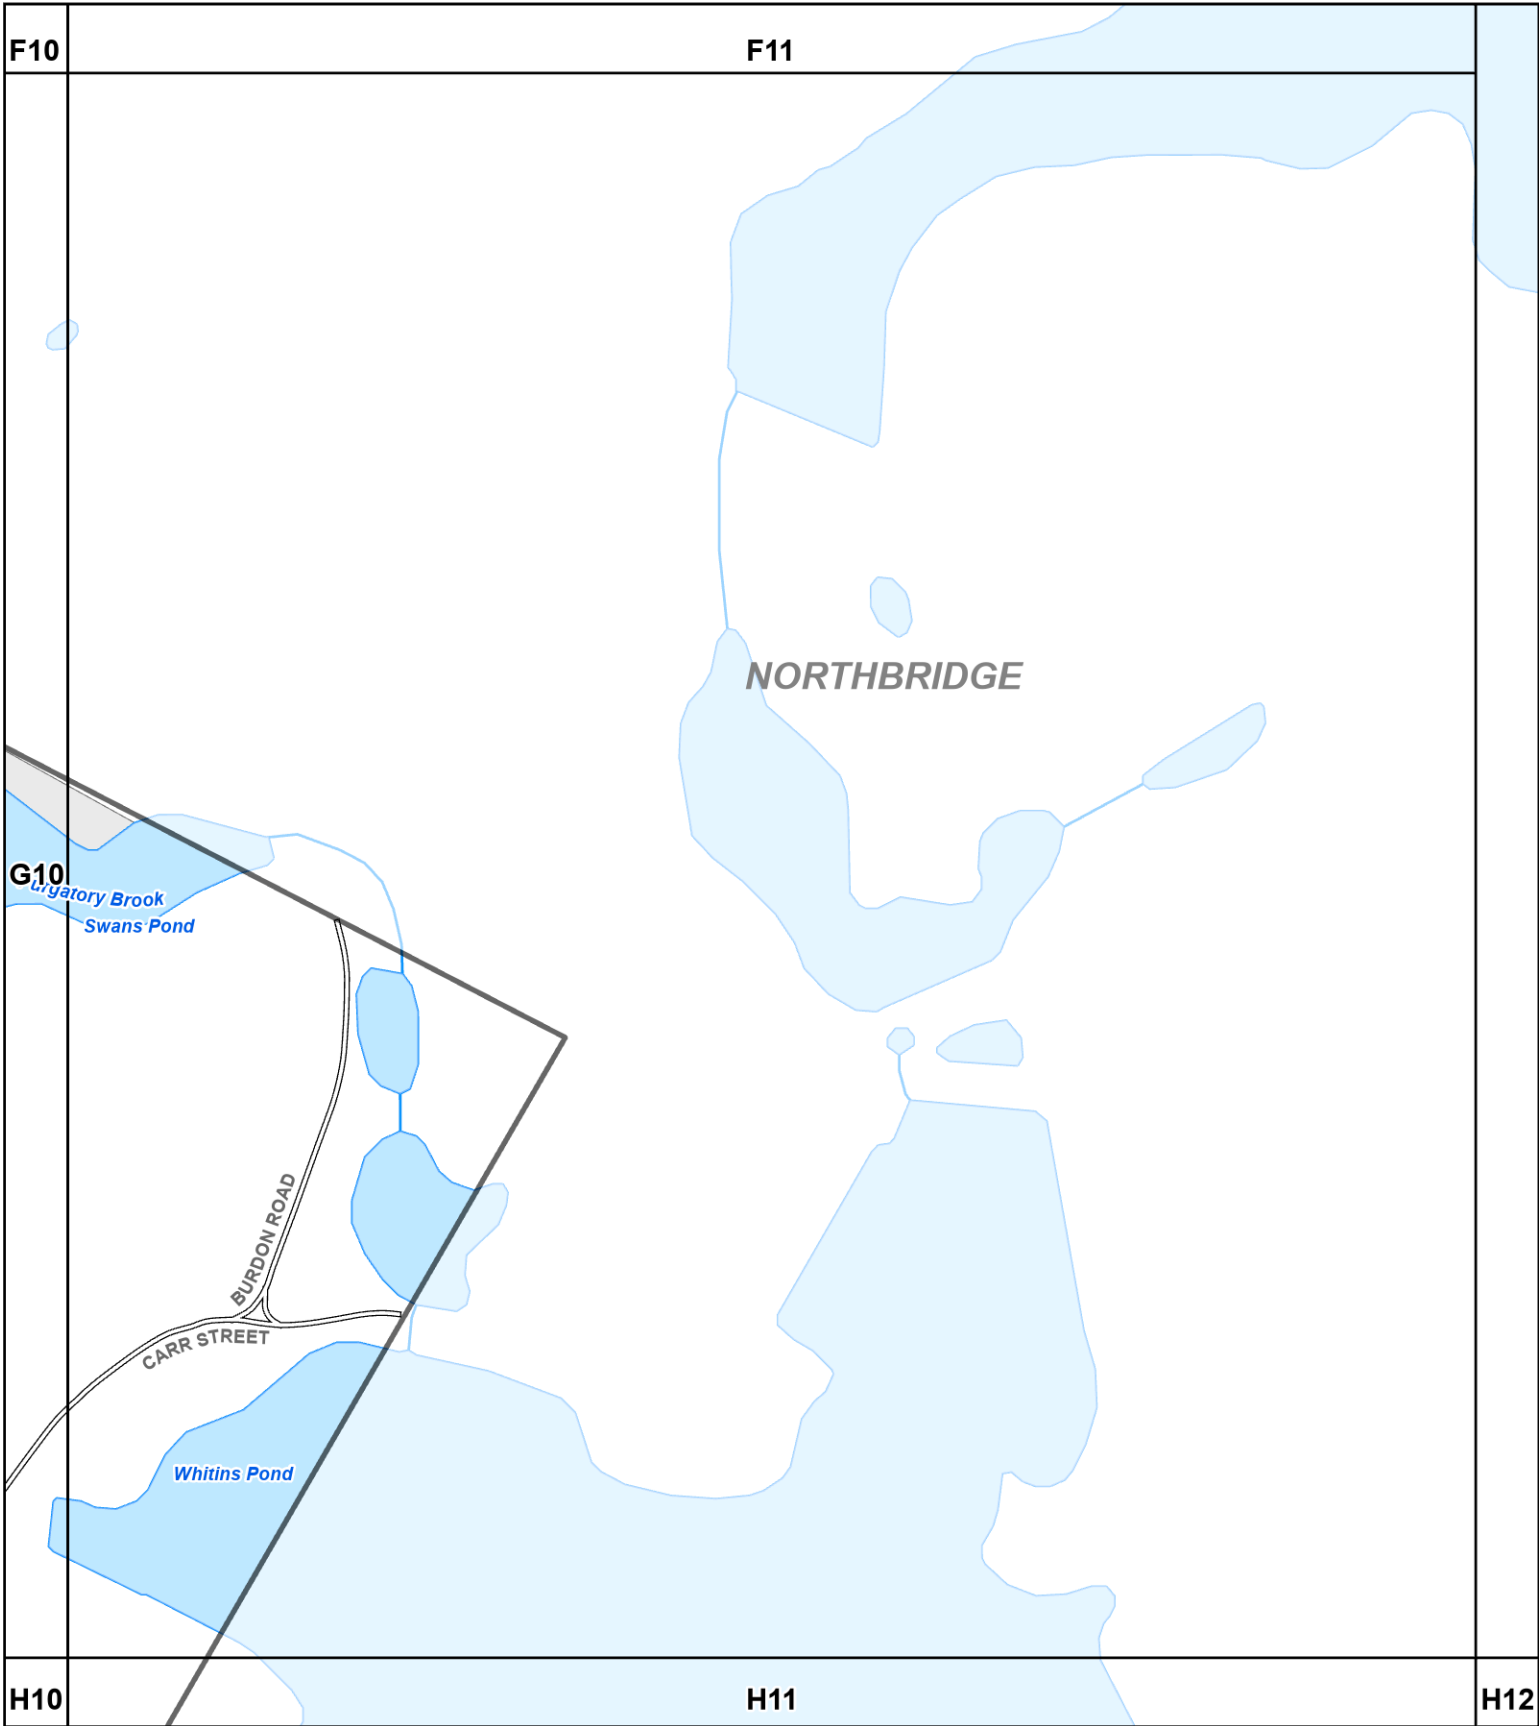


SHEET
G10




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI



SHEET
G11




**Comprehensive
Environmental
Incorporated**

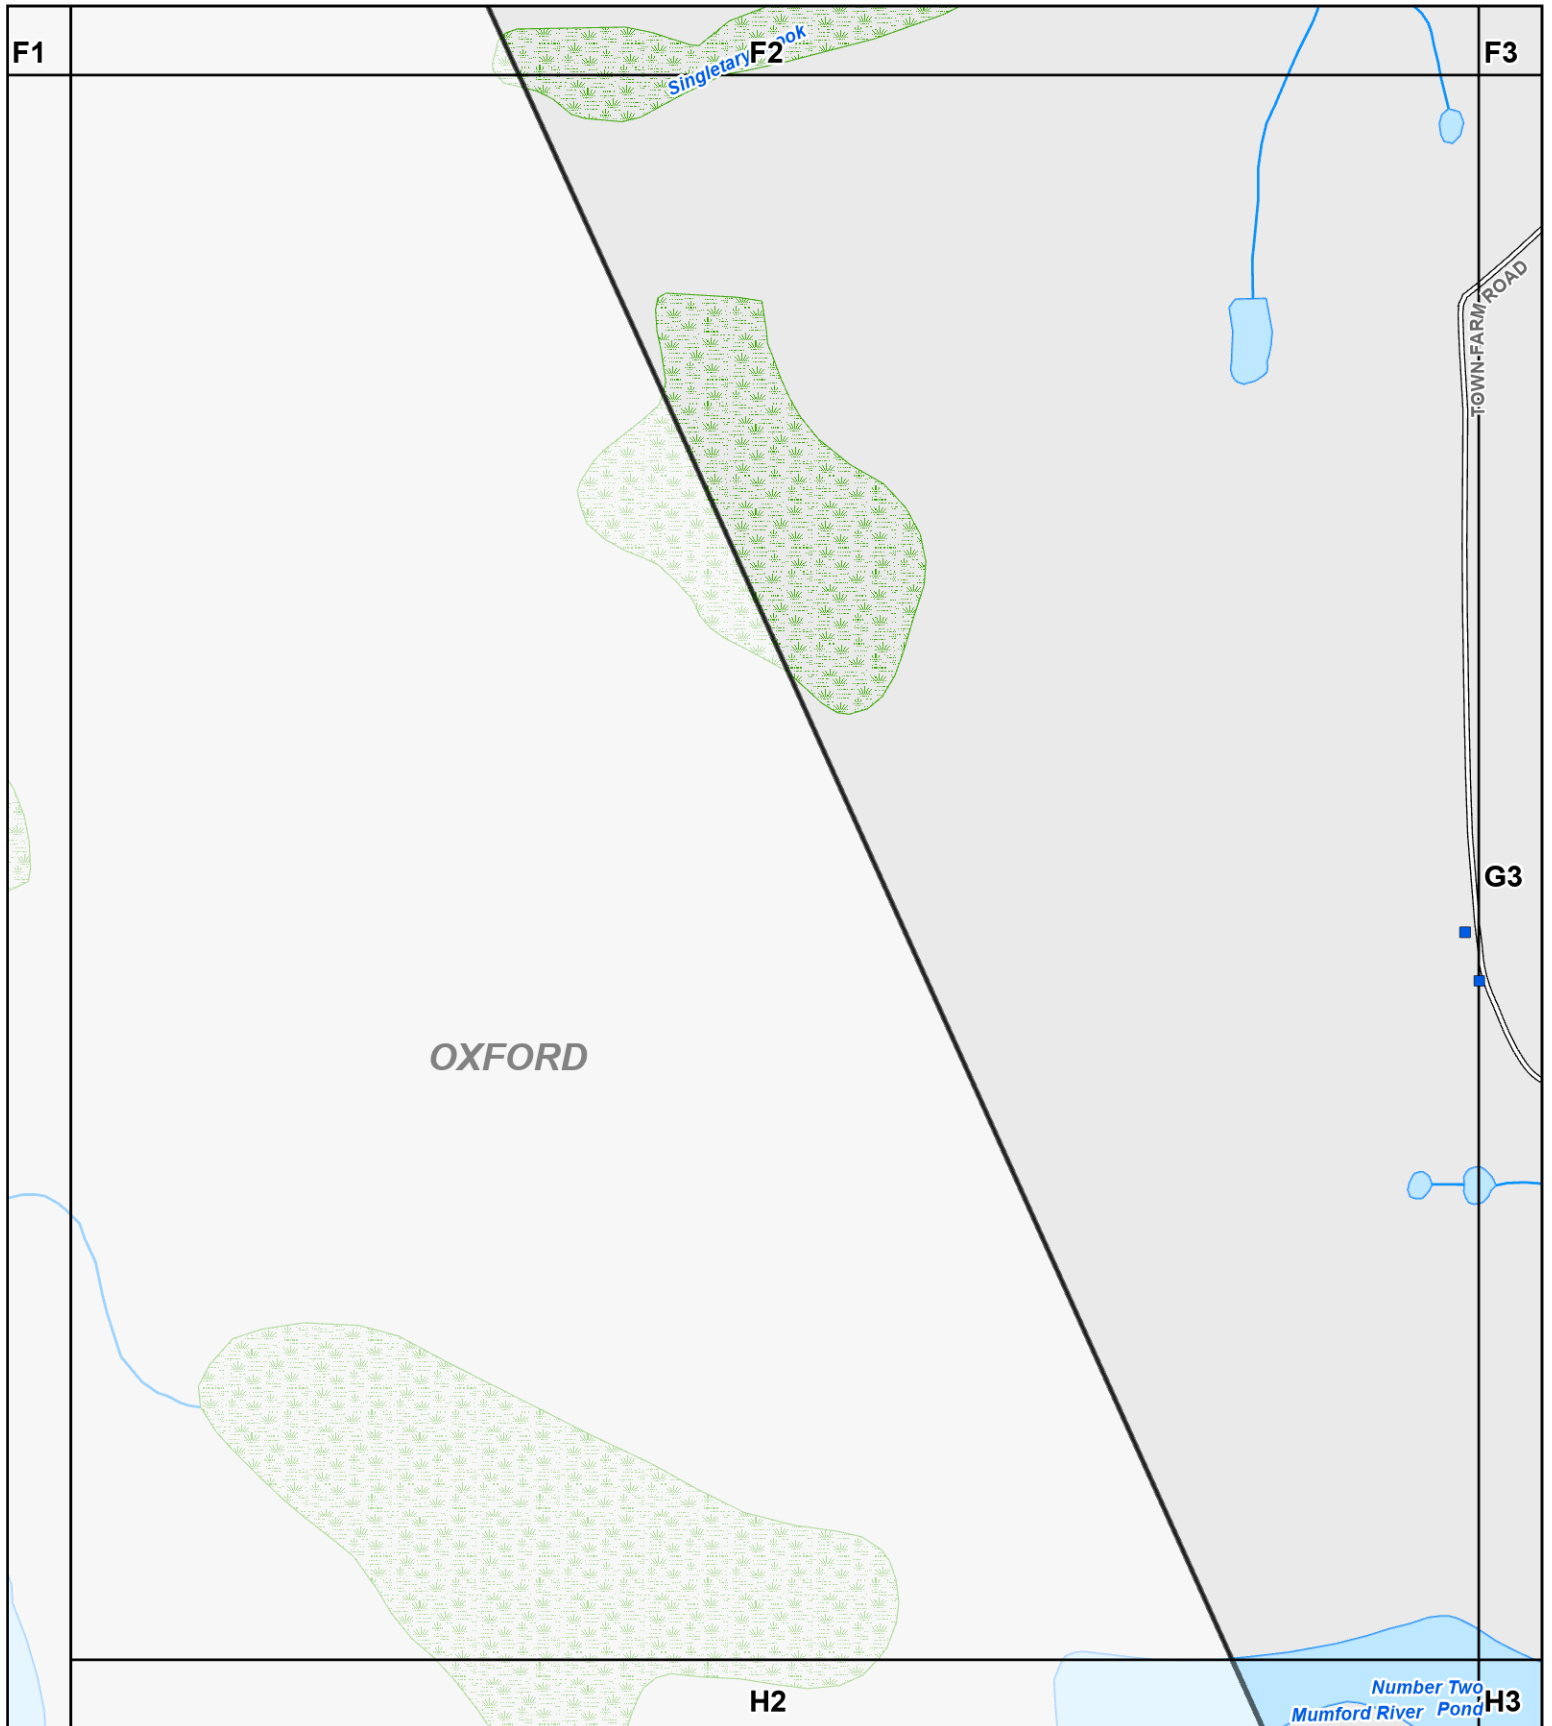

Legend

- | | | | |
|--|------------------|--|-----------------------|
| | Outfall | | Lake, Pond, Reservoir |
| | Catch Basin | | Wetland, Marsh, Swamp |
| | Sewer Force Main | | Stream, Brook |
| | Sewer Pipe | | Non-Urban Area |
| | Catchments | | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

G2



Comprehensive
Environmental
Incorporated

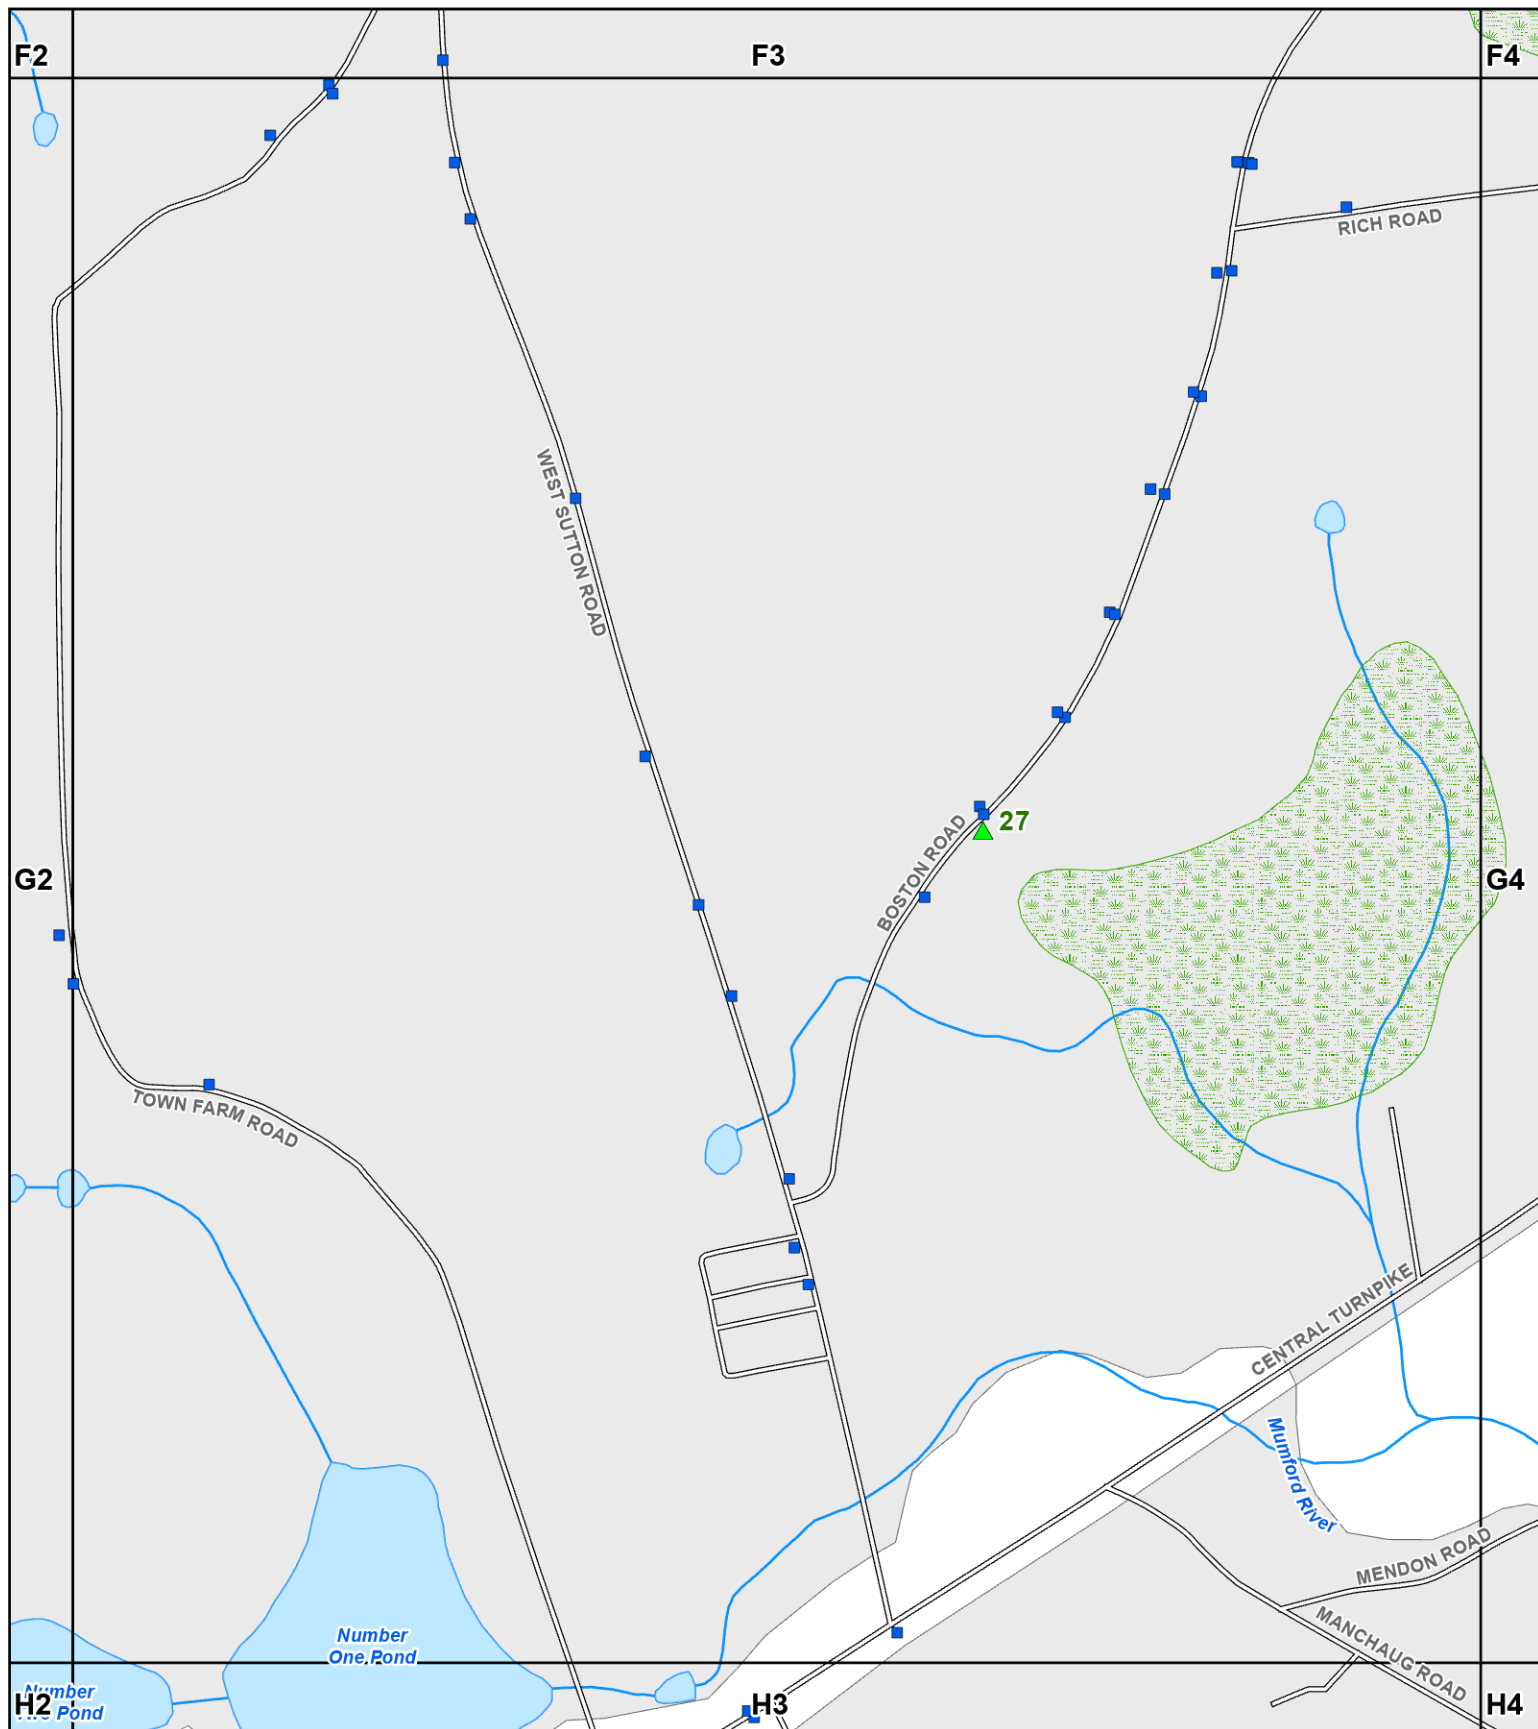

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

G3



**Comprehensive
Environmental
Incorporated**

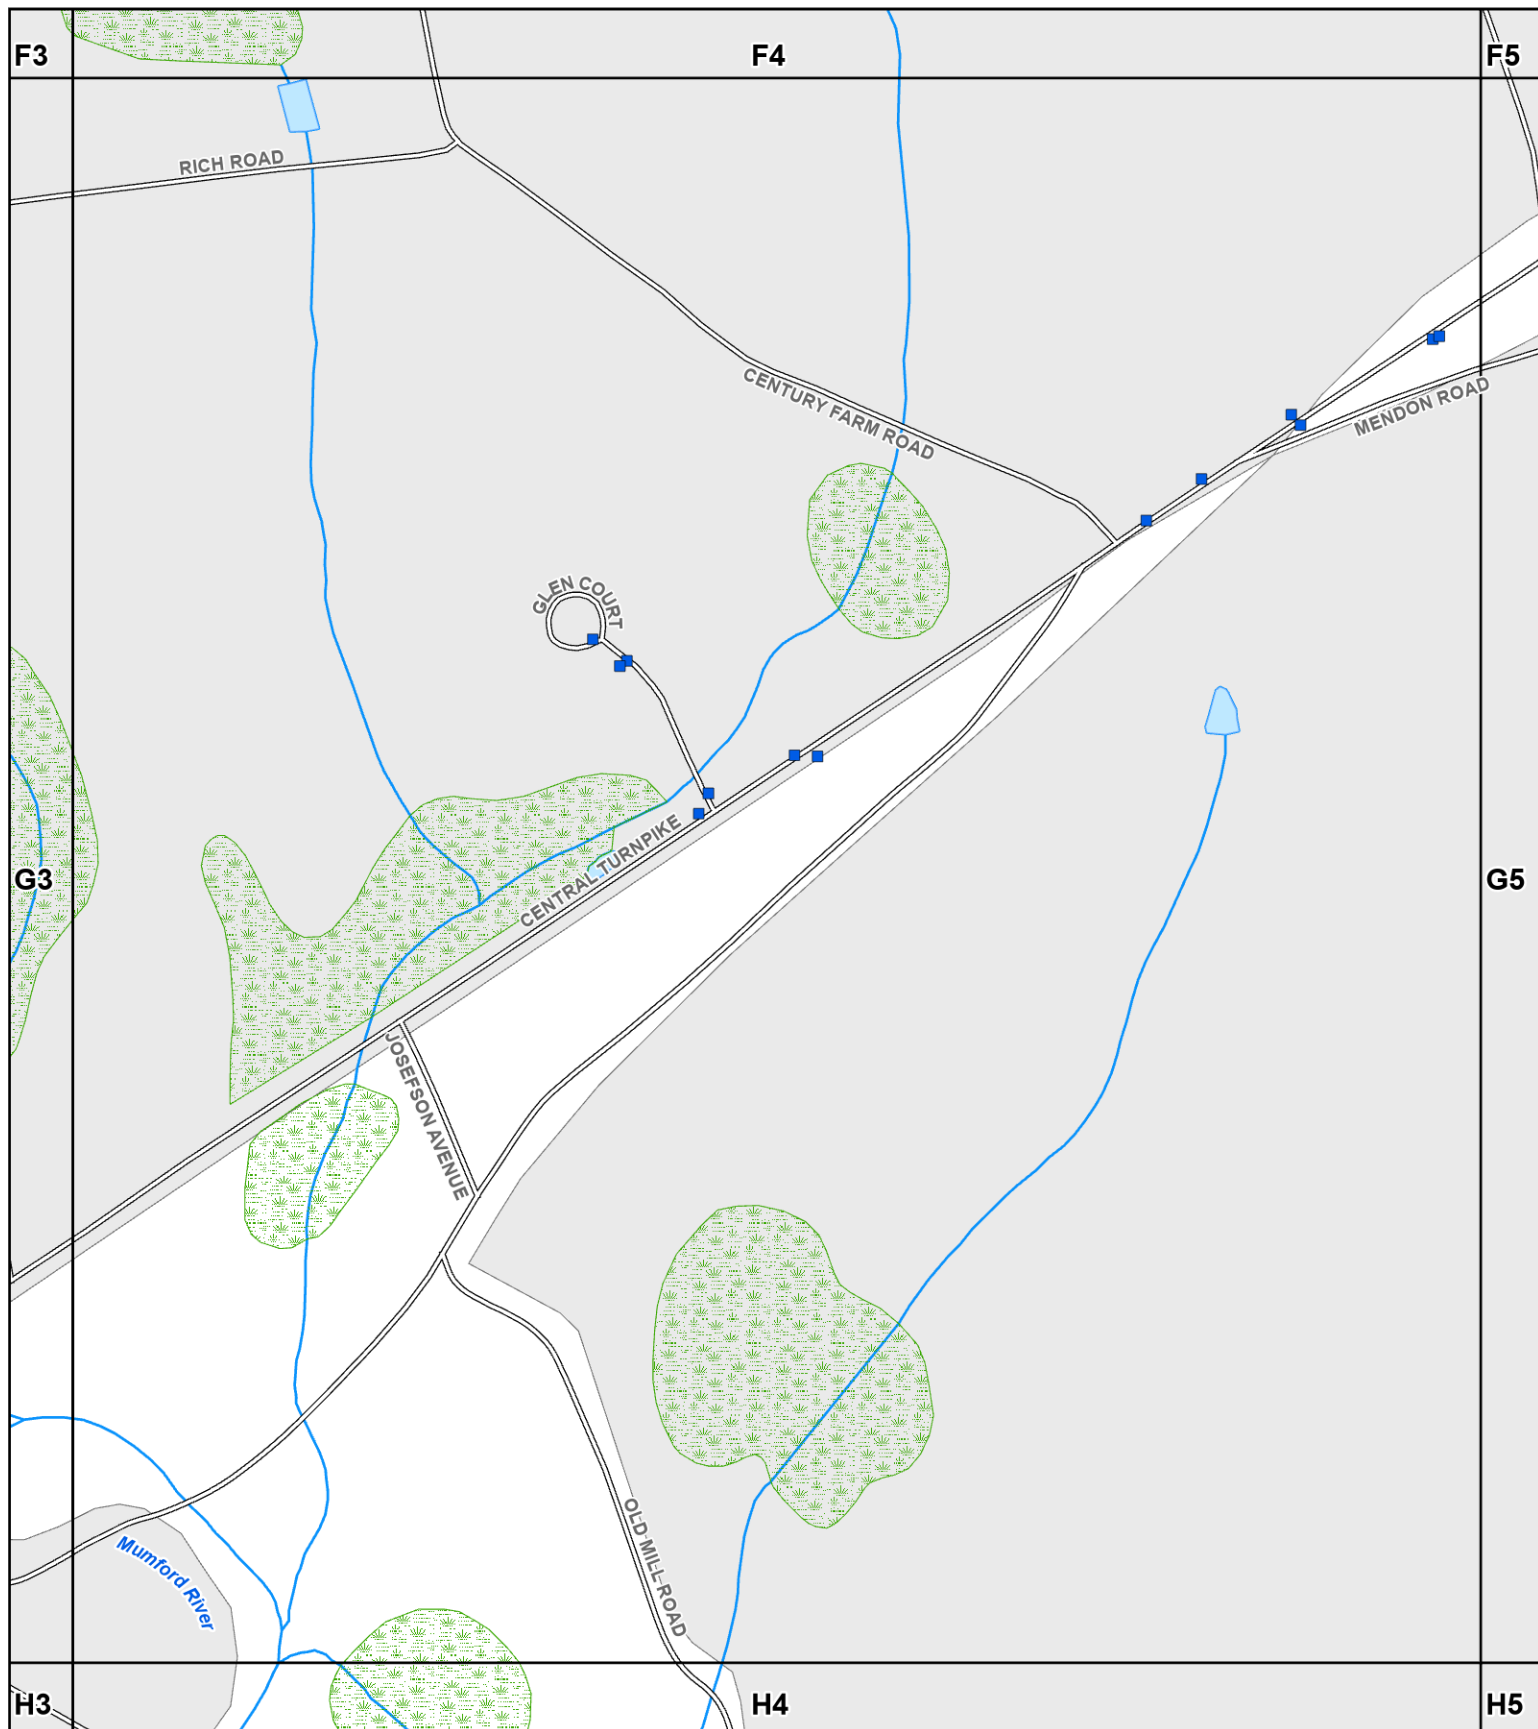

Legend

- | | | | |
|--|------------------|--|-----------------------|
| | Outfall | | Lake, Pond, Reservoir |
| | Catch Basin | | Wetland, Marsh, Swamp |
| | Sewer Force Main | | Stream, Brook |
| | Sewer Pipe | | Non-Urban Area |
| | Catchments | | |

Stormwater Map with Catchment Delineations Sutton, MA

0 100 200 300
Yards

Data Sources: MassGIS, Town of Sutton, CEI




SHEET







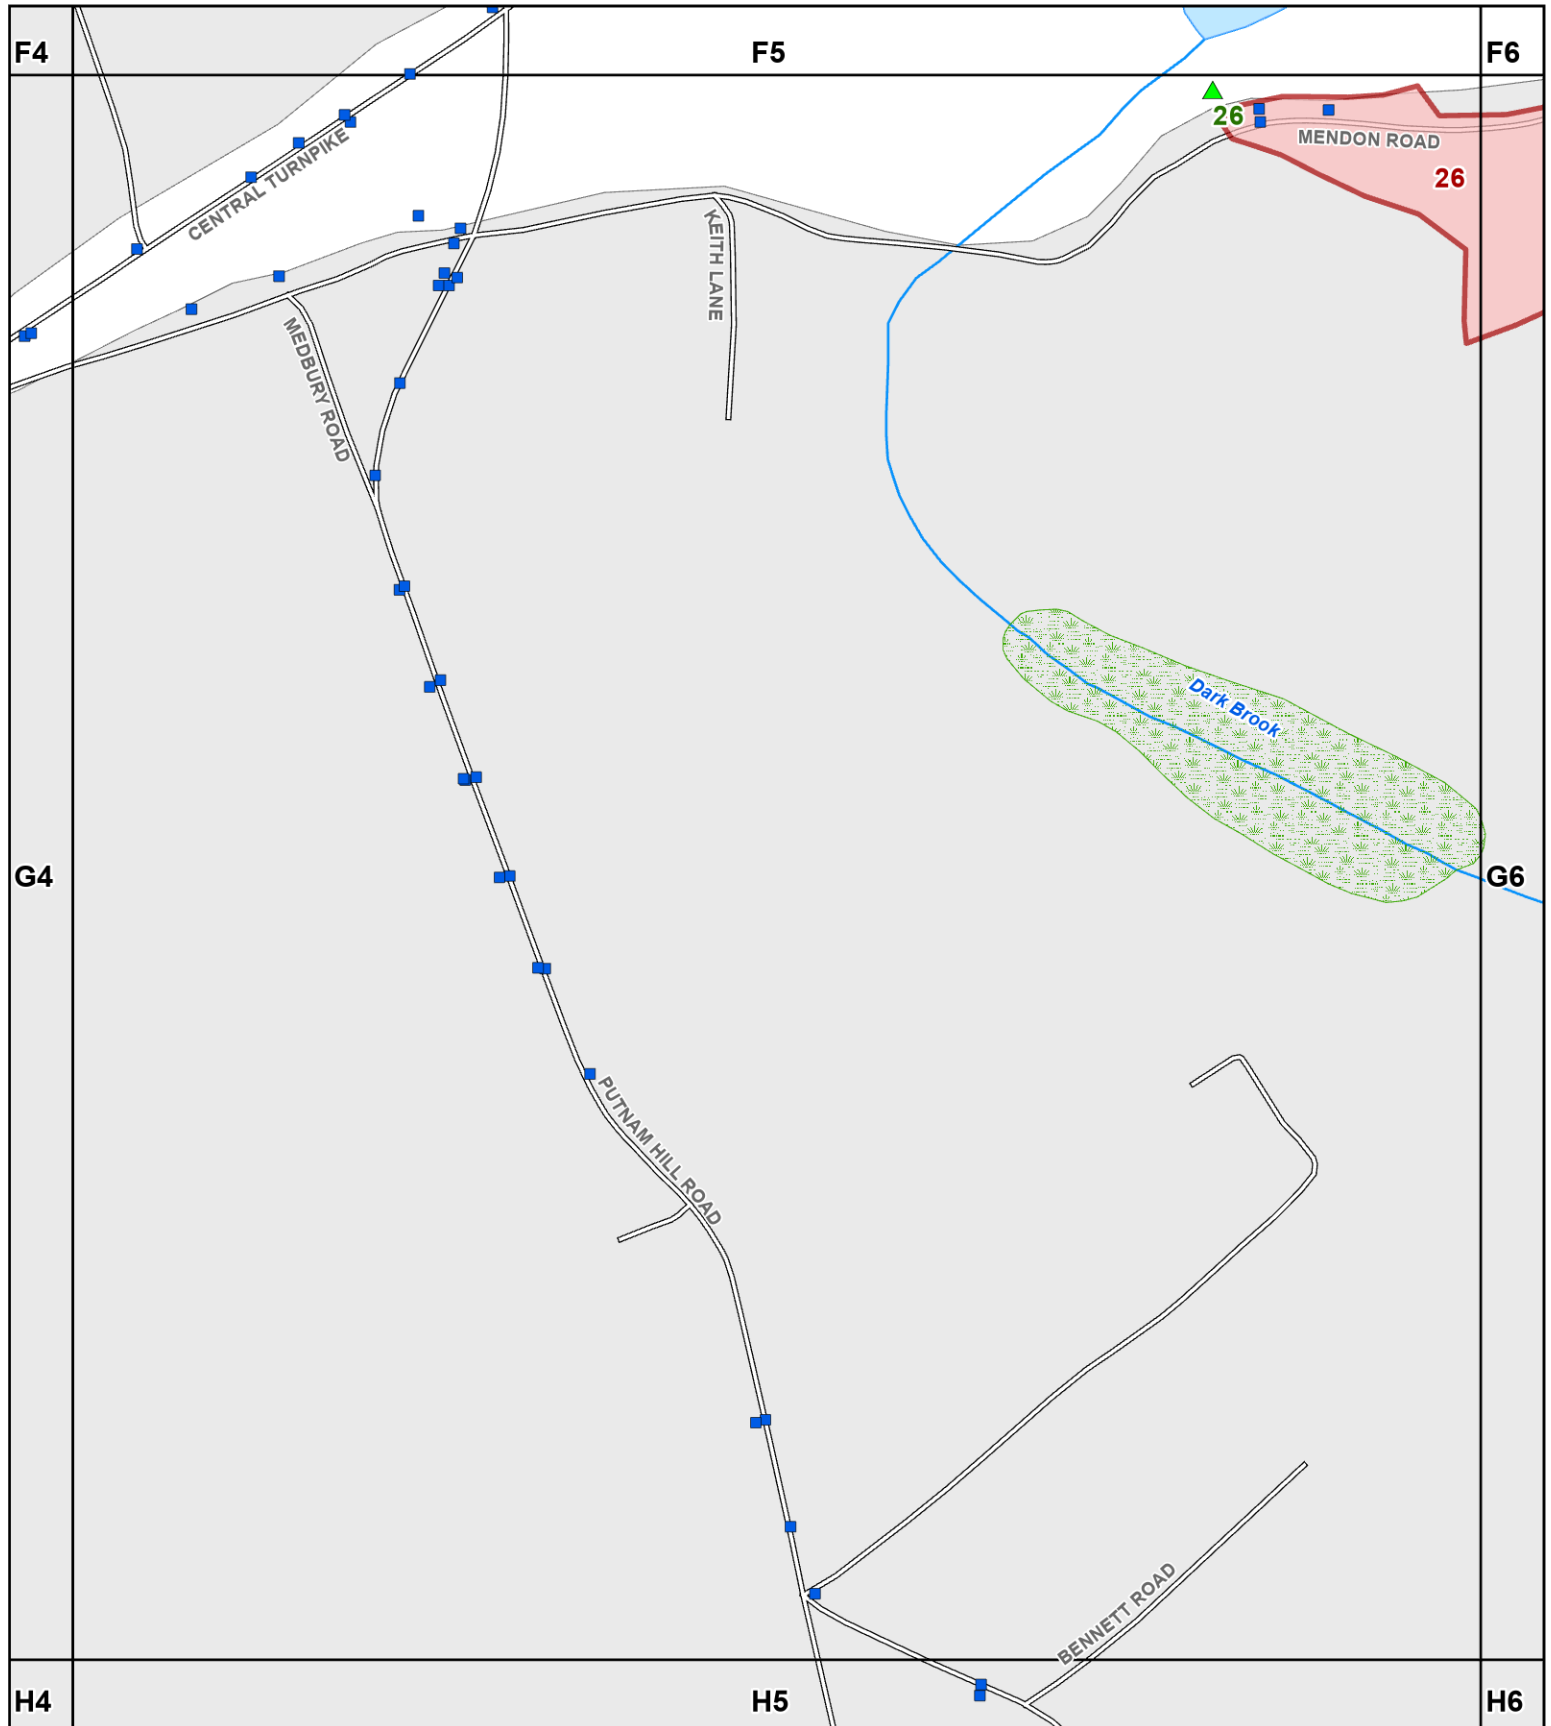


G4



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI



SHEET
G5



**Comprehensive
Environmental
Incorporated**

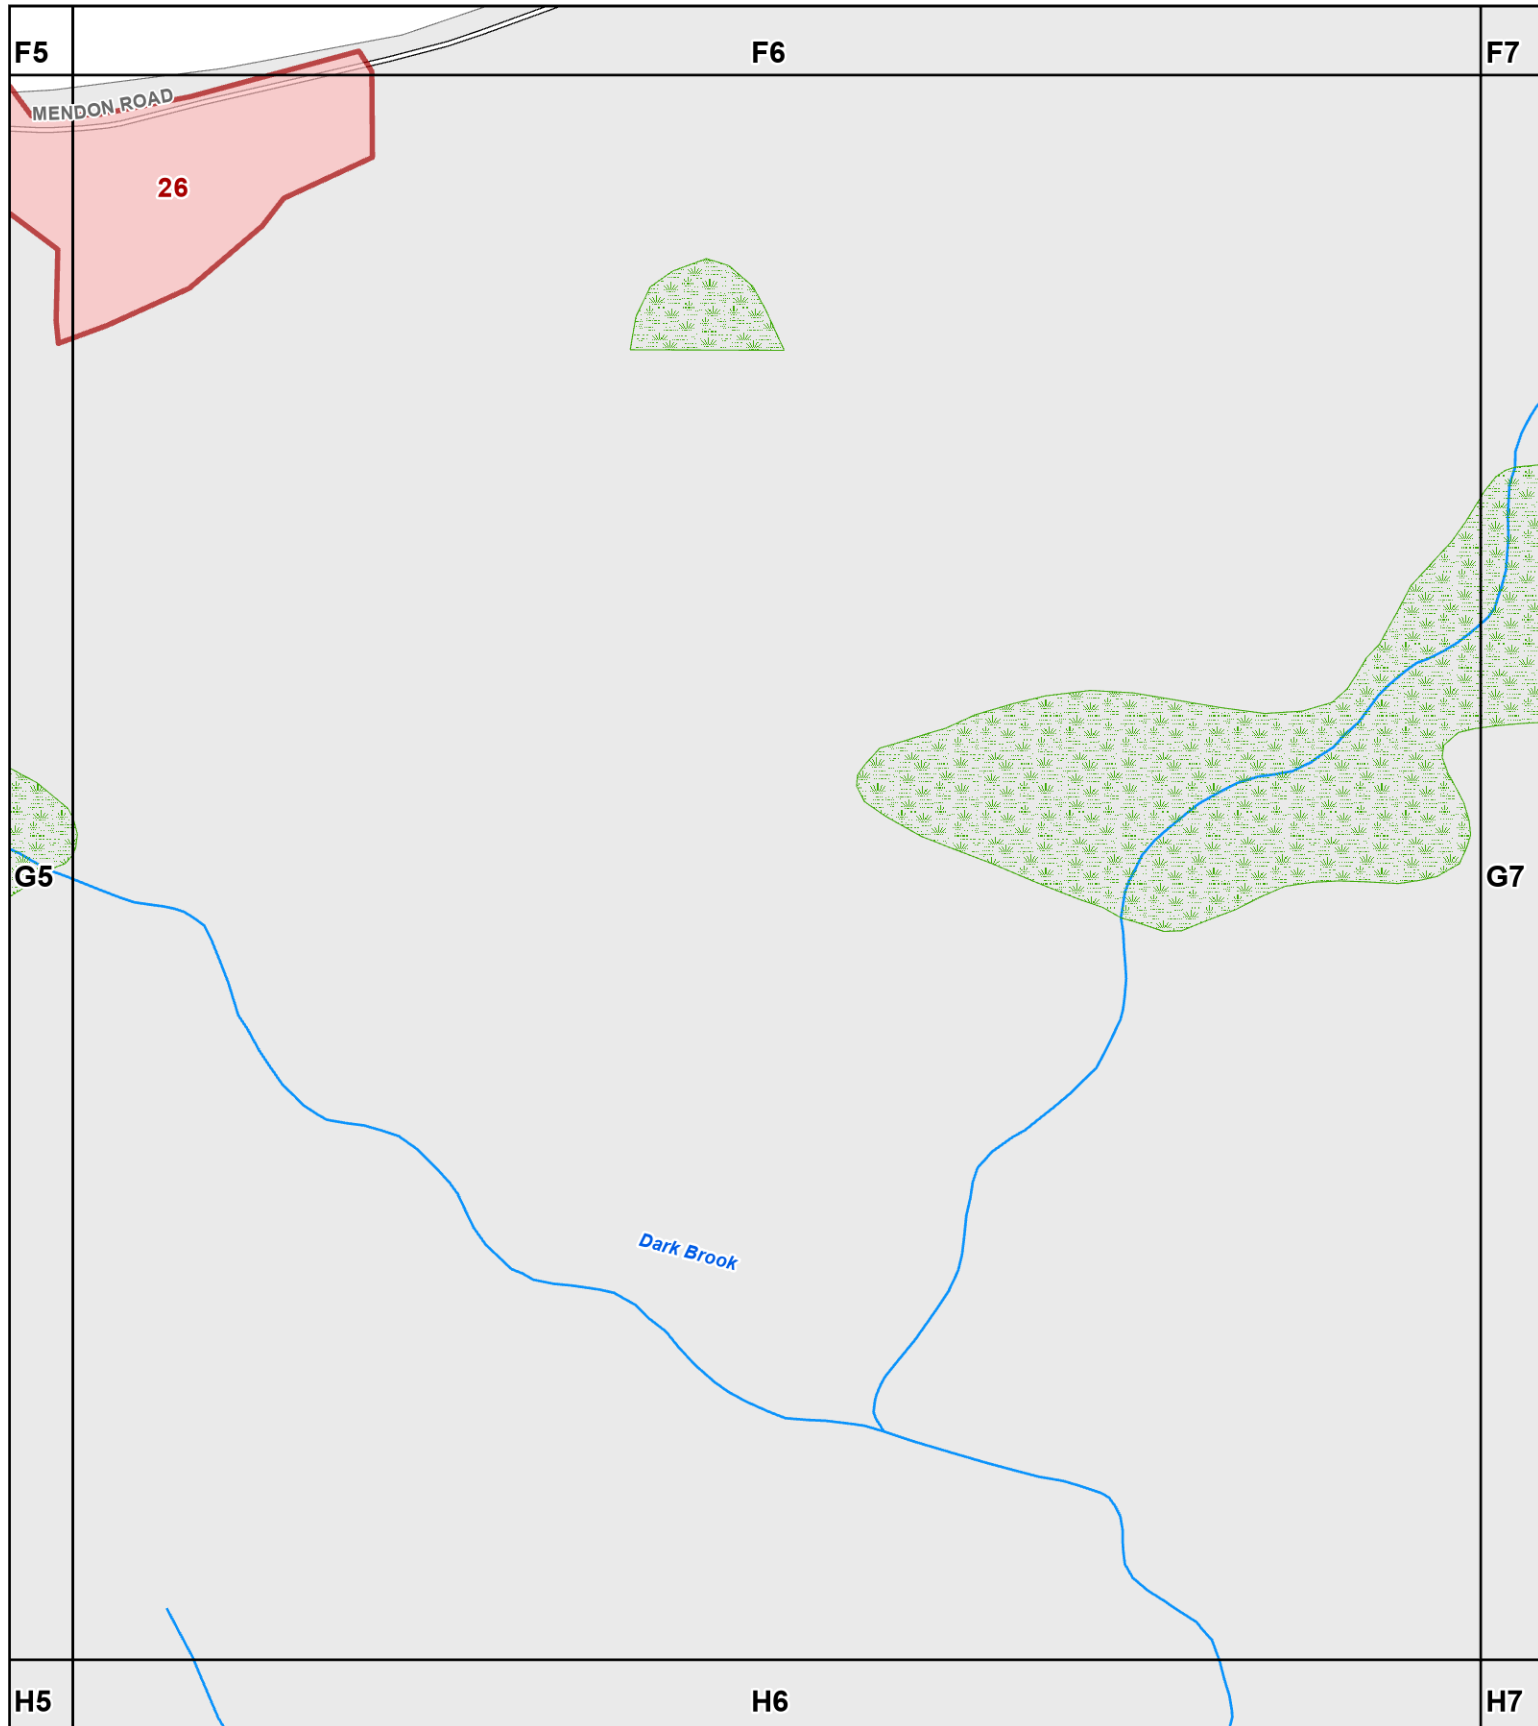

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







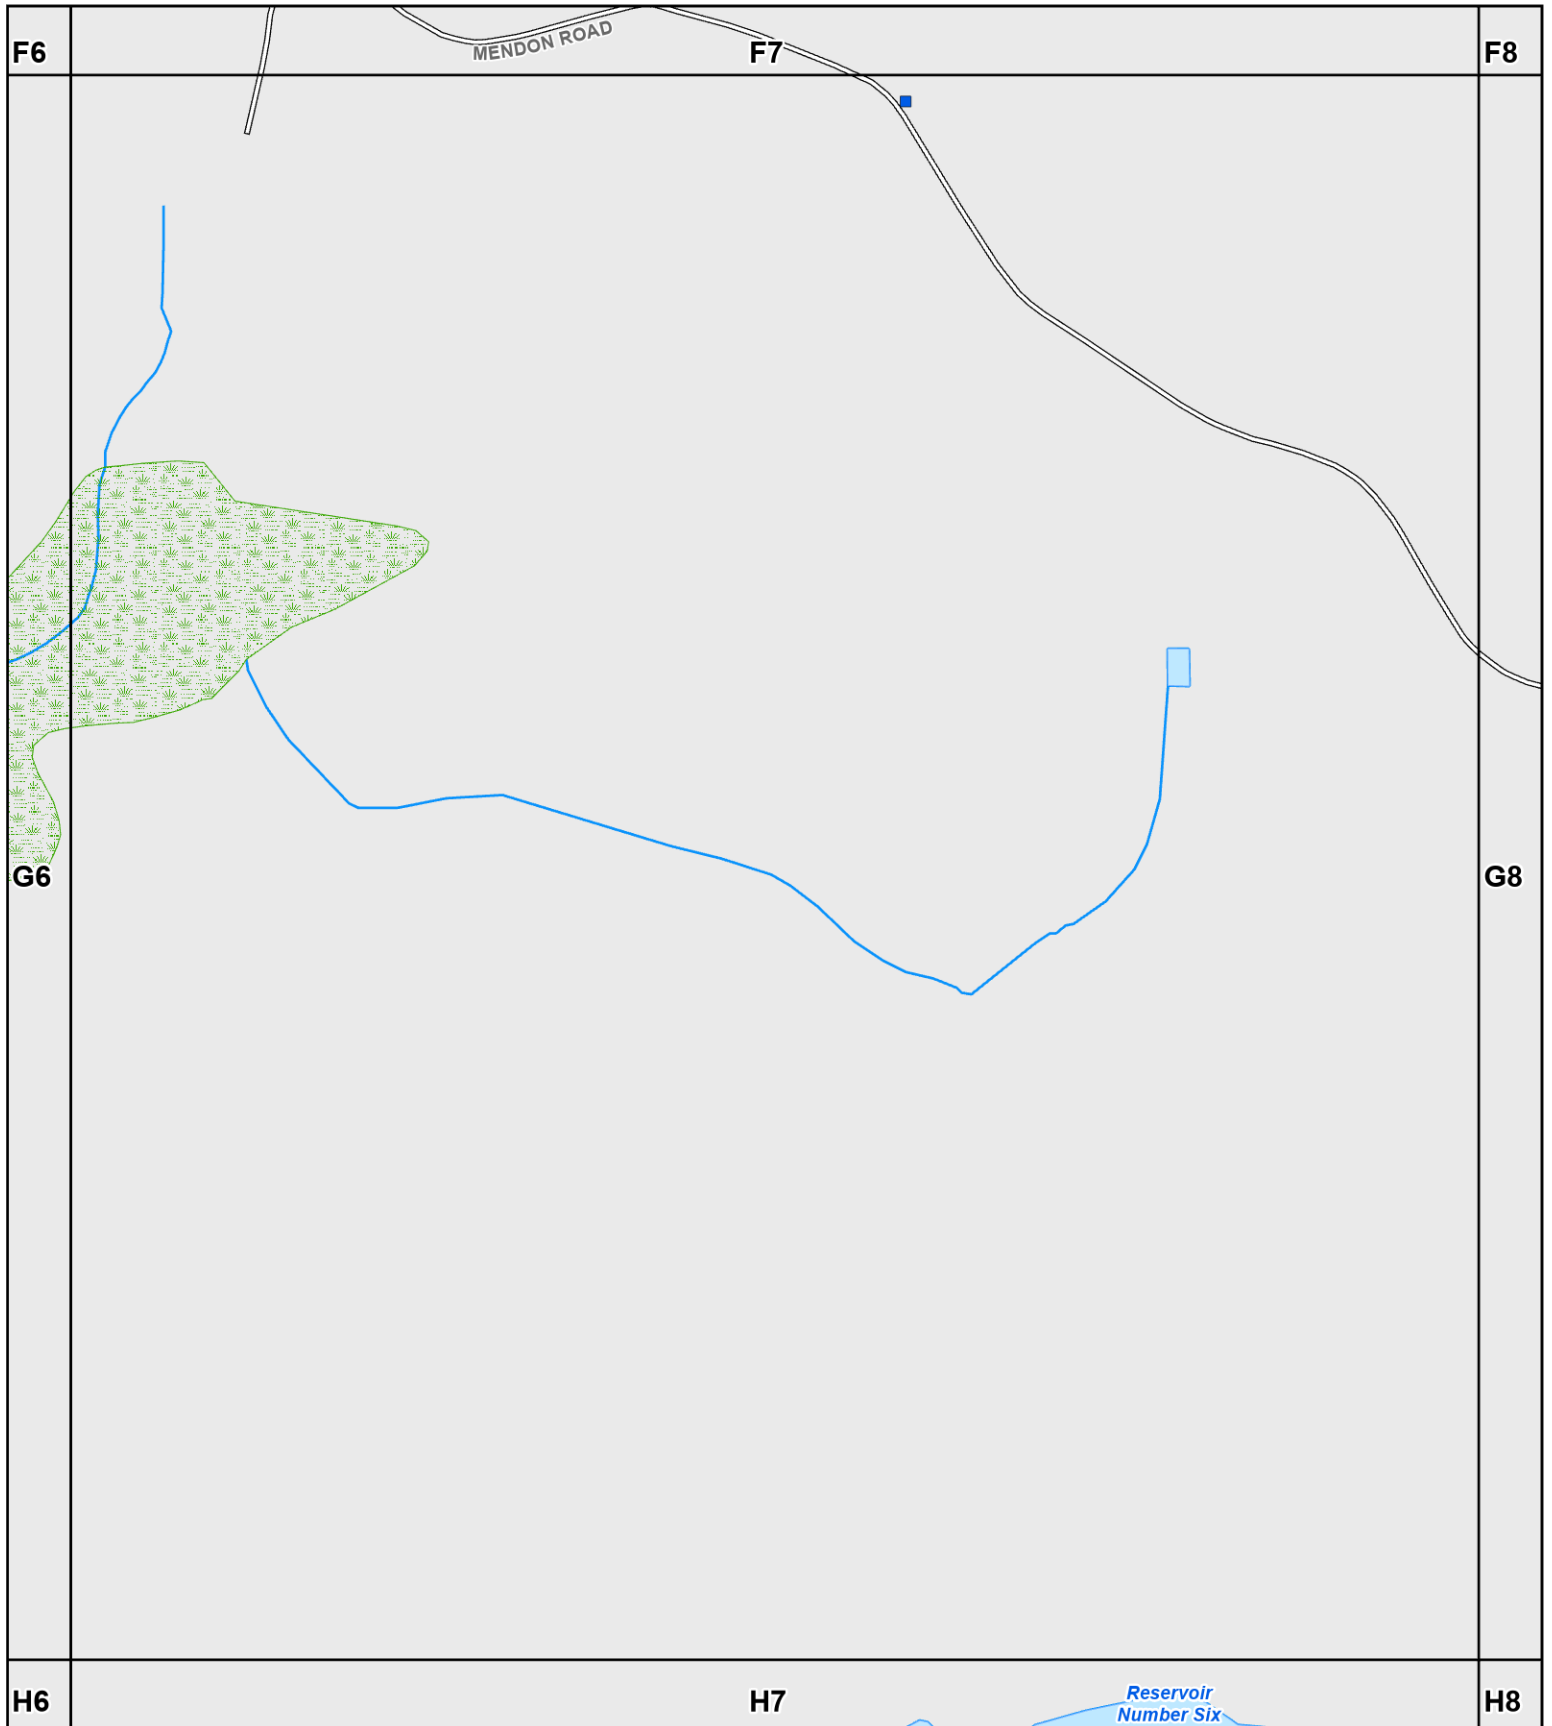


G6




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







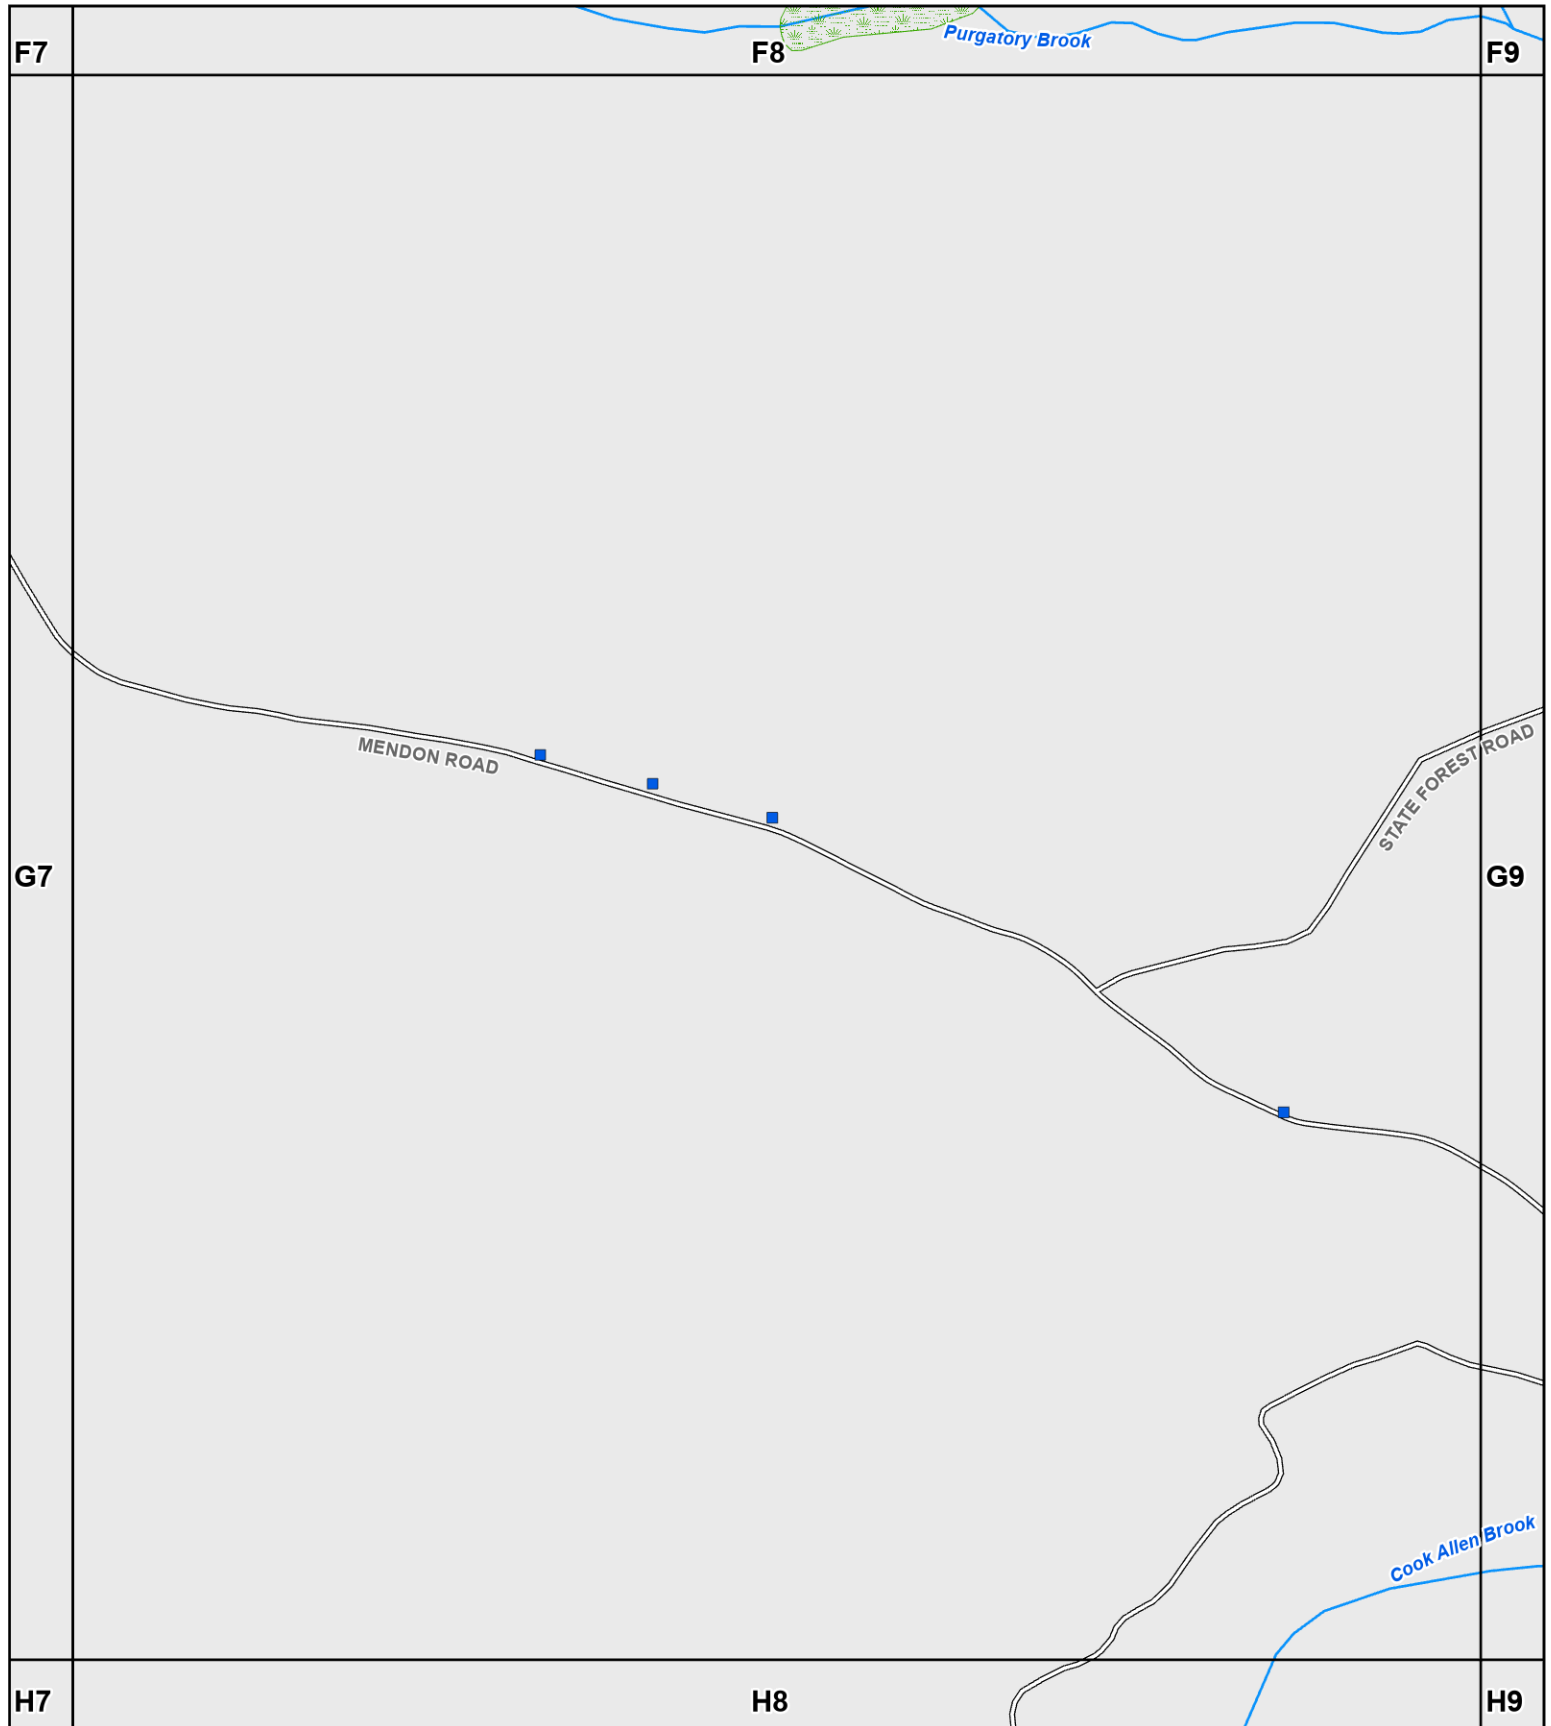


G7



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI



SHEET

G8



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







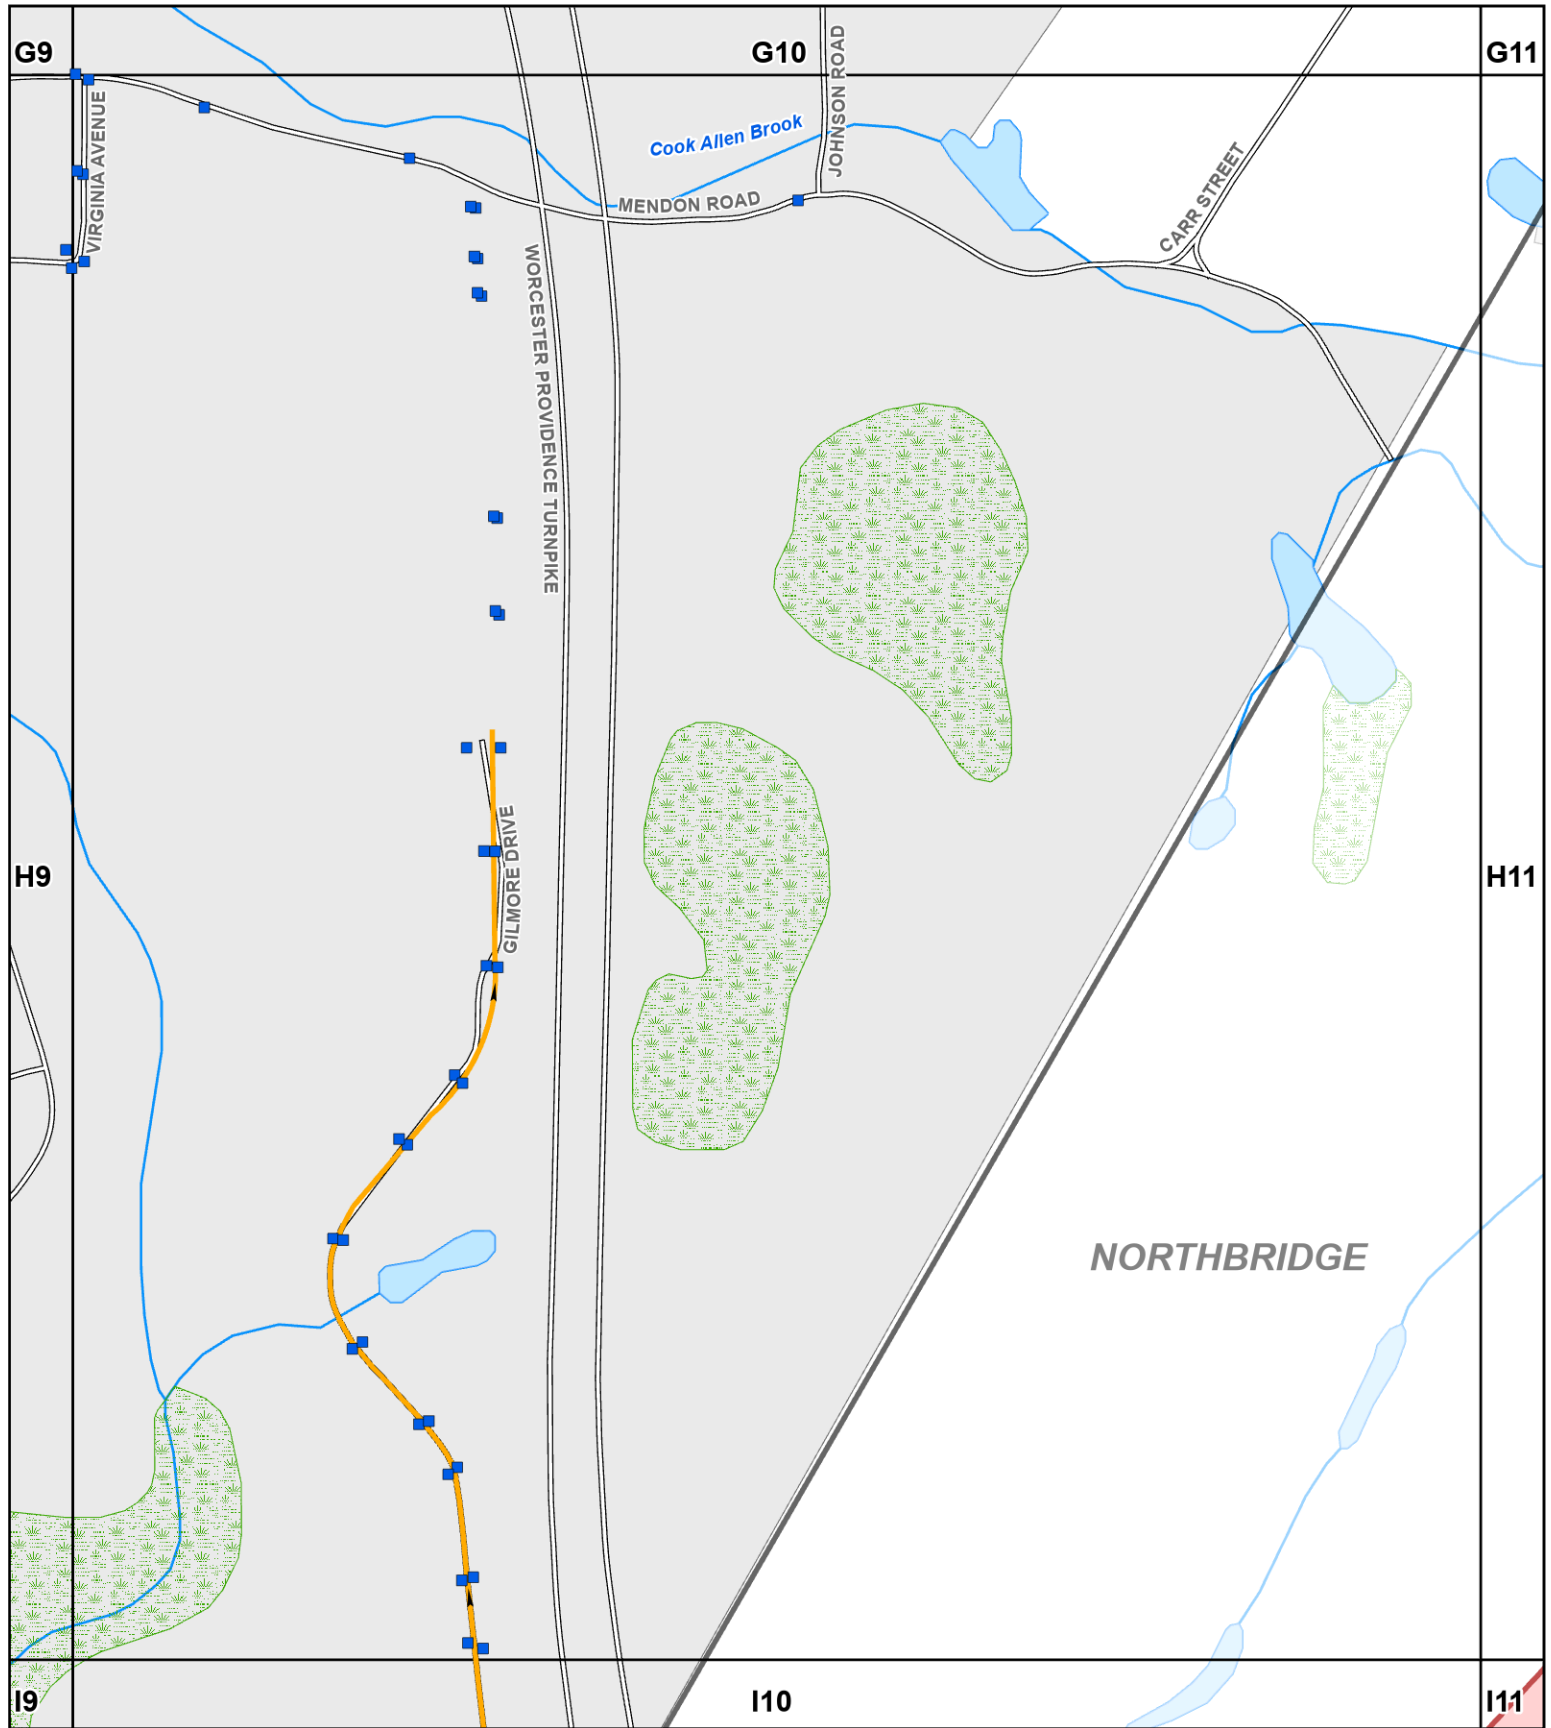


G9



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









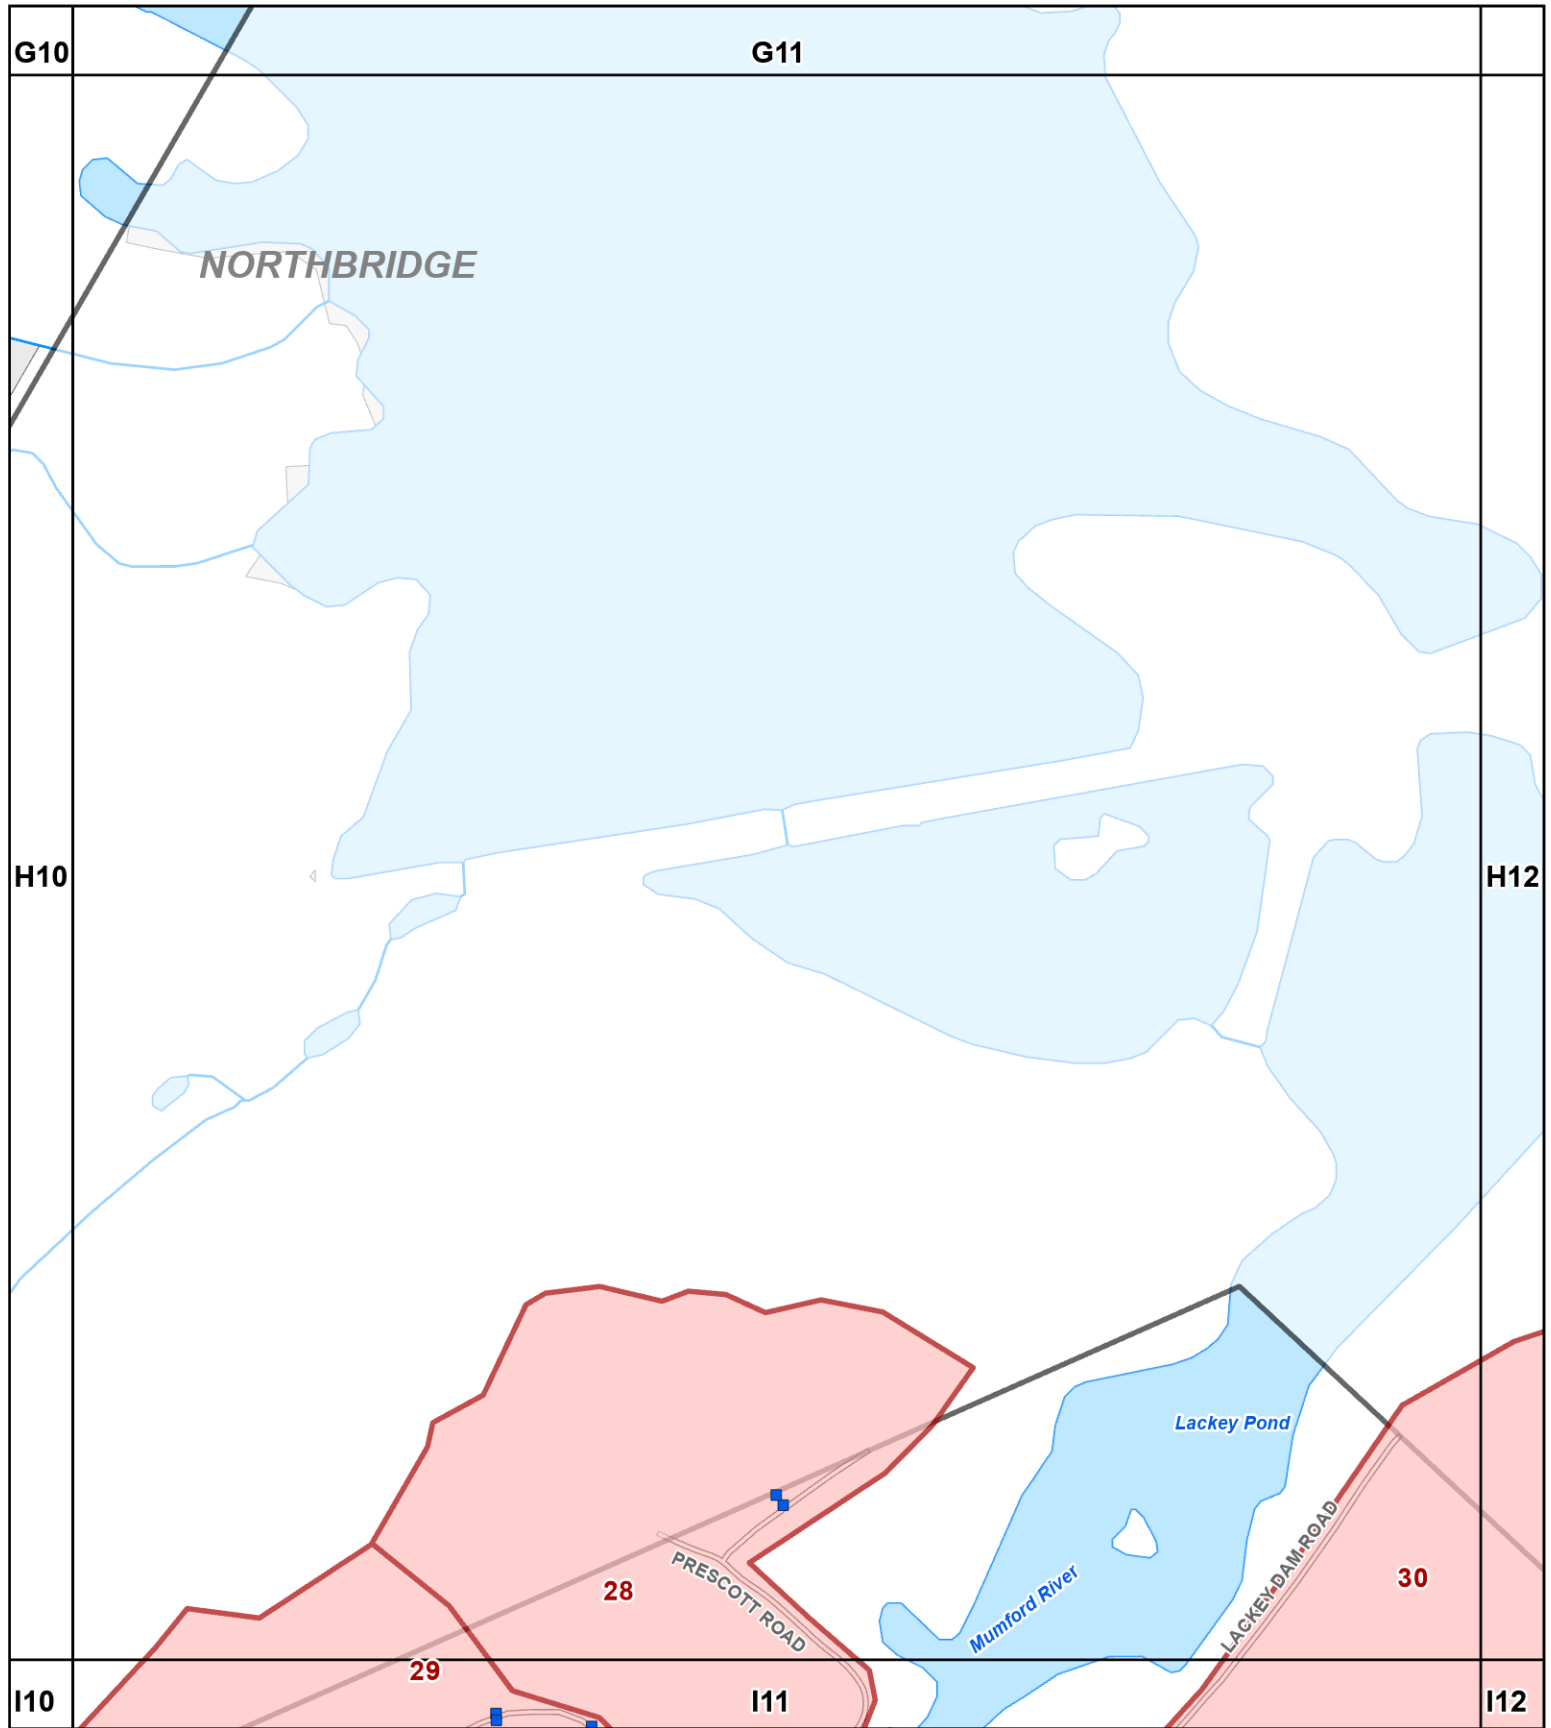


SHEET
H10




Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI



SHEET
H11



**Comprehensive
Environmental
Incorporated**

G11

H11










I11

I12

NORTHBRIDGE

30

Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

H12




**Comprehensive
Environmental
Incorporated**

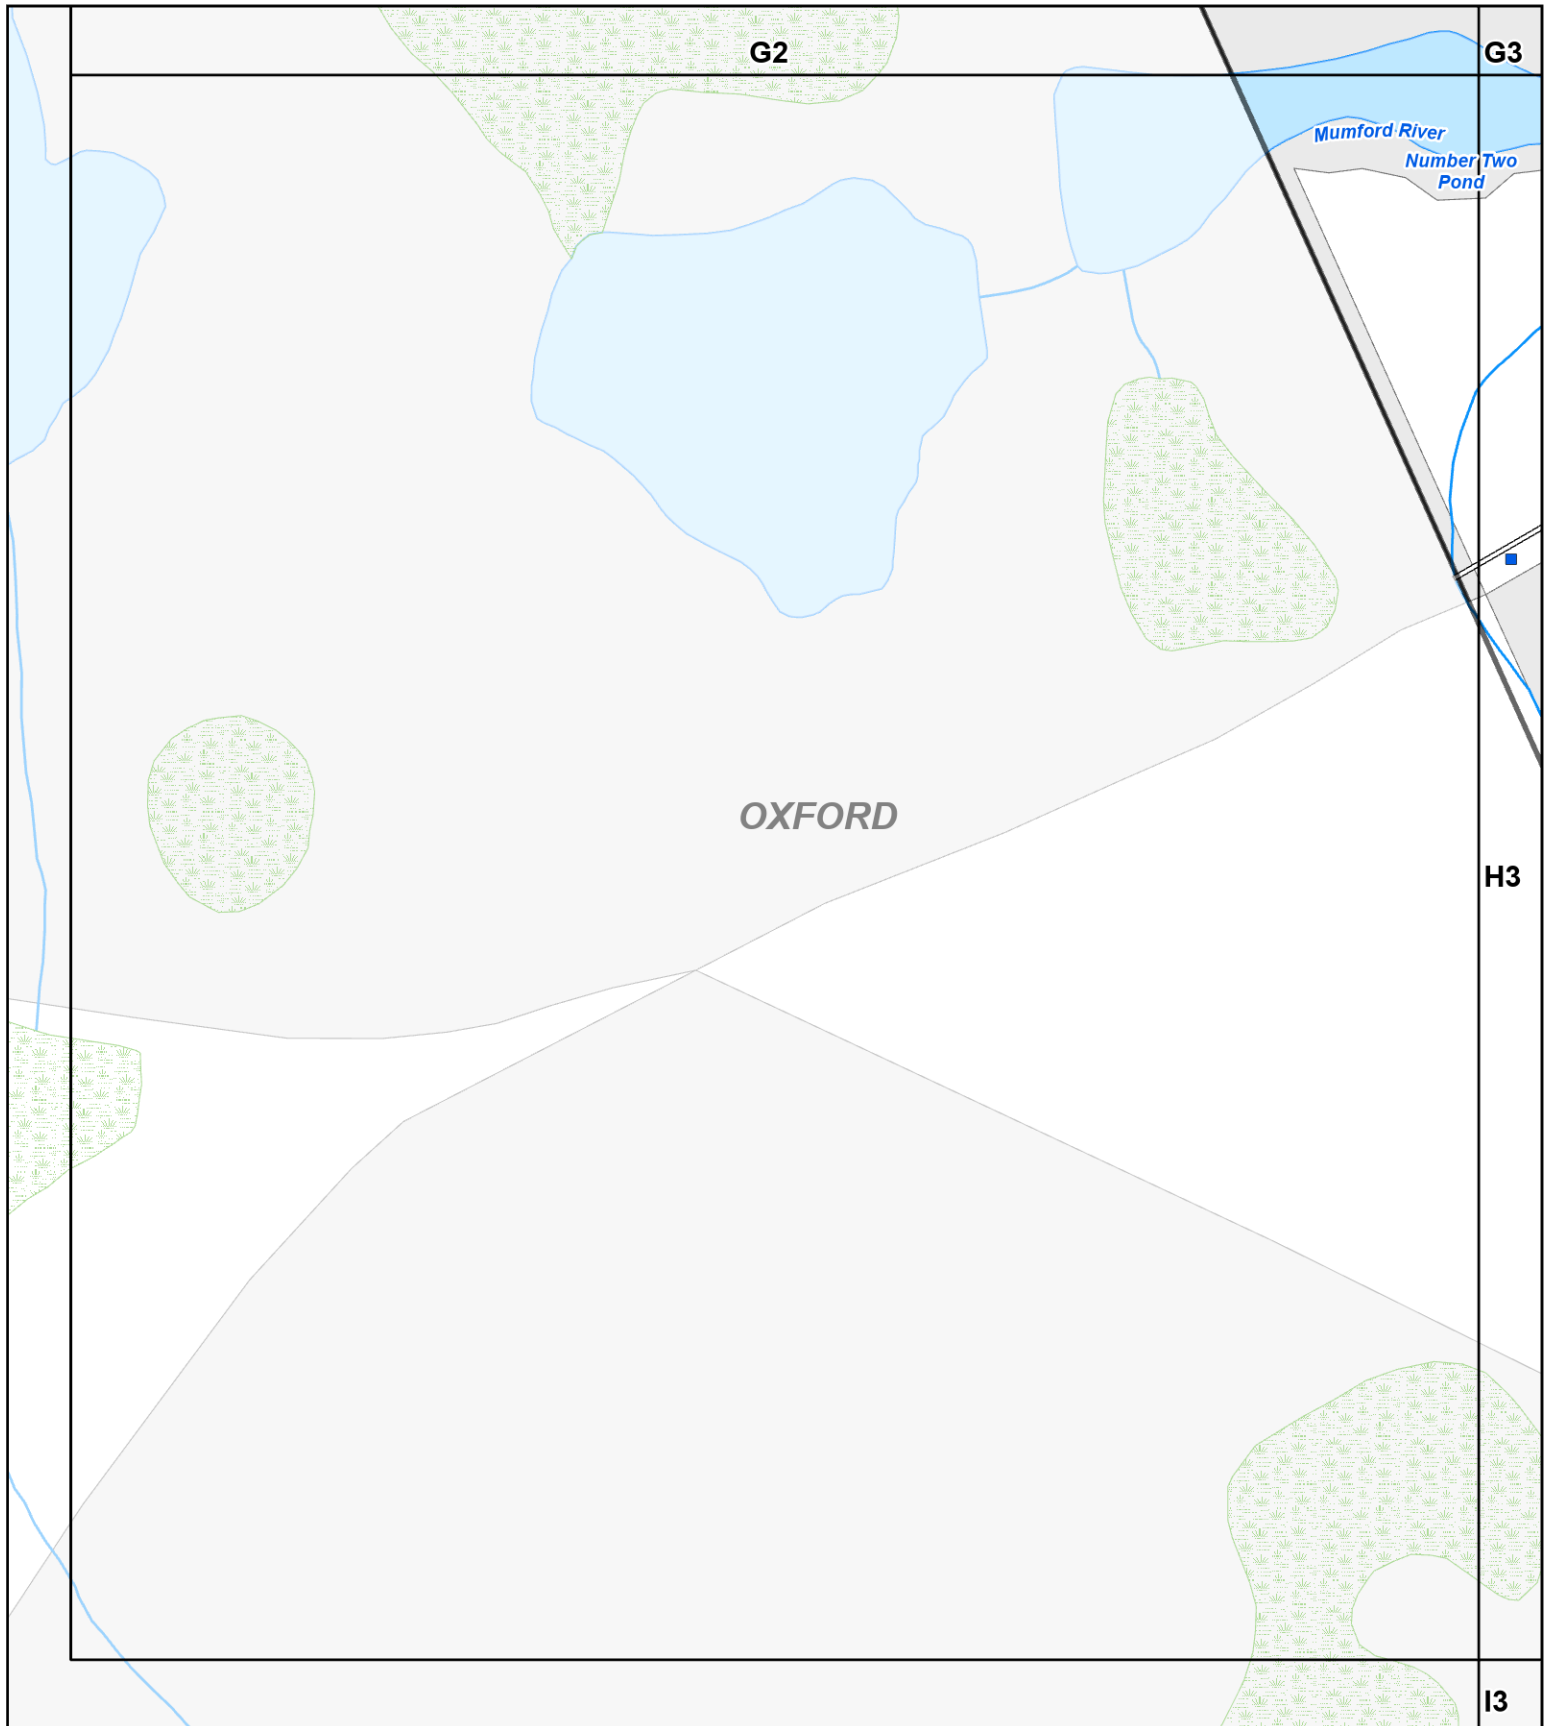

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







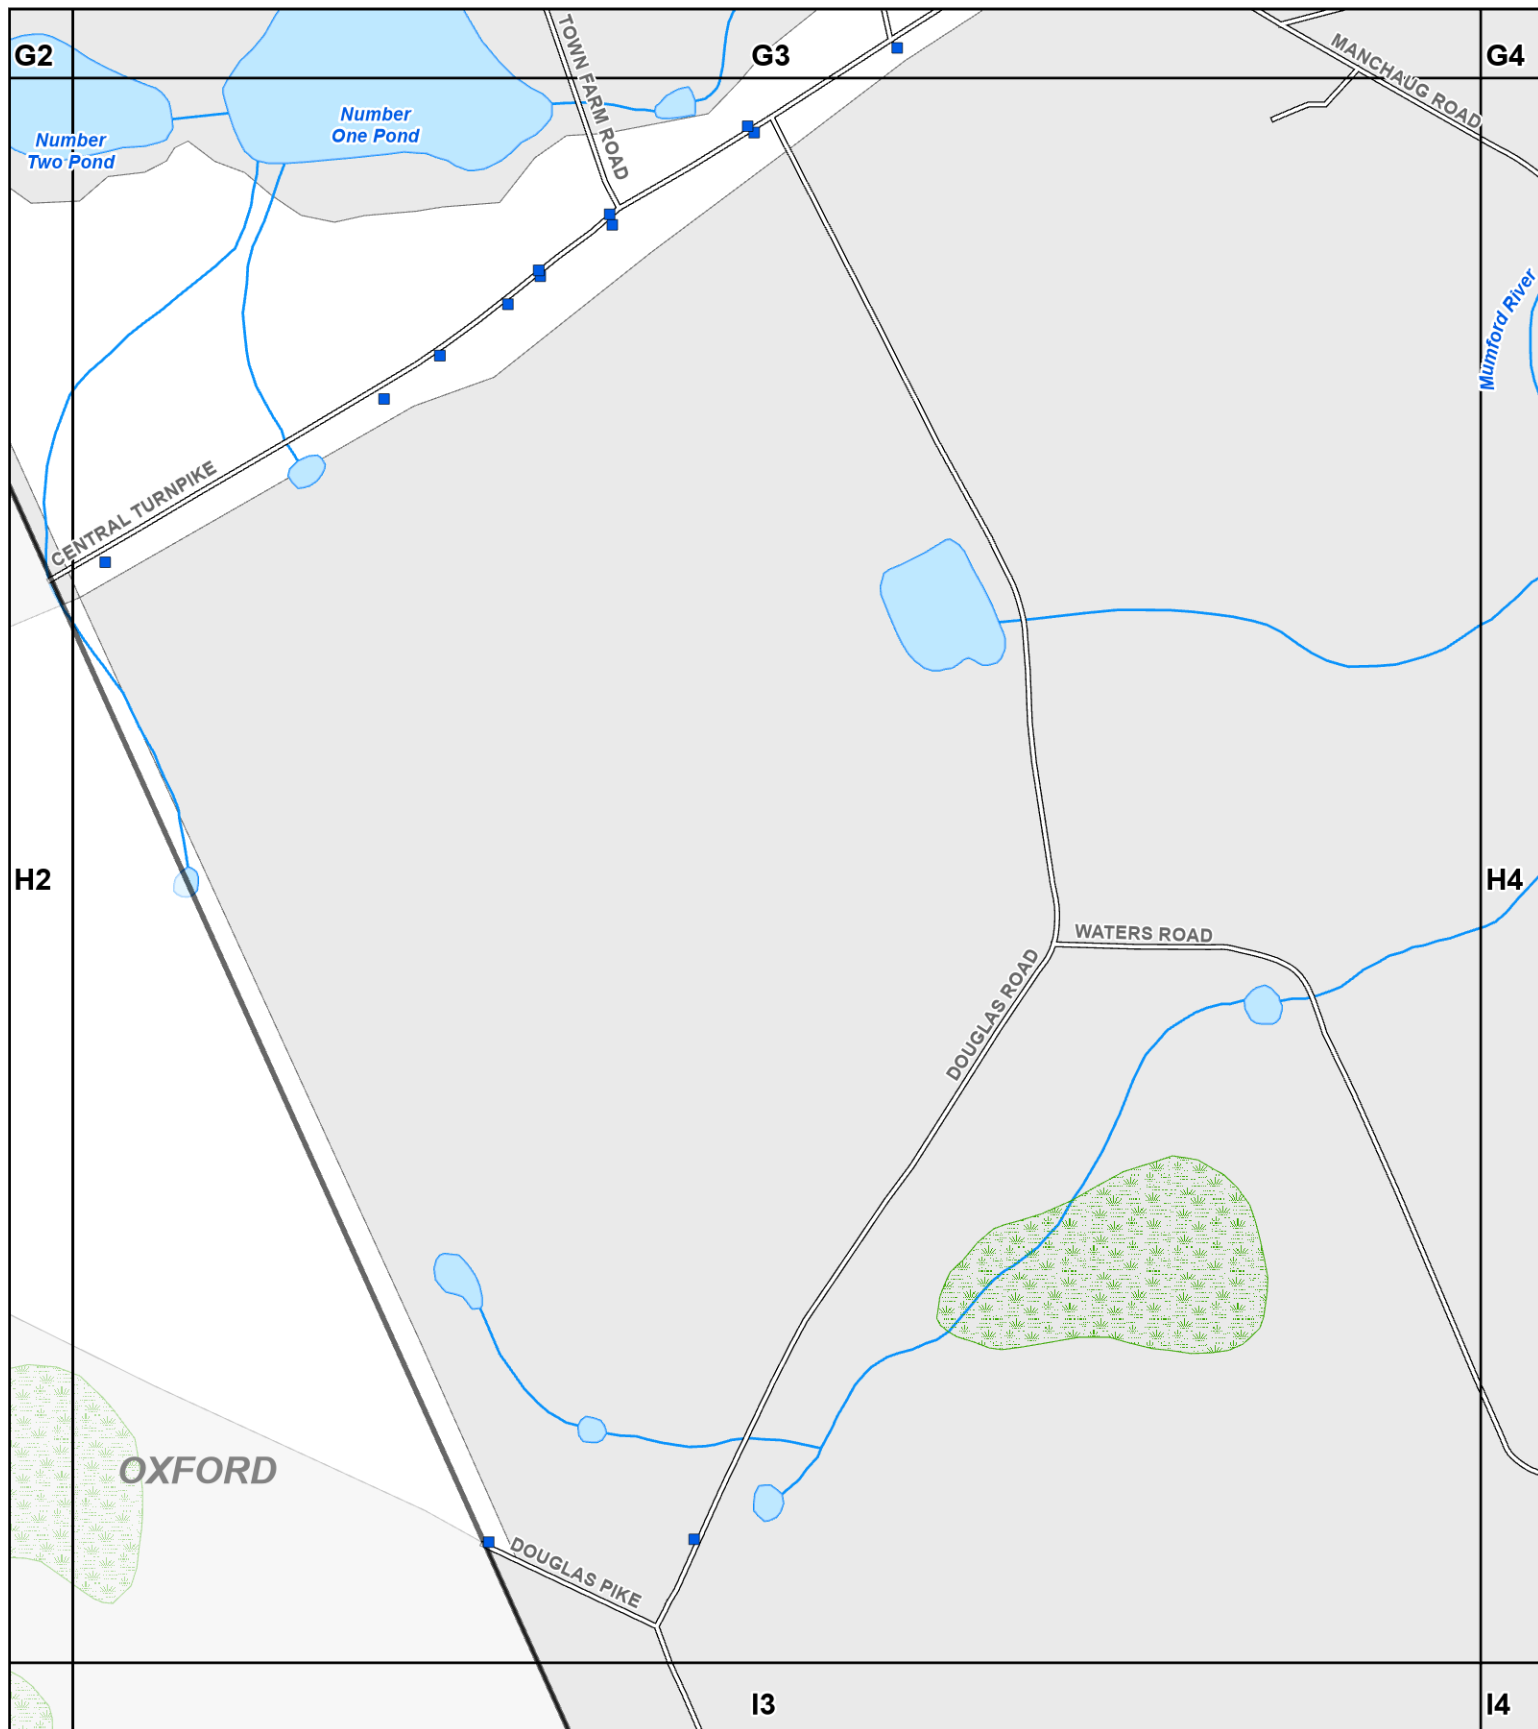


H2



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







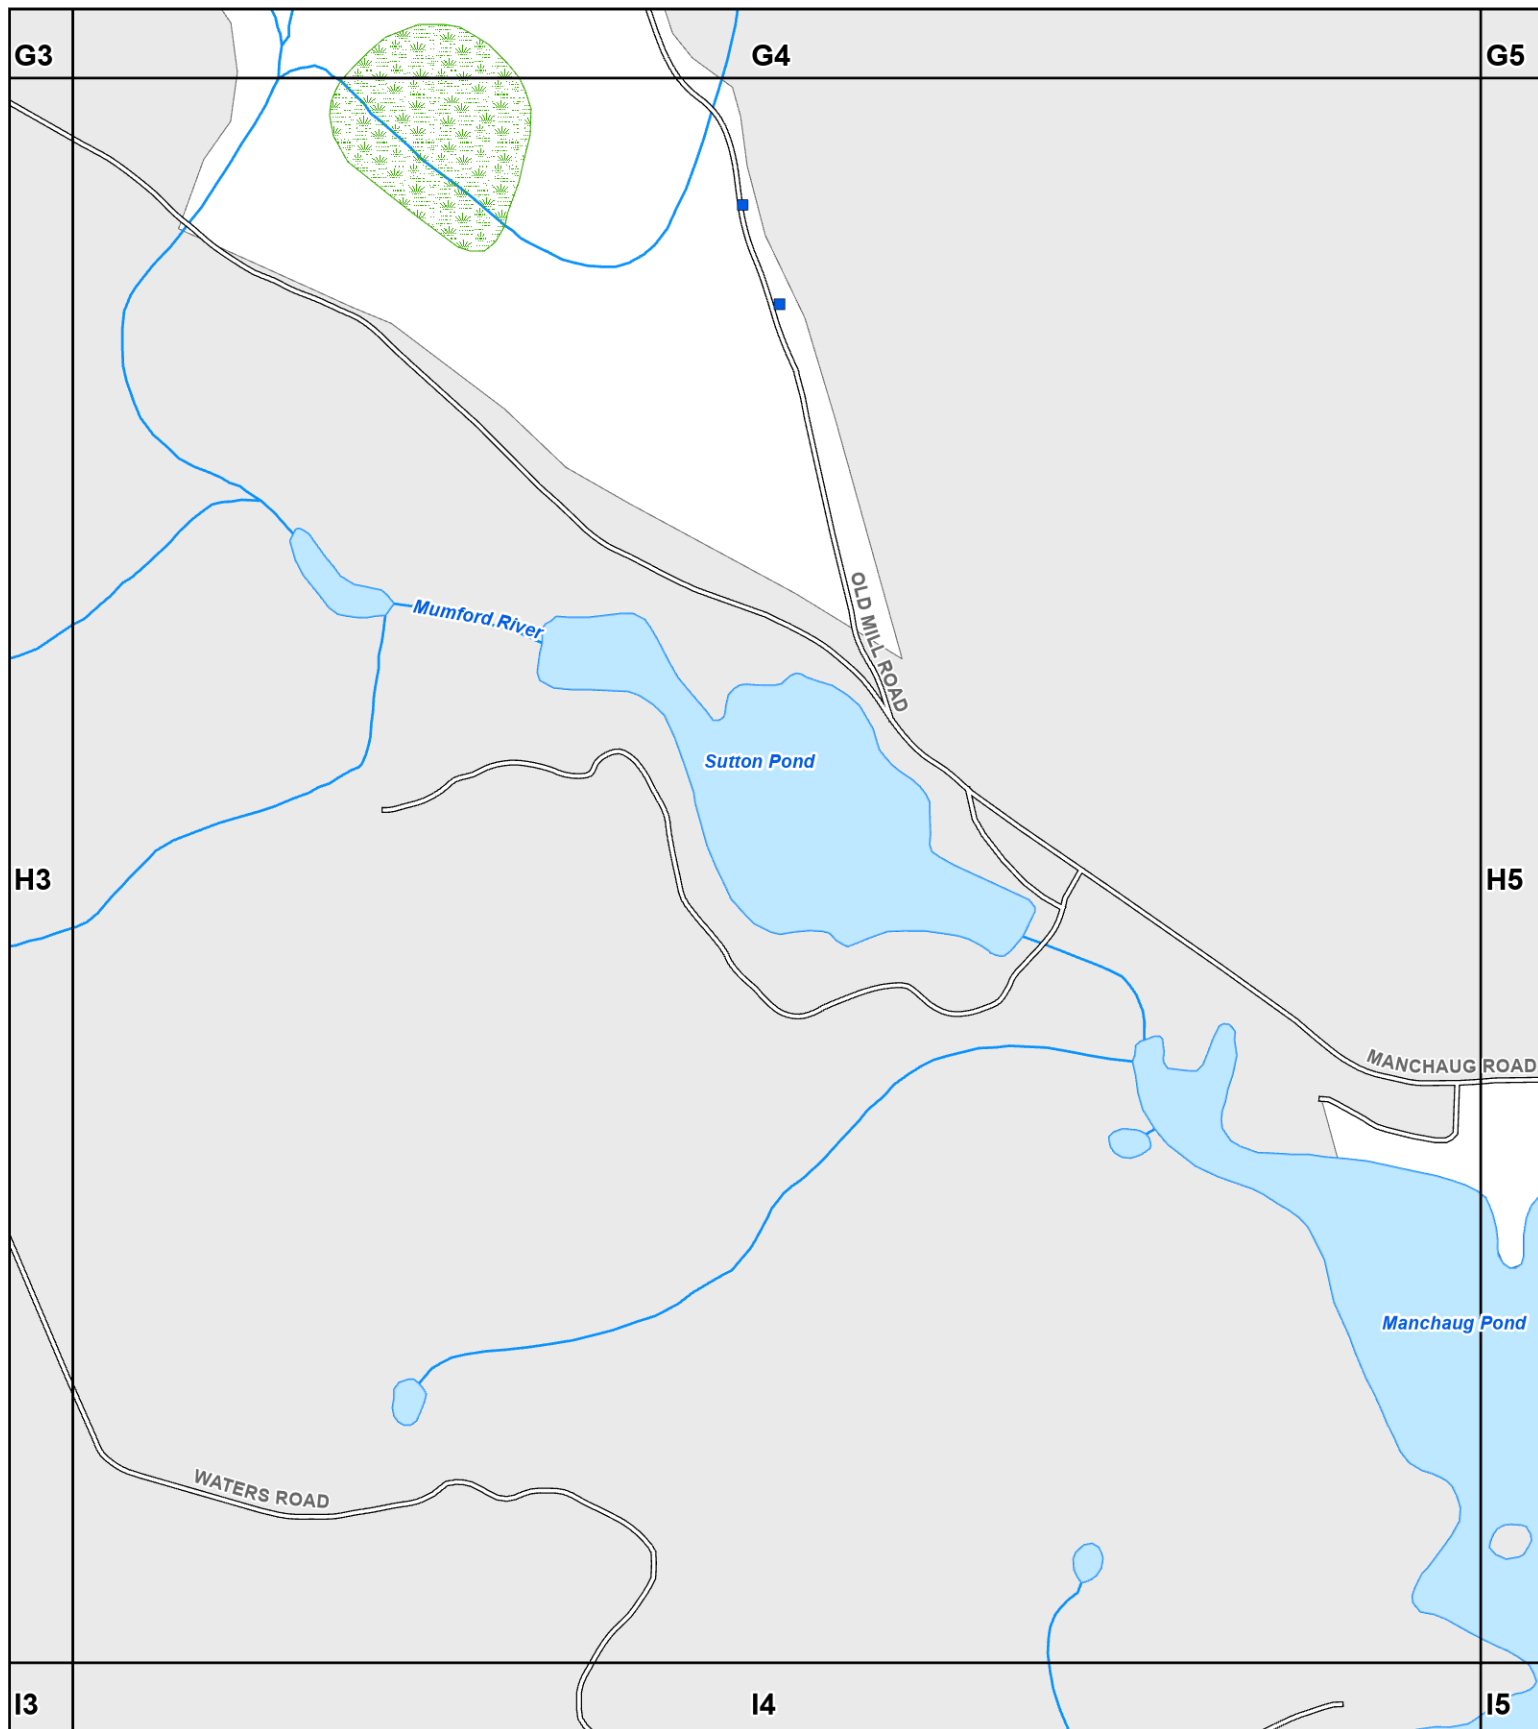


H3



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

H4



Comprehensive
Environmental
Incorporated

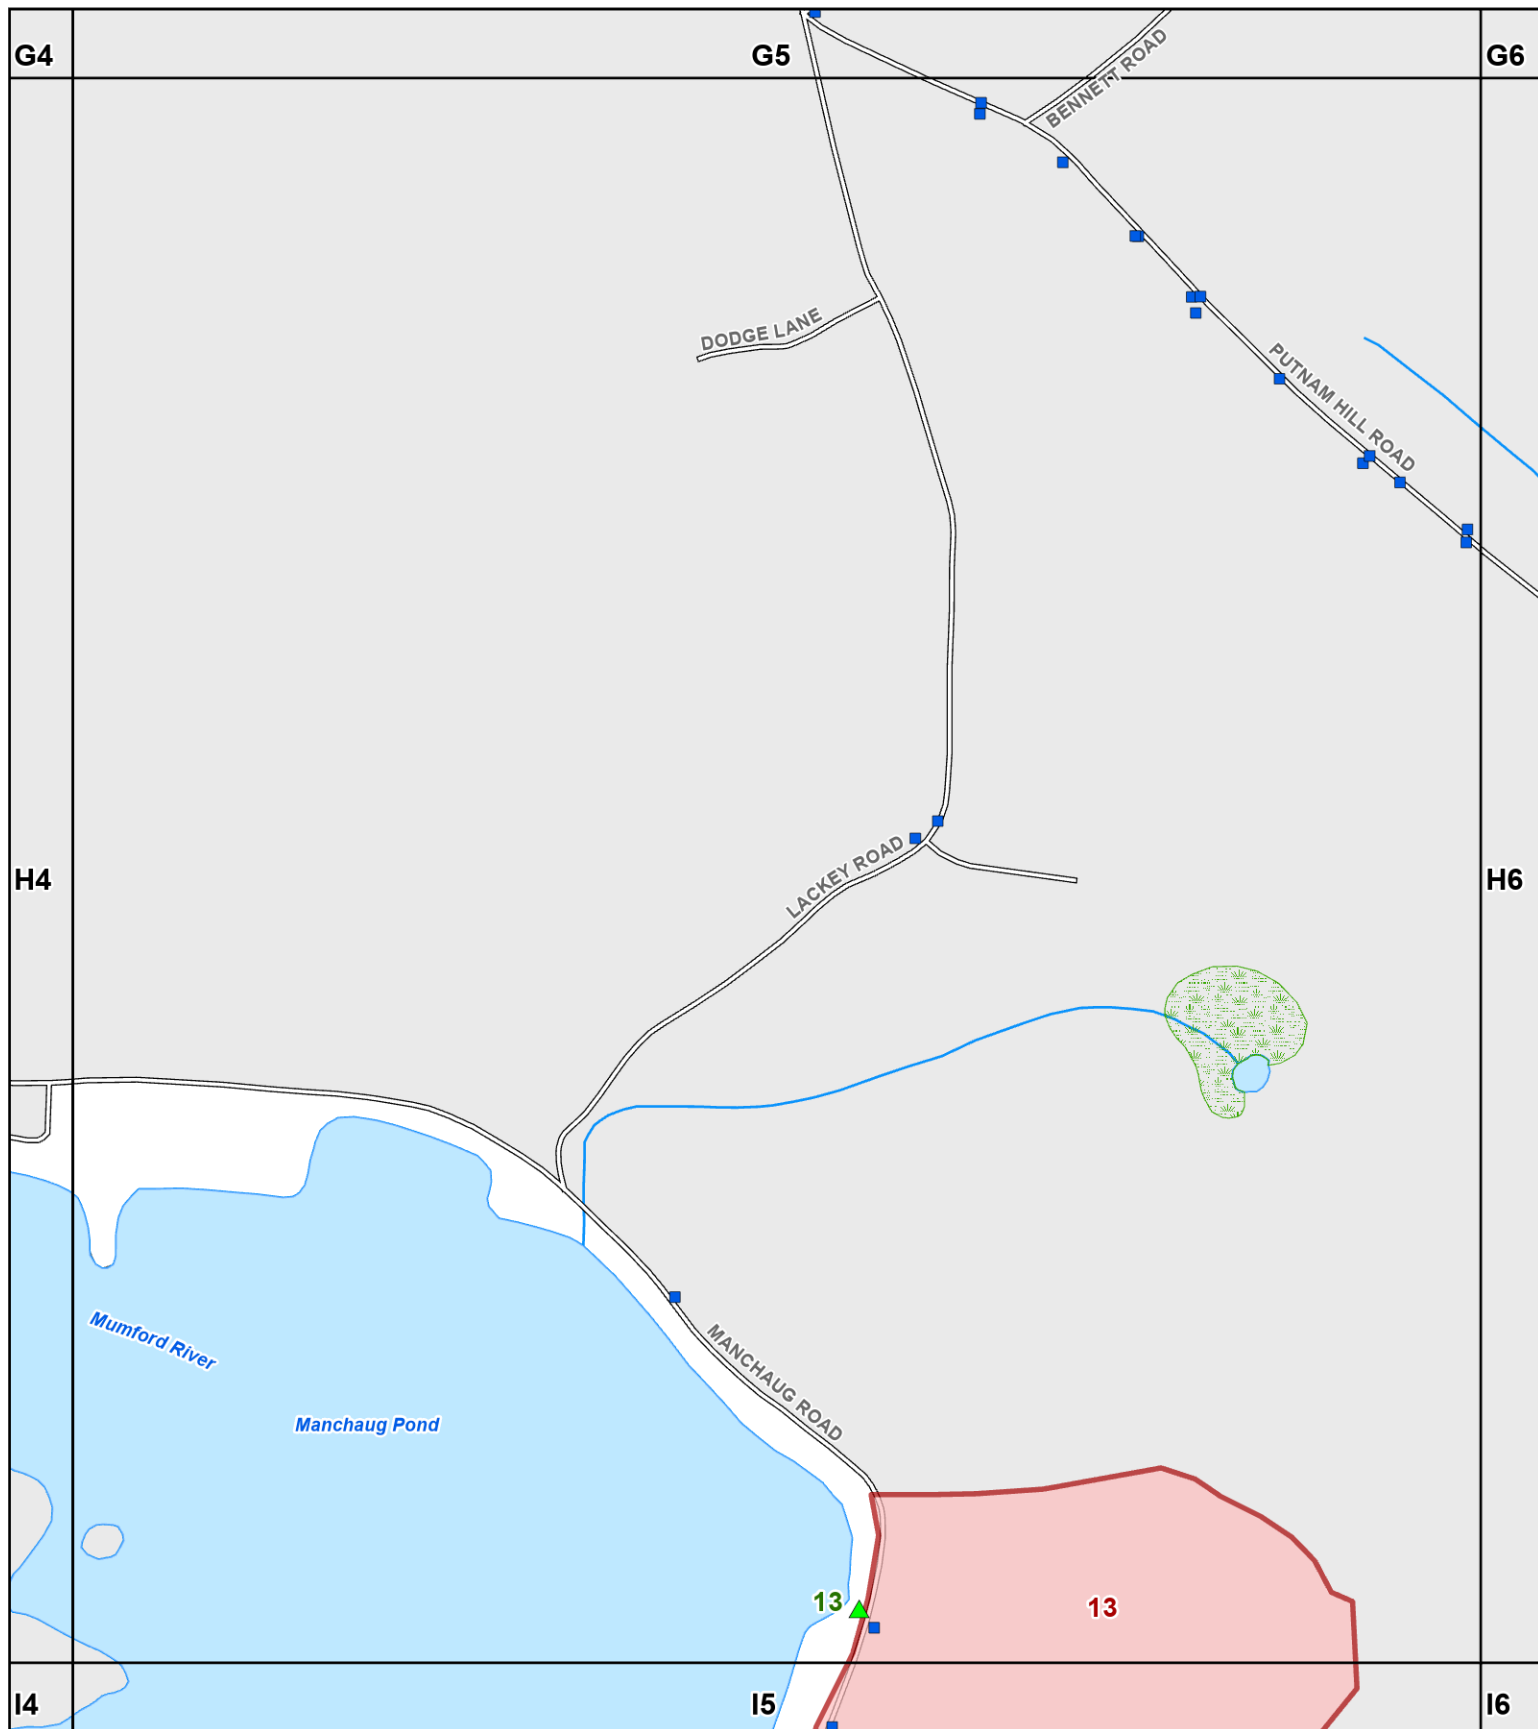

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









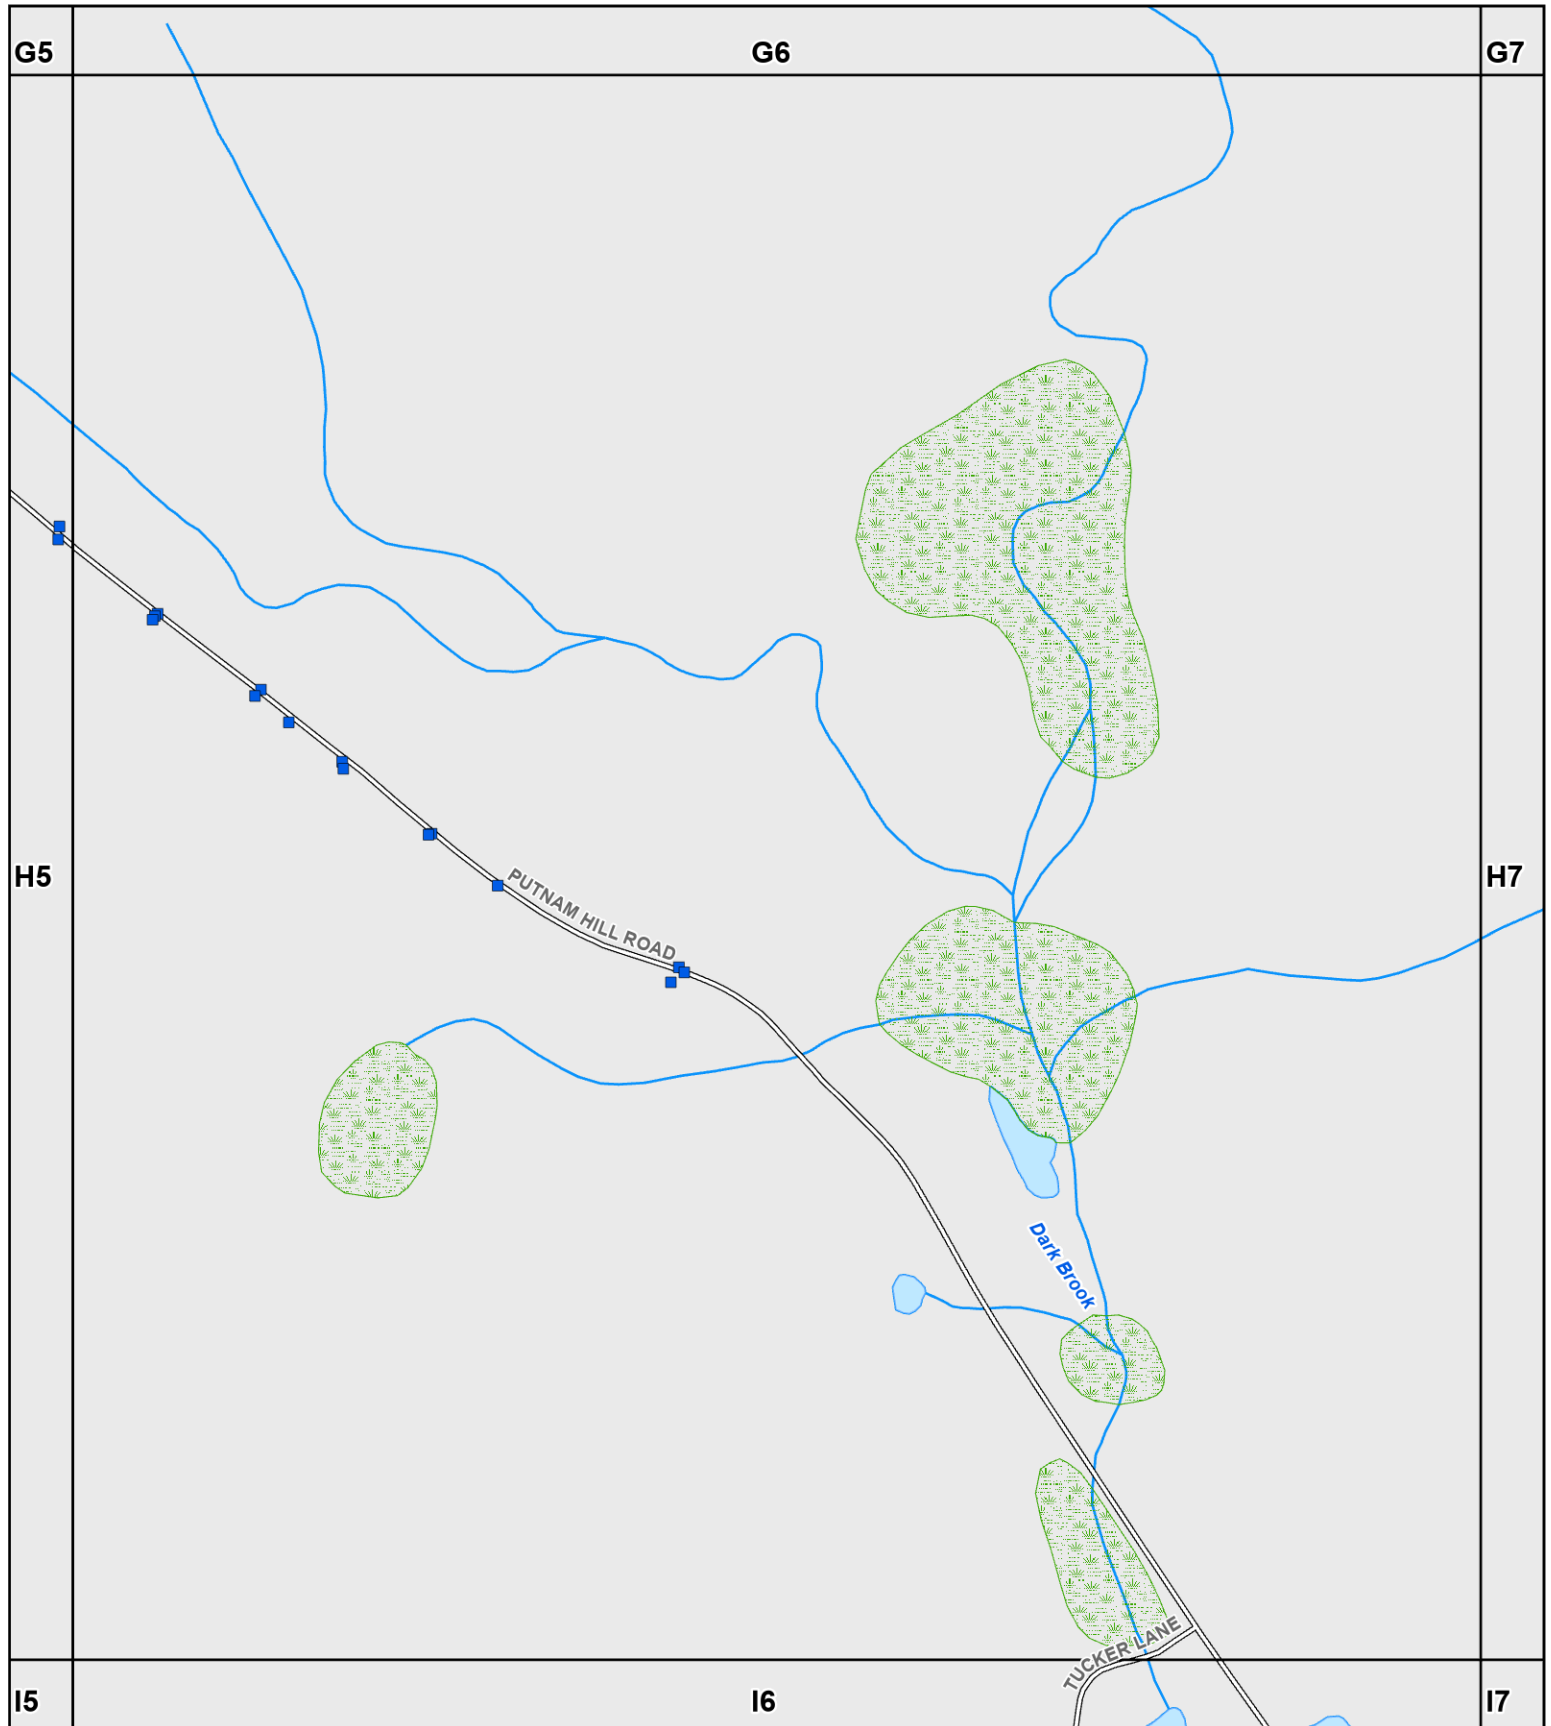


SHEET
H5



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







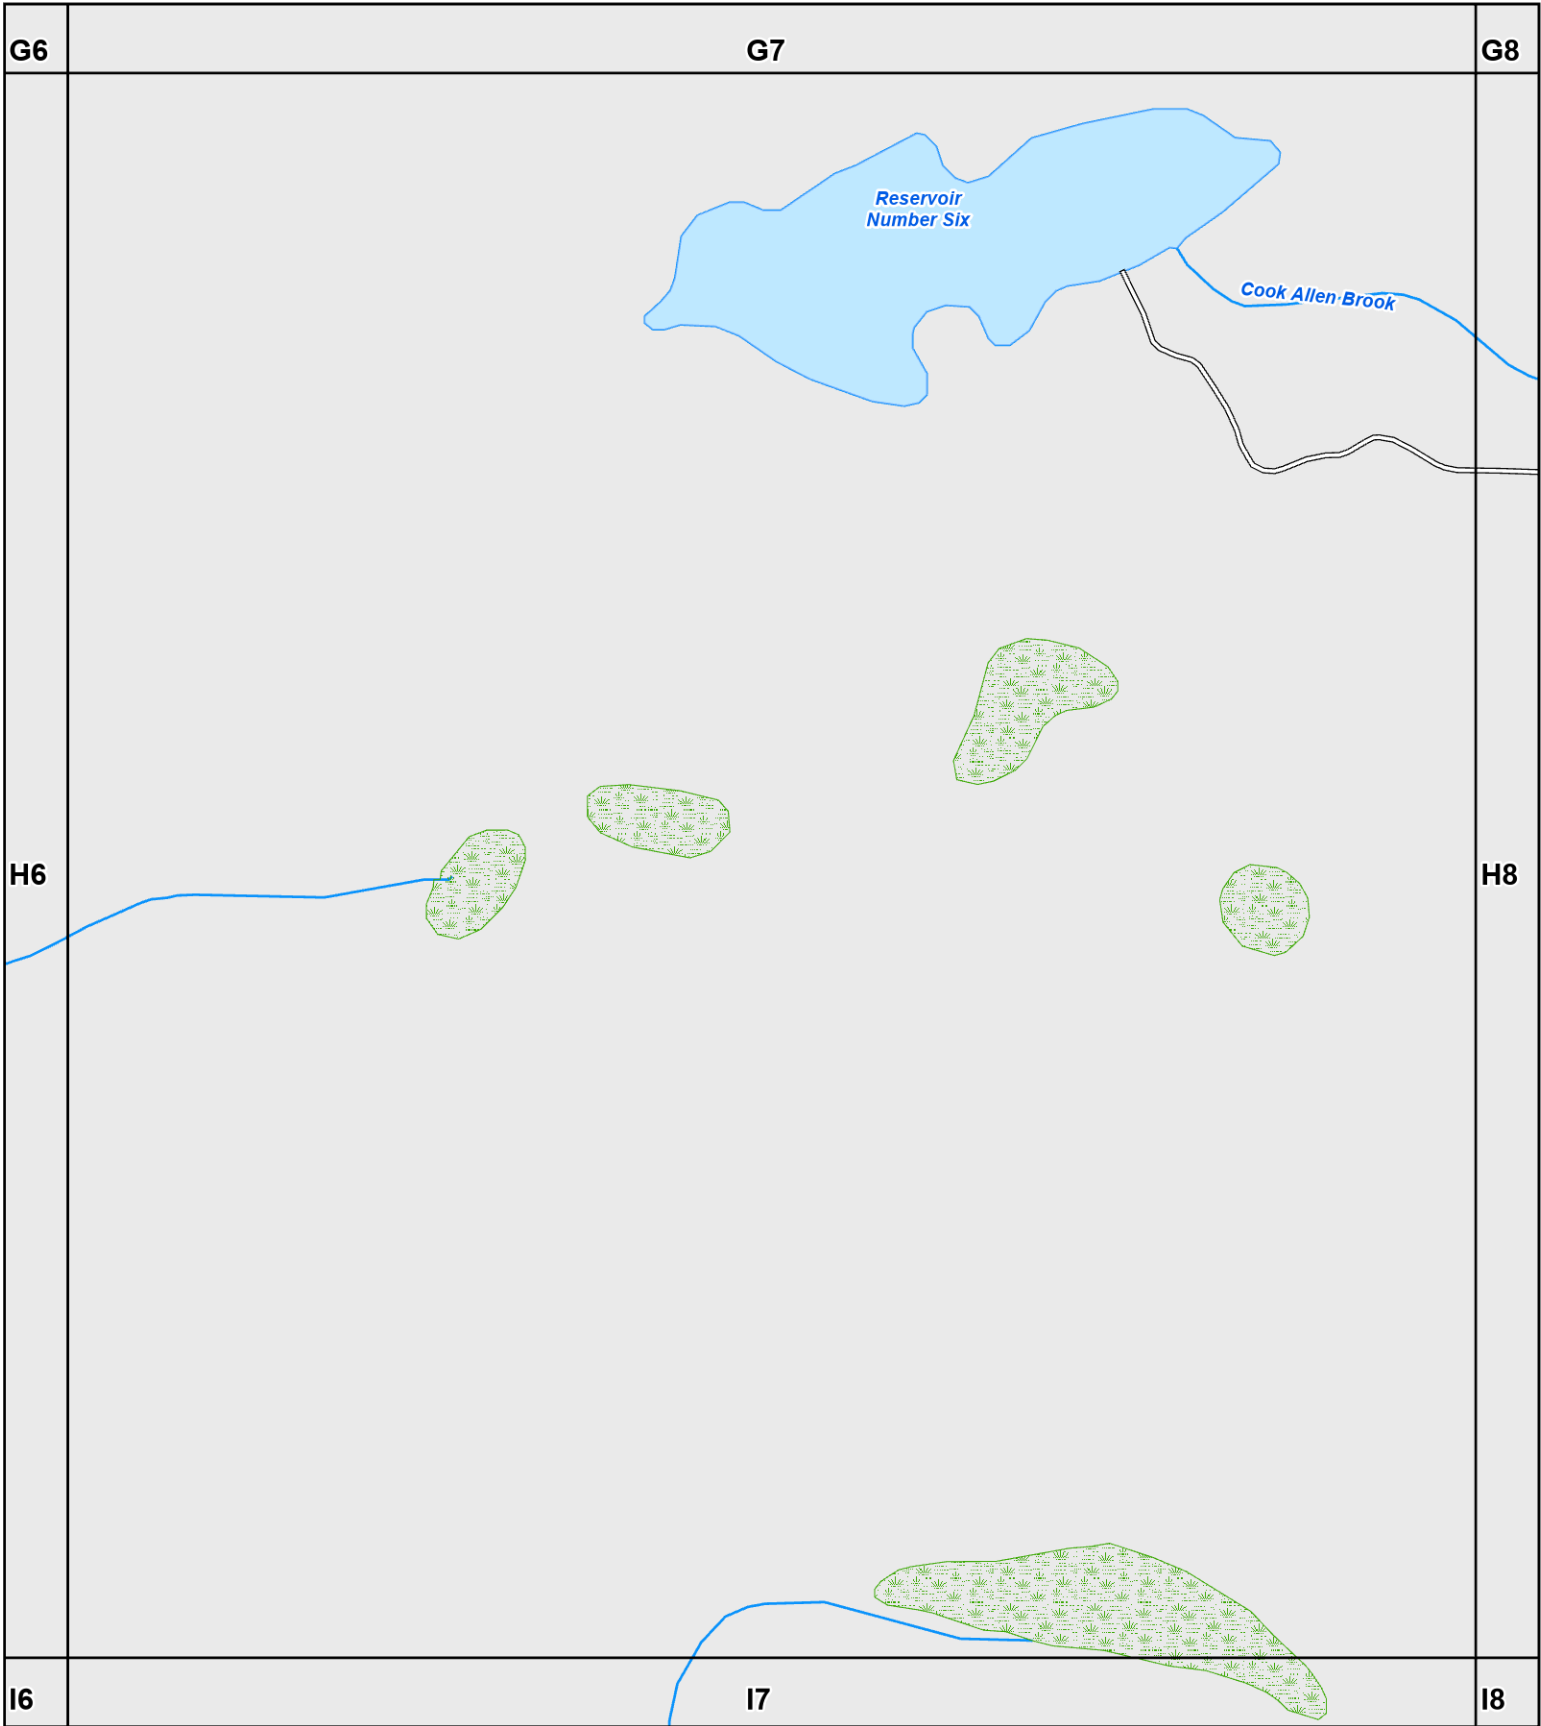


H6




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







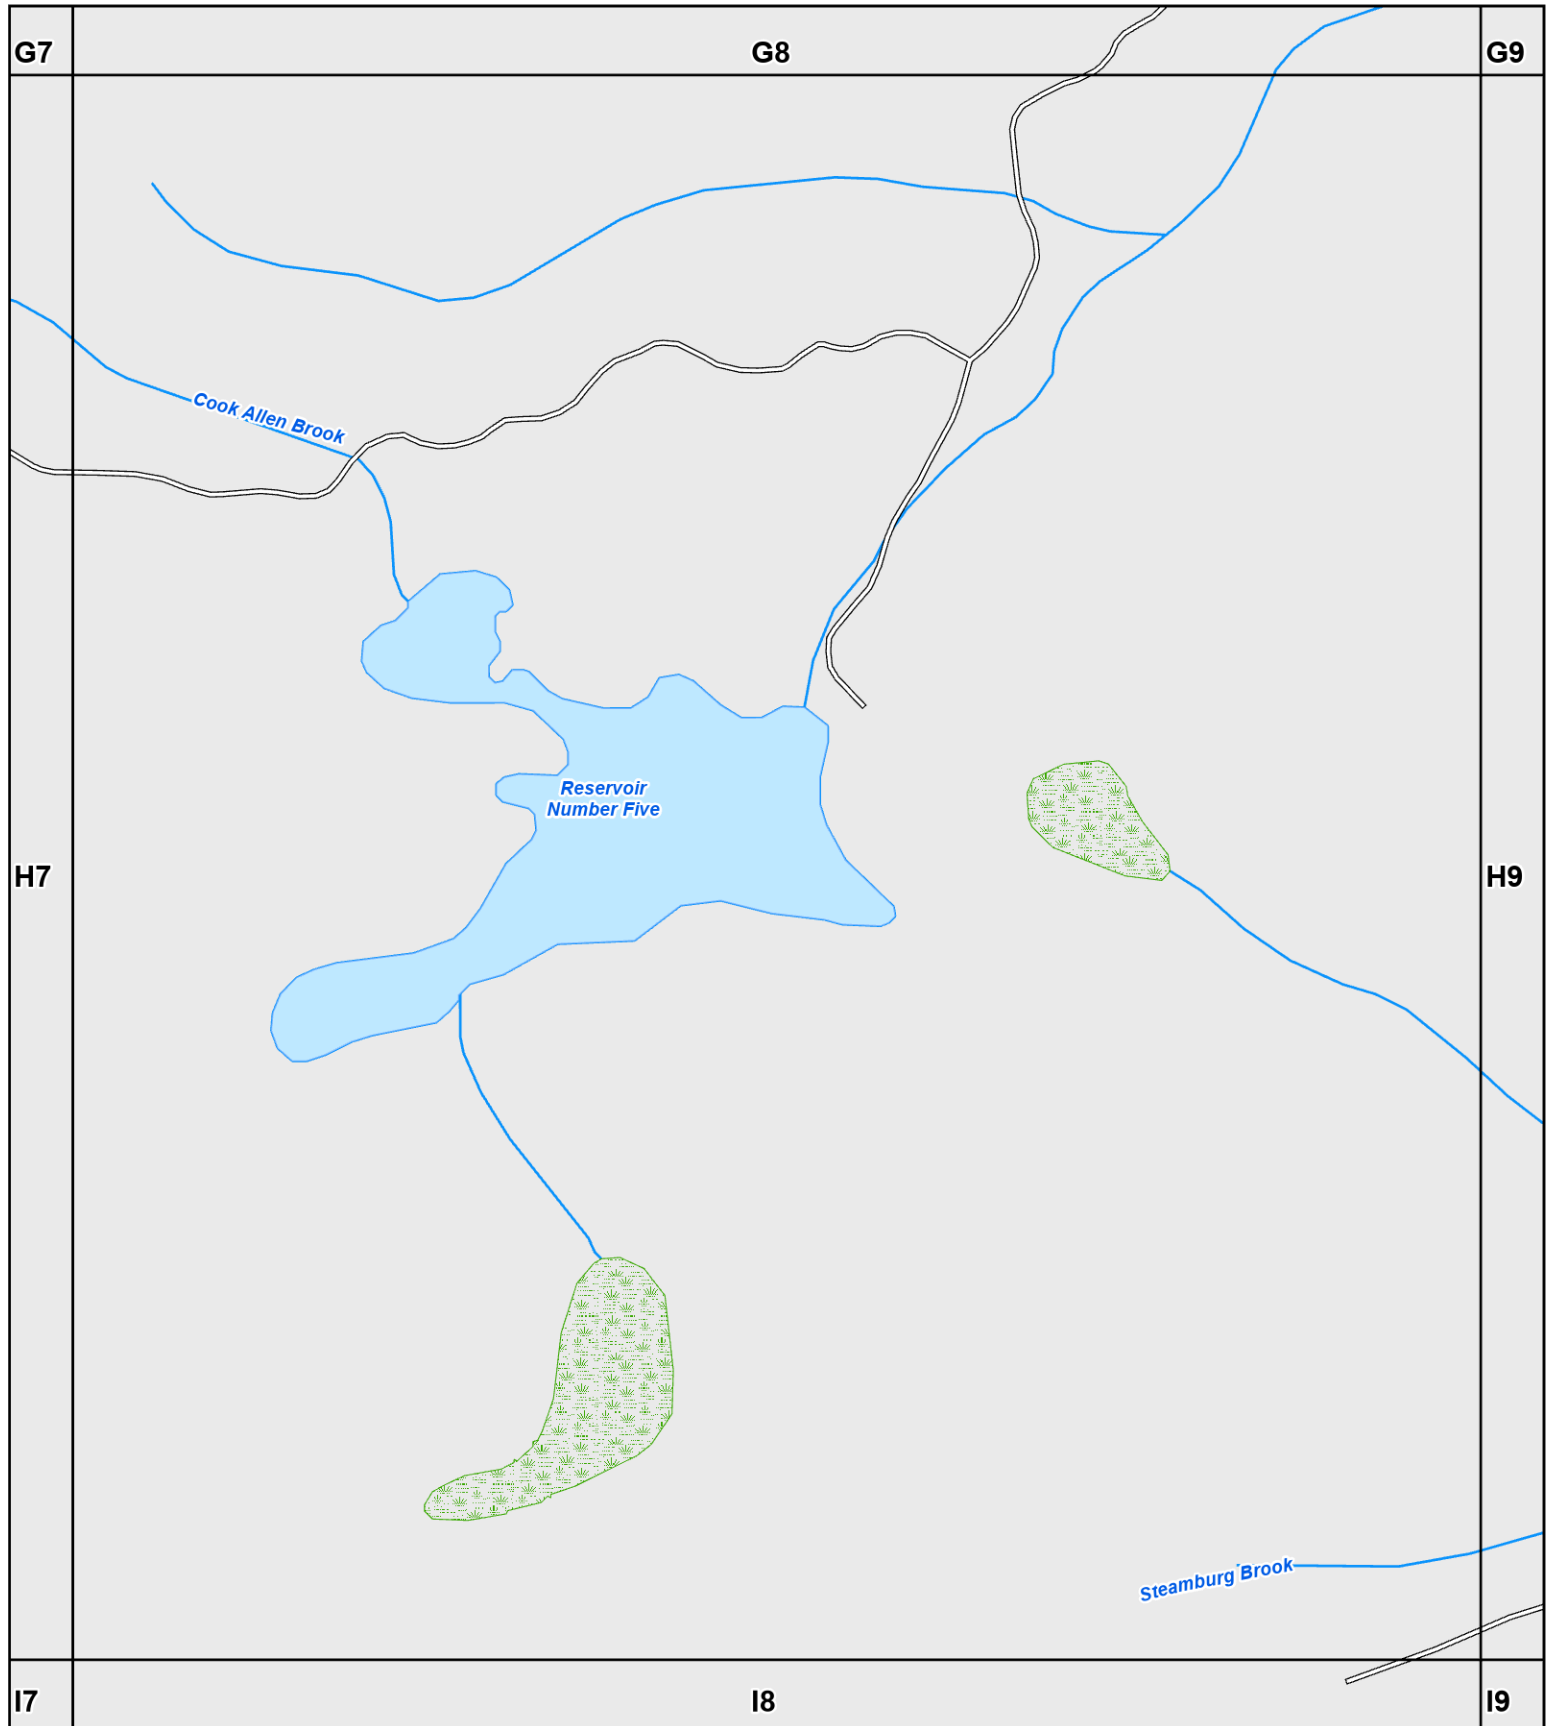


H7




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI



**SHEET
H8**




**Comprehensive
Environmental
Incorporated**

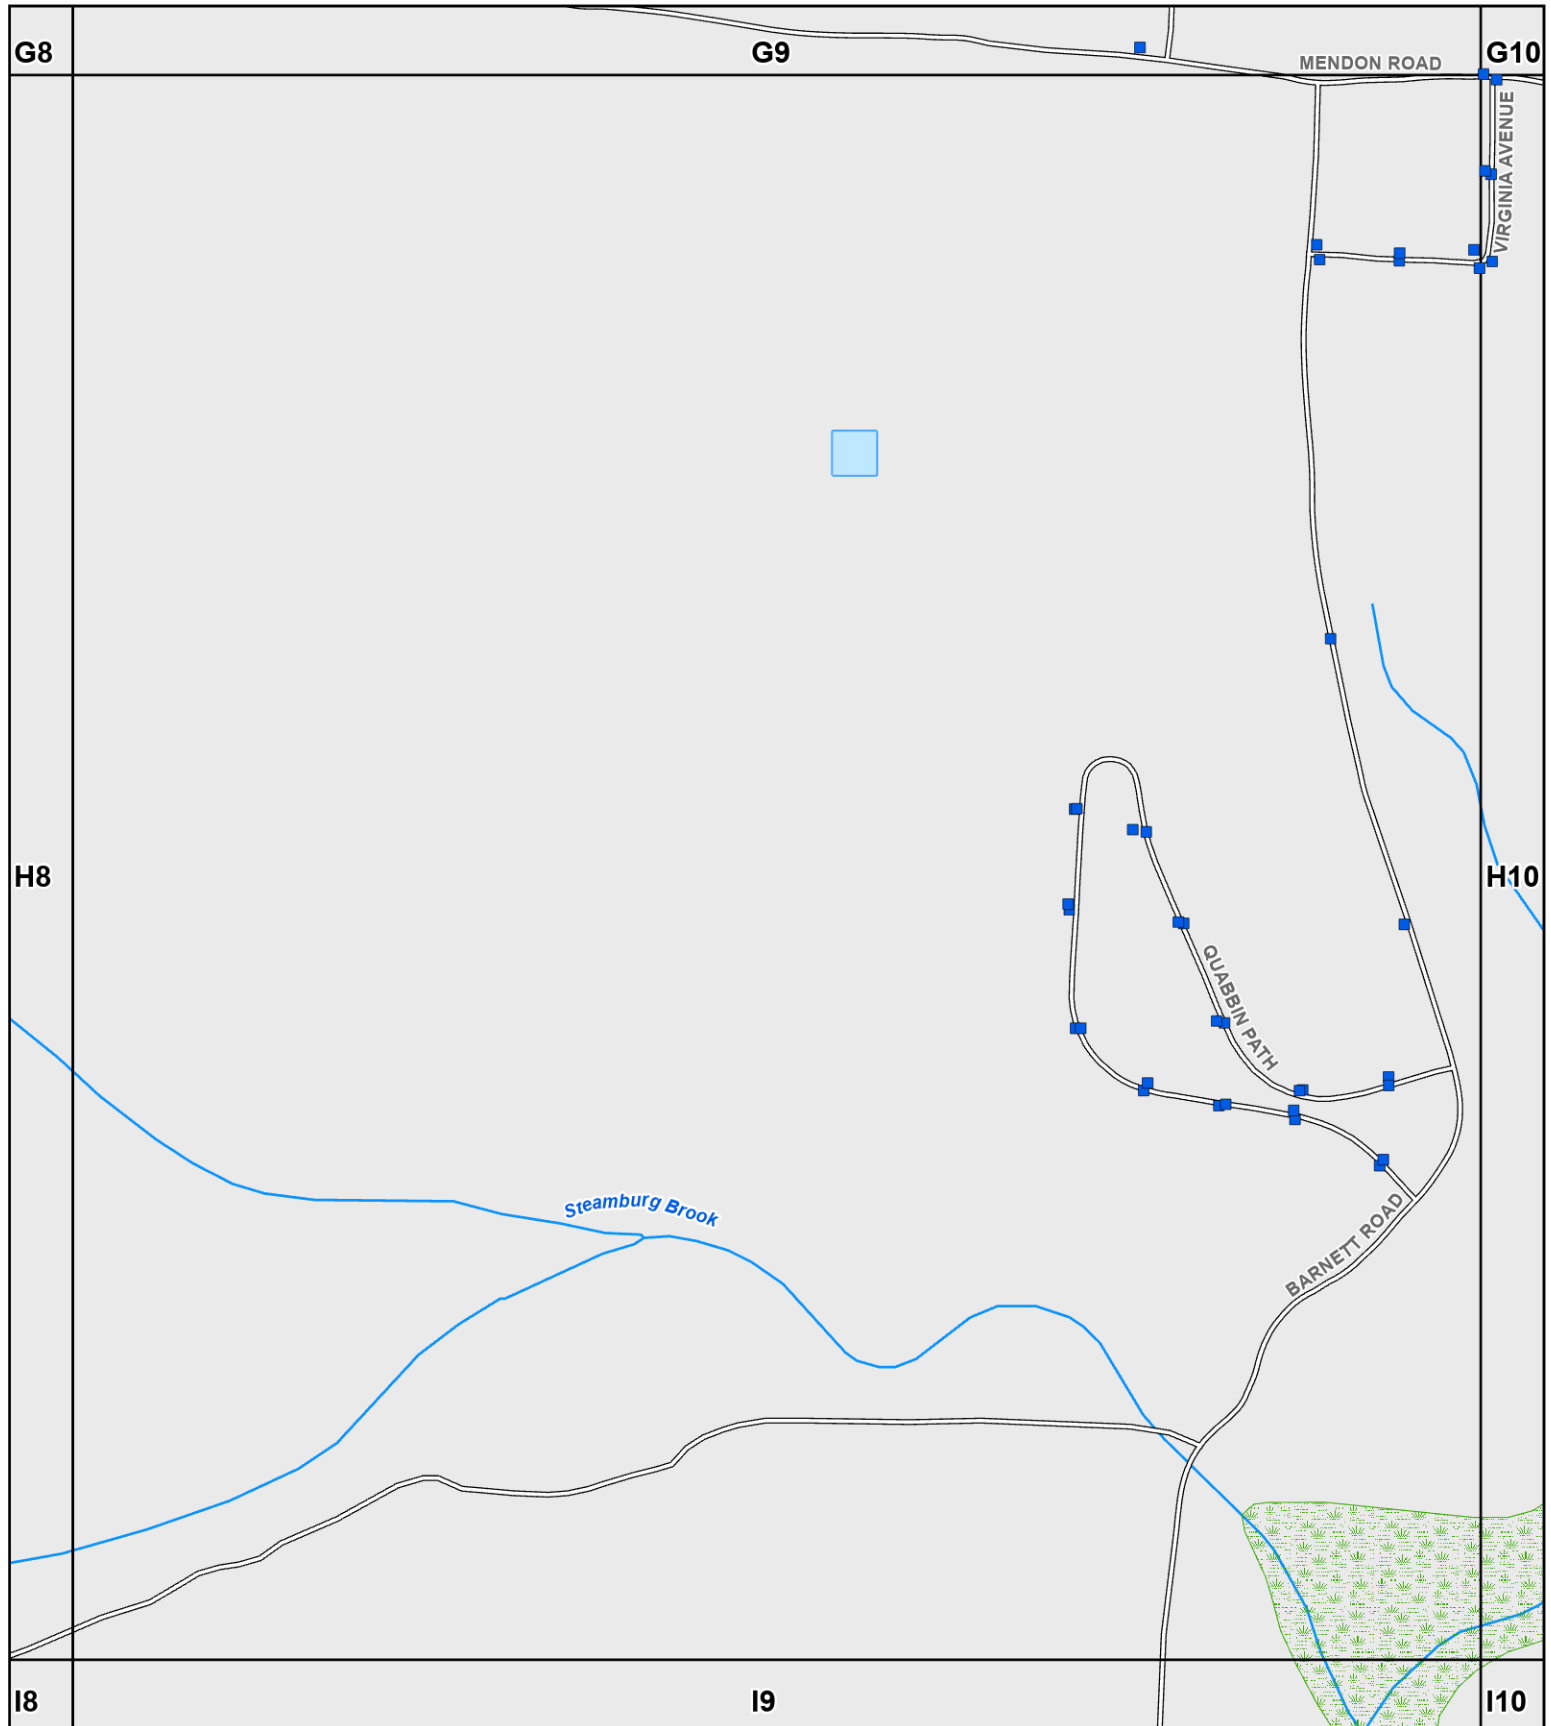

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI









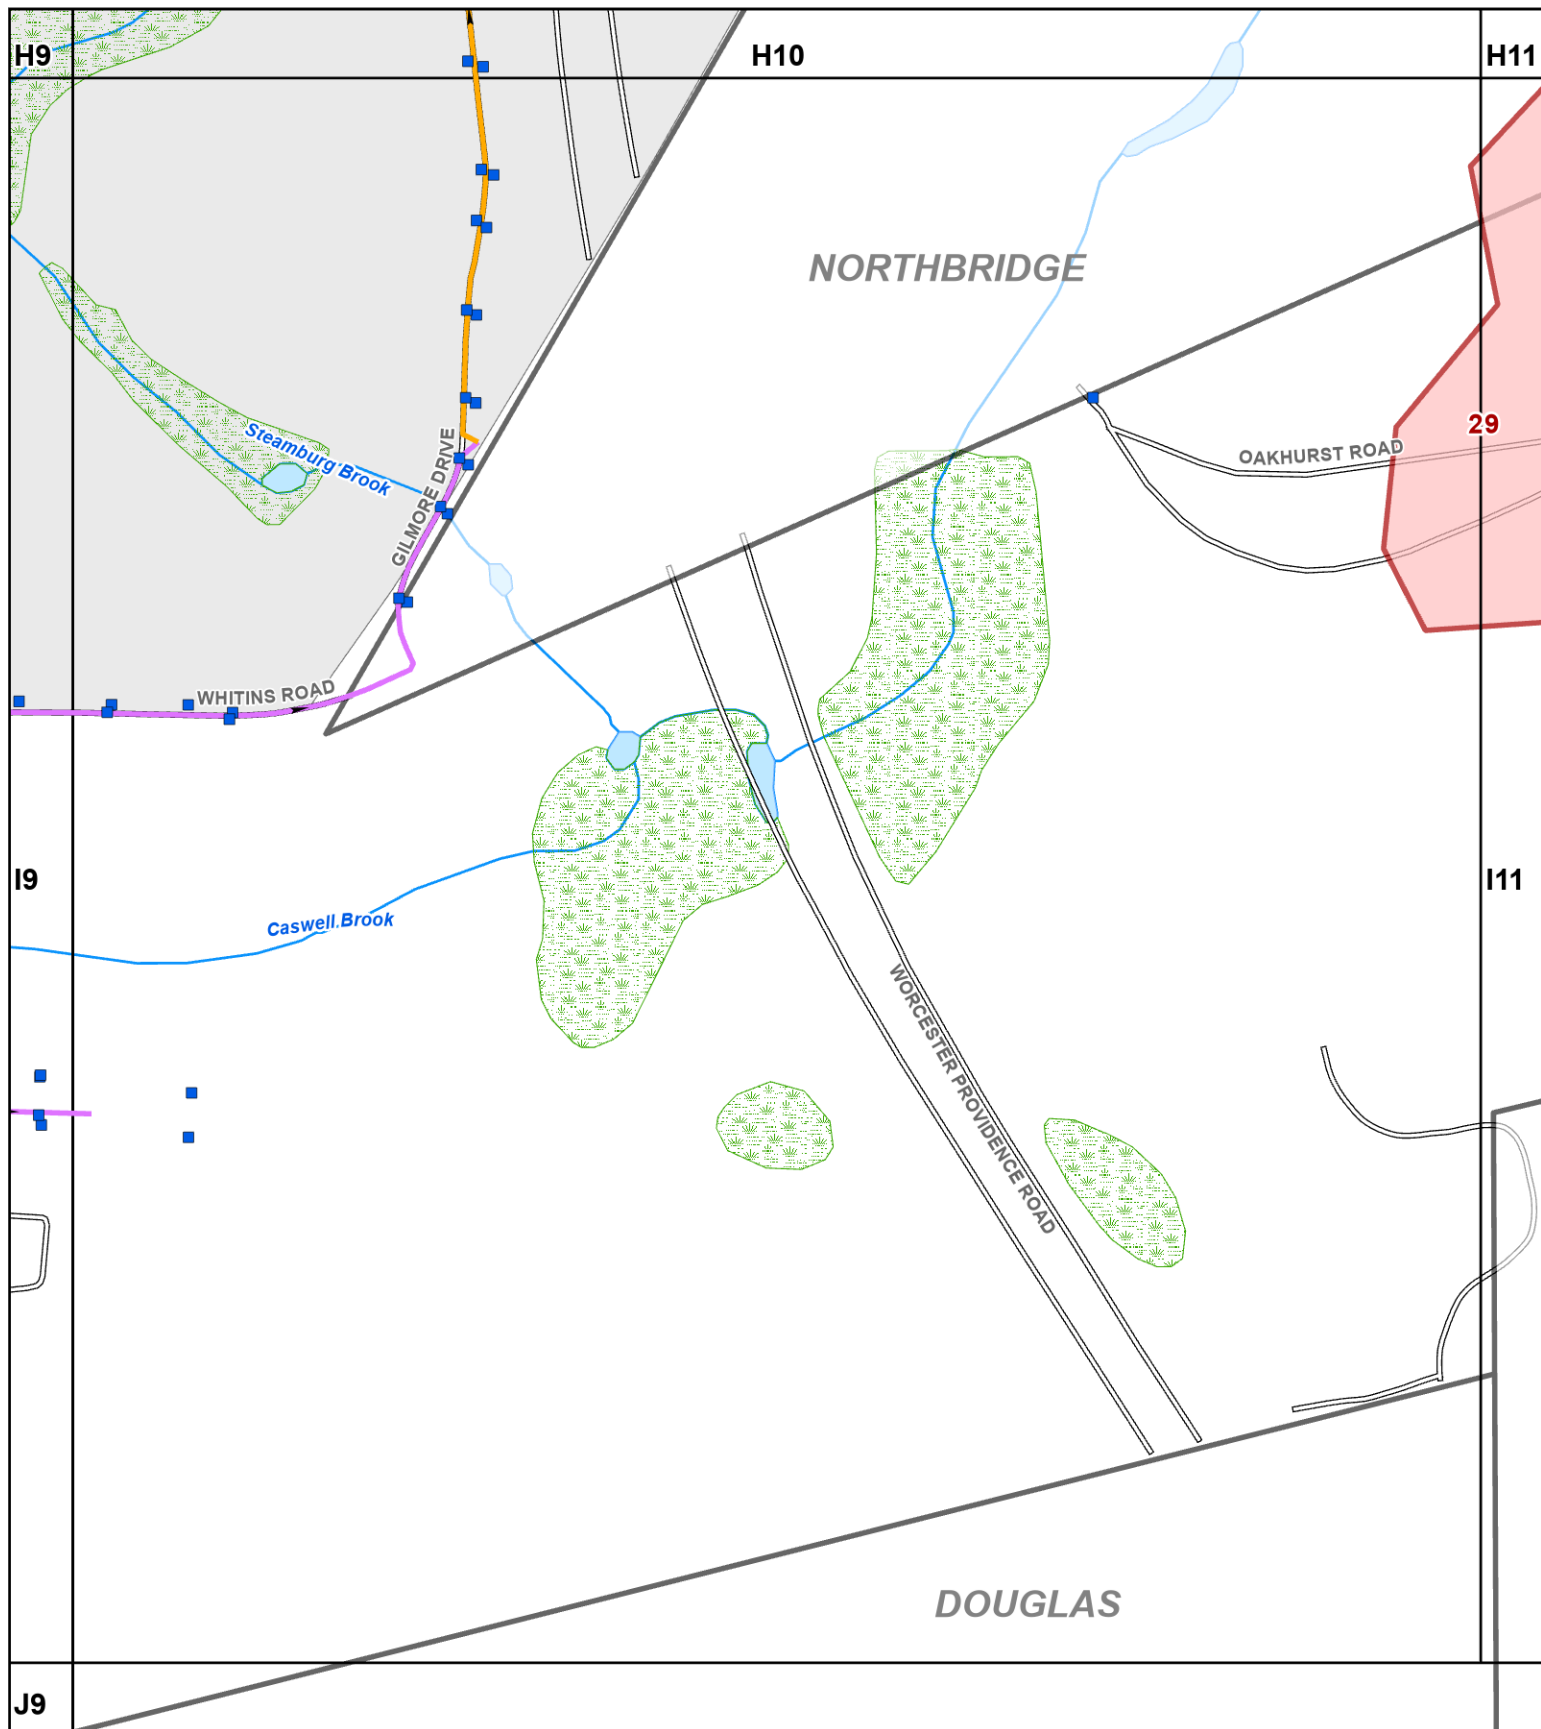


SHEET
H9



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







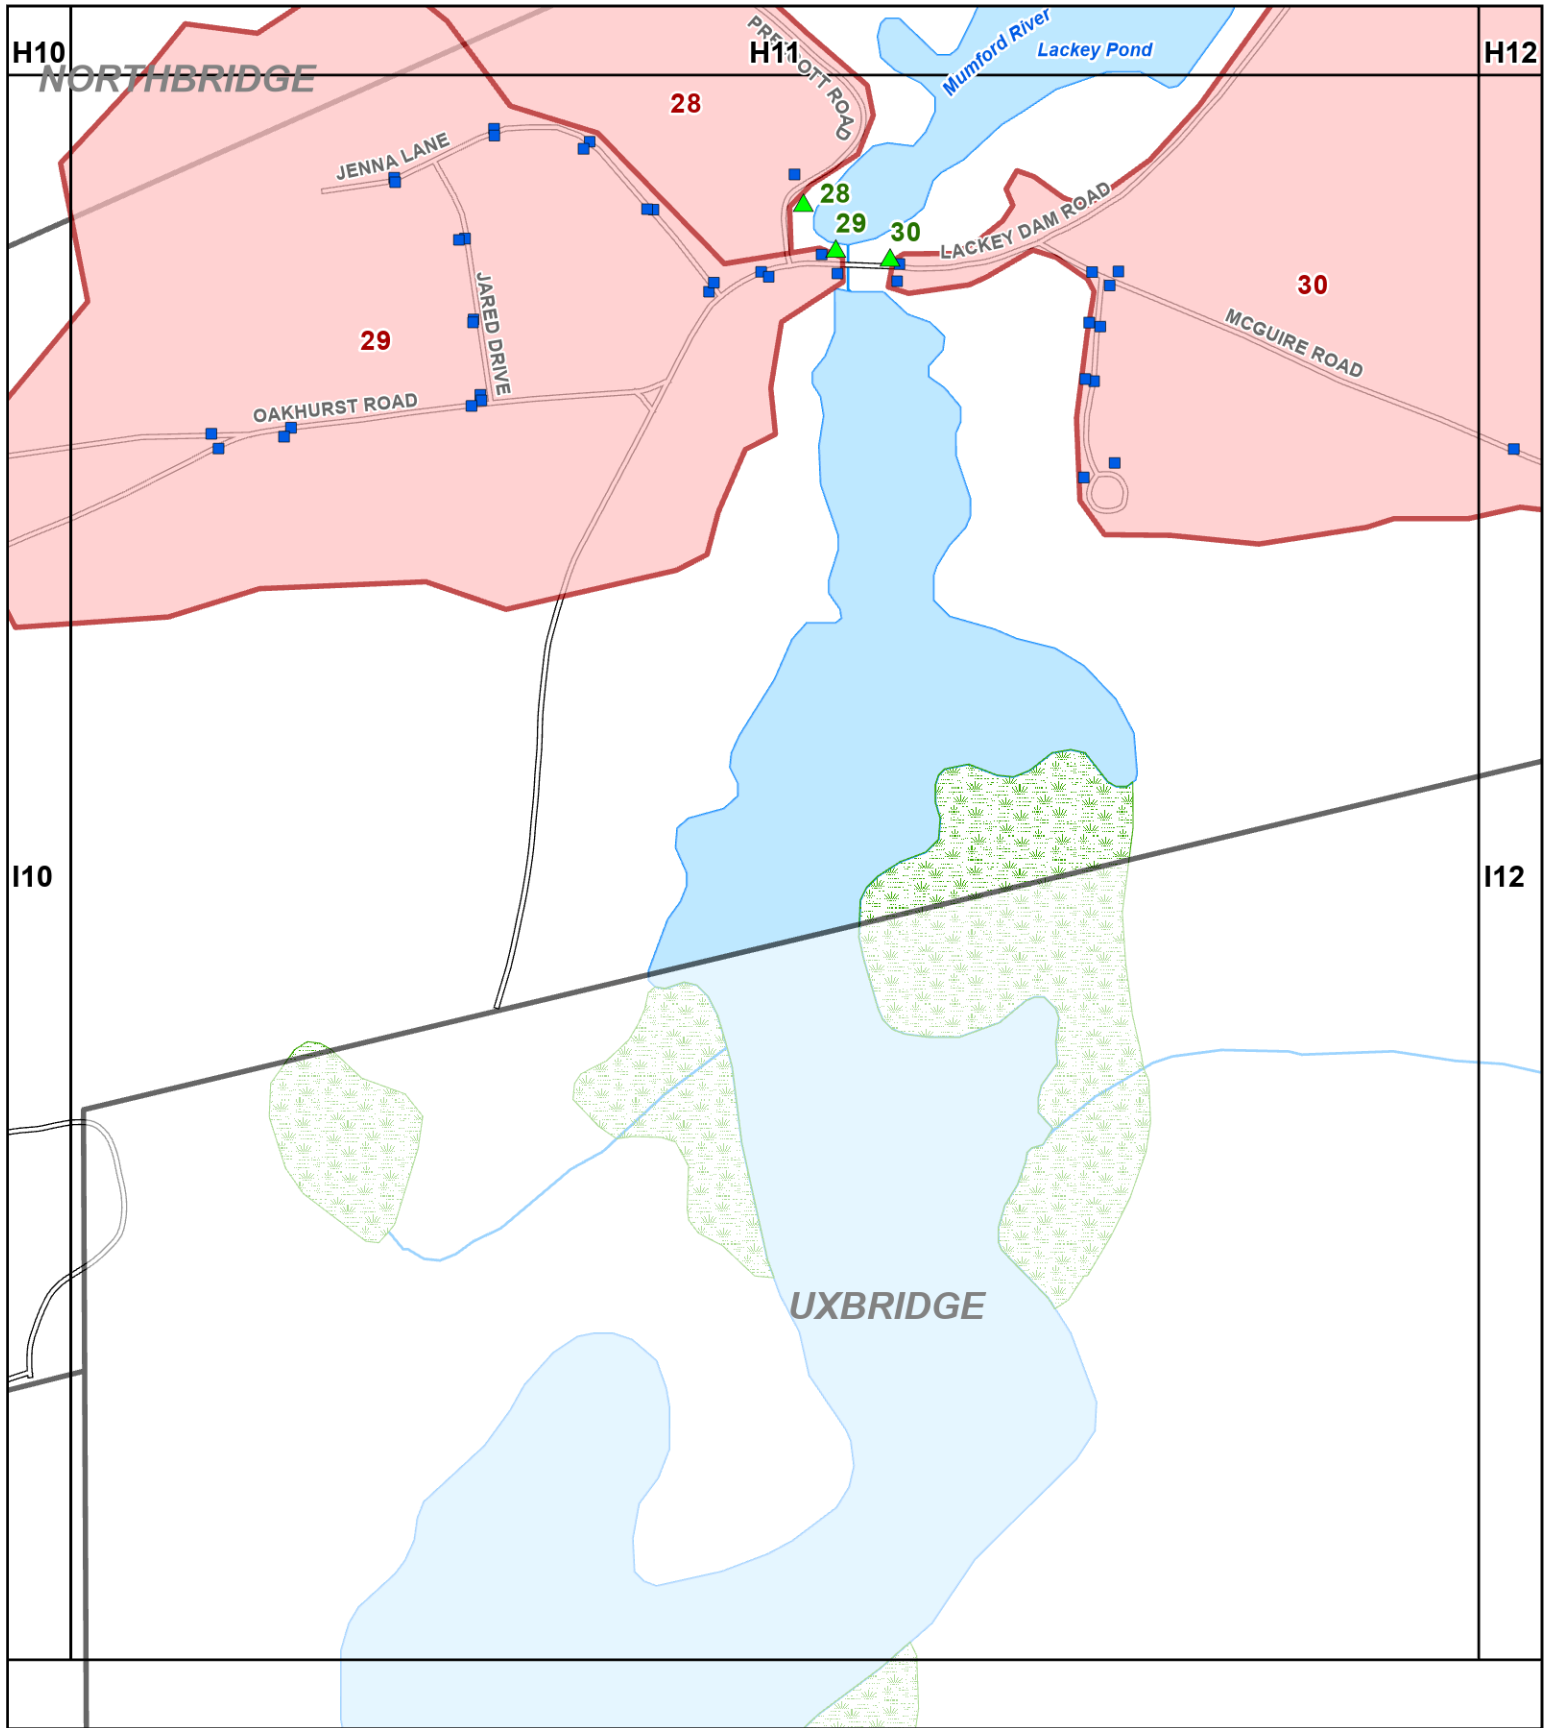


I10




Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







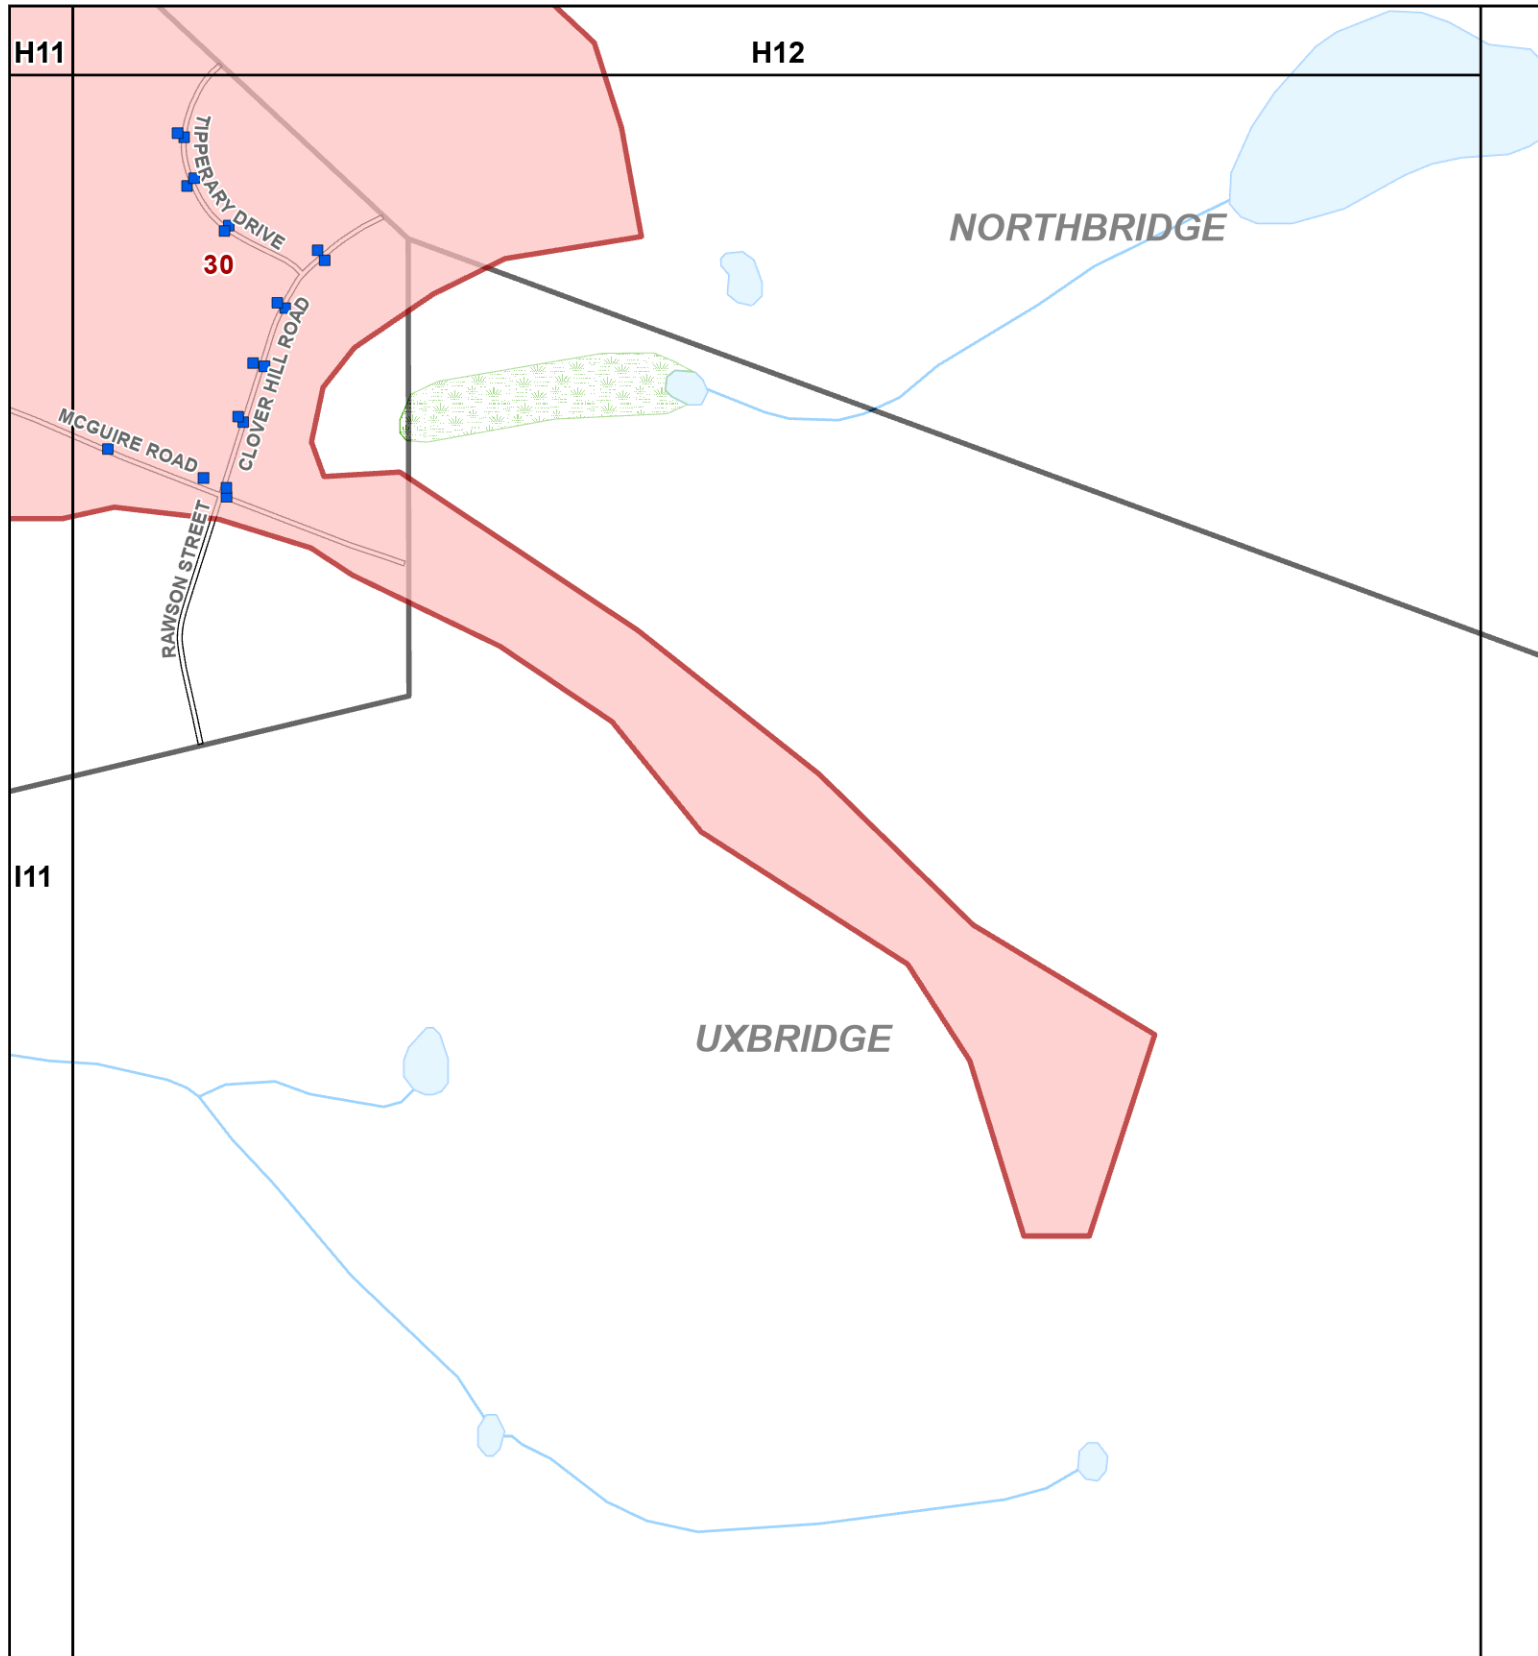


I11



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







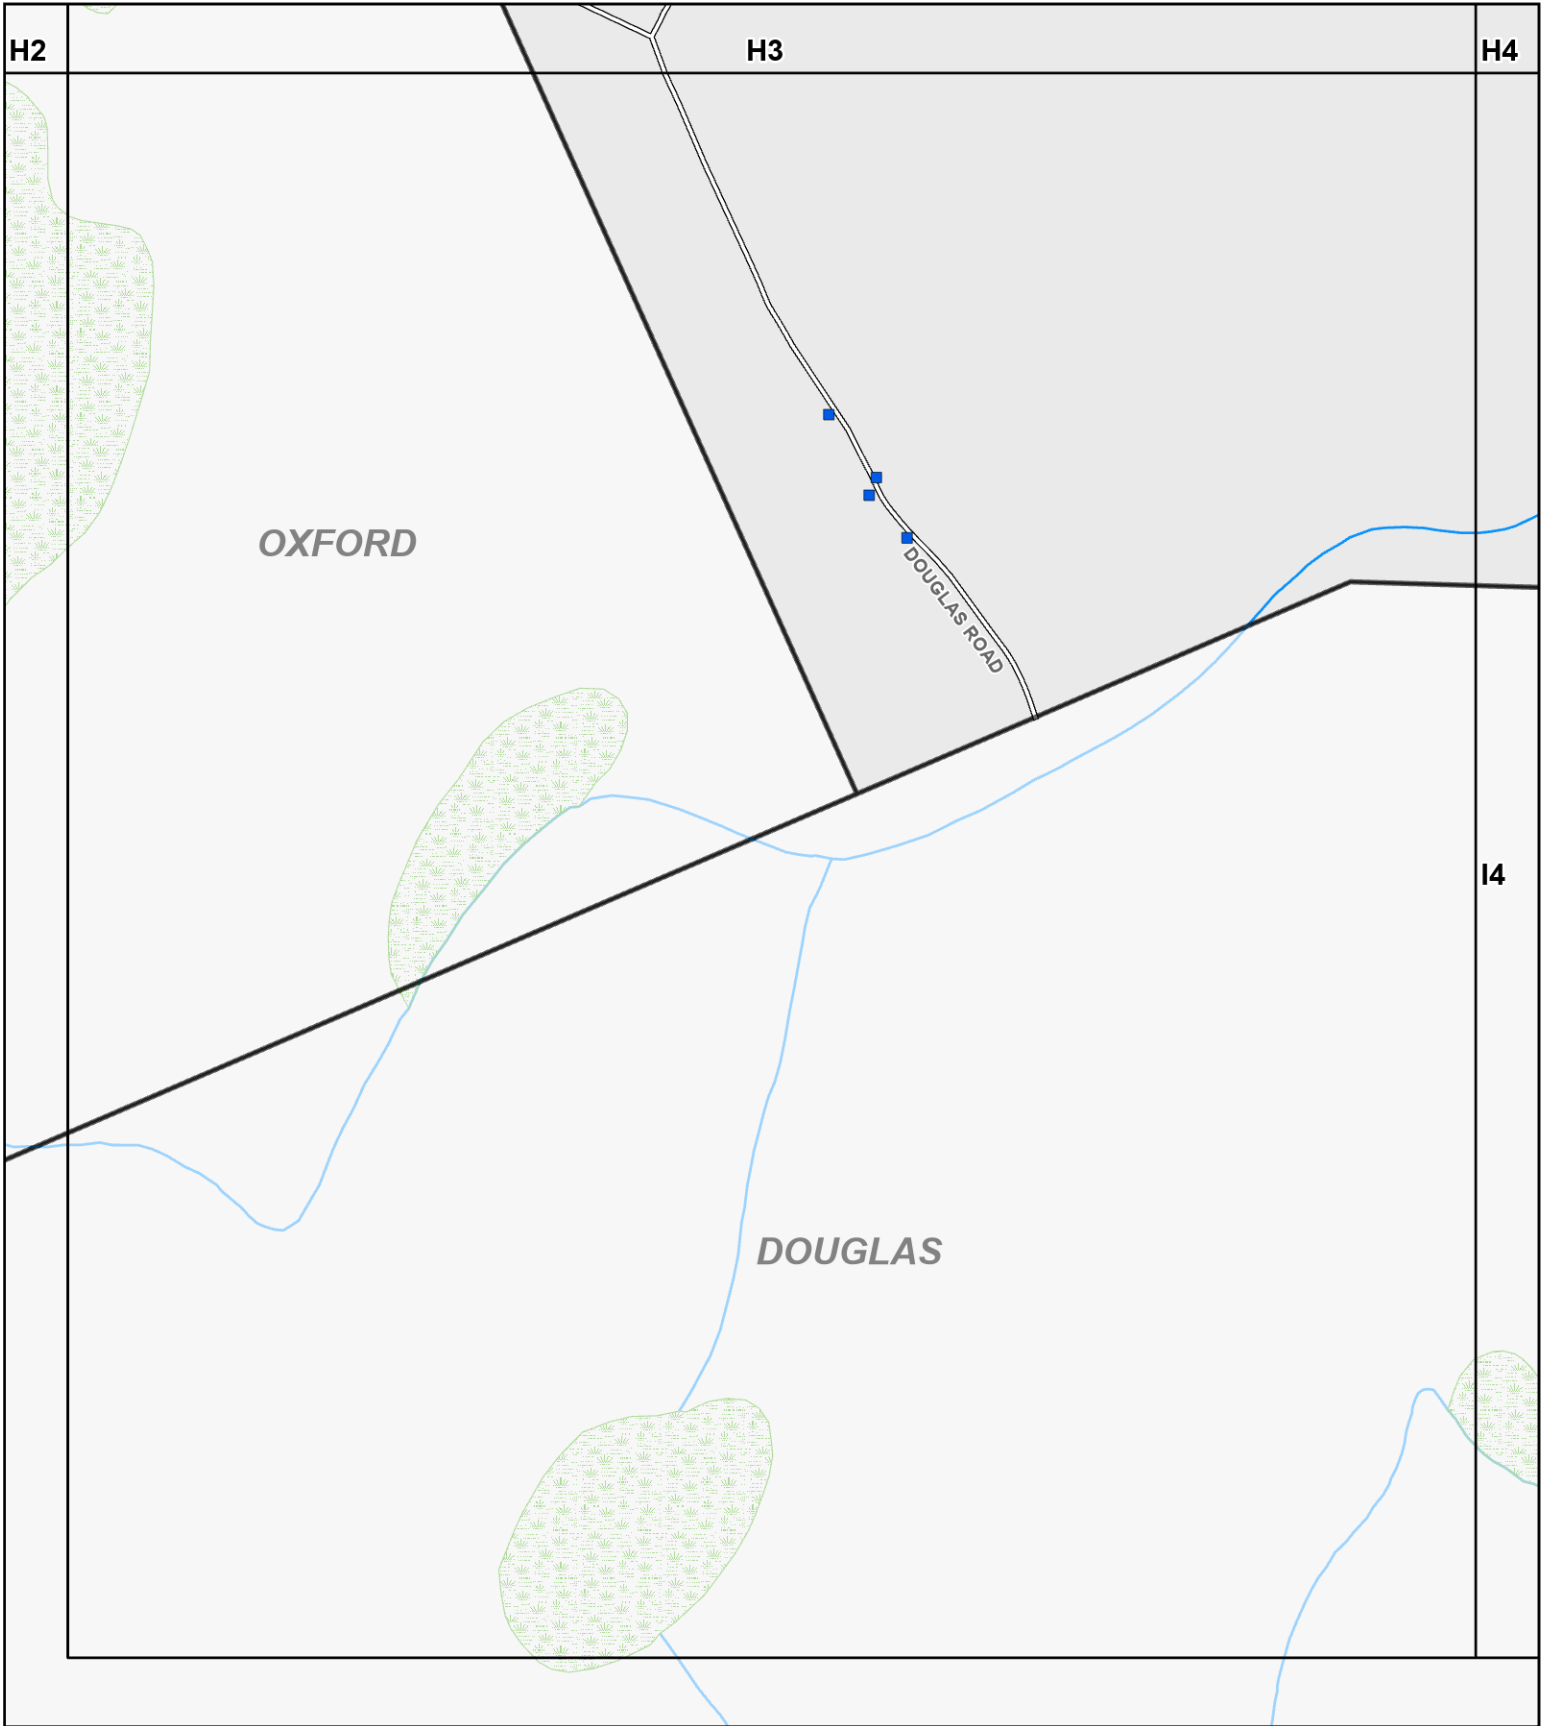


I12



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







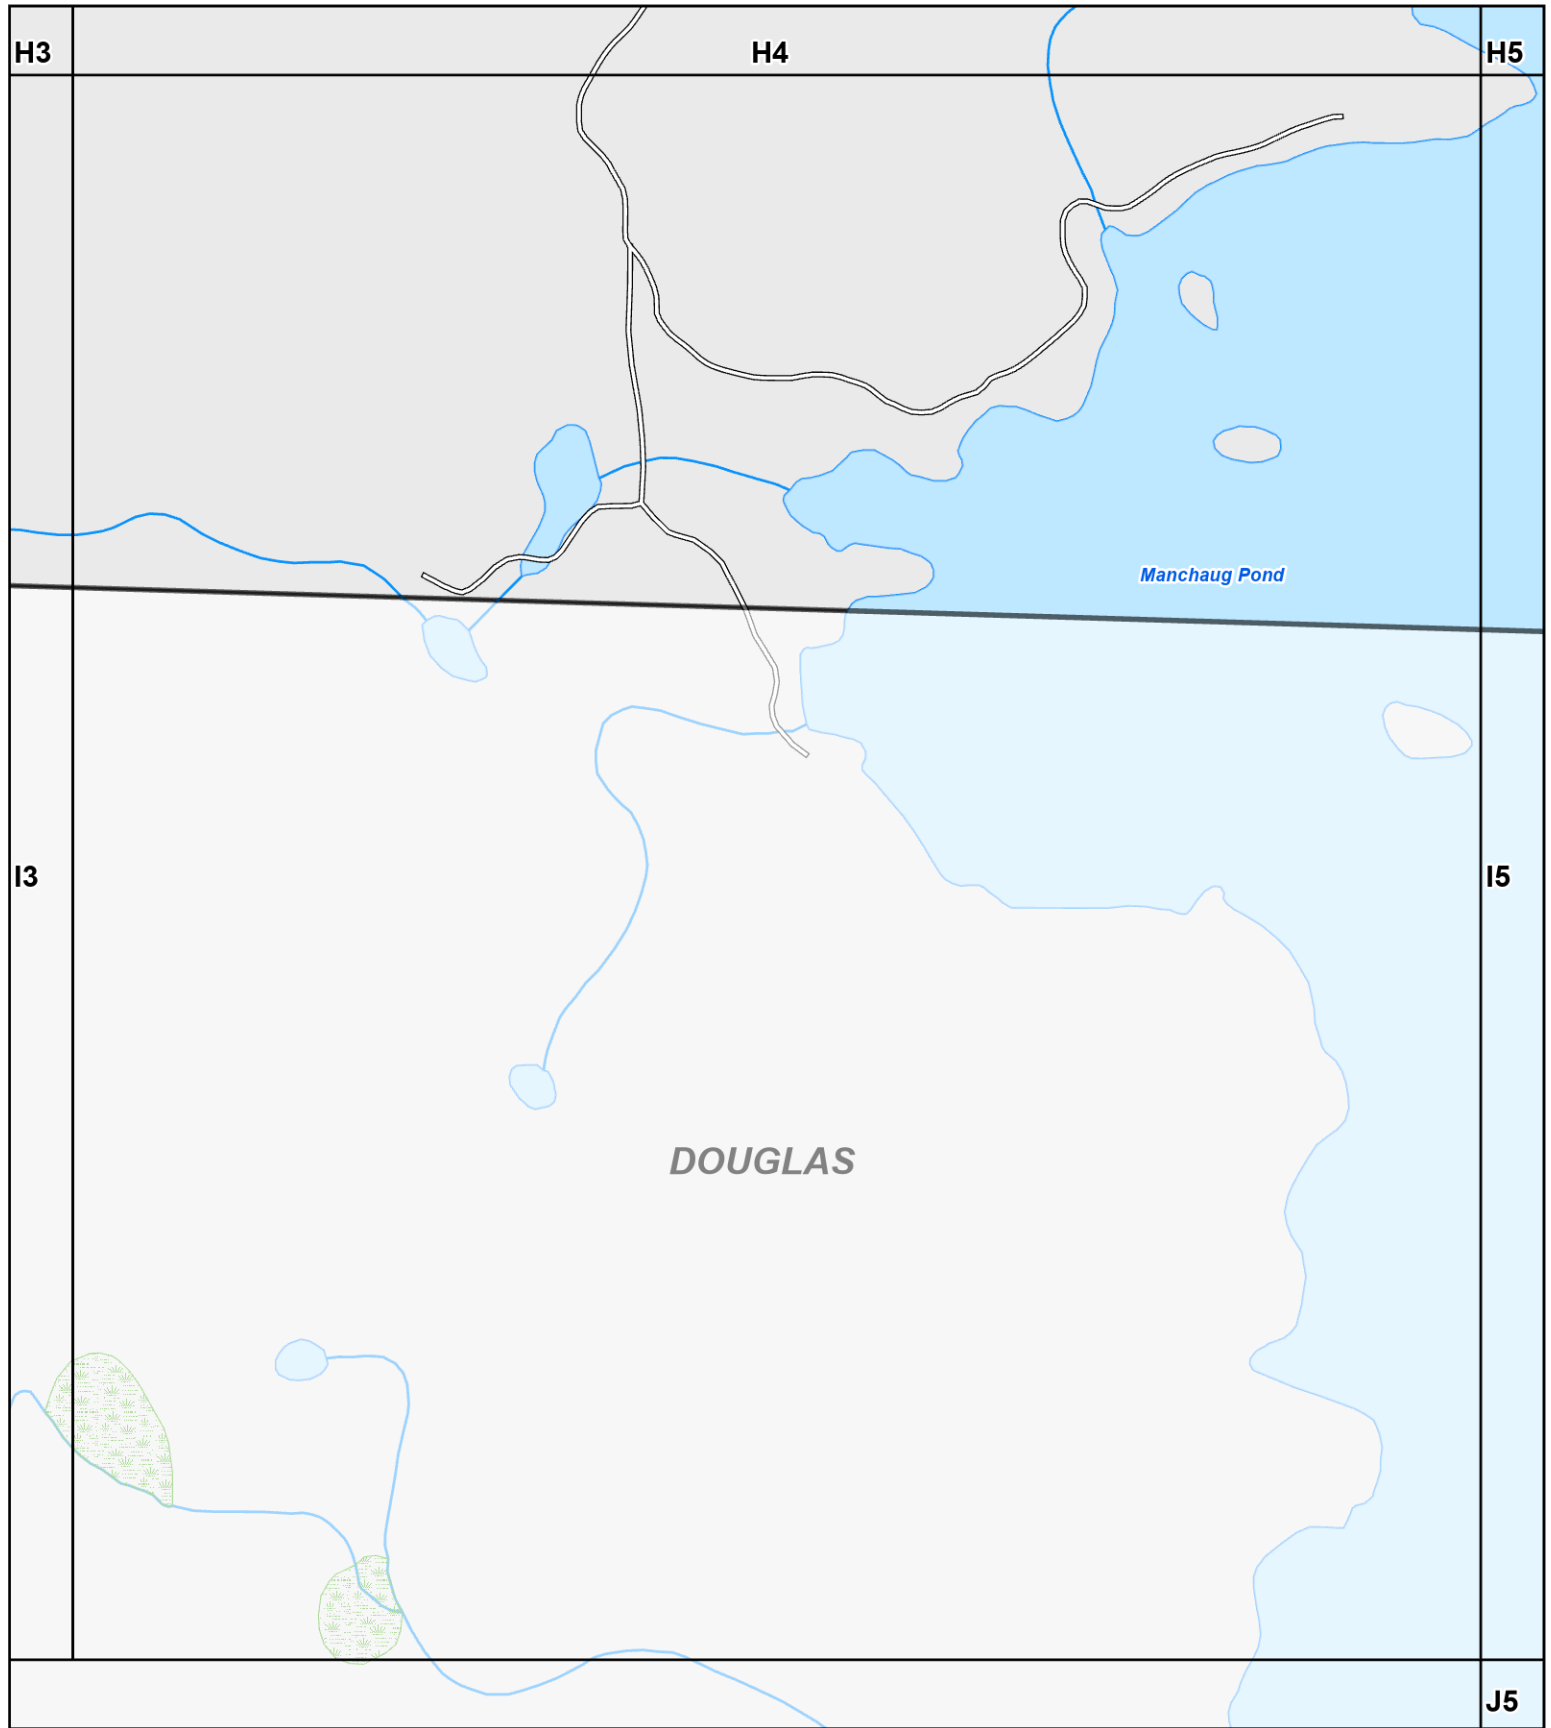


I3




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







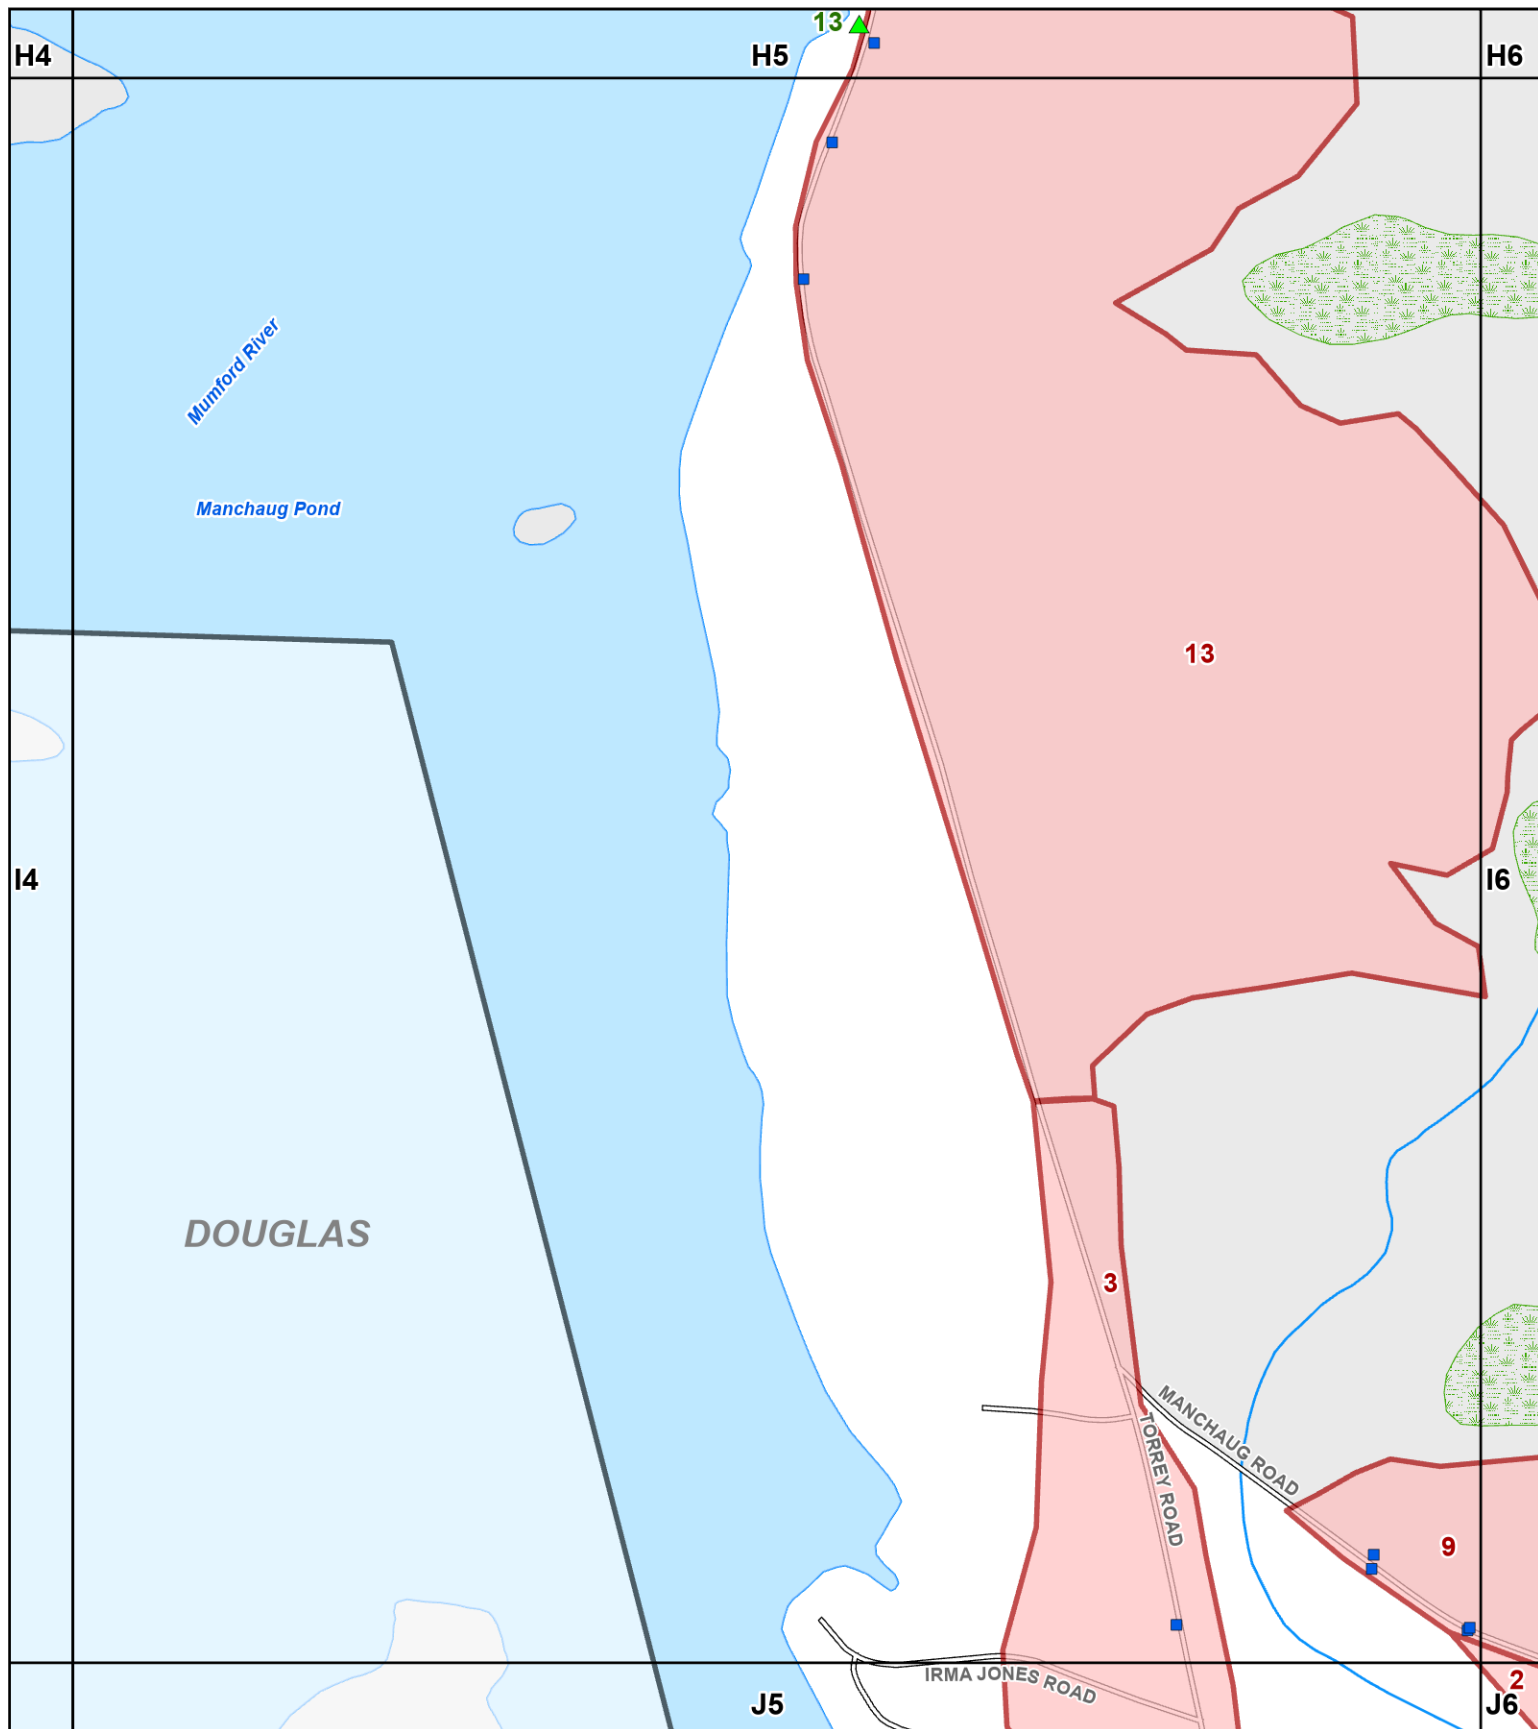


I4



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









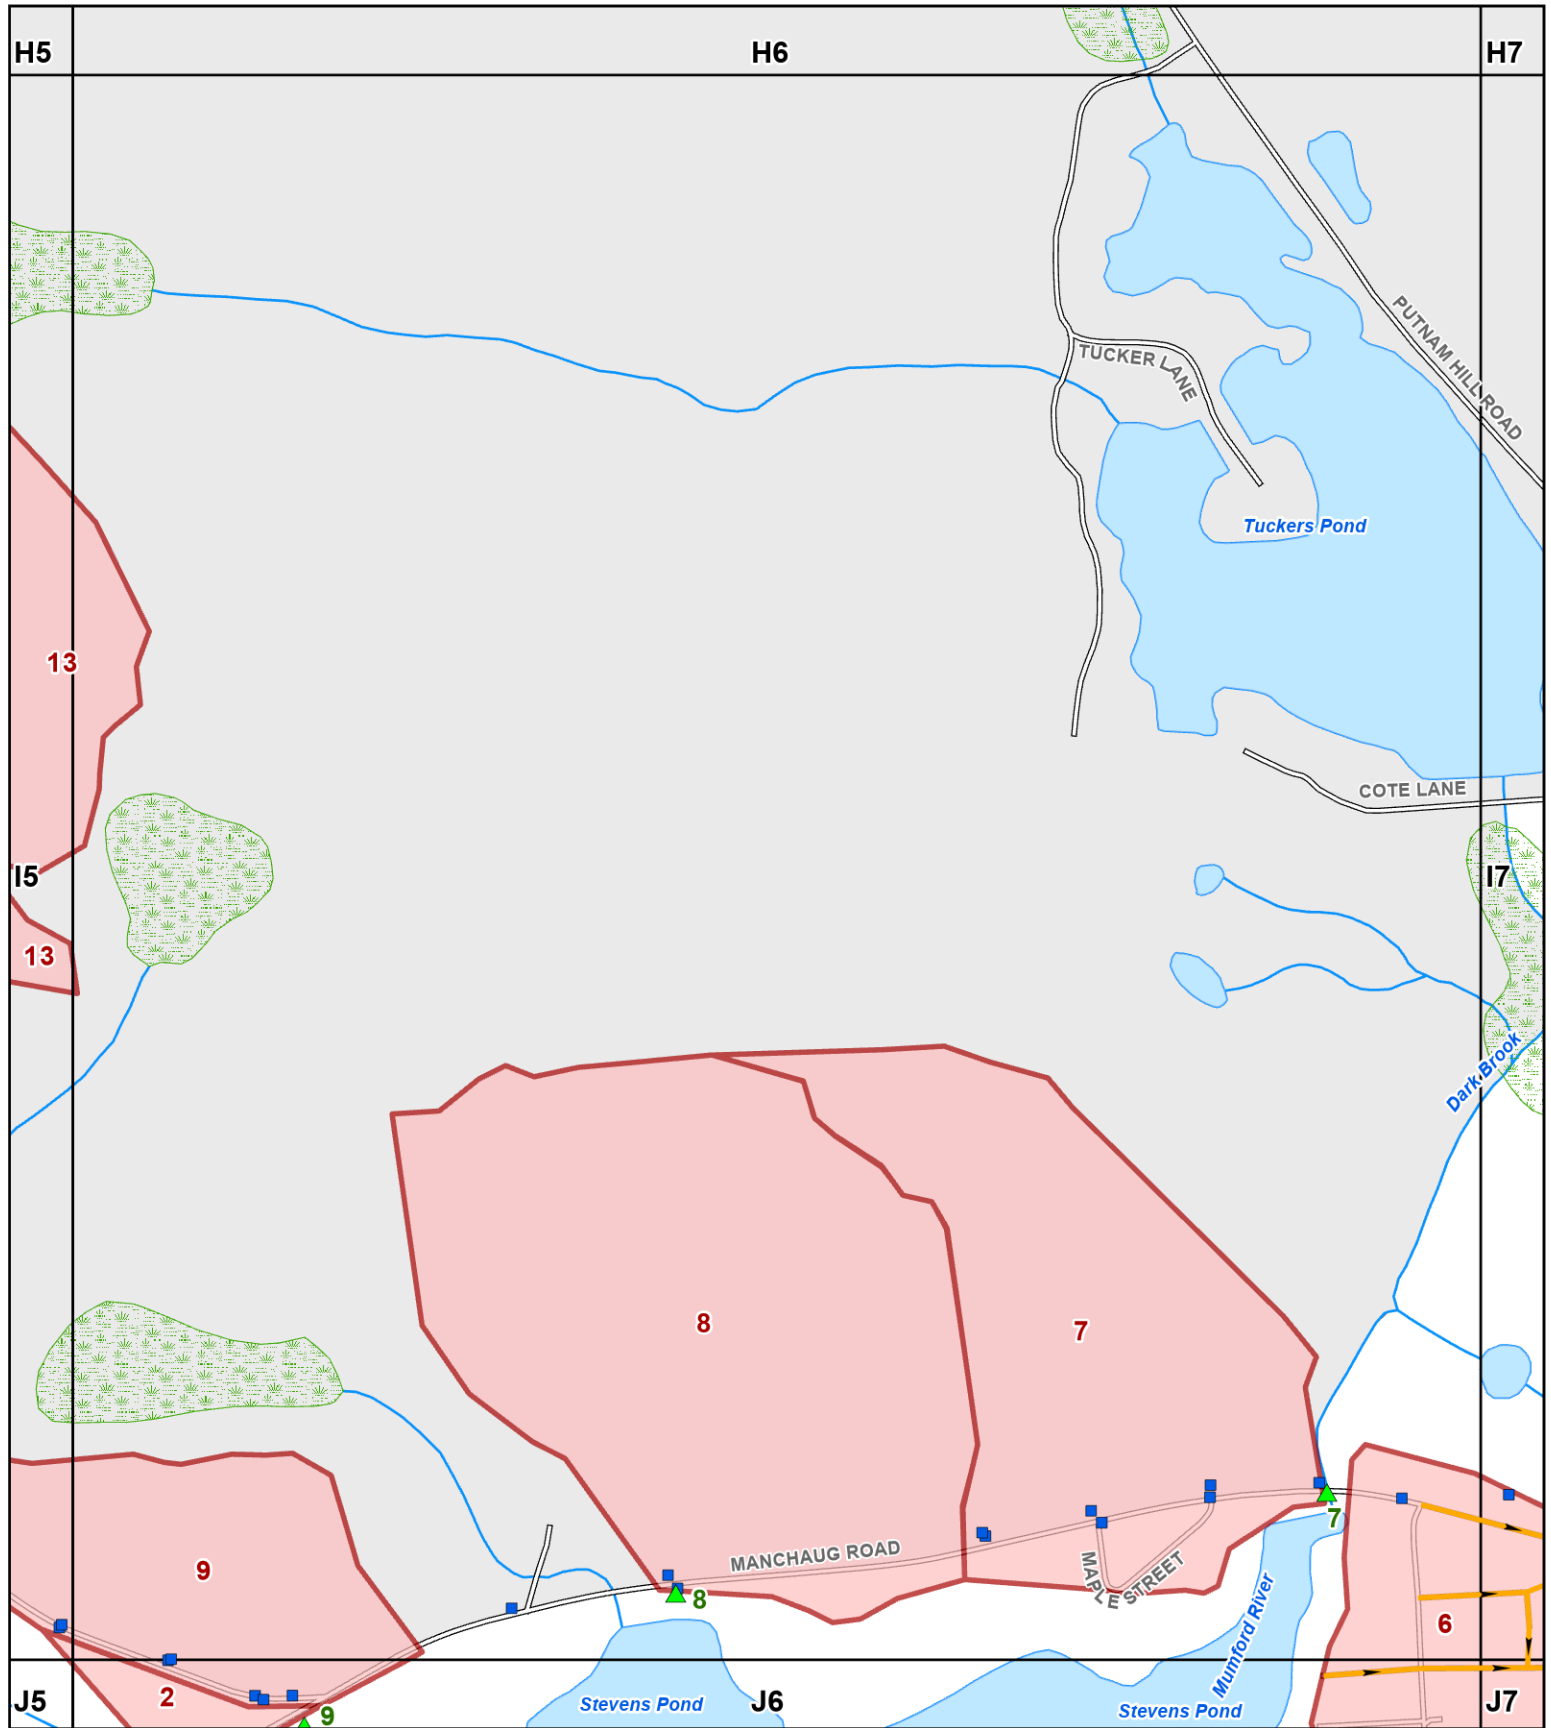


SHEET
I5




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA




Data Sources: MassGIS, Town of Sutton, CEI









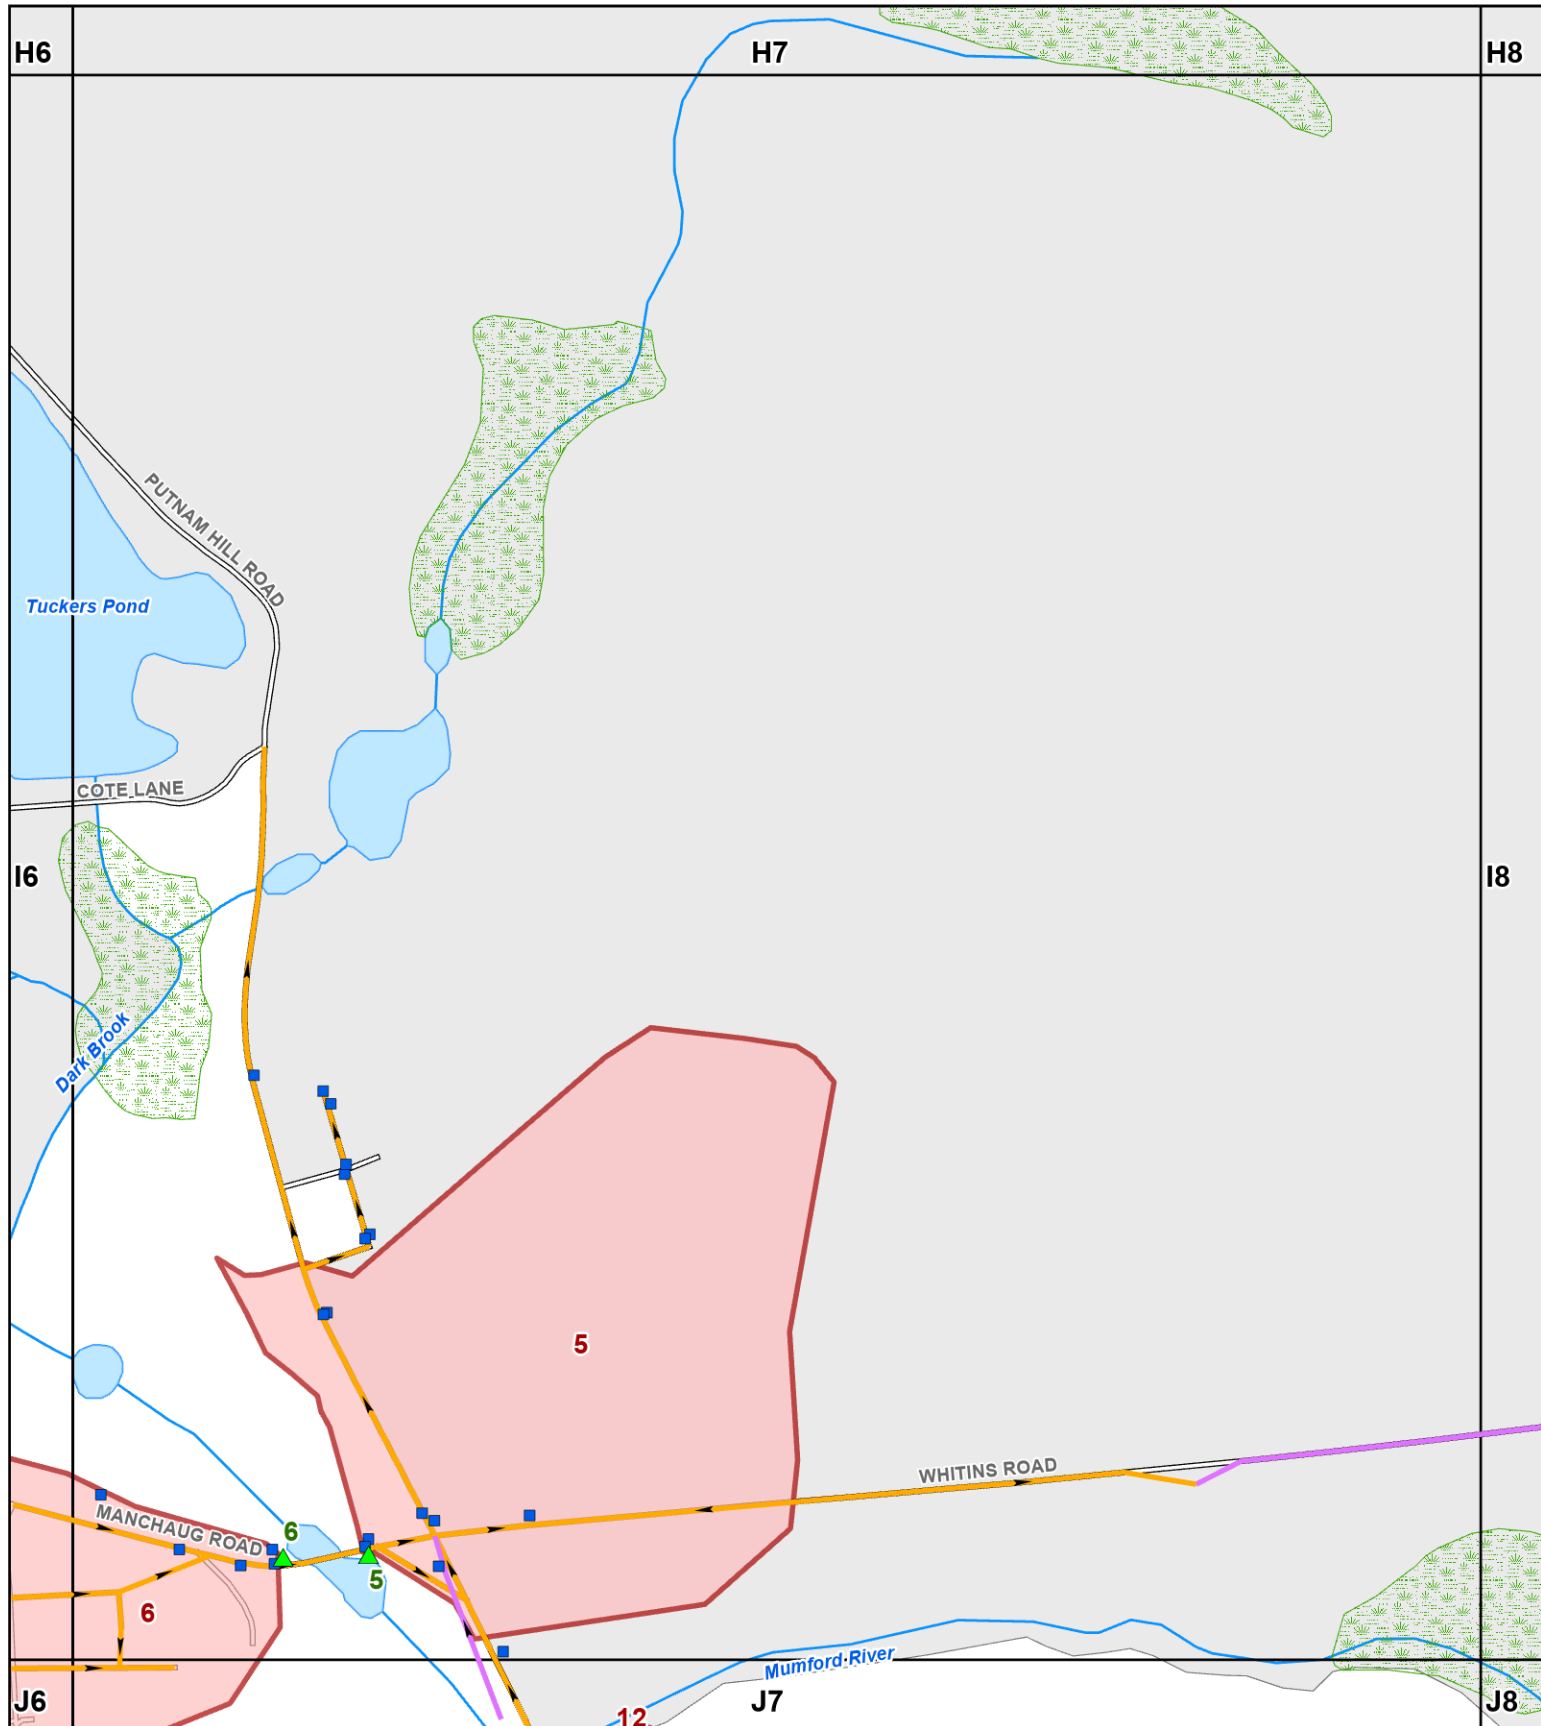


SHEET
I6



Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI



SHEET










I7




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI









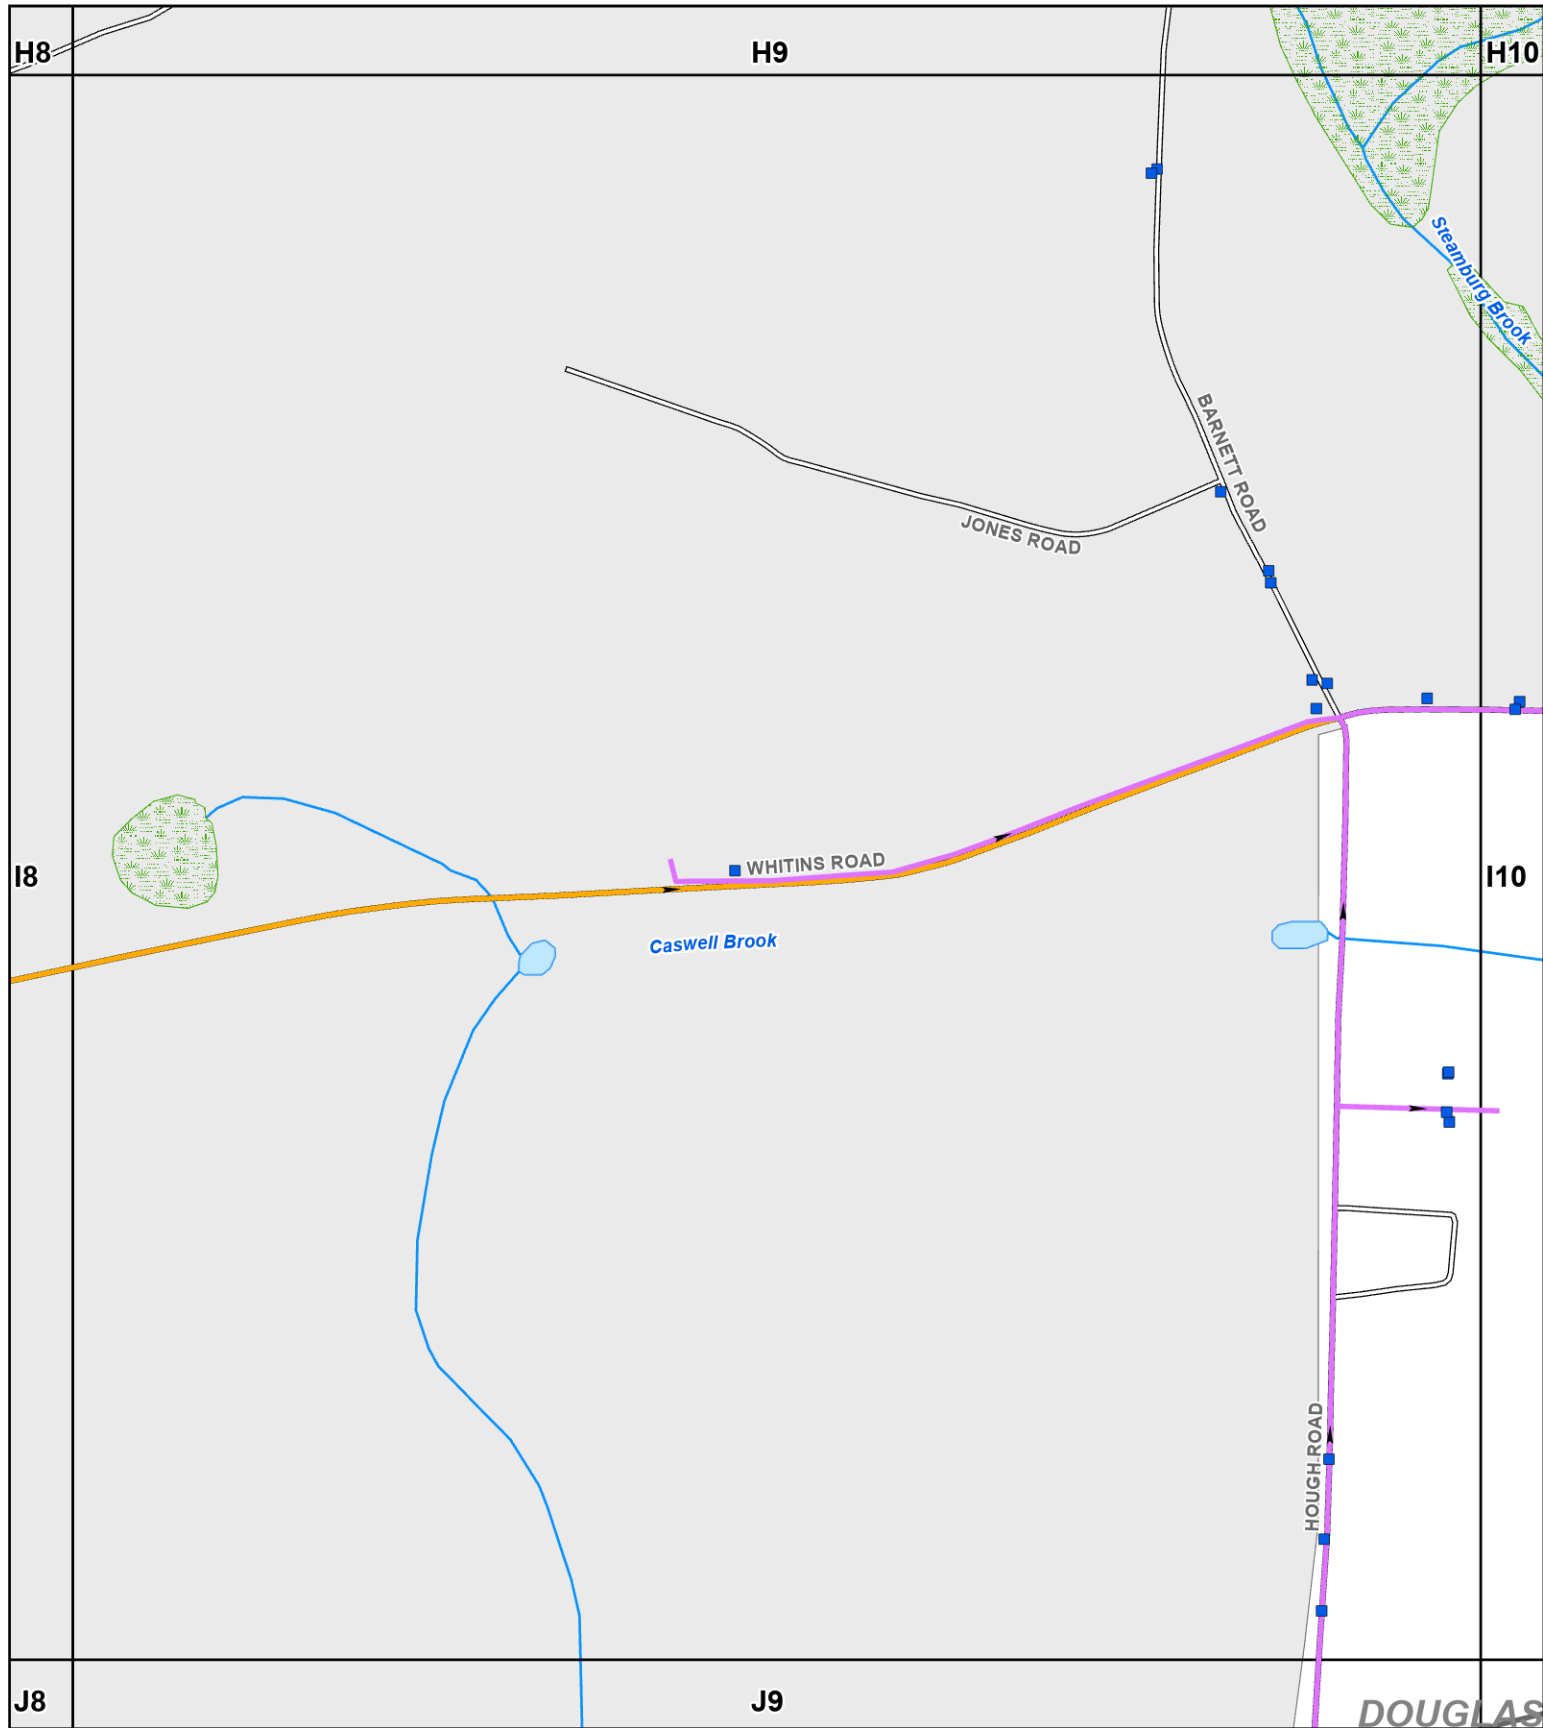


SHEET
I8



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**




Data Sources: MassGIS, Town of Sutton, CEI



SHEET
I9



**Comprehensive
Environmental
Incorporated**

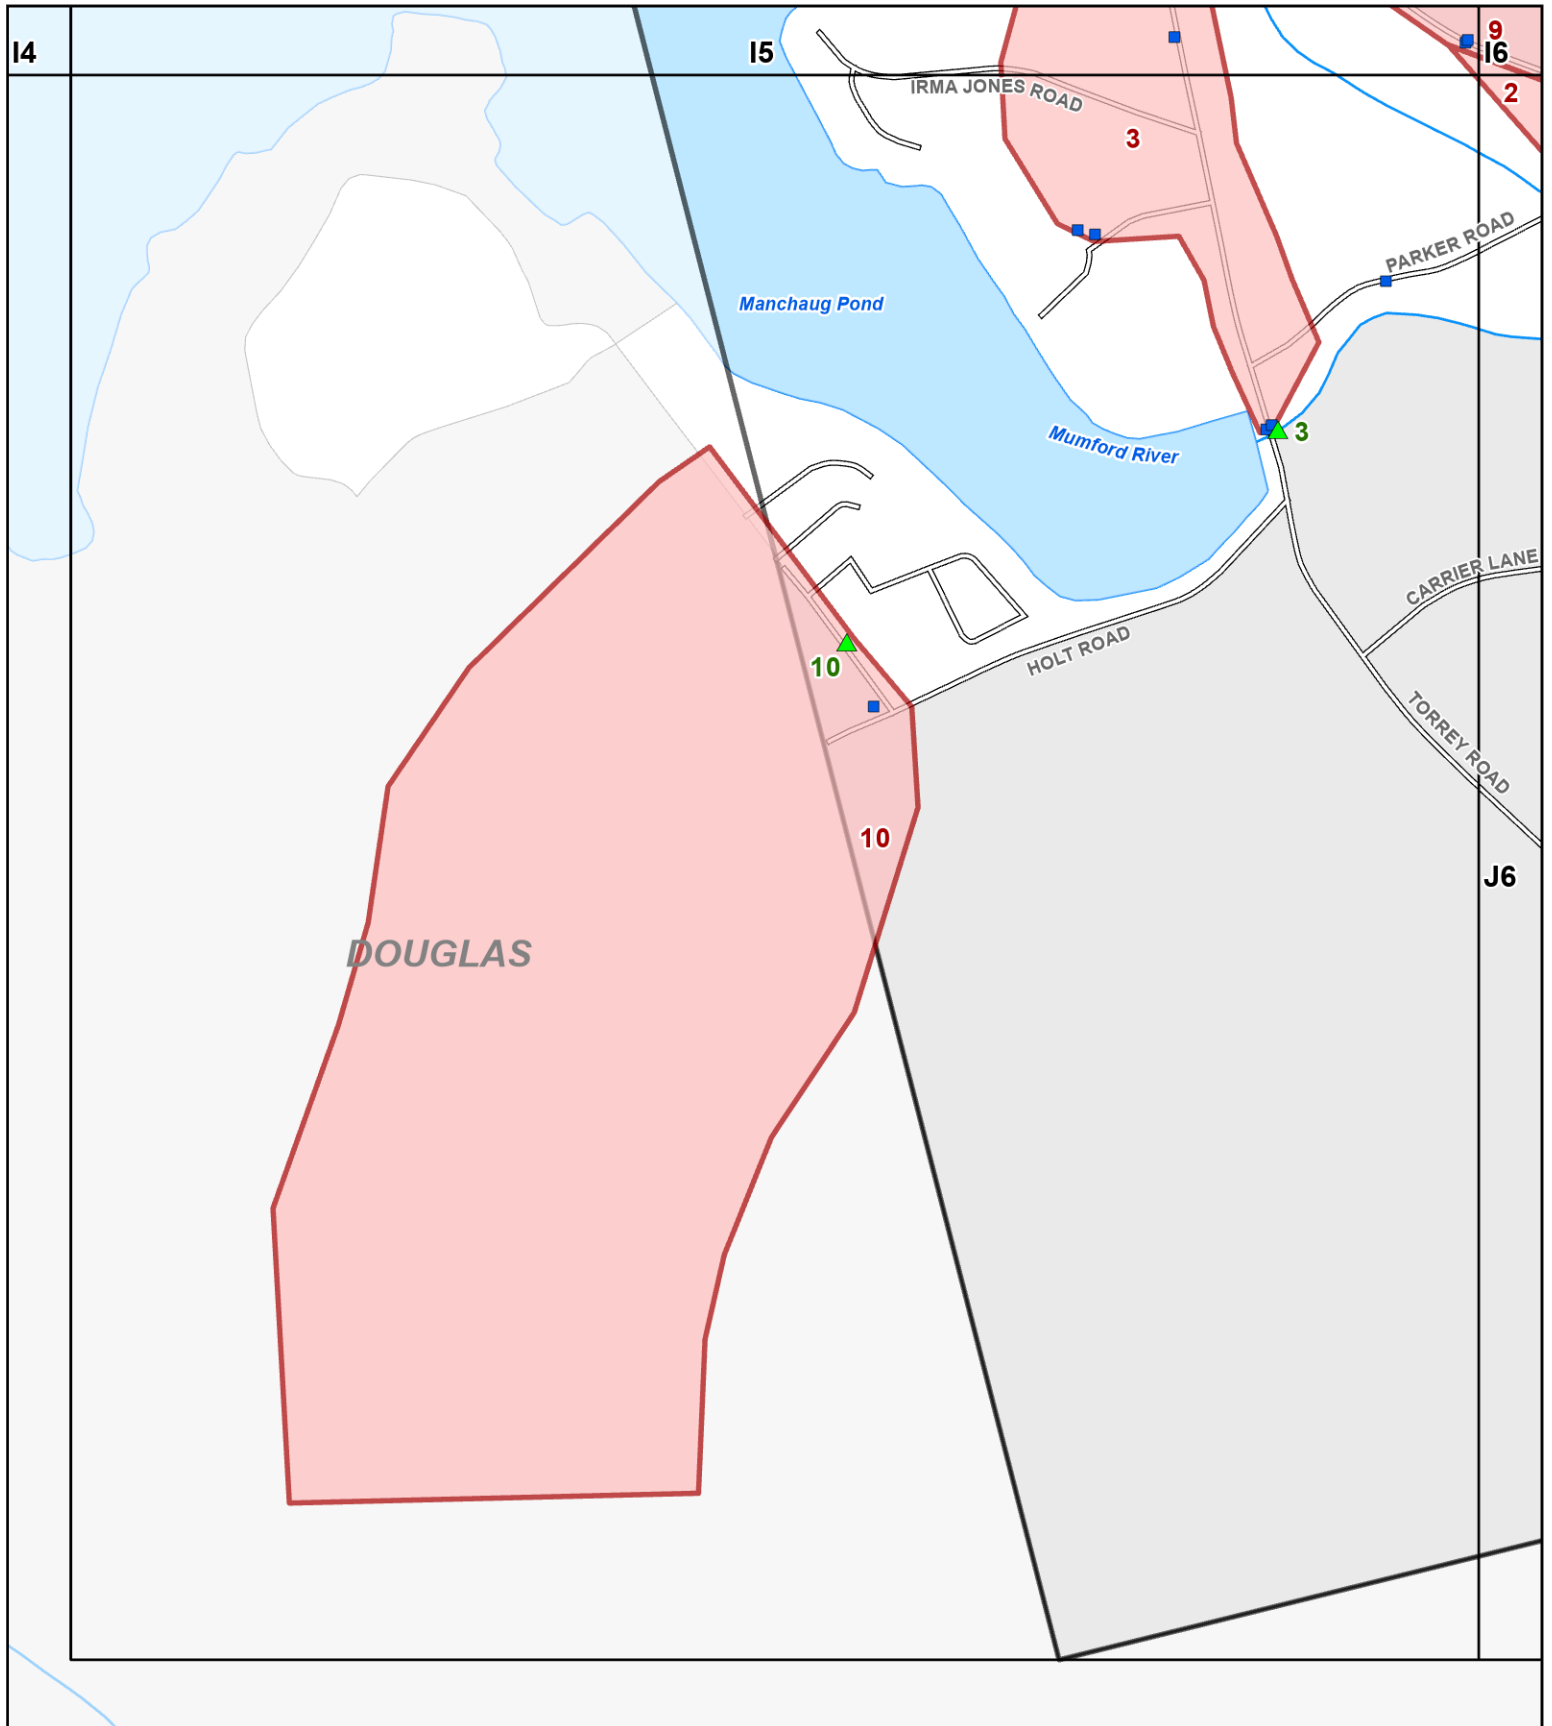

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET

J5



**Comprehensive
Environmental
Incorporated**

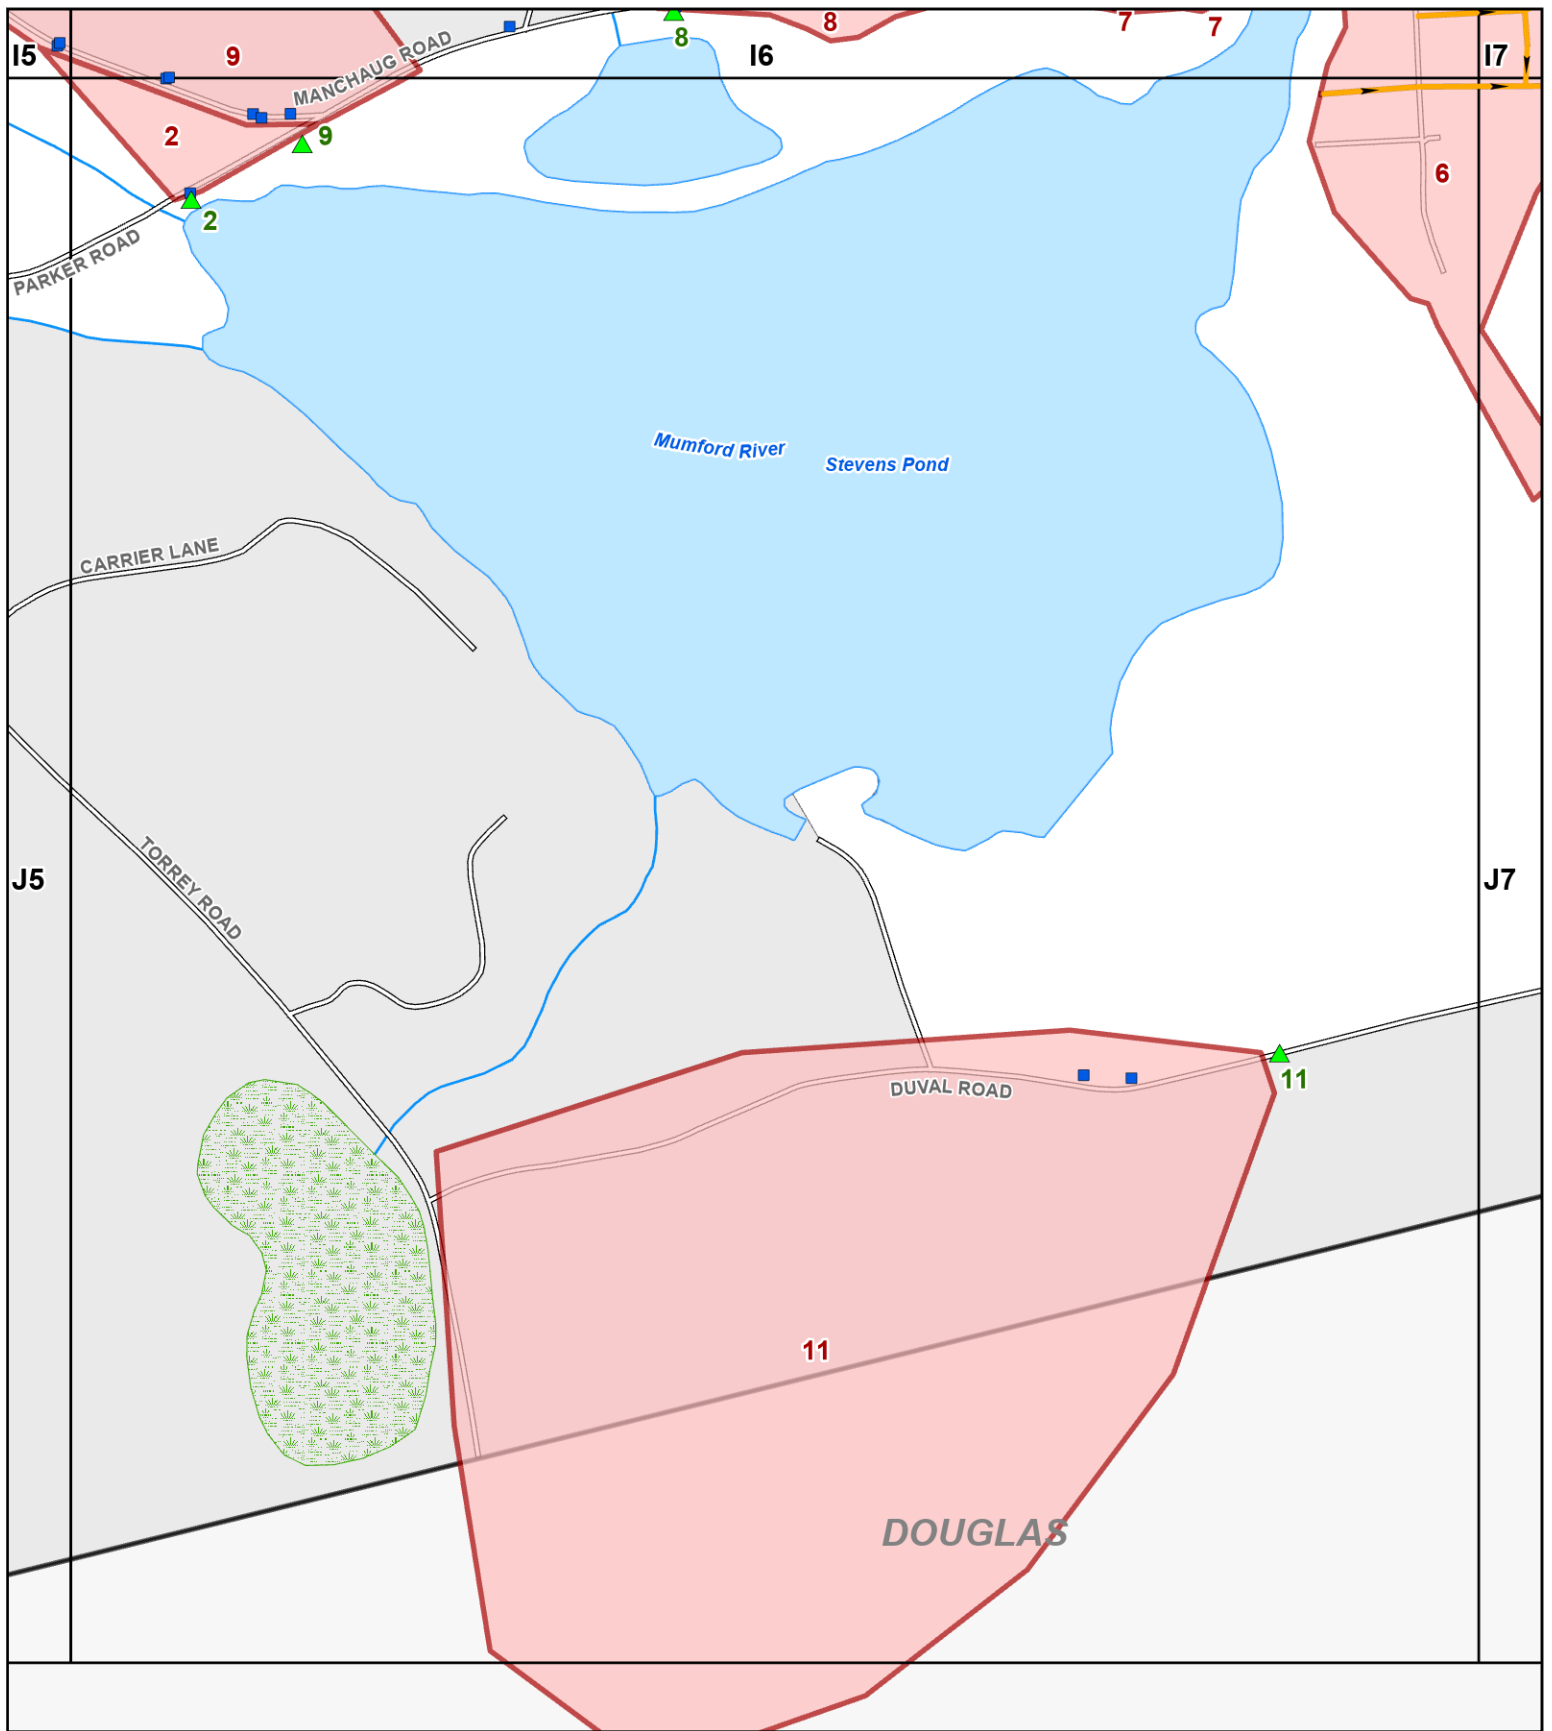

Legend

- | | |
|------------------|-----------------------|
| Outfall | Lake, Pond, Reservoir |
| Catch Basin | Wetland, Marsh, Swamp |
| Sewer Force Main | Stream, Brook |
| Sewer Pipe | Non-Urban Area |
| Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







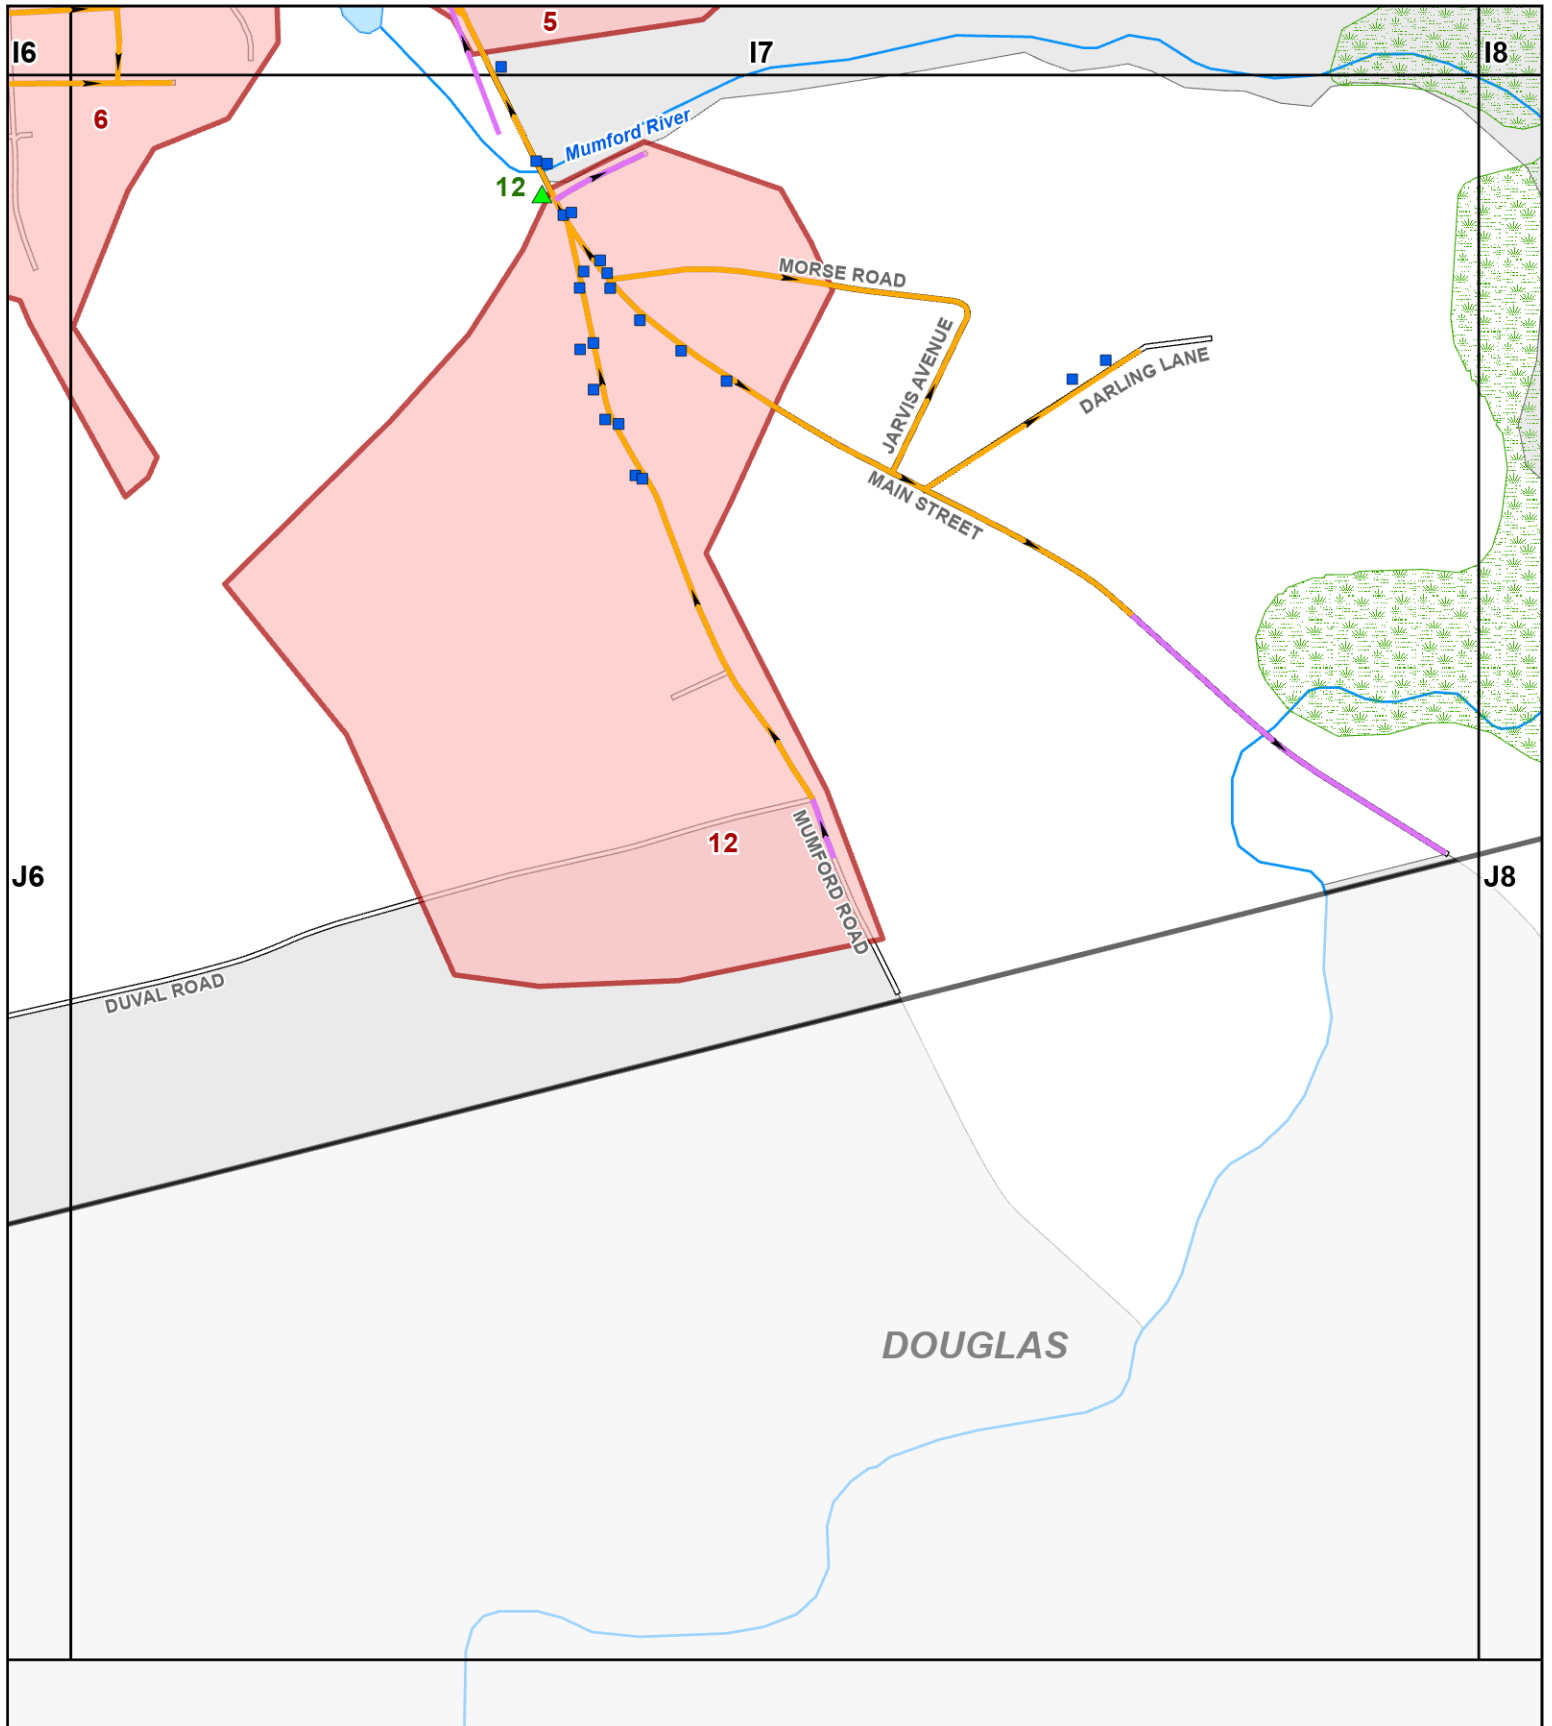


J6




Comprehensive
Environmental
Incorporated



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







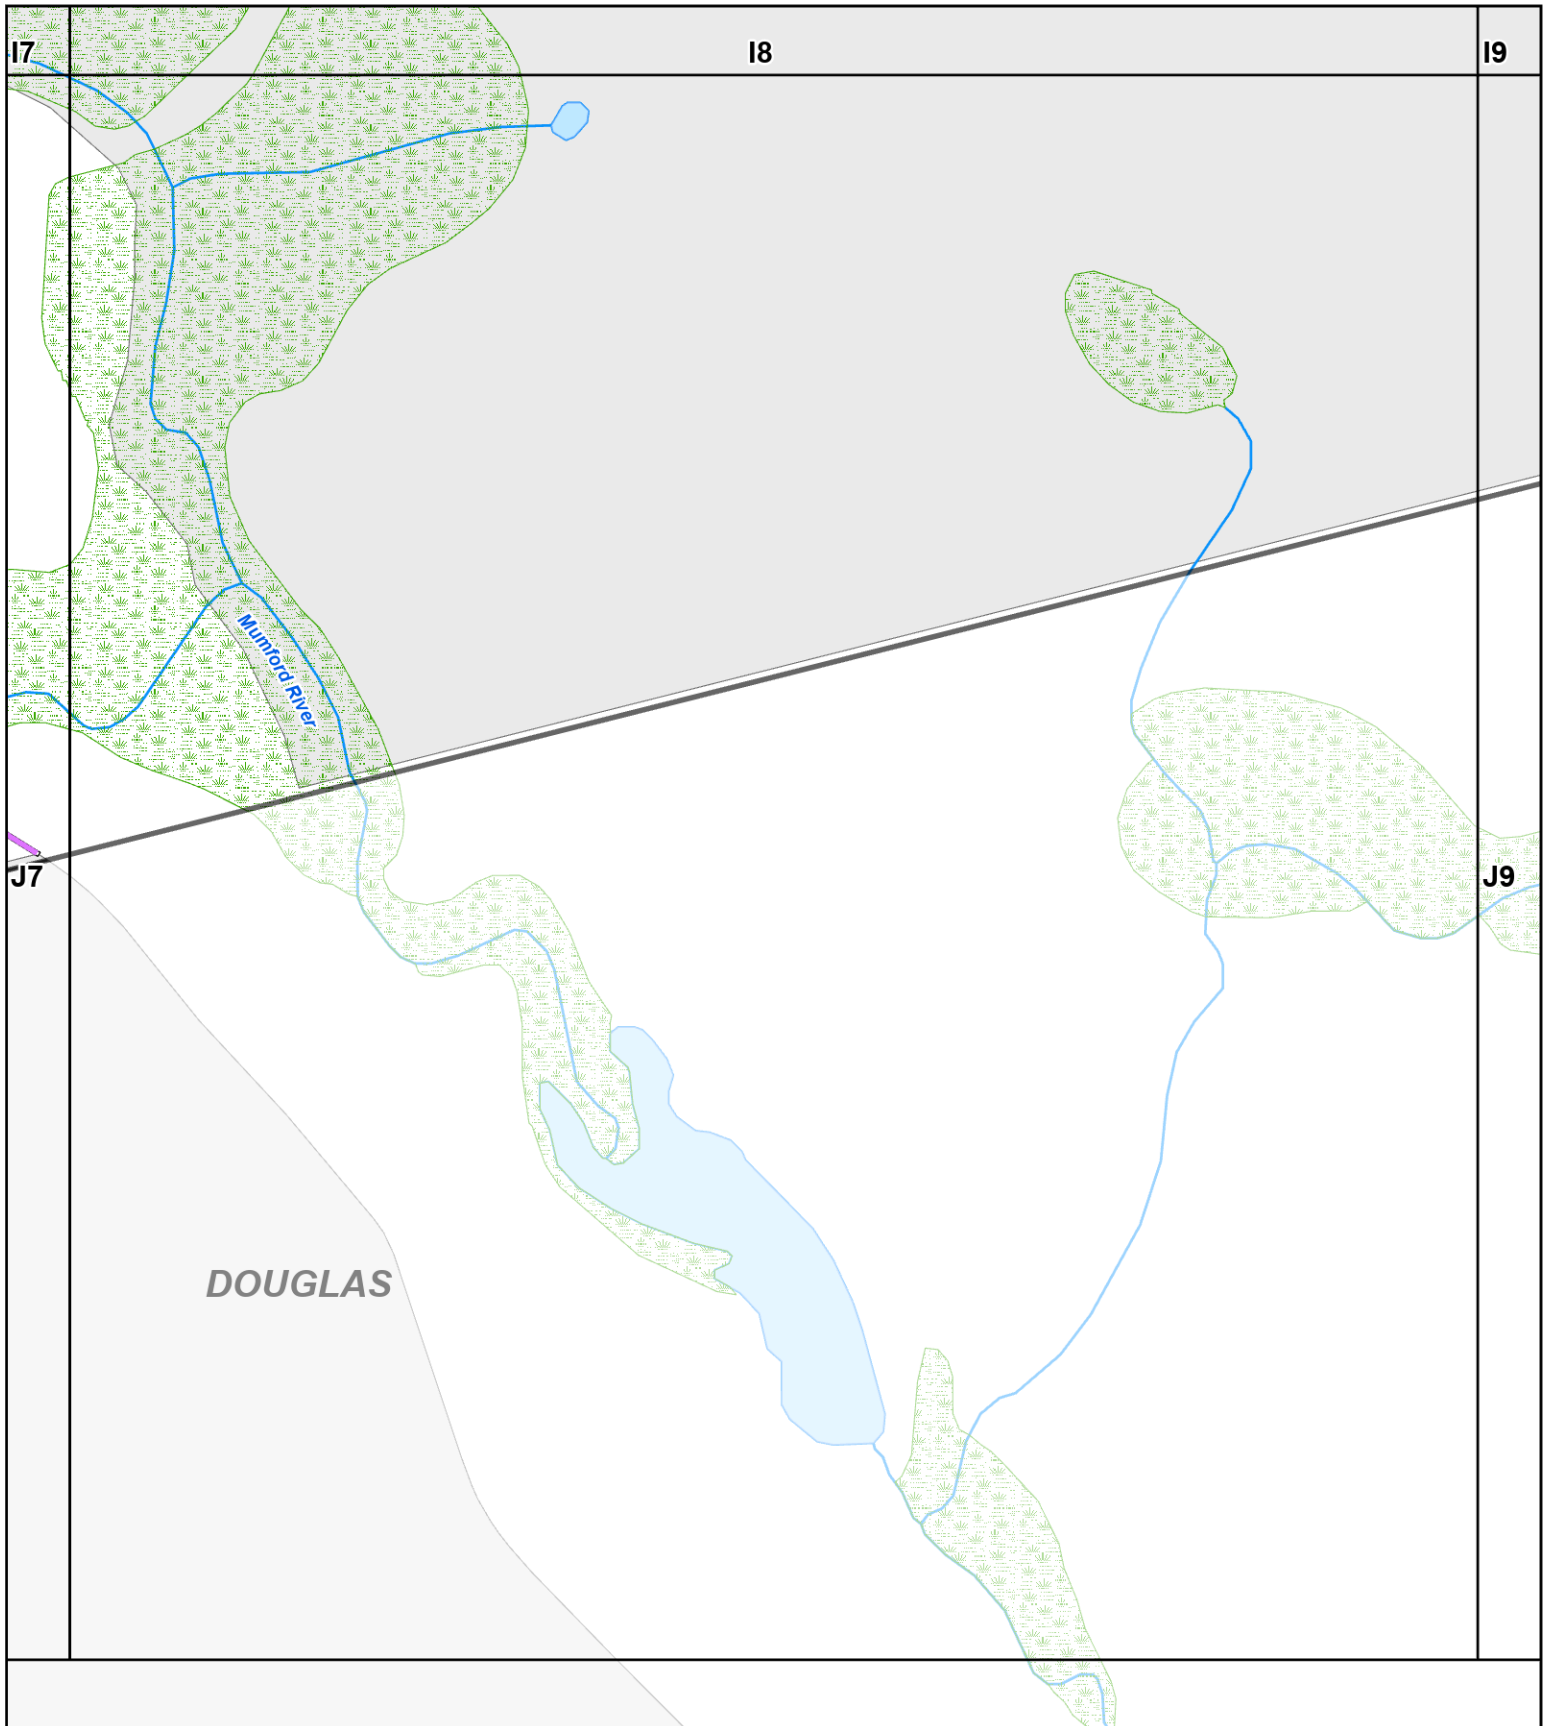


J7



**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

Stormwater Map with Catchment Delineations Sutton, MA



Data Sources: MassGIS, Town of Sutton, CEI




SHEET







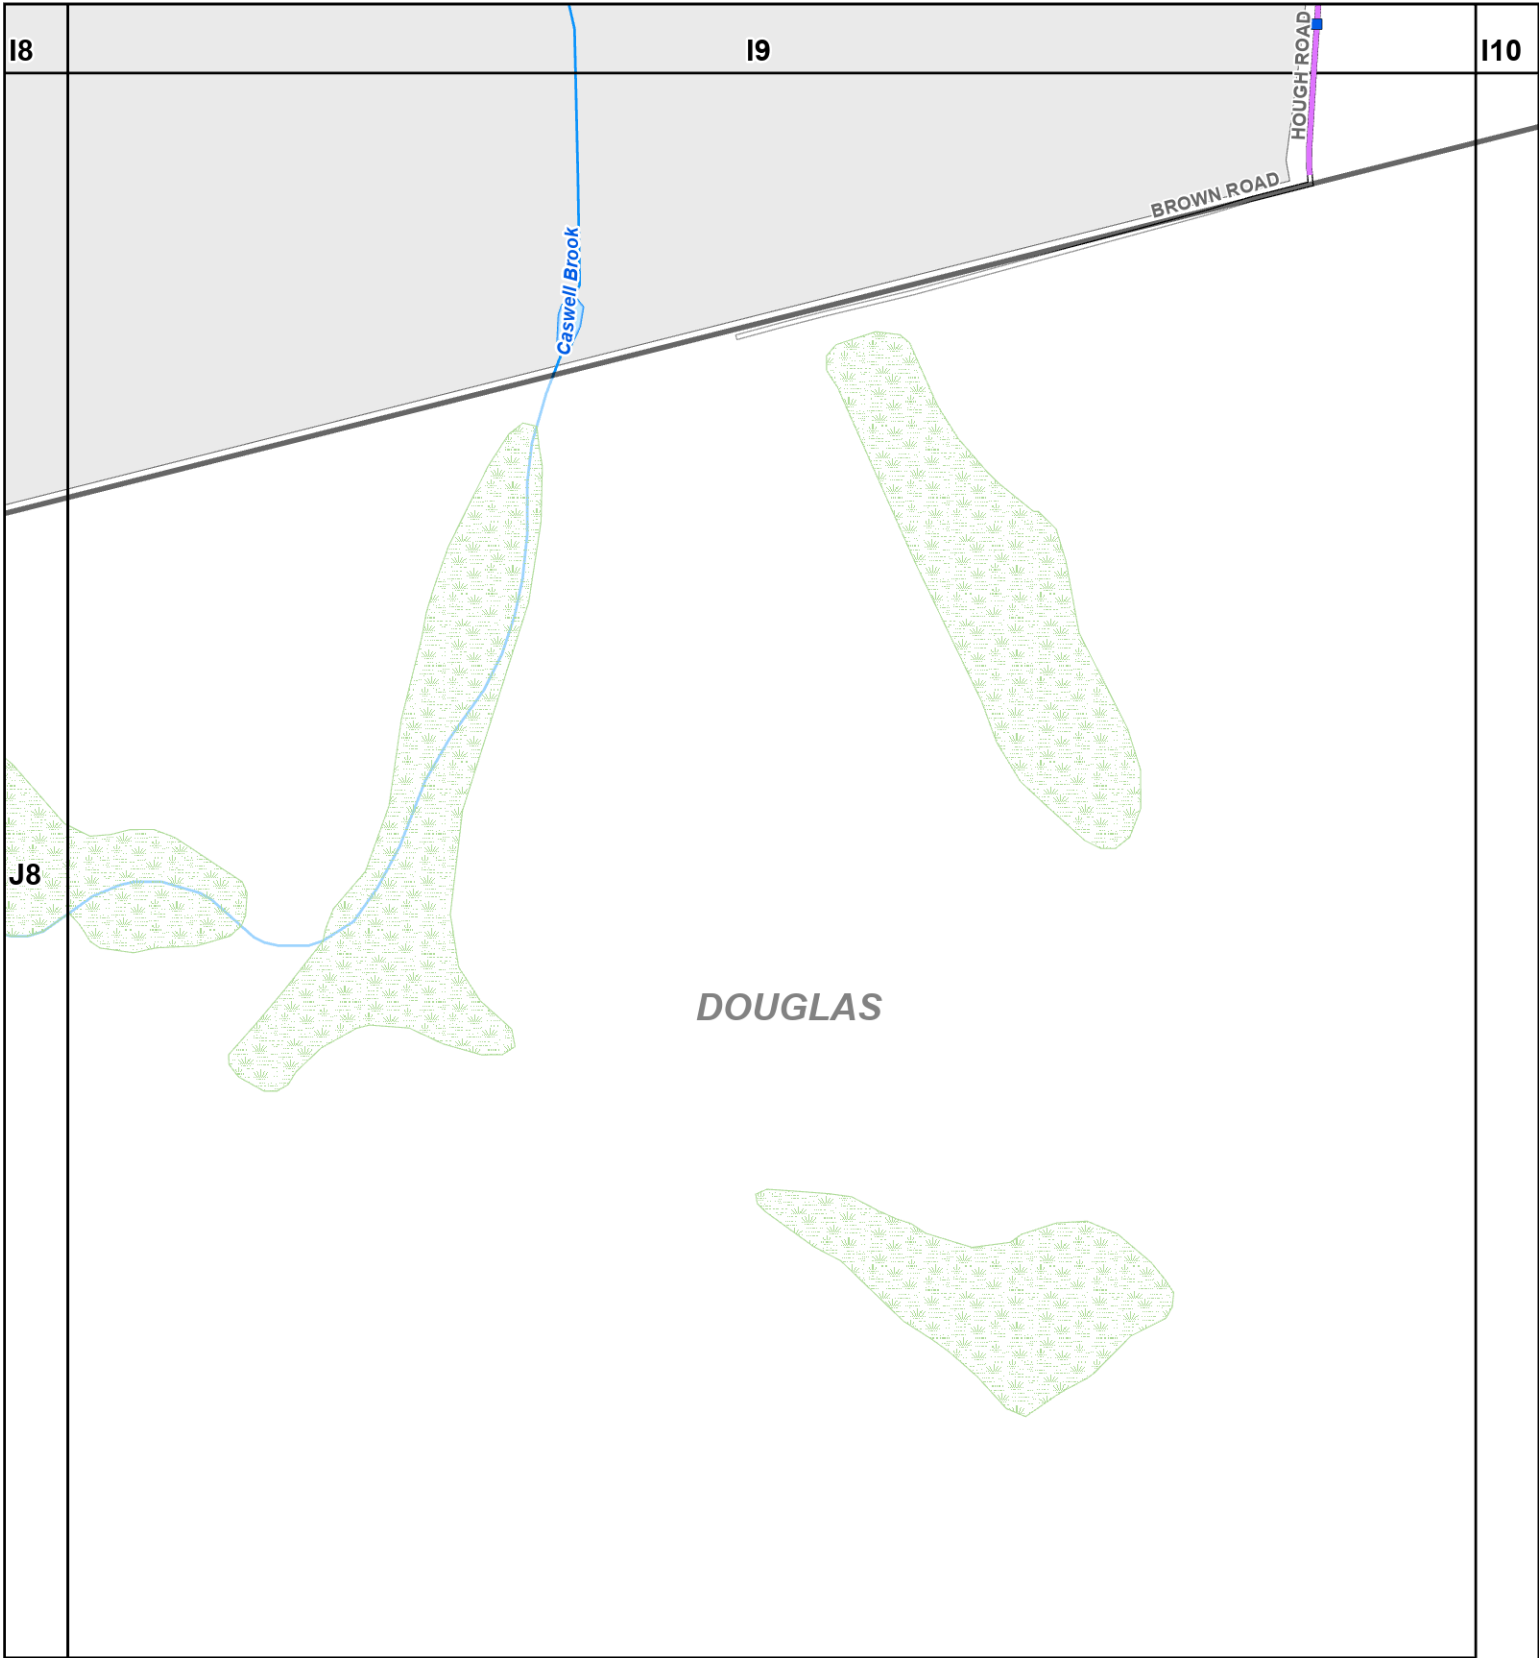


J8




**Comprehensive
Environmental
Incorporated**



Legend

- | | |
|--|---|
|  Outfall |  Lake, Pond, Reservoir |
|  Catch Basin |  Wetland, Marsh, Swamp |
|  Sewer Force Main |  Stream, Brook |
|  Sewer Pipe |  Non-Urban Area |
|  Catchments | |

**Stormwater Map with
Catchment Delineations
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI



SHEET

J9



**Comprehensive
Environmental
Incorporated**

Appendix B

SSO Inventory

Sanitary Sewer Overflow Inventory
Prior 5-Year Period (July 1, 2014 - June 30, 2019)

SSO Location ¹	Receiving Waterbody	Discharge Statement ²	Date & Time Start ³	Date & Time End ³	Date & Time Reported ³	Estimated Volume ⁴	Description of SSO, Expected Source and Cause ⁵	Mitigation Completed ⁶	Mitigation Planned ⁷

¹ Location (approximate street crossing/address and receiving water, if any)
² A clear statement of whether the discharge entered a surface water directly or entered the MS4
³ Date and time of each known SSO occurrence (i.e., beginning and end of any known discharge)
⁴ Estimated volume or quantity of the occurrence
⁵ Description of the occurrence indicating known or suspected cause(s)
⁶ Mitigation and corrective measures taken to minimize volume and duration of bypass with dates implemented
⁷ Mitigation and corrective measures planned with implementation schedules

Appendix C

IDDE Outfall Classification/Ranking & Vulnerability Assessment

Sutton, MA IDDE Outfall Classification and Ranking, By Outfall ID #

Outfall Data			Sampling Data							Problem Outfalls		High Priority Outfalls																	Excluded				Ranking		Notes			
Outfall ID	Receiving Water	Receiving Water Impairment ¹	Ammonia > 0.5 mg/L	Surfactants > 0.25 mg/L	Chlorine > 0 mg/L	Bacteria > WQ criteria	Ammonia ≥ 0.5 mg/L, surfactants ≥ 0.25 mg/L, and bacteria > WQ criteria	Ammonia ≥ 0.5 mg/L, surfactants > 0.25 mg/L, and detectable levels of chlorine	Sewer odor detected during inspection	Known or suspected contributions of illicit discharges	Olfactory or visual evidence of sewage	Discharge to /near public beach	Discharge to /near recreational area	Discharge to /near drinking water supply	Discharge to /near shellfish beds	Past Discharge Complaints	Density of Generating Sites ²						Industrial areas >40 years old	Sewer areas >40 years old	Catchment areas serviced by septic systems converted to sewer	Historic combined sewer system that has been separated	Density of septic systems ≥30 years old in residential land use	Culverted stream lengths greater than a simple roadway crossing	Discharge to impaired water & potential to carry that pollutant	Presence of older industrial operations	Roadway drainage in undeveloped areas with no dwellings and no sanitary sewers	Outfall is drainage for athletic fields, parks or undeveloped green space & associated parking without services	Cross-country drainage alignments through undeveloped land	Overall Ranking (Problem, High, Low, Excluded)		Ranking Score (Number of Boxes Checked)		
																	Car dealers	Car washes	Gas stations	Garden centers	Industrial manufacturing	Other																
002	Stevens Pond	Plants																									x		x						High	2		
003	Manchaug Pond	DO, Plants, Hg																									x		x						High	2		
005	Mumford River																																		Low	0		
006	Mumford River																																		Low	0		
007	Stevens Pond	Plants			x																						x		x						High	2		
008	Stevens Pond	Plants																									x		x						High	2		
009	Stevens Pond	Plants																									x		x						High	2		
010													x	x													x								High	3	Zone I Wellhead Protection, Kings Family Campground	
011																											x								High	1		
012	Mumford River																		x			x													High	2	Bek's Welding & Fuel Corporation auto parts and gas station	
013	Manchaug Pond	DO, Plants, Hg																									x		x						High	2		
014																					x		x												High	2	Package Steel Buildings manufacturer	
015	Unnamed tributary to Marble Pond																				x		x												High	2	Package Steel Buildings manufacturer	
016	Woodbury Pond	Macro, Plants																											x						High	1		
017	Woodbury Pond	Macro, Plants																											x						High	1		
018	Woodbury Pond	Macro, Plants																											x						High	1		
019	Blackstone River	Oil, E. coli, Pb, P, Eutro, Hab, DO																			x		x						x						High	3	Indusol, Inc. plastic fabrication	
020	Cold Spring Brook																					x													High	1	Automagic Transmissions auto repair,	
													x					x			x	x								x					High	6	Frank Auto Sales, Tricentennial Park, Triola Brother mulch supplier, Aggregate Industries concrete, Al's Rubbish & Container waste management	
021	Blackstone River	Oil, E. coli, Pb, P, Eutro, Hab, DO			x																																	
022	Ramshorn Pond																										x								High	1		
023	Unnamed tributary to Ramshorn Pond																										x								High	1		
024	Unnamed tributary to Singletary Pond																										x								High	1		
026	Dark Brook Pond																										x								High	1		
028	Mumford River	Cu, Pb, Macro, Plants, Low Flow																									x		x						High	2		
029	Mumford River	Cu, Pb, Macro, Plants, Low Flow																									x		x						High	2		
030	Mumford River	Cu, Pb, Macro, Plants, Low Flow																									x		x						High	2		
031	Singletary Pond	Plants																											x							High	1	
032	Singletary Pond	Plants																											x							High	1	
033	Singletary Pond	Plants																											x							High	1	

Notes:
1. DO = Dissolved oxygen, P = Phosphorus, Pb = Lead, Cu = Copper, Macro = Macrophytes, Eutro = Eutrophication, Hab = Flow Regime/Habitat Alteration, Plants = Non-native aquatic plants, Oil = Foam/Flocs/Scum/Oil Slicks, Hg = Mercury in Fish Tissue
2. Locations of gas stations, car dealerships, car washes and garden centers obtained from Google in May 2019.

Sutton, MA Vulnerability Assessment

[illegible]

Appendix D

SOP for Dry Weather Outfall Investigation/Sampling

Dry Weather Outfall Inspection/Sampling SOP

Purpose of SOP

1. The inspection of stormwater drainage outfalls and interconnections to assess the **condition of the structure**;
2. The inspection of stormwater drainage outfalls and interconnections to assess the **possibility of illicit discharges**; and
3. The **collection of samples** during dry weather conditions.

Prior to the Leaving the Facility

1. **Check the weather**: Dry weather screening and sampling shall proceed only when no more than 0.1 inches of rainfall has occurred in the previous 24-hour period and no significant snow melt is occurring.
2. **Gather** all required equipment and materials:
 - Necessary Forms:
 - Form 1: Outfall Description and Condition Inventory and Inspection
 - Form 2: Illicit Discharge Detection Inspection
 - Form 3: Dry Weather Water Quality Sampling Form
 - Multi-meters for chlorine, conductivity, salinity, and temperature
 - Sample kits ammonia and surfactants
 - Sampling bottles for *E. coli* analysis
 - Multi meters for turbidity and dissolved oxygen (*for discharges to impaired and TMDL waters only*)
 - Sampling bottles for total phosphorus, total nitrogen, BOD5, TSS, copper, and lead (*for discharges to impaired and TMDL waters only*)
 - Dipper with extension rod
 - Tape measure
 - Pen
 - Cooler with ice or ice packs to transport samples
3. **Calibrate** meters following methods in the instruction manuals.

In Field

1. **Observe** each outfall under dry weather conditions. If an outfall/interconnection is inaccessible or submerged, proceed to the first accessible upstream manhole or structure for the observation and sampling.
2. **Record observations** about the condition of the outfall and interconnection on **Form 1: Outfall Description and Condition Inventory and Inspection**. Take photos and document on form.
3. **Record observations** about the possibility of an illicit discharge on **Form 2: Illicit Discharge Detection Inspection**. Take photos and document on form.
4. If flow is present, **collect samples** for analysis following procedures in **Table 1**. Follow hold times and instructions in **Table 2**. Record information in **Form 3**.
5. **Report** any signs of illicit discharges to your supervisor.

Dry Weather Outfall Inspection/Sampling SOP

Form 1: Outfall Description and Condition Inventory and Inspection

Inspection Information					
Outfall ID					
Outfall Location					
Inspector's Name					
Date of Inspection					
Rainfall (in)	Last 24 hours:		Last 48 hours:		
Outfall Description					
Type of Outfall (circle)	Material	Shape	Dimensions	Submerged	
Closed Pipe	<input type="checkbox"/> RCP <input type="checkbox"/> CMP <input type="checkbox"/> HDPE <input type="checkbox"/> Aluminum Other: _____	<input type="checkbox"/> Circular <input type="checkbox"/> Elliptical <input type="checkbox"/> Box Other: _____	Diameter/ Dimensions:	In water:	With sediment:
				<input type="checkbox"/> No <input type="checkbox"/> Partially <input type="checkbox"/> Fully	<input type="checkbox"/> No <input type="checkbox"/> Partially <input type="checkbox"/> Fully
Open Drainage	<input type="checkbox"/> Paved <input type="checkbox"/> Grass <input type="checkbox"/> Rip-rap Other: _____	<input type="checkbox"/> Trapezoid <input type="checkbox"/> Parabolic Other: _____	Depth: _____ Top Width: _____ Bottom Width: _____		
Condition Assessment					
Outfall Damage:	No Yes	Damage Type: Spalling Cracking/Chipping Corrosion Other:			
Deposits:	No Yes	None Grease/Oil Trash Foam Sediment Other:			
Sediment:	No Yes, Depth:	None Minor Moderate High Other:			
Vegetation Distress:	No Yes	Little or No Moderate High N/A Other:			
Erosion Damage:	No Yes	Little or No Moderate High N/A Other:			
Comments or any other non-illicit discharge concerns (e.g. trash or needed infrastructure repairs?):					

Dry Weather Outfall Inspection/Sampling SOP

Form 2: Illicit Discharge Detection Inspection

Outfall ID:		Date:	
Outfall Location:		Inspector's Name:	
Indicators (all outfalls with indicators)			
Indicator	Description (circle all that apply)		
<input type="checkbox"/> Deposits and Stains	Oily Flow Line Paint Other:		
<input type="checkbox"/> Poor Pool Quality (circle)	Odors Colors Oil Sheen Suds Algae Floatables Other:		
<input type="checkbox"/> Pipe Benthic Growth (circle)	Brown Orange Green Other:		
Flow Description			
Flow Present: Yes No		Notes:	
Flow Description: Trickle Moderate Substantial			Flow Depth:
Physical Indicators (flowing outfalls)			
Indicator	Description	Severity Indicators	Notes
Odor	<input type="checkbox"/> Sewage	<input type="checkbox"/> 1 – Faint (unclear source)	<i>Confirm the odor is coming from the discharge location and water and not the surrounding area. Avoid deeply inhaling odors as they may potentially be harmful vapors.</i>
	<input type="checkbox"/> Petroleum/Gas	<input type="checkbox"/> 2 – Easily detected	
	<input type="checkbox"/> Sulfide	<input type="checkbox"/> 3 – Noticeable from a distance	
	<input type="checkbox"/> Rancid/Sour		
	<input type="checkbox"/> Other: _____		
Color	<input type="checkbox"/> Clear <input type="checkbox"/> Brown	<input type="checkbox"/> 1 – Faint colors in sample bottle	<i>Color is defined by the tint or intensity of color observed.</i>
	<input type="checkbox"/> Gray <input type="checkbox"/> Yellow	<input type="checkbox"/> 2 – Clearly visible in sample bottle	
	<input type="checkbox"/> Green <input type="checkbox"/> Orange	<input type="checkbox"/> 3 – Clearly visible in the flow	
	<input type="checkbox"/> Red <input type="checkbox"/> Other: _____		
Turbidity/Cloudiness		<input type="checkbox"/> 1 – Slight <input type="checkbox"/> 2 – Cloudy <input type="checkbox"/> 3 – Opaque	<i>Turbidity or cloudiness is a measure of how easily light can penetrate through the sample.</i>
Floatables (other than trash)	<input type="checkbox"/> Sewage (toilet paper, etc.) <input type="checkbox"/> Suds <input type="checkbox"/> Petroleum/oil sheen <input type="checkbox"/> Other: _____	<input type="checkbox"/> 1 – Few/slight; origin not obvious <input type="checkbox"/> 2 – Some; indications of origin <input type="checkbox"/> 3 – Some; origin clear	<i>- In some cases, surface sheens may be created by in-stream processes. A thick or swirling sheen with a gas-like odor may indicate an oil discharge.</i> <i>- Suds that break up quickly may simply indicate water turbulence. Suds with a strong organic/sewage odor may indicate sewage. Suds with a fragrant odor may indicate laundry water.</i>
Possibility of Illicit Discharge			Sum of Severity Indicators: _____
<input type="checkbox"/> Unlikely	<input type="checkbox"/> Potential (two or more indicators)	<input type="checkbox"/> Suspect (one or more indicators at severity 3)	<input type="checkbox"/> Obvious
Comments/Possible Sources:			

Dry Weather Outfall Inspection/Sampling SOP

Table 1: Sampling Protocol

General Sampling Protocols

- 1) Do not eat, drink or smoke during sample collection and processing.
- 2) Do not collect or process samples near a running vehicle.
- 3) Do not park vehicles in the immediate sample collection area, including both running and non-running vehicles.

Sample Collection Protocols

- 1) Bring all materials and equipment including all forms, the cooler containing the sample bottles, and multi-meters to the site where the sample is going to be taken.
- 2) For any sample to be collected with a **multi-meter**, follow this protocol:
 - a. Turn on multi-meters and place the probe in the flow being careful not to let it rest on the bottom or become encased in sediment.
 - b. Once the numbers on the probe have stopped changing, record data from the multi-meters onto **Form 3: Dry Weather Water Quality Sampling Form**.
- 3) For any sample that must be collected by **bottle**, follow this protocol:
 - a. Put on clean, powder-free nitrile gloves and be careful not to touch anything other than the dippers or the sampling containers.
 - b. The second sampler should be prepared to open bottles and hand them to the first sampler when needed. The bottle caps should be left in the bags and not placed on the ground or other surface.
 - c. Keep hands away from the bottle opening to prevent contamination.
 - d. Collect the sample by placing the bottle in the main stream of flow, being careful not to allow the water to flow over your hands or the outside of the bottle first.
 - e. Do not overfill the bottle (only fill to about ½ inch from the top of the bottle) and do not dump any liquid from them as some of the bottles supplied by the lab have preservatives.
 - f. Once the sample bottle is filled, immediately hand the bottle to the second sampler to place and tighten the cap on the bottle.
 - g. Label sample bottle with location, date, and time.
 - h. Place the bottle in the plastic bag and immediately store it in the cooler before taking the next sample.
 - i. If the flow cannot be reached by the sampler, remove the dipper and extension rod from the sealed bag. Fill and rinse the dipper in the flow three times being careful not to disturb the sediment. Collect the sample in the dipper and carefully pour into the bottle following the protocol listed above.
- 4) Complete **Form 3: Dry Weather Water Quality Sampling Form** if analytical samples were collected, specify parameters, and note the sample time on the form. This creates a reference point for samples.
- 5) Complete the Chain of Custody for any samples delivered to a laboratory for analytical analysis.
- 6) Clean and maintain all equipment according to user manual.

Dry Weather Outfall Inspection/Sampling SOP

Analyte or Parameter	Analytical Method ¹	Detection Limit	Max. Hold Time	Preservative/Cooling
Ammonia	EPA: 350.2 SM: 4500-NH3C	0.05 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2, none if analyzed immediately
BOD5	EPA: 405.1 SM: 5210	EPA: 0.1mg/L SM: 0.1 mg/L	24 hours	Cool ≤6°C
Chlorine	SM: 4500-Cl G	0.02 mg/L	15 minutes	None
Conductivity	EPA: 120.1 SM: 2510B	0.2 µs/cm	28 days	Cool ≤6°C
Copper	EPA: 200.7	0.0033 mg/L	14 days	HNO ₃ to pH <2
Indicator Bacteria: <i>E.coli</i>	EPA: 1603 SM: 9221B, 9221F, 9223 B Other: Colilert, Colilert-18	EPA: 1 cfu/100mL SM: 2 MPN/100mL Other: 1 MPN/100mL	6 hours	Cool ≤10°C, 0.0008% Na ₂ S ₂ O ₃
Indicator Bacteria: Enterococcus	EPA: 1600 SM: 9230 C Other: Enterolert	EPA: 1 cfu/100mL SM: 1 MPN/100mL Other: 1 MPN/100mL	6 hours	Cool ≤10°C, 0.0008% Na ₂ S ₂ O ₃
Indicator Bacteria: Fecal coliform	SM: 9221E, 9222D	SM: 1.8 org/100mL	6 hours	Cool 4°C, 0.0008% Na ₂ S ₂ O ₃
Lead	EPA: 200.7	0.0033 mg/L	14 days	HNO ₃ to pH <2
Salinity	SM: 2520		28 days	Cool ≤6°C
Surfactants	SM: 5540-C	0.01 mg/L	48 hours	Cool ≤6°C
Temperature	SM: 2550B	Not applicable	Immediate	None
Total Nitrogen (TN) (methods are for TN and TKN, NO ₃ /NO ₂ which comprise TN)	TN SM: 4500 NC TKN EPA: 353-3 TKN SM: 4500 NH ₃ -H NO₃/NO₂ EPA: 353.2 NO₃/NO₂ SM: 4500NO ₃ -F	TN: 0.055 mg/L TKN EPA: 0.05 mg/L NO₃/NO₂: 0.005 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2
Total Phosphorus	EPA: Manual-365.3, Automated Ascorbic acid digestion-365.1 Rev. 2, ICP/AES4 200.7 Rev. 4.4 SM: 4500-P E-F	EPA: 0.01 mg/L SM : 0.01 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2
TSS	EPA: 160.2 (residue, non-filterable) SM: 2540D	EPA: 0.5 mg/L SM: 0.5 mg/L	7 days	Cool ≤6°C

Notes:

Select meters/test kits that can read below the detection limit provided in the table.

Follow the instrumentation/test kit instructions for sampling.

¹SM = Standard Methods

Dry Weather Outfall Inspection/Sampling SOP

Form 3: Dry Weather Water Quality Sampling Form

Outfall ID:		Date:	
Outfall Location:		Inspector's Name:	
FOR ALL OUTFALLS			
Sample Parameter	Field Meter/Test Kit Name	Field Screening Result	
Uses a Field Meter			
Temperature			
Salinity			
Specific Conductance			
Chlorine			
Uses a Test Kit			
Surfactant as MBAS			
Ammonia (NH ₃)			
Uses bottles to be sent to lab (see Table 2 for method, transport, and hold times)			
Sample Parameter	Time/Date	Laboratory	Result
<i>E.coli</i>			
FOR DISCHARGES TO IMPAIRED WATERS ONLY			
Sample Parameter	Field Meter/Test Kit Name	Field Screening Result	
Uses a Field Meter			
Dissolved Oxygen <i>(discharges to oxygen impaired waters)</i>			
Turbidity <i>(discharges to turbidity impaired waters)</i>			
Uses bottles to be sent to lab (see Table 2 for method, transport, and hold times)			
Sample Parameter	Time/Date	Laboratory	Result
BOD5 <i>(discharges to oxygen impaired waters)</i>			
Copper <i>(discharges to copper impaired waters)</i>			
Lead <i>(discharges to lead impaired waters)</i>			
Total Nitrogen <i>(discharges to nitrogen impaired waters)</i>			
Total Phosphorus <i>(discharges to phosp. and DO impaired waters)</i>			
TSS <i>(discharges to turbidity impaired waters)</i>			
TBD <i>(discharges to Fishes Bioassays, Ambient Bioassays – CAT, Foam/Flocs/Scum/Oil Slicks, and Other impaired waters)</i>			

Appendix E

SOP for Illicit Discharge Source Investigation

Illicit Discharge Source Investigation SOP

Purpose of SOP

1. Once a potential illicit discharge has been identified during routine dry weather sampling or inspection, an investigation to **identify the source** of the illicit discharge must be conducted.
2. **Observations of flow** during dry weather conditions will assist with identifying the source of an illicit discharge.

Prior to the Leaving the Facility

1. **Check the weather**: The illicit discharge source investigation shall proceed only when **no more than 0.1 inches** of rainfall has occurred in the **previous 24-hour period** and no significant snow melt is occurring.
2. **Gather** all required equipment and materials:
 - ☐ Necessary Forms:
 - Form 1: Illicit Discharge Source Investigation (at outfall)
 - Form 2: Illicit Discharge Source Investigation (for each structure upstream from outfall)
 - ☐ Detailed map of stormwater drainage infrastructure
 - ☐ Pen

Illicit Discharge Source Investigation

1. Once a potential illicit discharge has been identified during routine dry weather sampling or inspection, **observe the outfall** under dry weather conditions.
2. **Record observations** about the possibility of an illicit discharge on **Form 1: Illicit Discharge Source Investigation (at outfall)**. Take photos and document on form.
3. If flow is present, **proceed to the first accessible upstream manhole or structure** to continue the investigation to the source of the flow.
4. At each structure, **record observations about all flow** from inlet pipes on **Form 2: Illicit Discharge Source Investigation** (for each structure upstream from outfall). Take photos and document on form. Note flow on stormwater map.
5. If an illicit discharge is identified and sampling and flow observations do not identify the source, **use alternative investigation techniques** (additional sampling, dye or smoke testing, television inspection, etc.) as needed to identify the source.
6. Once the source is identified, **notify the responsible entity** of the illicit discharge and encourage voluntary removal.
7. **Use existing regulations** to enforce the removal of the illicit discharge. Impose a compliance schedule and fees (if allowed).

Illicit Discharge Source Investigation SOP

Form 1: Illicit Discharge Source Investigation (at outfall)

Outfall ID:	Date:
Inspector's Name:	
Flow Present: Yes No	
Flow Description (circle): Trickle Moderate Substantial	
Notes (color, odor, trash, etc.):	
Possibility of Illicit Discharge? Yes No	Possible Sources:

Form 2: Illicit Discharge Source Investigation

(for each structure upstream from outfall or key junction structure)

Structure ID:		Date:	
Inspector's Name:			
Flow in Inlet Pipes? Yes No		Notes:	
List all inlet pipes with flow (if more space is required, use back of form)			
Pipe ID		Flow Description (circle): Trickle Moderate Substantial	
		Notes (color, odor, trash, etc.):	
		Possibility of Illicit Discharge? Yes No	Possible Sources:
Pipe ID		Flow Description (circle): Trickle Moderate Substantial	
		Notes (color, odor, trash, etc.):	
		Possibility of Illicit Discharge? Yes No	Possible Sources:
Pipe ID		Flow Description (circle): Trickle Moderate Substantial	
		Notes (color, odor, trash, etc.):	
		Possibility of Illicit Discharge? Yes No	Possible Sources:
Pipe ID		Flow Description (circle): Trickle Moderate Substantial	
		Notes (color, odor, trash, etc.):	
		Possibility of Illicit Discharge? Yes No	Possible Sources:

Appendix F

SOP for Dry Weather Key Junction Investigation/Sampling

Dry Weather Key Junction Screening SOP

Purpose of SOP

1. The inspection of key junction structures to assess the **condition of the structure**;
2. The inspection of key junction structures to assess the **possibility of illicit discharges**; and
3. The **collection of samples** during dry weather conditions.

Prior to the Leaving the Facility

1. **Check the weather**: Dry weather screening and sampling shall proceed only when no more than 0.1 inches of rainfall has occurred in the previous 24-hour period and no significant snow melt is occurring.
2. **Gather** all required equipment and materials:
 - ☐ Necessary Forms:
 - Form 1: Key Junction Structure Description and Condition Inventory
 - Form 2: Illicit Discharge Detection Inspection
 - Form 3: Dry Weather Water Quality Sampling Form
 - ☐ Multi-meter for chlorine
 - ☐ Sample kits for ammonia and surfactants
 - ☐ Dipper with extension rod
 - ☐ Tape measure
 - ☐ Pen
 - ☐ Cooler with ice or ice packs to transport samples
3. **Calibrate** meters following methods in the instruction manuals.

In Field

1. **Observe** each key junction structure under dry weather conditions.
2. **Record observations** about the condition of the key junction structure on **Form 1: Key Junction Structure Description and Condition Inventory and Inspection**. Take photos and document on form.
3. **Record observations** about the possibility of an illicit discharge on **Form 2: Illicit Discharge Detection Inspection**. Take photos and document on form.
4. If flow is present, assign an ID to the flowing pipes on the site map. **collect samples** for analysis following procedures in **Table 1**. Follow hold times and instructions in **Table 2**. Record information in **Form 3**.
5. **Report** any signs of illicit discharges to your supervisor.

Table 2: Analytical Methods, Detection Limits, Hold Times, and Preservatives

Analyte or Parameter	Analytical Method ¹	Detection Limit	Max. Hold Time	Preservative/Cooling
Ammonia	EPA: 350.2 SM: 4500-NH3C	0.05 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2
Chlorine	SM: 4500-Cl G	0.02 mg/L	15 minutes	None
Surfactants	SM: 5540-C	0.01 mg/L	48 hours	Cool ≤6°C

Dry Weather Key Junction Screening SOP

Analyte or Parameter	Analytical Method ¹	Detection Limit	Max. Hold Time	Preservative/Cooling

Form 1: Key Junction Structure Description and Condition Inventory

Inspection Information	
Junction ID	
Associated Outfall ID	
Inspector's Name	

Dry Weather Key Junction Screening SOP

Date of Inspection					
Rainfall (in)	Last 24 hours:	Last 48 hours:			
Description of Key Junction Structure					
Type of Structure	Manhole	Catch Basin	Other: _____		
Condition of Structure	Good	Fair	Poor	Comments	Construction Material
Cover					
Frame					
Corbel					
Walls					
Floor					
Key Junction Damage (circle)	Spalling Cracking/Chipping Corrosion Other: _____				
Comments or any other non-illicit discharge concerns (e.g., trash or needed infrastructure repairs?):					

Dry Weather Key Junction Screening SOP

Form 2: Illicit Discharge Detection Inspection

Junction ID:				Date:			
Associated Outfall ID:				Inspector's Name:			
Flow Description							
Flow in Inlet Pipes? Yes No				Notes:			
List all inlet pipes with flow (if more space is required, use back of form)							
Pipe ID		Flow Description (circle): Trickle Moderate Substantial					
		Depth in Center of Flow (in.)		Width (in.)			
Pipe ID		Flow Description (circle): Trickle Moderate Substantial					
		Depth in Center of Flow (in.)		Width (in.)			
Physical Indicators (<i>all key structures</i>)							
Indicator		Description					
<input type="checkbox"/> Deposits and Stains (circle)		Oily	Flow Line	Paint	Other:		
<input type="checkbox"/> Pipe Benthic Growth (circle)		Brown	Orange	Green	Other:		
Physical Indicators (<i>flowing structures/pipes only</i>)							
Indicator	Description		Severity		Notes		
Odor	<input type="checkbox"/> Sewage		<input type="checkbox"/> 1 – Faint		<i>Confirm the odor is coming from the discharge location and water and not the surrounding area. Avoid deeply inhaling odors as they may potentially be harmful vapors.</i>		
	<input type="checkbox"/> Petroleum/Gas		<input type="checkbox"/> 2 – Easily detected				
	<input type="checkbox"/> Sulfide		<input type="checkbox"/> 3 – Noticeable from a distance				
	<input type="checkbox"/> Rancid/Sour						
	Other: _____						
Color	<input type="checkbox"/> Clear	<input type="checkbox"/> Brown	<input type="checkbox"/> 1 – Faint colors in sample bottle		<i>Color is defined by the tint or intensity of color observed</i>		
	<input type="checkbox"/> Gray	<input type="checkbox"/> Yellow	<input type="checkbox"/> 2 – Clearly visible in sample bottle				
	<input type="checkbox"/> Green	<input type="checkbox"/> Orange	<input type="checkbox"/> 3 – Clearly visible in the flow				
	<input type="checkbox"/> Red	<input type="checkbox"/> Other: _____					
Turbidity/Cloudiness			<input type="checkbox"/> 1 – Slight <input type="checkbox"/> 2 – Cloudy <input type="checkbox"/> 3 – Opaque		<i>Turbidity or cloudiness is a measure of how easily light can penetrate through the sample.</i>		
Floatables (other than trash)	<input type="checkbox"/> Sewage (toilet paper, etc.)		<input type="checkbox"/> 1 – Few/slight; origin not obvious		<i>- In some cases, surface sheens may be created by in-stream processes. A thick or swirling sheen with a gas-like odor may indicate an oil discharge.</i> <i>- Suds that break up quickly may simply indicate water turbulence. Suds with a strong organic/sewage odor may indicate sewage. Suds with a fragrant odor may indicate laundry water.</i>		
	<input type="checkbox"/> Suds		<input type="checkbox"/> 2 – Some; indications of origin				
	<input type="checkbox"/> Petroleum/oil sheen		<input type="checkbox"/> 3 – Some; origin clear				
		Other: _____					
Possibility of Illicit Discharge				Sum of Severity Indicators: _____			
<input type="checkbox"/> Unlikely	<input type="checkbox"/> Potential (two or more indicators)		<input type="checkbox"/> Suspect (one or more indicators with severity 3)			<input type="checkbox"/> Obvious	
Comments/Possible Sources:							

Dry Weather Key Junction Screening SOP

Table 1: Sampling Protocol

General Sampling Protocols

- 1) Do not eat, drink or smoke during sample collection and processing.
- 2) Do not collect or process samples near a running vehicle.
- 3) Do not park vehicles in the immediate sample collection area, including both running and non-running vehicles.

Sample Collection Protocols

- 1) Bring all materials and equipment including all forms, the cooler containing the sample bottles, and multi-meters to the site where the sample is going to be taken.
- 2) For any sample to be collected with a **multi-meter**, follow this protocol:
 - a. Turn on multi-meters and place the probe in the flow being careful not to let it rest on the bottom or become encased in sediment.
 - b. Once the numbers on the probe have stopped changing, record data from the multi-meters onto **Form 3: Dry Weather Water Quality Sampling Form**.
- 3) For any sample that must be collected by **bottle**, follow this protocol:
 - a. Put on clean, powder-free nitrile gloves and be careful not to touch anything other than the dippers or the sampling containers.
 - b. The second sampler should be prepared to open bottles and hand them to the first sampler when needed. The bottle caps should be left in the bags and not placed on the ground or other surface.
 - c. Keep hands away from the bottle opening to prevent contamination.
 - d. Collect the sample by placing the bottle in the main stream of flow, being careful not to allow the water to flow over your hands or the outside of the bottle first.
 - e. Do not overfill the bottle (only fill to about ½ inch from the top of the bottle) and do not dump any liquid from them as some of the bottles supplied by the lab have preservatives.
 - f. Once the sample bottle is filled, immediately hand the bottle to the second sampler to place and tighten the cap on the bottle.
 - g. Label sample bottle with location, date, and time.
 - h. Place the bottle in the plastic bag and immediately store it in the cooler before taking the next sample.
 - i. If the flow cannot be reached by the sampler, remove the dipper and extension rod from the sealed bag. Fill and rinse the dipper in the flow three times being careful not to disturb the sediment. Collect the sample in the dipper and carefully pour into the bottle following the protocol listed above.
- 4) Complete **Form 3: Dry Weather Water Quality Sampling Form** if analytical samples were collected, specify parameters, and note the sample time on the form. This creates a reference point for samples.
- 5) Complete the Chain of Custody for any samples delivered to a laboratory for analytical analysis.
- 6) Clean and maintain all equipment according to the user manual.

Dry Weather Key Junction Screening SOP

Form 3: Dry Weather Water Quality Sampling Form

Junction ID:	Date and Time:			
Associated Outfall ID:		Inspector's Name:		
Sample Parameter	Field Meter/Test Kit Name	Field Screening Result		
		Pipe ID	Pipe ID	Pipe
	Units:			
<i>Uses a Field Meter</i>				
Chlorine				
<i>Uses a Test Kit</i>				
Surfactant as MBAS				
Ammonia (NH ₃)				

Junction ID:	Date and Time:			
Associated Outfall ID:		Inspector's Name:		
Sample Parameter	Field Meter/Test Kit Name	Field Screening Result		
		Pipe ID	Pipe ID	Pipe
	Units:			
<i>Uses a Field Meter</i>				
Chlorine				
<i>Uses a Test Kit</i>				
Surfactant as MBAS				
Ammonia (NH ₃)				

Appendix G

SOP for Wet Weather Outfall Sampling

Wet Weather Outfall Sampling SOP

Purpose of SOP

- A **wet weather investigation** will be conducted for outfalls that have been identified by the Town of Abington as having a higher potential for illicit connections; and
- The investigation will include an **inspection** of stormwater drainage outfalls and the **collection of samples** during wet-weather induced flows to determine the presence of illicit discharges to the MS4.

Prior to the Leaving the Facility

1. **Check the weather:**
 - The storm event should be large enough to produce stormwater discharge.
 - Wet weather screening and sampling shall proceed when more than 0.1 inches of rainfall has occurred in the previous 24-hour period.
 - Sampling is recommended in the spring when groundwater levels are high.
2. **Gather** all required equipment and materials:
 - Necessary Forms:
 - Form 1: Wet Weather Illicit Discharge Detection Inspection
 - Form 2: Wet Weather Water Quality Sampling Form
 - Multi-meters for chlorine, conductivity, salinity, and temperature
 - Sample kits for ammonia and surfactants
 - Sampling bottles for *E. coli* analysis
 - Multi meters for turbidity and dissolved oxygen (*for discharges to impaired and TMDL waters only*)
 - Sampling bottles for total phosphorus, total nitrogen, BOD5, TSS, copper, and lead (*for discharges to impaired and TMDL waters only*)
 - Dipper with extension rod
 - Tape measure
 - Pen
 - Cooler with ice or ice packs to transport samples
3. **Calibrate** meters following methods in the instruction manuals.

In Field

1. **Observe** each outfall under wet weather conditions. If an outfall is inaccessible or submerged, proceed to the first accessible upstream manhole or structure.
2. **Record observations** about the general condition of the structure and the possibility of an illicit discharge on **Form 1: Wet Weather Illicit Discharge Detection Inspection**. Take photos and document on form.
3. **Collect samples** for analysis following procedures in **Table 1**. Follow hold times and instructions in **Table 2**. Record information in **Form 2: Wet Weather Water Quality Sampling Form**.
4. **Report** any signs of illicit discharges to your supervisor.

Wet Weather Outfall Sampling SOP

Form 1: Illicit Discharge Detection Inspection

Outfall ID:		Date:	
Outfall Location:		Inspector's Name:	
Indicators (all outfalls with indicators)			
Indicator	Description (circle all that apply)		
<input type="checkbox"/> Deposits and Stains	Oily Flow Line Paint Other:		
<input type="checkbox"/> Poor Pool Quality (circle)	Odors Colors Oil Sheen Suds Algae Floatables Other:		
<input type="checkbox"/> Pipe Benthic Growth (circle)	Brown Orange Green Other:		
Flow Description			
Flow Present: Yes No		Notes:	
Flow Description: Trickle Moderate Substantial			Flow Depth:
Physical Indicators (flowing outfalls)			
Indicator	Description	Severity Indicators	Notes
Odor	<input type="checkbox"/> Sewage <input type="checkbox"/> Petroleum/Gas <input type="checkbox"/> Sulfide <input type="checkbox"/> Rancid/Sour <input type="checkbox"/> Other: _____	<input type="checkbox"/> 1 – Faint (unclear source) <input type="checkbox"/> 2 – Easily detected <input type="checkbox"/> 3 – Noticeable from a distance	<i>Confirm the odor is coming from the discharge location and water and not the surrounding area. Avoid deeply inhaling odors as they may potentially be harmful vapors.</i>
Color	<input type="checkbox"/> Clear <input type="checkbox"/> Brown <input type="checkbox"/> Gray <input type="checkbox"/> Yellow <input type="checkbox"/> Green <input type="checkbox"/> Orange <input type="checkbox"/> Red <input type="checkbox"/> Other: _____	<input type="checkbox"/> 1 – Faint colors in sample bottle <input type="checkbox"/> 2 – Clearly visible in sample bottle <input type="checkbox"/> 3 – Clearly visible in the flow	<i>Color is defined by the tint or intensity of color observed.</i>
Turbidity/Cloudiness		<input type="checkbox"/> 1 – Slight <input type="checkbox"/> 2 – Cloudy <input type="checkbox"/> 3 – Opaque	<i>Turbidity or cloudiness is a measure of how easily light can penetrate through the sample.</i>
Floatables (other than trash)	<input type="checkbox"/> Sewage (toilet paper, etc.) <input type="checkbox"/> Suds <input type="checkbox"/> Petroleum/oil sheen <input type="checkbox"/> Other: _____	<input type="checkbox"/> 1 – Few/slight; origin not obvious <input type="checkbox"/> 2 – Some; indications of origin <input type="checkbox"/> 3 – Some; origin clear	<i>- In some cases, surface sheens may be created by in-stream processes. A thick or swirling sheen with a gas-like odor may indicate an oil discharge.</i> <i>- Suds that break up quickly may simply indicate water turbulence. Suds with a strong organic/sewage odor may indicate sewage. Suds with a fragrant odor may indicate laundry water.</i>
Possibility of Illicit Discharge			Sum of Severity Indicators: _____
<input type="checkbox"/> Unlikely	<input type="checkbox"/> Potential (two or more indicators)	<input type="checkbox"/> Suspect (one or more indicators at severity 3)	<input type="checkbox"/> Obvious
Comments/Possible Sources:			

Wet Weather Outfall Sampling SOP

Table 1: Sampling Protocol

General Sampling Protocols

- 1) Do not eat, drink or smoke during sample collection and processing.
- 2) Do not collect or process samples near a running vehicle.
- 3) Do not park vehicles in the immediate sample collection area, including both running and non-running vehicles.

Sample Collection Protocols

- 1) Bring all materials and equipment including all forms, the cooler containing the sample bottles, and multi-meters to the site where the sample is going to be taken.
- 2) For any sample to be collected with a **multi-meter**, follow this protocol:
 - a. Turn on multi-meters and place the probe in the flow being careful not to let it rest on the bottom or become encased in sediment.
 - b. Once the numbers on the probe have stopped changing, record data from the multi-meters onto **Form 2: Wet Weather Water Quality Sampling Form**.
- 3) For any sample that must be collected by **bottle**, follow this protocol:
 - a. Put on clean, powder-free nitrile gloves and be careful not to touch anything other than the dippers or the sampling containers.
 - b. The second sampler should be prepared to open bottles and hand them to the first sampler when needed. The bottle caps should be left in the bags and not placed on the ground or other surface.
 - c. Keep hands away from the bottle opening to prevent contamination.
 - d. Collect the sample by placing the bottle in the main stream of flow, being careful not to allow the water to flow over your hands or the outside of the bottle first.
 - e. Do not overfill the bottle (only fill to about ½ inch from the top of the bottle) and do not dump any liquid from them as some of the bottles supplied by the lab have preservatives.
 - f. Once the sample bottle is filled, immediately hand the bottle to the second sampler to place and tighten the cap on the bottle.
 - g. Label sample bottle with location, date, and time.
 - h. Place the bottle in the plastic bag and immediately store it in the cooler before taking the next sample.
 - i. If the flow cannot be reached by the sampler, remove the dipper and extension rod from the sealed bag. Fill and rinse the dipper in the flow three times being careful not to disturb the sediment. Collect the sample in the dipper and carefully pour into the bottle following the protocol listed above.
- 4) Complete **Form 2: Wet Weather Water Quality Sampling Form** if analytical samples were collected, specify parameters, and note the sample time on the form. This creates a reference point for samples.
- 5) Complete the Chain of Custody for any samples delivered to a laboratory for analytical analysis.
- 6) Clean and maintain all equipment according to user manual.

Wet Weather Outfall Sampling SOP

Table 2: Analytical Methods, Detection Limits, Hold Times, and Preservatives

Analyte or Parameter	Analytical Method ¹	Detection Limit	Max. Hold Time	Preservative/Cooling
Ammonia	EPA: 350.2 SM: 4500-NH ₃ C	0.05 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2, none if analyzed immediately
BOD ₅	EPA: 405.1 SM: 5210	EPA: 0.1mg/L SM: 0.1 mg/L	24 hours	Cool ≤6°C
Chlorine	SM: 4500-Cl G	0.02 mg/L	15 minutes	None
Conductivity	EPA: 120.1 SM: 2510B	0.2 µs/cm	28 days	Cool ≤6°C
Copper	EPA: 200.7	0.0033 mg/L	14 days	HNO ₃ to pH <2
Indicator Bacteria: <i>E.coli</i>	EPA: 1603 SM: 9221B, 9221F, 9223 B Other: Colilert, Colilert-18	EPA: 1 cfu/100mL SM: 2 MPN/100mL Other: 1 MPN/100mL	6 hours	Cool ≤10°C, 0.0008% Na ₂ S ₂ O ₃
Indicator Bacteria: Enterococcus	EPA: 1600 SM: 9230 C Other: Enterolert	EPA: 1 cfu/100mL SM: 1 MPN/100mL Other: 1 MPN/100mL	6 hours	Cool ≤10°C, 0.0008% Na ₂ S ₂ O ₃
Indicator Bacteria: Fecal coliform	SM: 9221E, 9222D	SM: 1.8 org/100mL	6 hours	Cool 4°C, 0.0008% Na ₂ S ₂ O ₃
Lead	EPA: 200.7	0.0033 mg/L	14 days	HNO ₃ to pH <2
Salinity	SM: 2520		28 days	Cool ≤6°C
Surfactants	SM: 5540-C	0.01 mg/L	48 hours	Cool ≤6°C
Temperature	SM: 2550B	Not applicable	Immediate	None
Total Nitrogen (TN) (methods are for TN and TKN, NO ₃ /NO ₂ which comprise TN)	TN SM: 4500 NC TKN EPA: 353-3 TKN SM: 4500 NH ₃ -H NO₃/NO₂ EPA: 353.2 NO₃/NO₂ SM: 4500NO ₃ -F	TN: 0.055 mg/L TKN EPA: 0.05 mg/L NO₃/NO₂: 0.005 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2
Total Phosphorus	EPA: Manual-365.3, Automated Ascorbic acid digestion-365.1 Rev. 2, ICP/AES4 200.7 Rev. 4.4 SM: 4500-P E-F	EPA: 0.01 mg/L SM : 0.01 mg/L	28 days	Cool ≤6°C, H ₂ SO ₄ to pH <2
TSS	EPA: 160.2 (residue, non-filterable) SM: 2540D	EPA: 0.5 mg/L SM: 0.5 mg/L	7 days	Cool ≤6°C
Notes: Select meters/test kits that can read below the detection limit provided in the table. Follow the instrumentation/test kit instructions for sampling. ¹ SM = Standard Methods				

Wet Weather Outfall Sampling SOP

Form 2: Wet Weather Water Quality Sampling Form

Outfall ID:		Date:	
Outfall Location:		Inspector's Name:	
FOR ALL OUTFALLS			
Sample Parameter	Field Meter/Test Kit Name	Field Screening Result	
Uses a Field Meter			
Temperature			
Salinity			
Specific Conductance			
Chlorine			
Uses a Test Kit			
Surfactant as MBAS			
Ammonia (NH ₃)			
Uses bottles to be sent to lab (see Table 2 for method, transport, and hold times)			
Sample Parameter	Time/Date	Laboratory	Result
<i>E.coli</i>			
FOR DISCHARGES TO IMPAIRED WATERS ONLY			
Sample Parameter	Field Meter/Test Kit Name	Field Screening Result	
Uses a Field Meter			
Dissolved Oxygen <i>(discharges to oxygen impaired waters)</i>			
Turbidity <i>(discharges to turbidity impaired waters)</i>			
Uses bottles to be sent to lab (see Table 2 for method, transport, and hold times)			
Sample Parameter	Time/Date	Laboratory	Result
BOD5 <i>(discharges to oxygen impaired waters)</i>			
Copper <i>(discharges to copper impaired waters)</i>			
Lead <i>(discharges to lead impaired waters)</i>			
Total Nitrogen <i>(discharges to nitrogen impaired waters)</i>			
Total Phosphorus <i>(discharges to phosp. and DO impaired waters)</i>			
TSS <i>(discharges to turbidity impaired waters)</i>			
TBD <i>(discharges to Fishes Bioassays, Ambient Bioassays – CAT, Foam/Flocs/Scum/Oil Slicks, and Other impaired waters)</i>			

Appendix H

Illicit Discharge Records



DRY WEATHER OUTFALL INSPECTION REPORT

1

To: Matt Stencel, Town of Sutton

From: Nick Cristofori, P.E., Comprehensive Environmental Inc.

Date: September 20, 2021

Town: Sutton, MA

Subject: Dry Weather Outfall Inspection and Screening

Under the Environmental Protection Agency's (EPA's) 2016 National Pollutant Discharge and Elimination System (NPDES) Municipal Separate Storm Sewer System (MS4) Permit, regulated communities such as Sutton are required to inspect all known outfalls and interconnections for the presence of dry weather flow (no more than 0.1-inches of rainfall has occurred during the previous 24-hour period and no significant snow melt is occurring) within three years of the permit effective date, or by June 30, 2021. CEI performed field work related to dry weather screening over the course of 2 field days on July 23, 2021 and August 31, 2021.

The following relevant outfall conditions were observed:

Table 1 – Dry Weather Flow Screening Results

Parameter	Number
Known Outfalls within the Urbanized Area	43
Outfalls that were Attempted to Visit	40
Outfalls that Could Not be Located	3
Outfalls that Could Not be Accessed	5
Structures Identified as an Outfall Found that were not an Outfall	0
Actual Outfalls Found	32
Outfalls Found Not Flowing	26
Outfalls Found with Evidence of Flow	6
Found with Illicit Discharge Potential	2
Total Not Yet Attempted to Visit	3

The six flowing outfalls were sampled for the following parameters as required by the permit: ammonia, chlorine, conductivity, salinity, e.coli, surfactants, temperature, dissolved oxygen, and pH. Four of these outfalls were also sampled for total nitrogen as they discharged to a waterbody within the Long Island Sound watershed. One of these four outfalls were also sampled for both total phosphorus and BOD as it discharges to Manchaug Pond. Copper and lead tests were performed for one of the outfalls which discharged into Mumford River.

Results are as follows:



DRY WEATHER OUTFALL INSPECTION REPORT

2

Table 2 – Dry Weather Flow Screening Results

Outfall ID	Ammonia (mg/L)	Chlorine (mg/L)	Surfactants (mg/L)	Conductivity (uS/cm)	Salinity (ppt)	Temperature (C)	E. Coli (MPN/100 mL)	Total Phosphorus (mg/L)	Total Nitrogen (mg/L)	BOD	Copper (mg/L)	Lead (mg/L)
7	0	0.08*	0.23	417.6	0.20	23.5	0		1.42		0	0.0001
9	0	0	0.04	346.3	0.16	19.5	60		2.47			
13	0	0	0	61.7	0.03	17.5	0	0	0.09	0		
21	0	0.04*	0.04	320	0.15	18	12					
26	0	0	0	331.8	0.16	18.6	28					
42	0	0	0.04	102.2	0.05	19.2	490*		0.27			

Note, Numbers in bold exceeds illicit discharge or water quality benchmarks

Per the 2016 MS4 Permit, the following criteria indicate likely sewer input and should be considered highly likely to contain illicit discharges from sanitary sources:

1. Olfactory or visual evidence of sewage;
2. Ammonia ≥ 0.5 mg/L, surfactants ≥ 0.25 mg/L, and bacteria levels greater than the water quality criteria applicable to the receiving water (235 colonies per 100 mL); and/or
3. Ammonia ≥ 0.5 mg/L, surfactants ≥ 0.25 mg/L, and detectable levels of chlorine.

Recommendations and Next Steps

The following items are recommended as follow-up actions:

- As shown in Table 2, none of the flowing outfalls met the Permit criteria as being highly likely to contain illicit discharges from sanitary sources.
- Outfall 10 exhibited orange benthic growth and phosphorus sheen but was determined to be stream flow and not sampled.
- Outfall 42 exhibited some discoloration and a sulfur smell; however, additional sampling did not indicate the presence of a likely illicit discharge from sanitary sources.
- Outfalls 12, 35, 37, and 40 were observed to be at least half buried in sediment and should be cleaned out to preserve flow capacity.
- Outfalls 2, 10, 13, 15, 20, 26, 27, 32, 40, 42, 43, and 44 are showing some evidence of deterioration and should be monitored during future years and/or repaired as soon as practical.
- Outfalls 8, 14, 34, and 37 exhibited headwall deterioration which should be monitored during future years and/or repaired as soon as practical.
- Outfalls 9, 26, 34, 35, 36, and 42 exhibit some evidence of downstream erosion which should be monitored during future years and/or repaired as soon as practical.
- The 8 outfalls that could not be located or accessed were instead screened at the next upgradient structure. It is recommended that these outfalls be field-located or determined not to exist and removed from mapping.



DRY WEATHER OUTFALL INSPECTION REPORT

3


- The remaining 3 outfalls that have not yet been visited should be screened during Permit Year 4, either at the outfalls themselves or at the next upgradient structure.

If you have any further questions or would like additional information, please feel free to contact me at 800.725.2550 x303 or ncristofori@ceiengineers.com. Thank you.

Nick Cristofori, P.E.
Principal, Project Manager

Attachments:

- Dry Weather Outfall Sampling Results Map
- Table of Results
- Stormwater Infrastructure Map

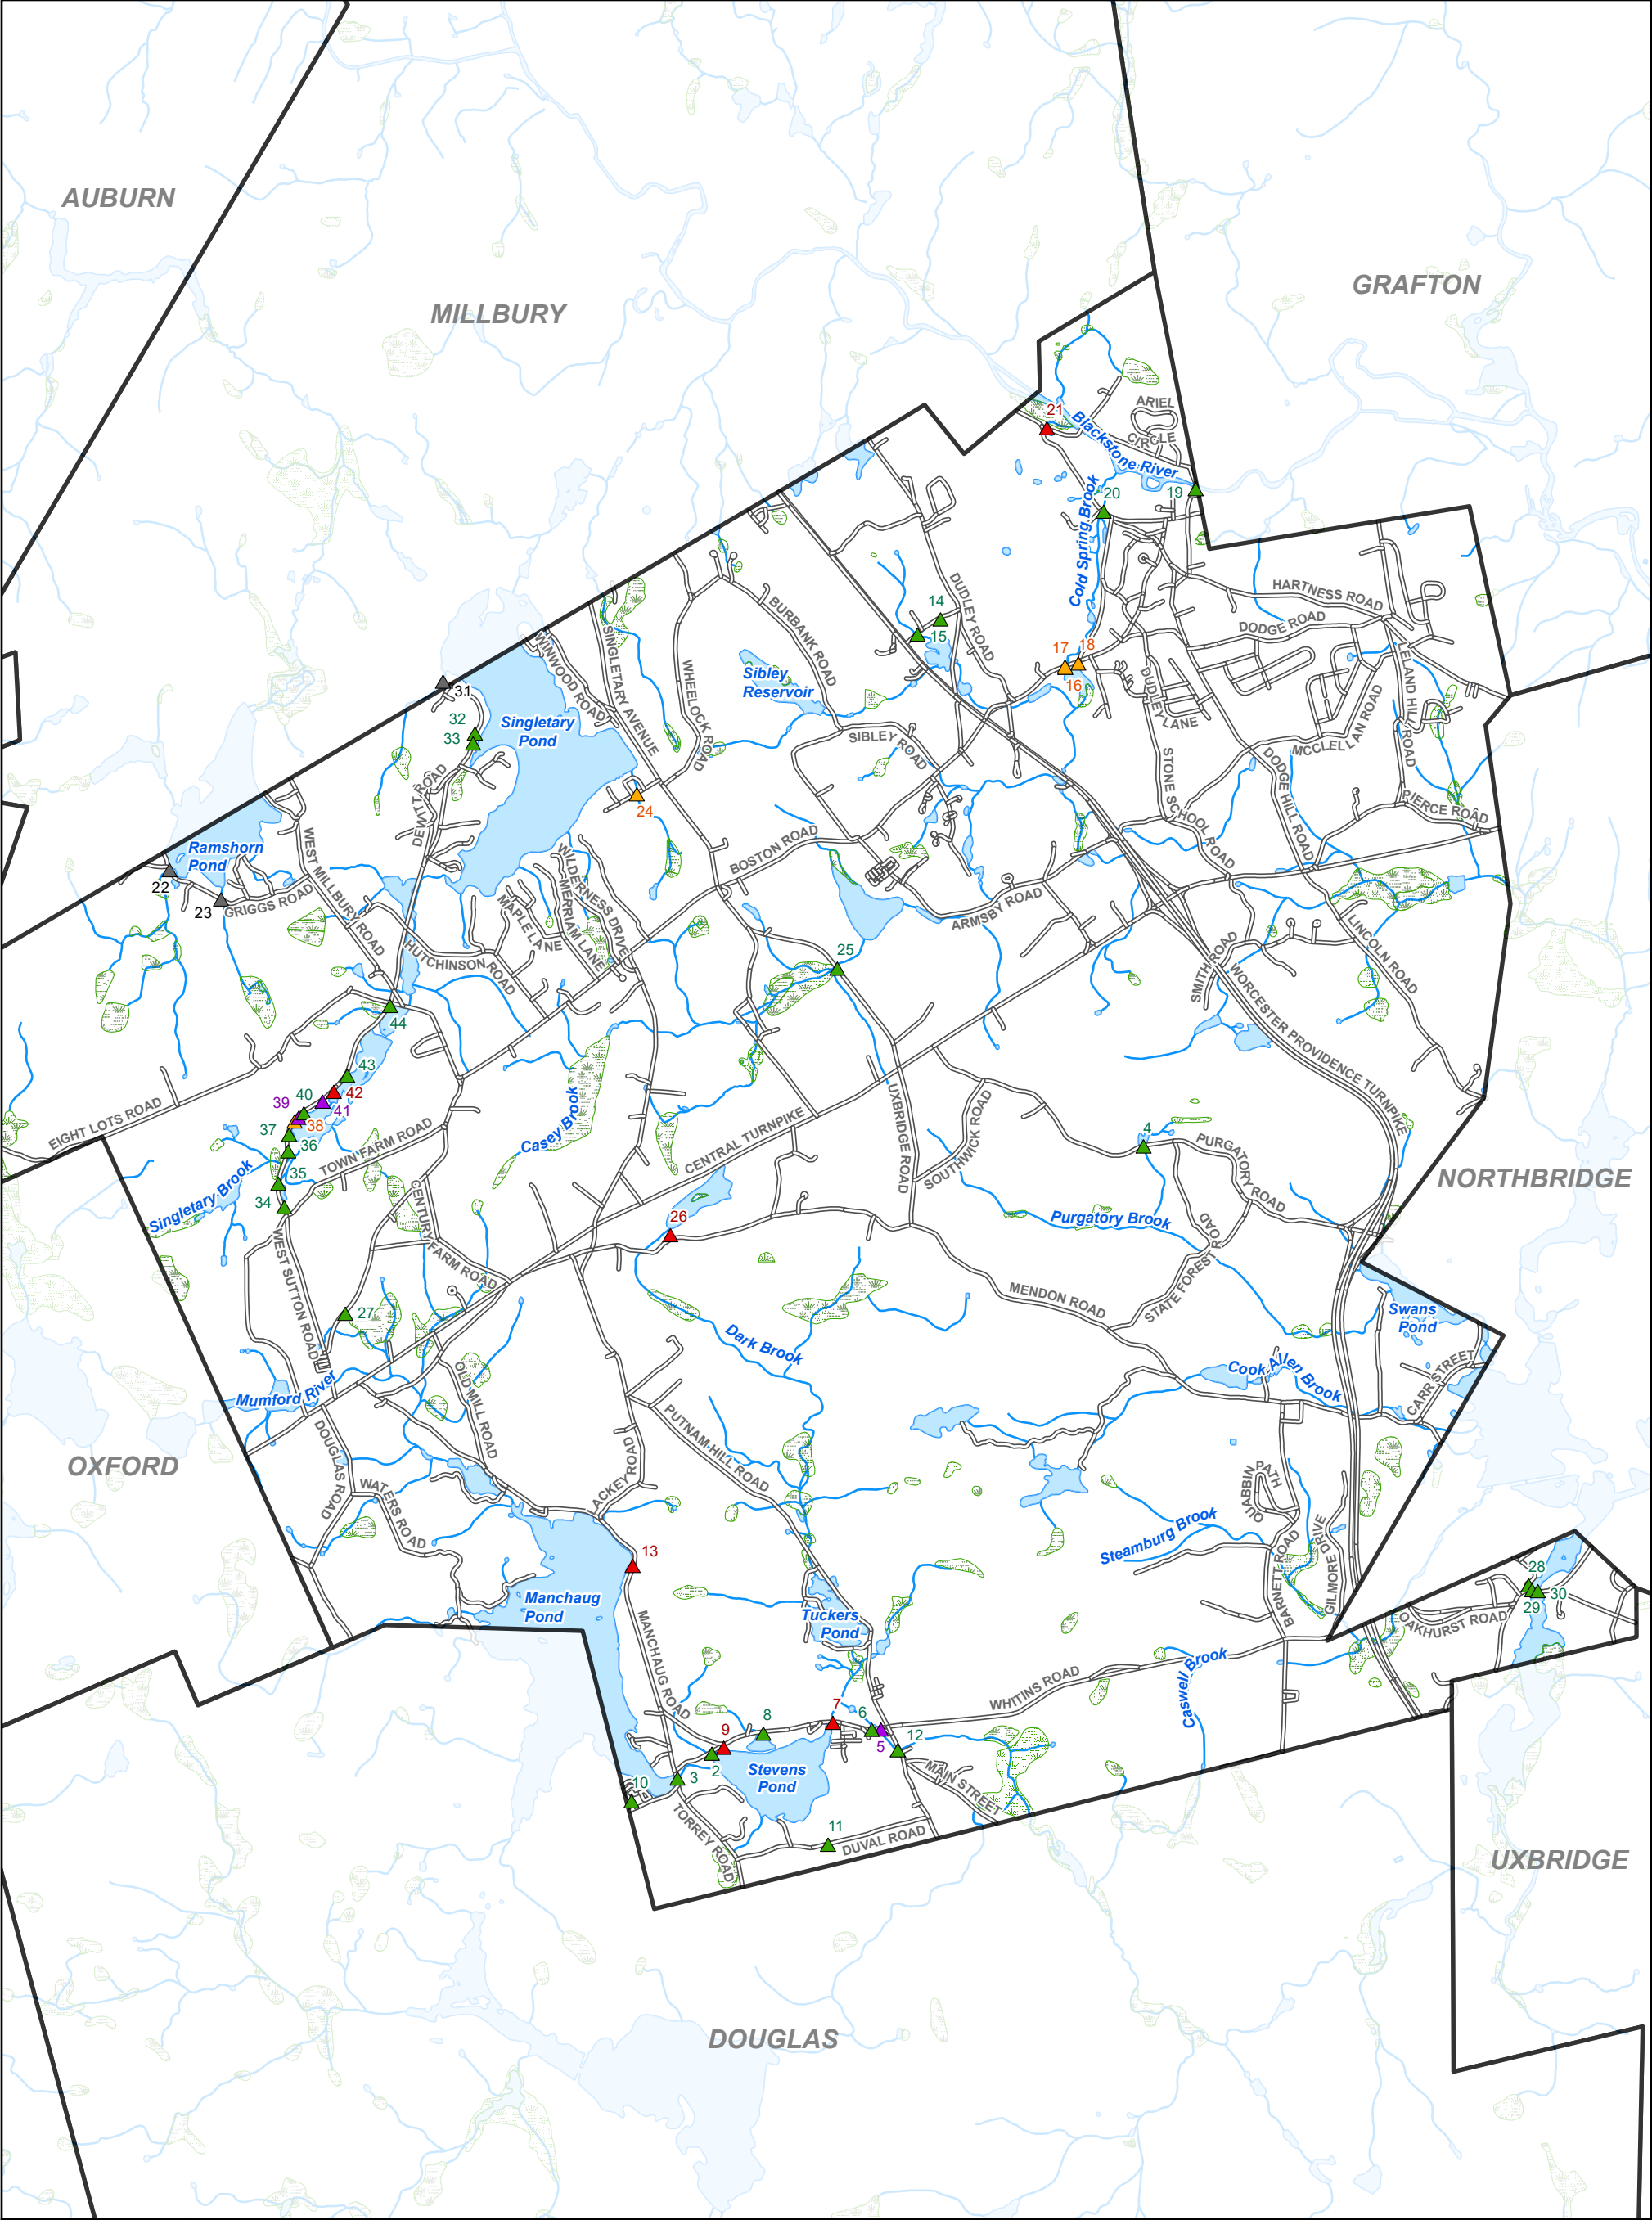

Legend

- Outfall Inspection Result:
- ▲

 Not Visited

▲

 Flowing

▲

 Not Flowing

▲

 Not Found

▲

 Could Not Access

—

 Roads

—

 Lake, Pond, Reservoir

—

 Wetland, Marsh, Swamp

—

 Stream, Brook




**Dry Weather Outfall
Screening Map
Sutton, MA**



Data Sources: MassGIS, Town of Sutton, CEI



Outfall Characteristics													Pipe Ends and Headwall Conditions					Erosion and Sedimentation			Illicit Discharge Potential		
Outfall ID	Lon.	Lat.	Date / Time of Inspection	Outfall Located?	Receiving Water	Number of Outfall Pipes	Outfall Type	Outfall Shape	Outfall Diameter (inches)	Pipe Material	Outfall Damage	Outfall Condition Comment	Pipe End Treatment	Pipe End Treatment Condition	Headwall Material	Headwall Condition	Headwall Condition Comment	Downstream Erosion	Sedimentation Level	Downstream Erosion Comment	Any Illicit Discharge Indicators?	Illicit Discharge Potential	Illicit Discharge Indicator Comments
2	-71.7630	42.0922	7/23/2021 12:29	Found	Stevens Pond	1	Outfall, Pipe	Round	12	CMP	Other	Top of pipe is bent	Projecting	Fair	N/A	N/A		No	None		No		
3	-71.7663	42.0906	7/23/2021 12:24	Found	Mumford River		Outfall, Pipe																
4	-71.7244	42.1331	8/31/2021 15:59	Found		1	Outfall, Pipe														No		
5	-71.7476	42.0937	7/23/2021 12:54	Not Found		1																	
6	-71.7487	42.0939	7/23/2021 12:47	Found	Mumford River		Outfall, Pipe	Round	12	RCP	None		Flush with Headwall	Good	Reinforced Concrete	Good		No	None		No		
7	-71.7525	42.0944	7/23/2021 14:02	Found	Mumford River		Outfall, Pipe	Round	18	CMP	None		Projecting	Good	N/A	N/A		No	None		No		
8	-71.7584	42.0936	7/23/2021 12:38	Found	Stevens Pond		Outfall, Pipe	Round	12	CMP	None		Projecting	Good	Stone	Poor	Appears to have a collapsed stone headwall.	No	None		No		
9	-71.7615	42.0929	7/23/2021 13:21	Found	Stevens Pond		Outfall, Pipe	Round	18	CMP	None		Projecting	Good	Stone	Good		Moderate	<25%	Small plunge pool	No		
10	-71.7699	42.0886	7/23/2021 12:10	Found	Manchaug Pond		Outfall, Pipe	Round	24	RCP	Spalling	Mild spalling	Projecting	Good	N/A	N/A		No	25%-50%		Yes	Unlikely	Orange benthic growth and phosphorus sheen. Orange growth also present before inlet structure.
11	-71.7526	42.0862	7/23/2021 13:15	Found		1	Outfall, Pipe																
12	-71.7463	42.0924	7/23/2021 13:04	Found	Mumford River		Outfall, Pipe	Round	12	RCP	None	Outfall partially buried, unable to fully assess	Flush with Headwall	Fair	Stone	Good		No	>75%		No		
13	-71.7707	42.1037	7/23/2021 14:59	Found	Manchaug Pond		Outfall, Pipe	Round	12	CMP	Corrosion	Some corrosion at bottom of pipe	Flush with Headwall	Good	Stone	Good		No	None		No		
14	-71.7427	42.1682	8/31/2021 17:48	Found			Outfall, Pipe	Round	12	CMP	None		Flush with Headwall	Good	Stone	Poor	Stones are collapsing	No	None		No		
15	-71.7449	42.1672	8/31/2021 17:55	Found			Outfall, Pipe	Round	12	RCP	Spalling	Some minor chipping around rim	Flush with Headwall	Good	Reinforced Concrete	Good		No	<25%		No		
16	-71.7315	42.1650	8/31/2021 17:34	Could Not Access		1																	
17	-71.7304	42.1654	8/31/2021 17:40	Could Not Access		1																	
18	-71.7304	42.1653	8/31/2021 17:28	Could Not Access		1																	
19	-71.7200	42.1768	8/31/2021 18:12	Found	Branch River		Outfall, Pipe	Round	12	RCP	None		Mitered	Good	Reinforced Concrete	Good		No	None		No		
20	-71.7283	42.1754	8/31/2021 17:20	Found			Outfall, Pipe	Round	24	CMP	None	Invert corrosion	Projecting	Fair	Stone	Good		No	None		No		
21	-71.7335	42.1809	8/31/2021 16:59	Found	Tributary to Branch River		Outfall, Pipe	Round	24	RCP	None	Stormwater drainage connected to culvert, sampled upstream catch basin	Flush with Headwall	Good	Reinforced Concrete	Good		No	<25%		No		
24	-71.7701	42.1564	8/31/2021 16:35	Could Not Access		1																	
25	-71.7518	42.1447	8/31/2021 16:22	Found	Casey Brook	1	Outfall, Open Drainage						n/a	n/a	N/A	N/A			25%-50%		No		
26	-71.7668	42.1270	8/31/2021 15:25	Found	Pidgeon Hill Pond		Outfall, Pipe	Round	12	CMP	Other	Top of pipe end is dented in.	Projecting	Fair	N/A	N/A		Moderate	25%-50%	Some scouring in channel	No		
27	-71.7961	42.1216	7/23/2021 15:20	Found	Unnamed Stream		Outfall, Pipe	Round	12	CMP	Corrosion	Minimal corrosion	Flush with Headwall	Good	Stone	Good		No	<25%		No		
28	-71.6897	42.1037	8/31/2021 18:45	Found	Meadow Pond		Outfall, Pipe	Round	18	RCP	None		Flared End	Good	N/A	N/A		No	<25%		No		
29	-71.6894	42.1033	8/31/2021 18:41	Found			Outfall, Pipe	Round	24	RCP	None		Projecting	Good	N/A	N/A		No	None		No		
30	-71.6889	42.1033	8/31/2021 18:38	Found	Lackey Pond		Outfall, Pipe	Round	18	RCP	None		Flared End	Good	N/A	Good		No	None		No		
32	-71.7845	42.1605	7/23/2021 17:11	Found	Singletary Pond		Outfall, Pipe	Round	12	CMP	Corrosion		Projecting	Good	Stone	Good		No	None		No		
33	-71.7844	42.1597	7/23/2021 17:20	Found	Singletary Pond		Outfall, Pipe	Round	12	CMP		Outfall is fully submerged, unable to fully inspect						No			No		
34	-71.8017	42.1289	7/23/2021 15:28	Found			Outfall, Pipe	Round	12	CMP	None		Flush with Headwall	Good	Stone	Poor	Loose and unstable stones	Moderate	<25%	Bank erosion	No		
35	-71.8021	42.1302	7/23/2021 15:33	Found			Outfall, Pipe					Pipe submerged and covered by headwall so could not inspect fully	Flush with Headwall		Stone	Good		Moderate	>75%	Channelization and bank erosion	No		
36	-71.8013	42.1325	7/23/2021 15:39	Found			Outfall, Pipe	Round	12	CMP	None		Flush with Headwall	Good	Stone	Good		Moderate	None	Plunge pool	No		
37	-71.8012	42.1336	7/23/2021 15:43	Found	Arnold Pond		Outfall, Pipe	Round	18	CMP	None		Projecting	Good	Stone	Poor	Displaced stones have fallen into conveyance	No	>75%		No		
38	-71.8008	42.1345	7/23/2021 15:47	Could Not Access		1																	
39	-71.8003	42.1347	7/23/2021 15:53	Not Found		1																	
40	-71.7999	42.1350	7/23/2021 15:56	Found	Adams Pond		Outfall, Pipe	Round	12	CMP	Corrosion		Flush with Headwall	Good	Stone	Good		No	50%-75%		No		
41	-71.7983	42.1358	7/23/2021 16:02	Not Found		1																	
42	-71.7972	42.1364	7/23/2021 16:07	Found	Adams Pond		Outfall, Pipe	Round	18	CMP	Corrosion	Some invert corrosion	Flush with Headwall	Good	Stone	Good		Moderate	None	Small plunge pool	Yes	Potential, two or more indicator	Flow has a sulfide smell and is discolored.
43	-71.7961	42.1375	7/23/2021 16:27	Found	Adams Pond		Outfall, Pipe	Round	12	CMP	Corrosion	Mild invert corrosion	Flush with Headwall	Good	Stone	Good		No	None	Mild channelization	No		
44	-71.7922	42.1422	7/23/2021 16:59	Found	Adams Pond		Outfall, Pipe	Round	12	CMP	Collapsing, Corrosion	Slight corrosion and collapsing in outlet	Flush with Headwall	Fair	Stone	Good		No	25%-50%		No		

Notes
1. Outfall Material: RCP = Reinforced Concrete Pipe; CMP = Corrugated Metal Pipe; HDPE = High Density Polyethylene; CI = Cast Iron; PVC = Polyvinyl Chloride

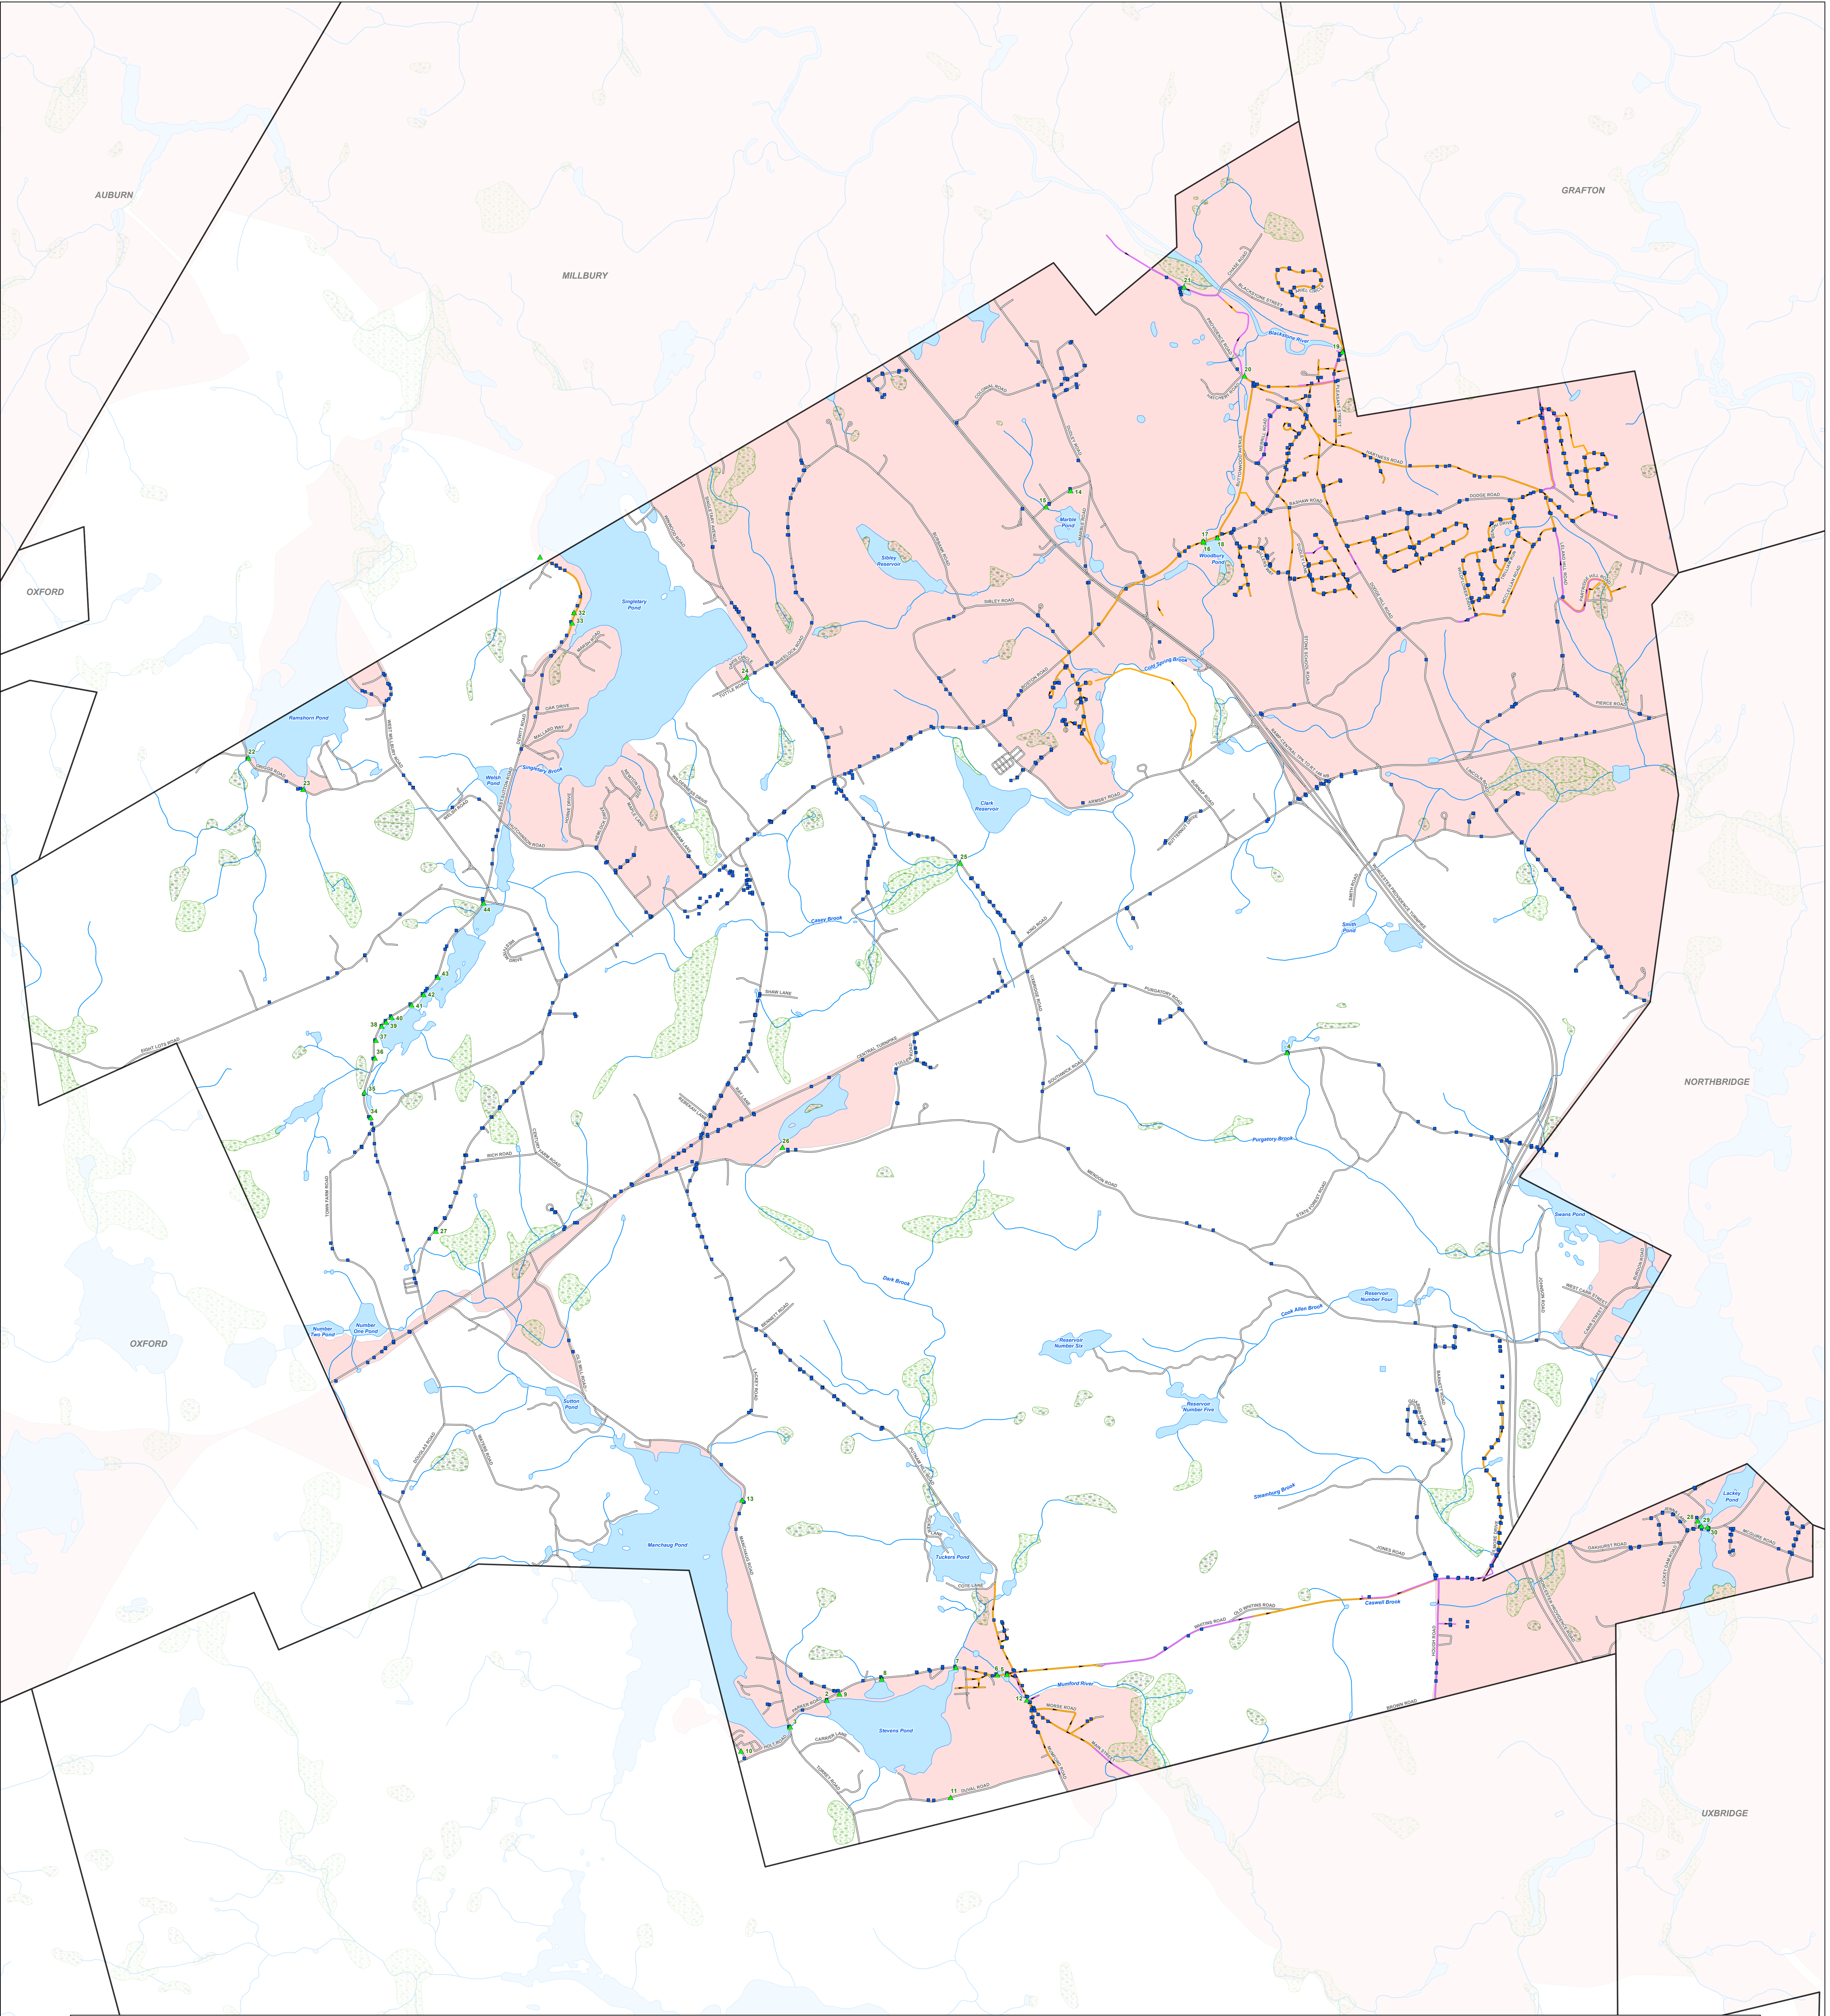

Legend

- ▲ Outfall
- Catch Basin
- Sewer Force Main
- Sewer Pipe
- Roads
- Lake, Pond, Reservoir
- Wetland, Marsh, Swamp
- Stream, Brook
- Urbanized Area

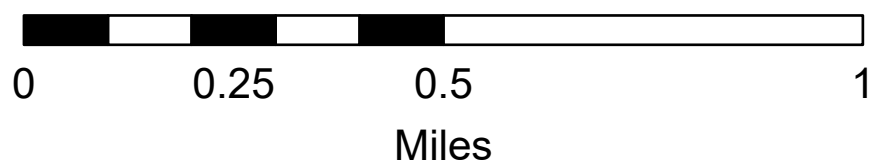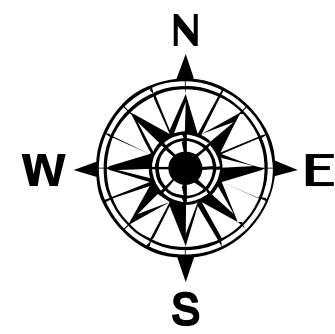

Stormwater Infrastructure Map
Sutton, MA

Comprehensive
Environmental
Incorporated



Data Sources: CEI, MassGIS, Town of Sutton

Illicit Discharge Log

Date	Outfall ID	Outfall Location	Description of Discharge	Description of Discovery	Source of Discharge	Date of Mitigation	Planned Corrective Actions	Estimated volume of Flow Removed

Illicit Discharge Tracking Form

Outfall ID:	
Outfall Location:	
Description of Discharge:	
Description of Discovery (Methods used):	
Source of Discharge:	
Date of Discovery:	Date of Mitigation (if corrected):
Planned Corrective Actions (with schedule):	
Estimated Volume of Flow Removed:	

Appendix I

IDDE Employee Training Records

